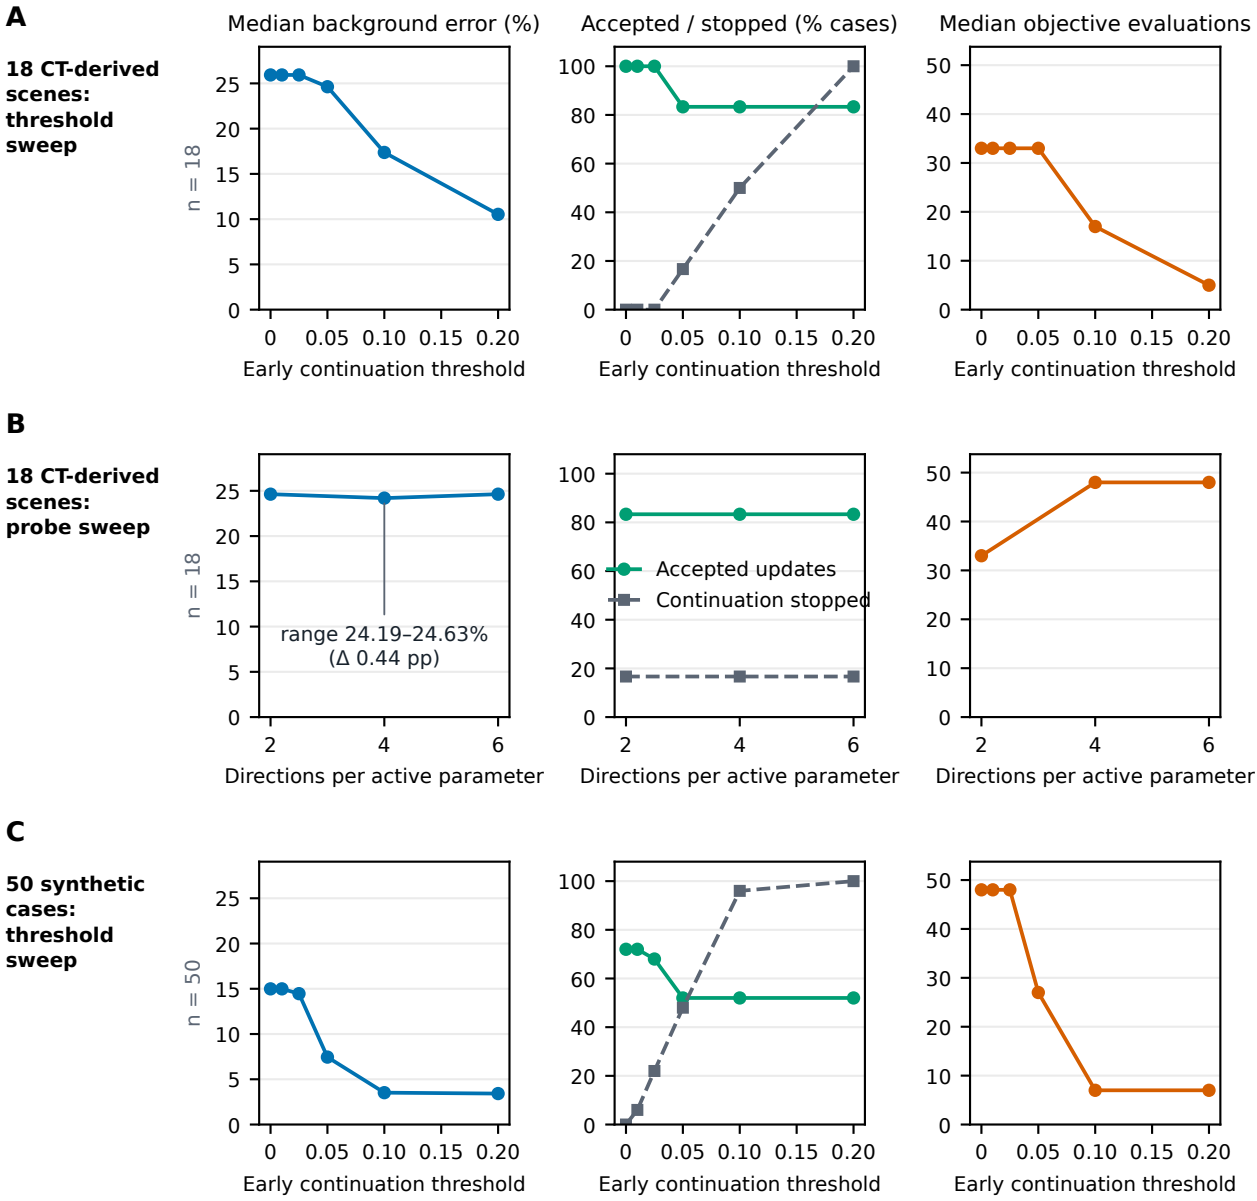
A
18 CT-derived scenes: threshold sweep
Median background error (%)
Accepted / stopped (% cases)
Median objective evaluations
n = 18
Early continuation threshold
B
18 CT-derived scenes: probe sweep
range 24.19–24.63%
(Δ 0.44 pp)
Accepted updates
Continuation stopped
Directions per active parameter
C
50 synthetic cases: threshold sweep
n = 50