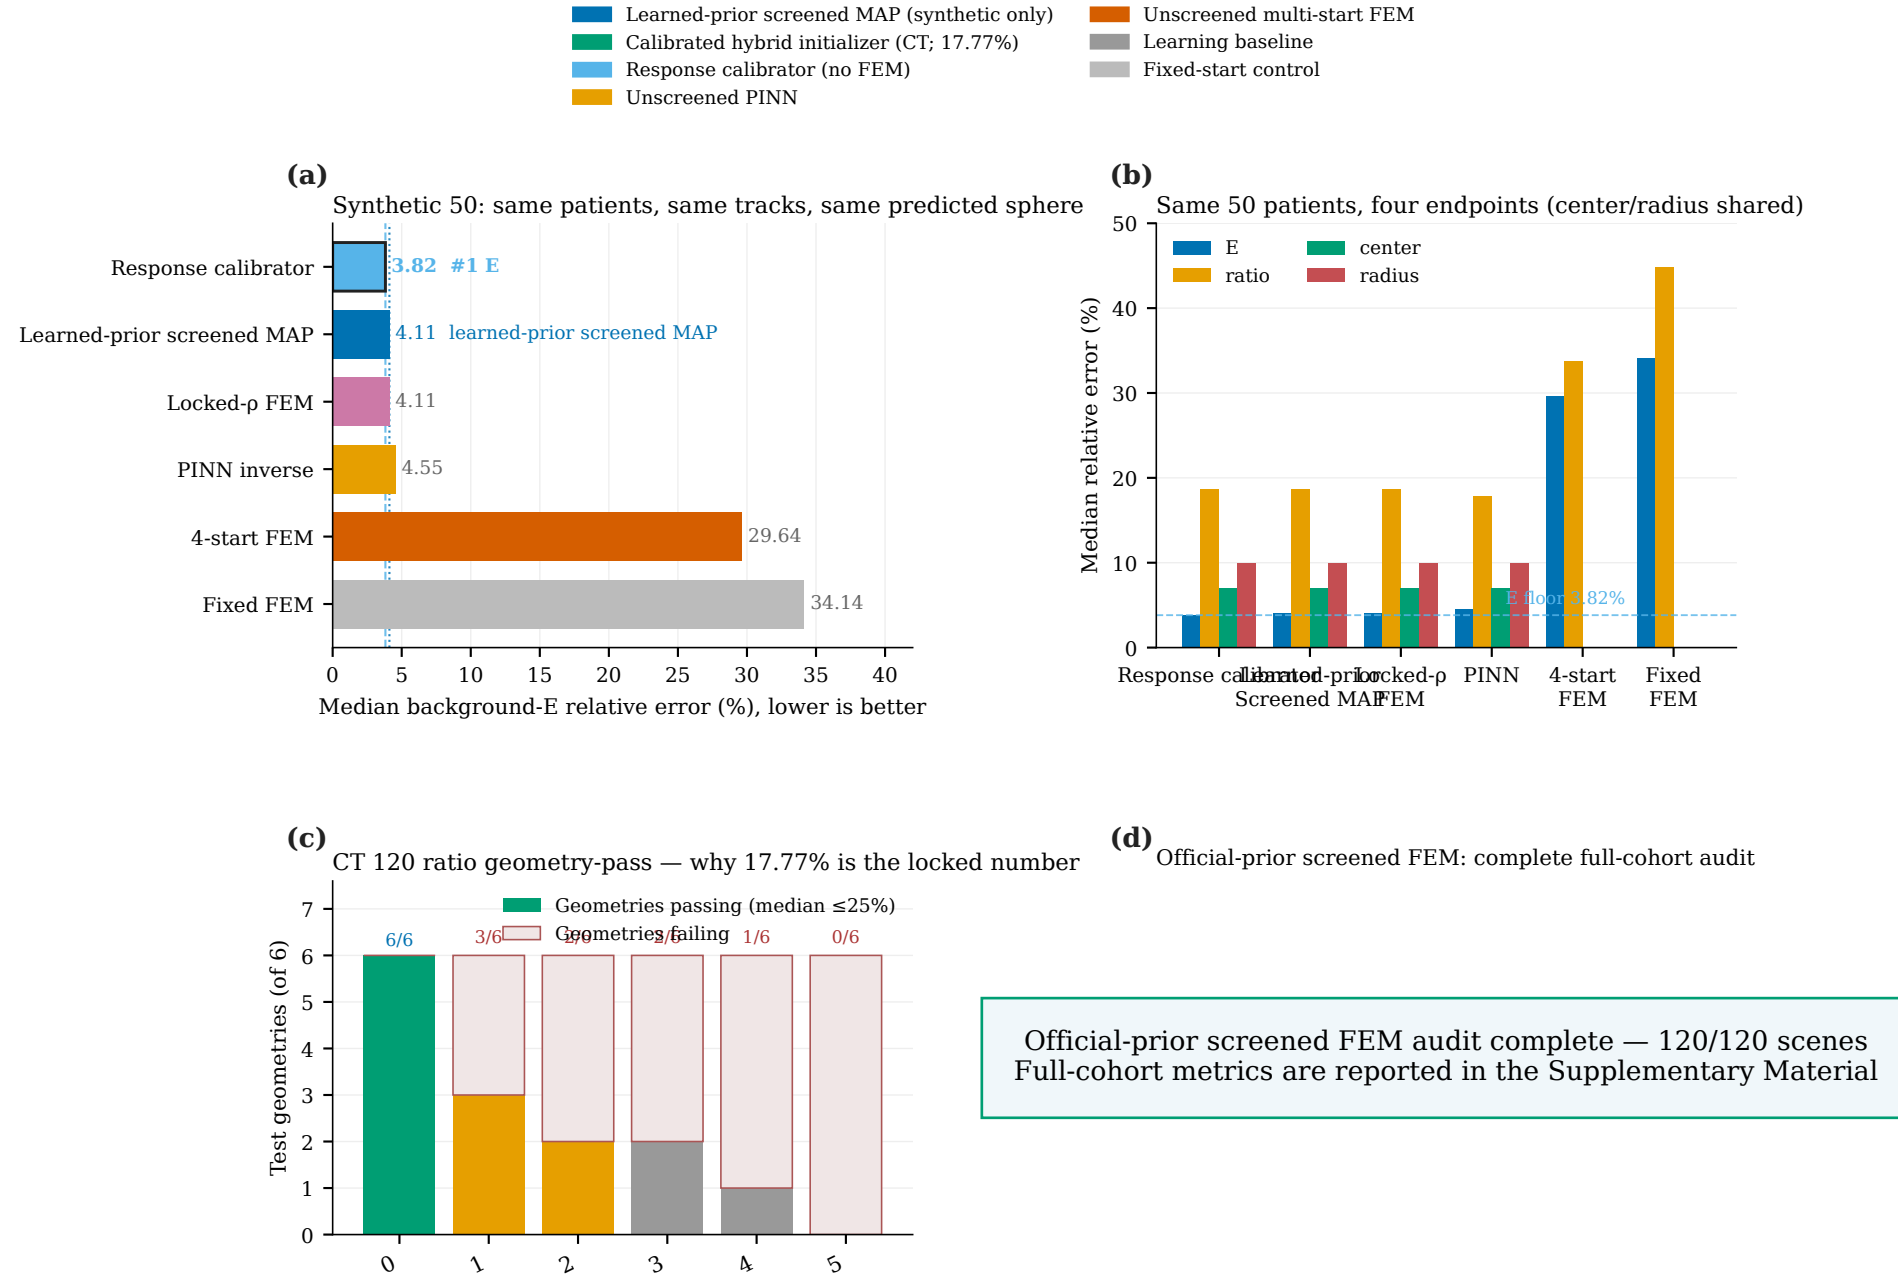Fair protocol: estimator arms on matched splits and endpoints. CT hybrid value is initializer-only; official-prior FEM audit is complete and reported separately.