



(a) Pixel generation vs copy-last

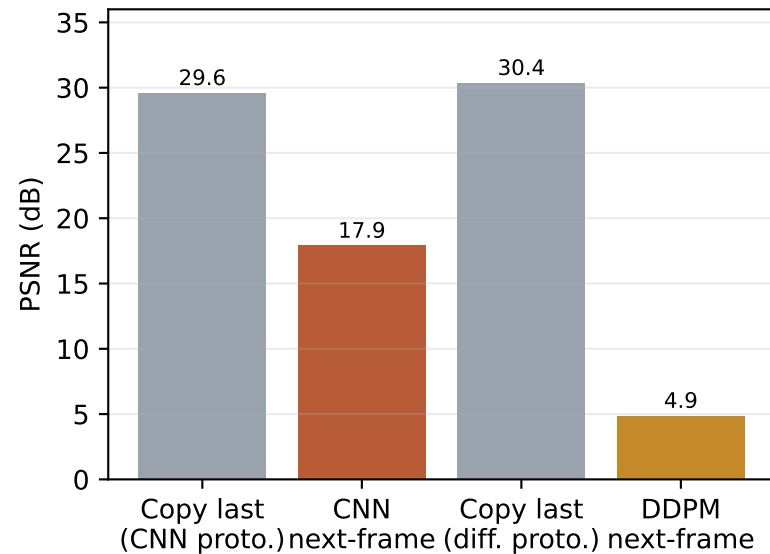

(b) Near-wall diagnostics
energy $\rho = -0.47$; risk failed

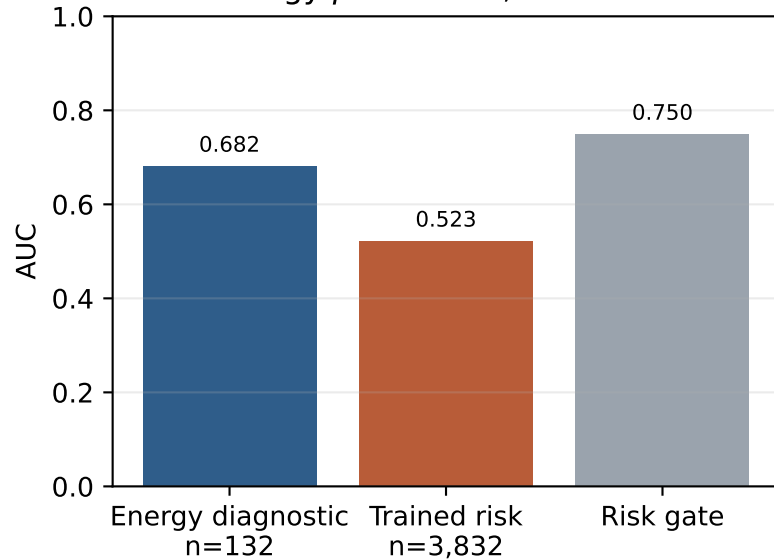

(c) STIR deformation regulariser

