



FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
---	-----	----	-----	---
1	PIPE (GREP) 7.0MM WT API 15LR	200	MC000007306--(1G03)	5.8M
2	TEE EQUAL (GREP)	200 x 200	MC000006172--(1G03)	1
3	GLASS REINFORCED PLASTIC (GRP) SADDLE REDUCING SW (GREP)	200 x 50	MC000005838--(1G03)	3
4	GLASS REINFORCED PLASTIC (GRP) ELBOW 45 (GREP)	200	MC000006171--(1G03)	1
5	GLASS REINFORCED PLASTIC (GRP) FLANGE SW 150LB FF HUBLESS	200	MC000006183--(1G03)	1
	GLASS REINFORCED PLASTIC (GRP)			
ERECTION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
---	-----	----	-----	---
6	FLANGE BLIND 150LB RF ST.STL. ASTM A182 F316L	200	MC000002420--(1G03)	1
7	GASKET 150LB FF 3.2MM (COMPR)	200	MC000006175--(1G03)	1
8	COMP CARBON FIBRE / NBR BINDER 175 MM LG STUD BOLT C/W 2 NUTS	19	PC000000358--(1G03)	8
	ASTM A193-B8M CL2 & A194-8M			

CUT PIPE LENGTH				CUT PIPE LENGTH			
PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<9>	2038	200		<10>	2331	200	
<11>	1411	200					

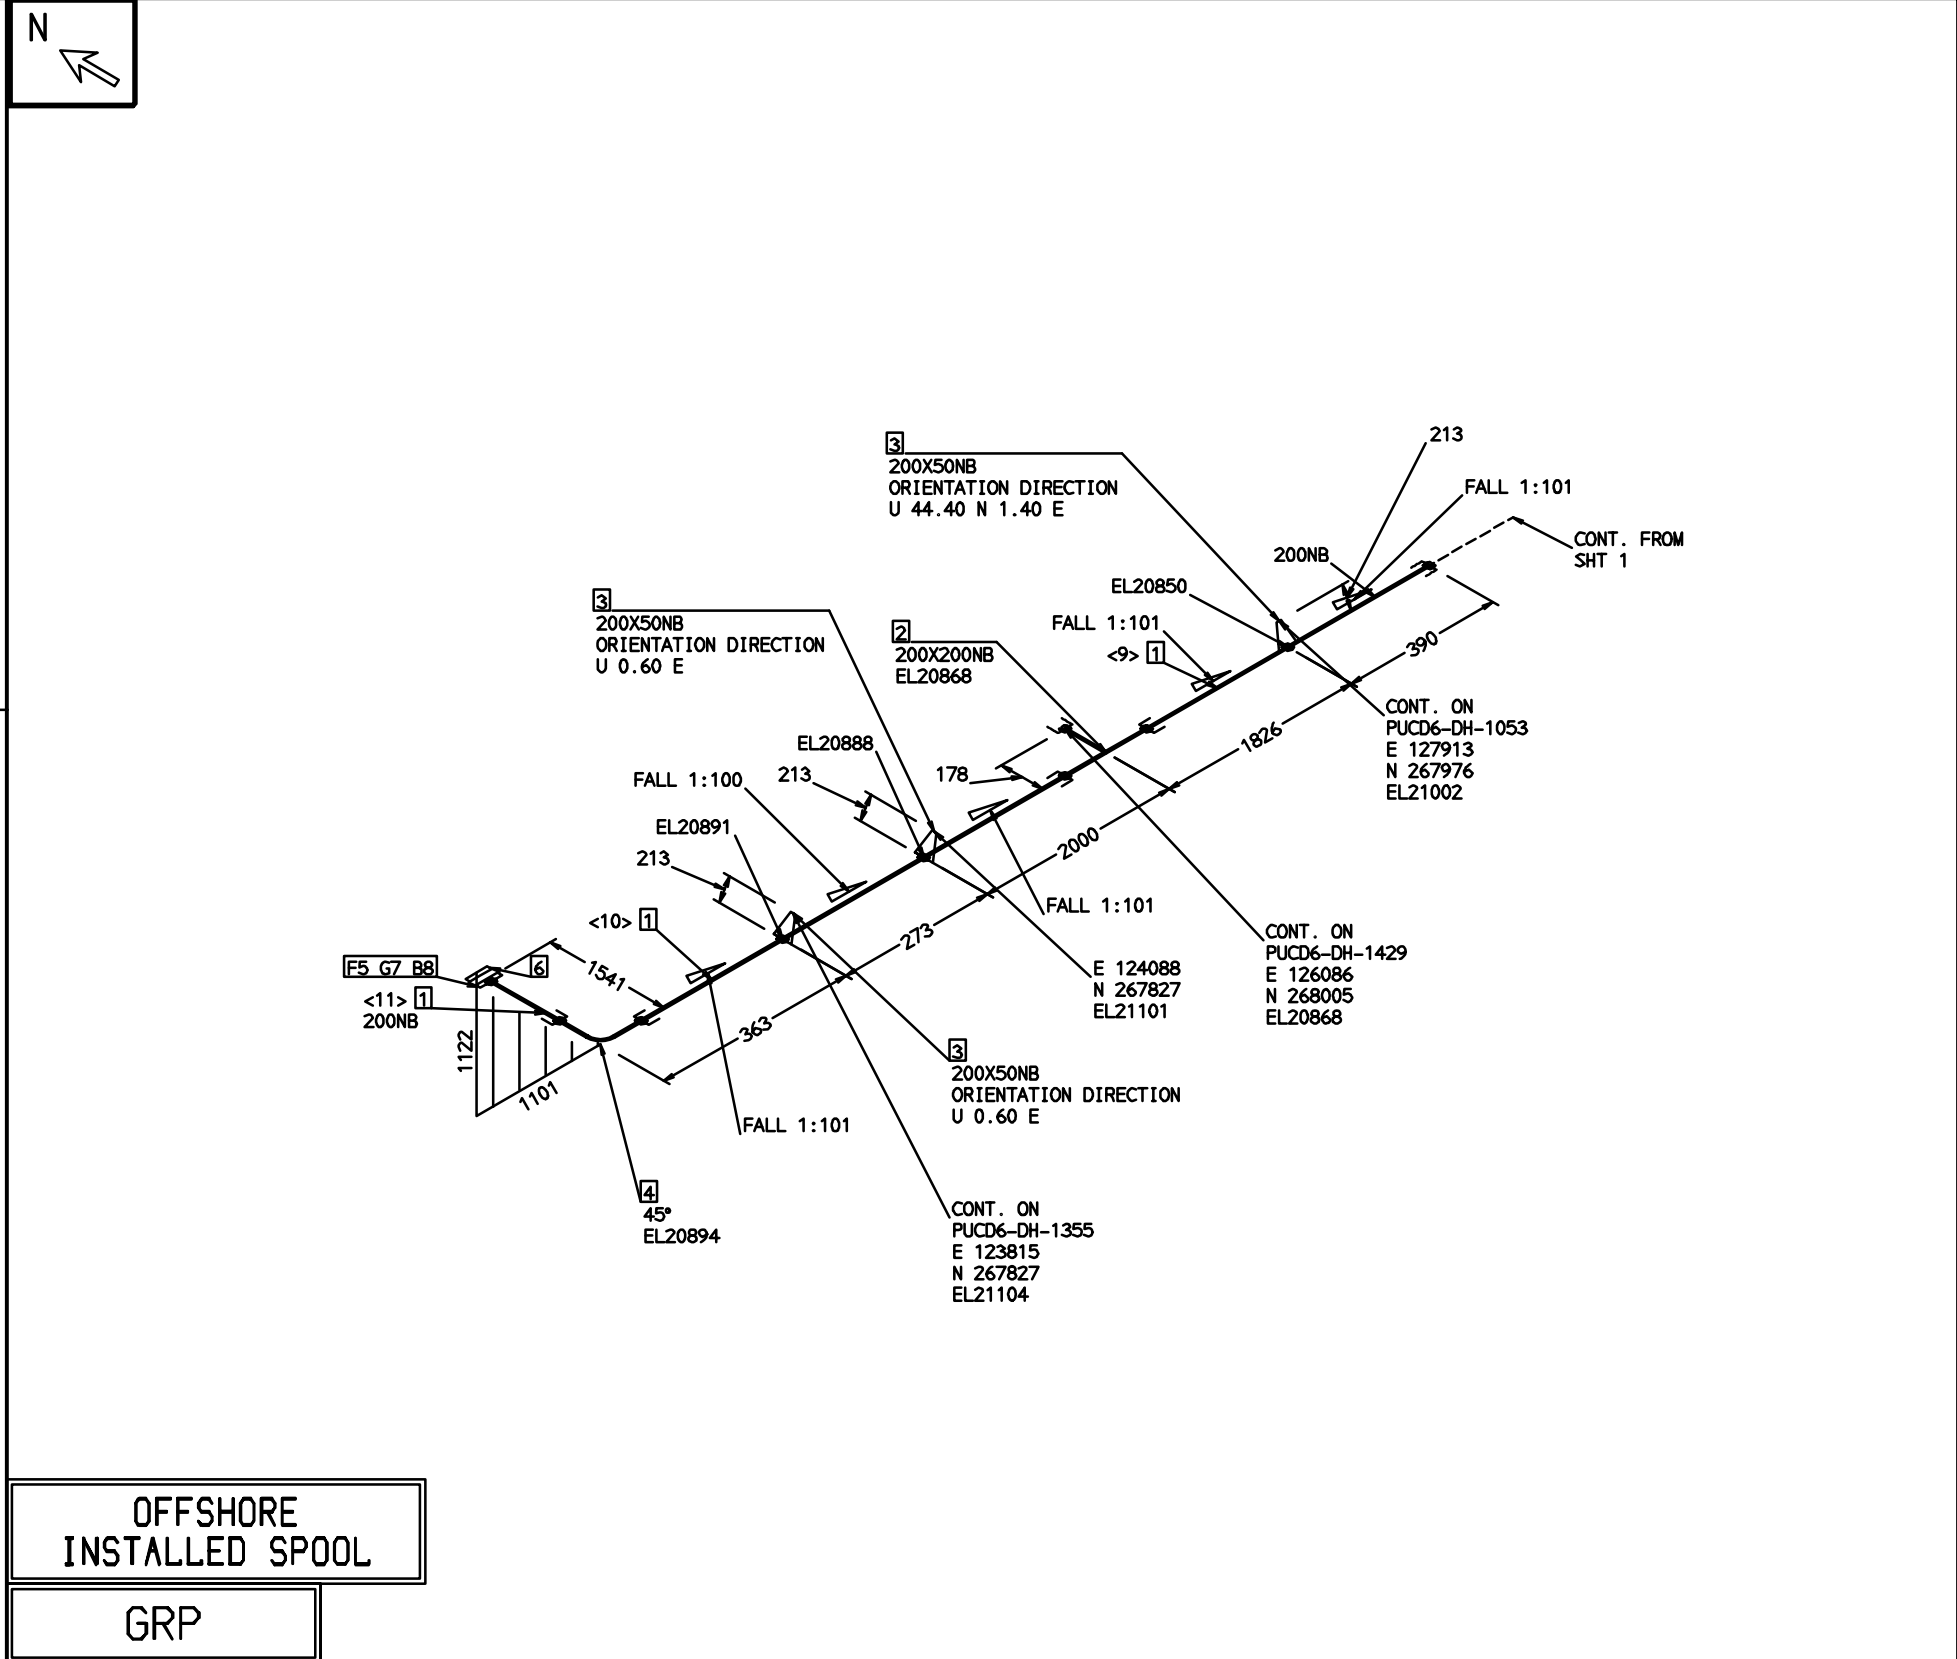

HOLDS			Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.			MATL CODE		COMM. PACK		TEST LOOP NO.		PRIORITY	
												6	
Reference Drawings FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01								ISO DATA : bbrzz05 30-DEC-96					
								G.A. REFERENCE : 2604.01					
								P&ID REFERENCE : 3090.02					
								DESTINATION CODE : A					
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER						AREA : CD6					
TEST MEDIUM	POT. WATER							STRESS RELIEF : N					
INSULATION THICKNESS	NONE							CRITICAL LINE : Y					
COLOUR CODE	BLACK.W.Y11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN		INSULATION CLASS :					RFV
PAINT SYSTEM	-							SPECIFICATION : 1G3					C1
N.D.T. CLASS	2		REV	DATE	REVISIONS	BY		DRAWING NUMBER					SHT
							22798	WNB-PUCD6-DH-1360.02					2 OF 2