
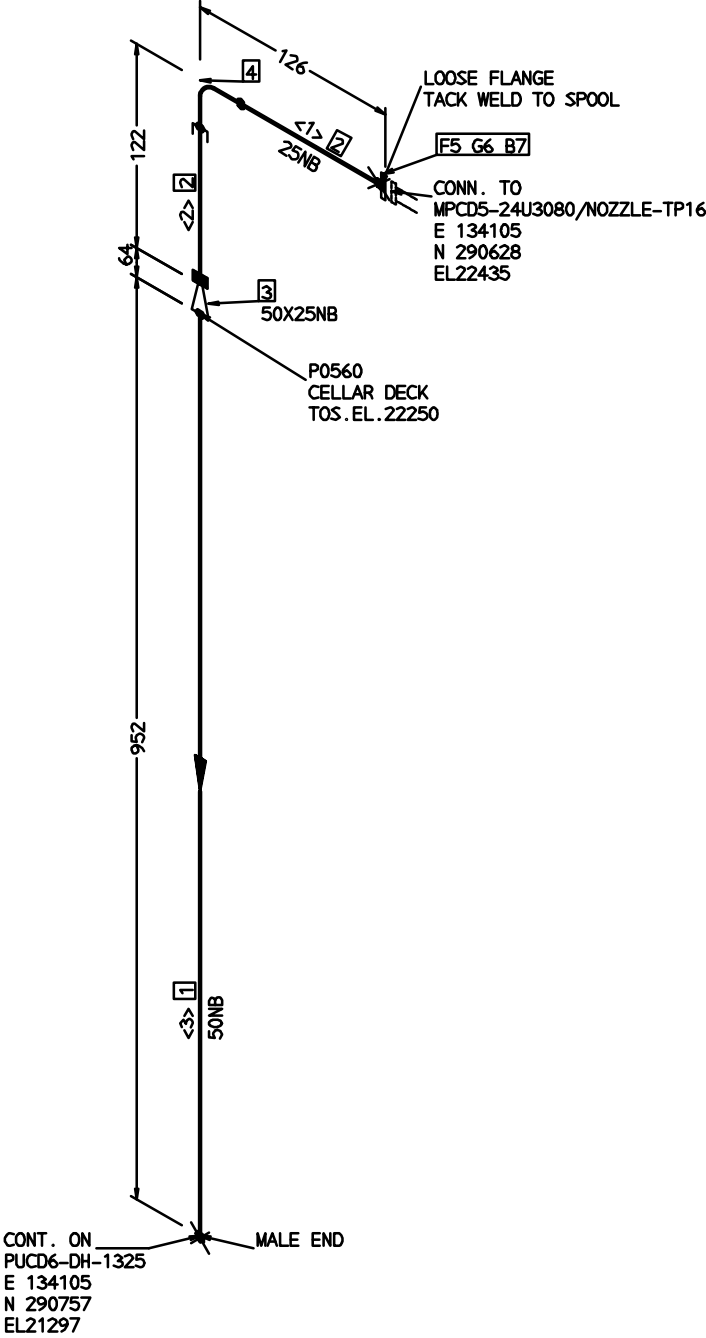



FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 4.1MM WT API 15LR	50	MC000007249-(1G03)	1.0M
2	PIPE (GREP) 4.3MM WT API 15LR	25	MC000007270-(1G03)	0.2M
3	REDUCER CONC (GREP) GLASS REINFORCED PLASTIC (GRP)	50 x 25	MC000006042-(1G03)	1
ERECTION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
4	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	25	MC000006165-(1G03)	1
5	FLANGE SW 150LB FF HUBLESS GLASS REINFORCED PLASTIC (GRP)	25	MC000006159-(1G03)	1
6	GASKET 150LB FF 3.2MM (COMPR)	25	MC000005301-(1G03)	1
7	COMP CARBON FIBRE / NBR BINDER 100 MM LG STUD BOLT C/W 2 NUTS ASTM A193-B8M CL2 & A194-8M	13	PC000001990-(1G03)	4

CUT PIPE LENGTH					
PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH
<1>	58	25		<2>	57
<3>	952	50			



GRP

HOLDS 1 Cleared 2 Cleared			Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.			MATL CODE	COMM. PACK	TEST LOOP NO.	PRIORITY
Reference Drawings FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01									6
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER					ISO DATA : bbrzz05 30-DEC-96		
TEST MEDIUM	POT. WATER						G.A. REFERENCE : 2601.01		
INSULATION THICKNESS	NONE						P&ID REFERENCE : 3026.02		
COLOUR CODE	BLACK.W.Y11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION		DESTINATION CODE : A		
PAINT SYSTEM	-		REV	DATE	REVISIONS		AREA : CD6		
N.D.T. CLASS	2						STRESS RELIEF : N		
							CRITICAL LINE : N		
							INSULATION CLASS :		
							SPECIFICATION : 1G3		
							DRAWING NUMBER		
							WNB-PUCD6-DH-1323		
							RFV C1		