



FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 4.1MM WT API 15LR	50	MC000007249-(1G03)	7.6M
2	PIPE (GREP) 4.3MM WT API 15LR	25	MC000007270-(1G03)	0.2M
3	TEE EQUAL (GREP) GLASS REINFORCED PLASTIC (GRP)	50 x 50	MC000006147-(1G03)	1
4	REDUCER CONC (GREP) GLASS REINFORCED PLASTIC (GRP)	50 x 25	MC000006042-(1G03)	1
5	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	50	MC000006148-(1G03)	3
6	ELBOW 45 (GREP) GLASS REINFORCED PLASTIC (GRP)	50	MC000006146-(1G03)	1
ERECTION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
7	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	25	MC000006165-(1G03)	1
8	FLANGE SW 150LB FF HUBLESS GLASS REINFORCED PLASTIC (GRP)	25	MC000006159-(1G03)	1
9	GASKET 150LB FF 3.2MM (COMPR) COMP CARBON FIBRE / NBR BINDER	25	MC000005301-(1G03)	1
10	100 MM LG STUD BOLT C/W 2 NUTS ASTM A193-B8M CL2 & A194-8M	13	PC000001990-(1G03)	4

CUT PIPE LENGTH							
PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<1>	57	25		<2>	57	25	
<3>	908	50		<4>	3060	50	
<5>	211	50		<6>	1802	50	
<7>	969	50		<8>	564	50	

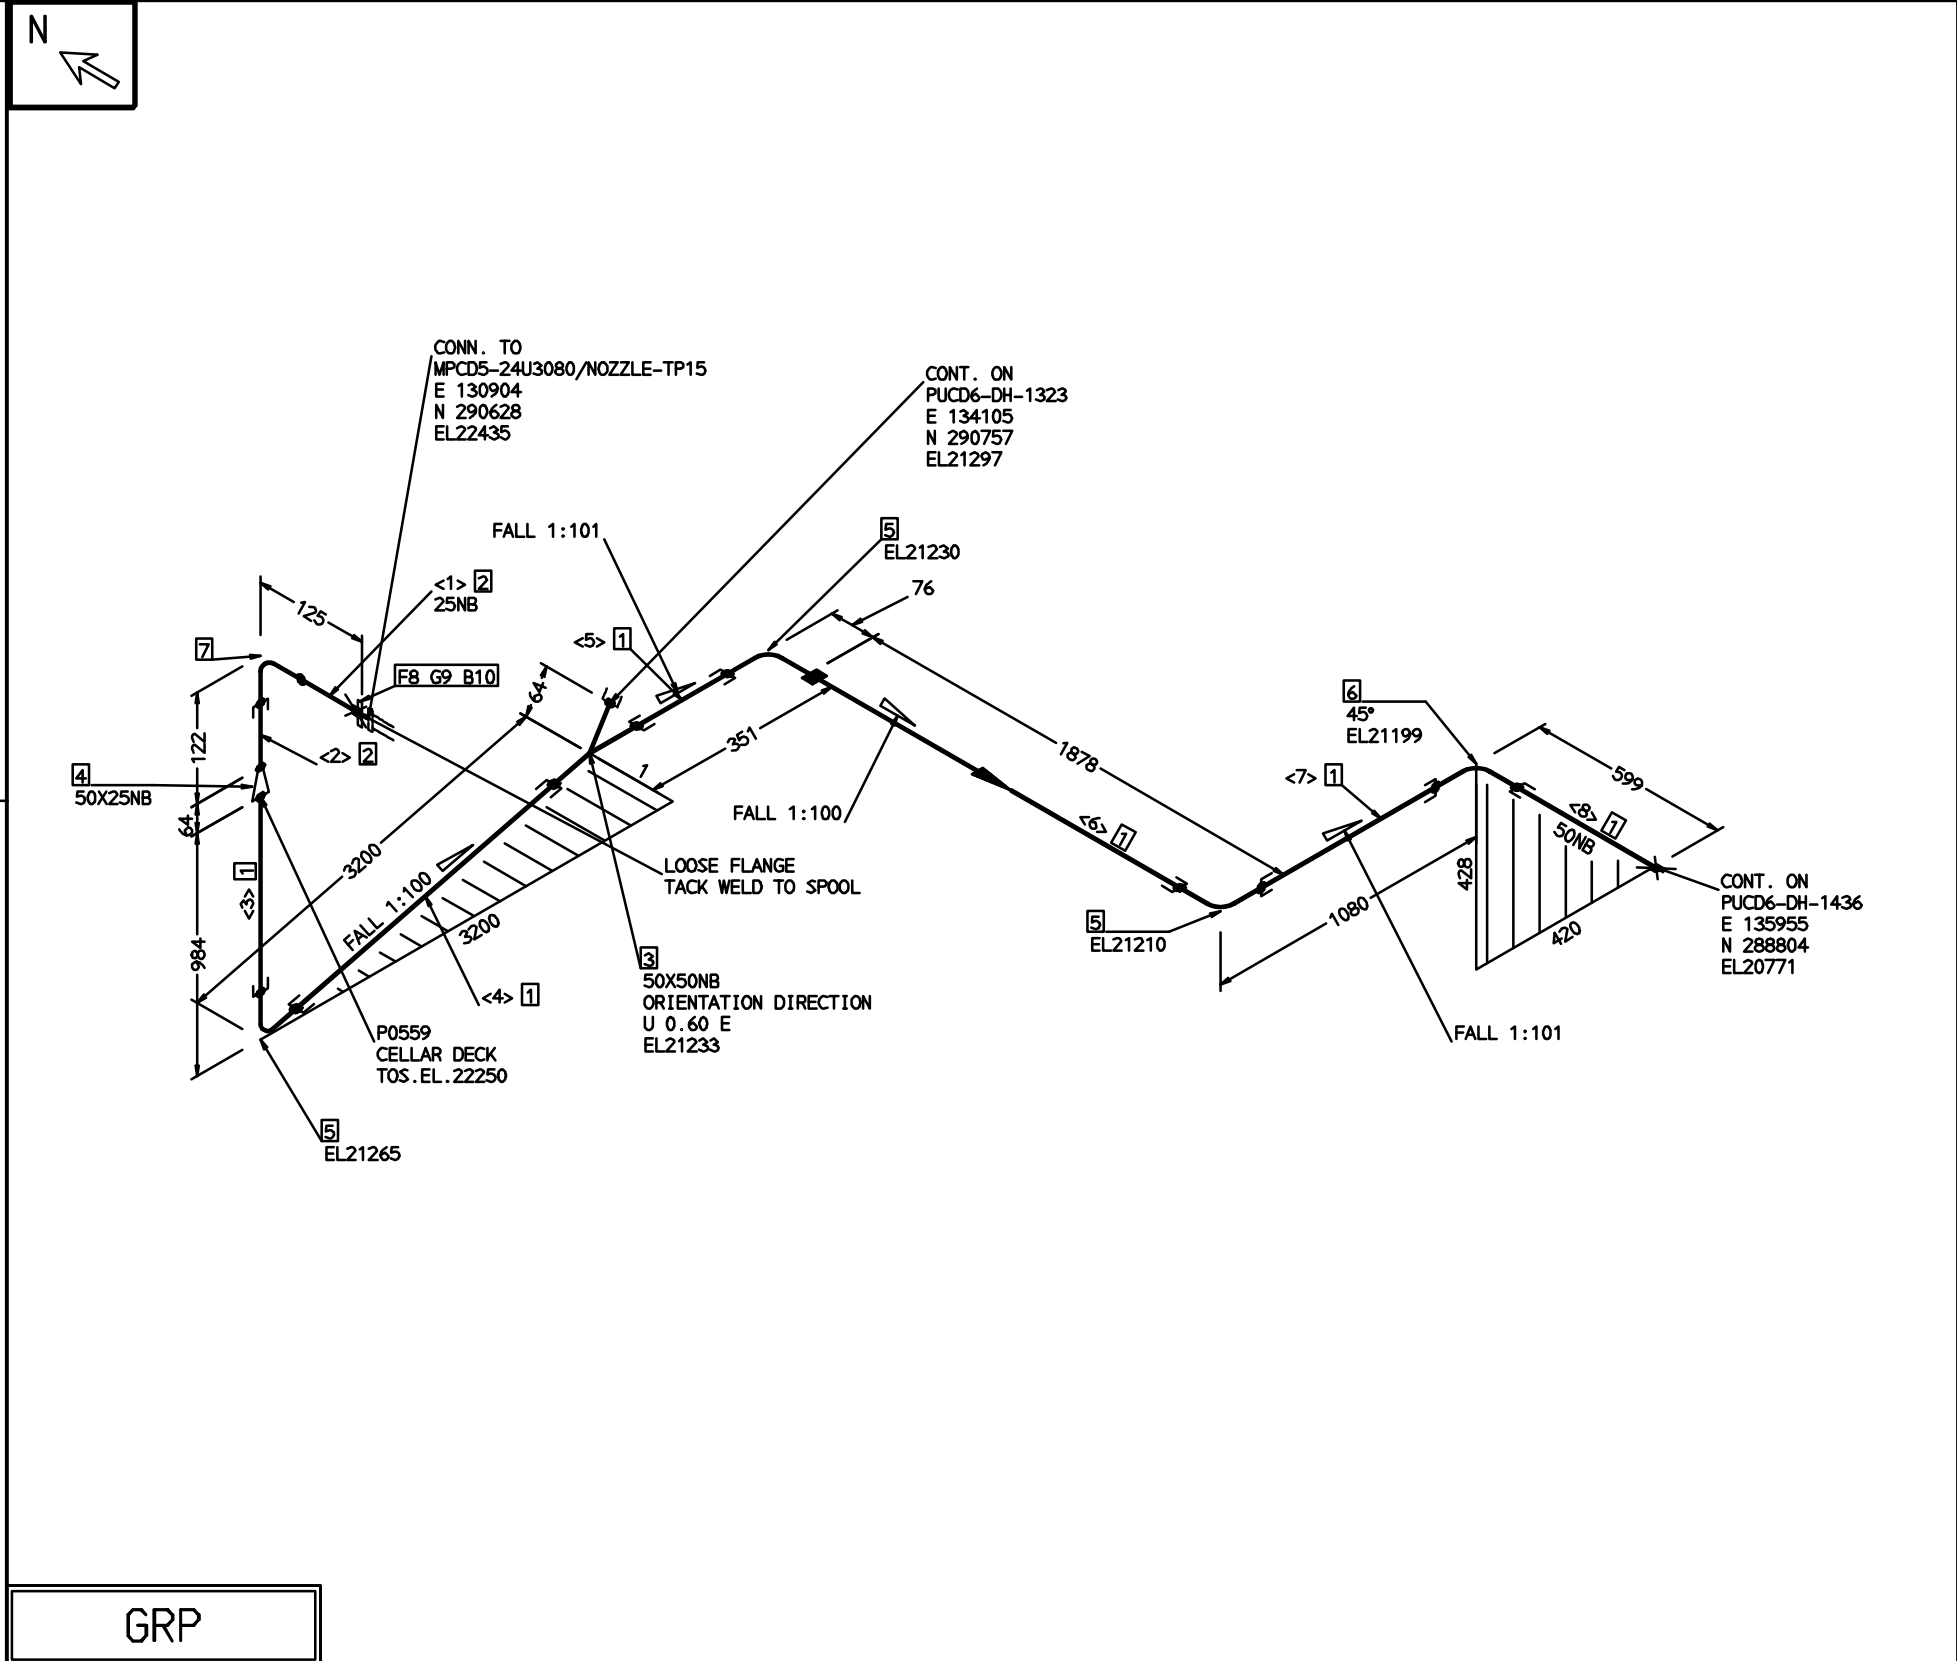

GRP

HOLDS 1 Cleared 2 Cleared			Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.			MATL CODE	COMM. PACK	TEST LOOP NO.	PRIORITY	
									6	
Reference Drawings FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01							ISO DATA : bbrzz05 30-DEC-96			
							G.A. REFERENCE : 2601.01			
							P&ID REFERENCE : 3026.01/26.02/90.02			
							DESTINATION CODE : A			
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER						AREA	: CD6	
TEST MEDIUM	POT. WATER							STRESS RELIEF	: N	
INSULATION THICKNESS	NONE							CRITICAL LINE	: N	
COLOUR CODE	BLACK.W.Y 11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION		AN	INSULATION CLASS	:	RFV
PAINT SYSTEM	-		REV	DATE	REVISIONS	BY	SPECIFICATION	: 1G3	C1	
N.D.T. CLASS	2						DRAWING NUMBER			
							22978	WNB-PUCD6-DH-1325		