
	FABRICATION MATERIALS			
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	0.2M
1	PIPE (GREP) 7.0MM WT	200	MC000007306-(1G03)	
2	API 15LR PIPE (GREP) 4.1MM WT	80	MC000007258-(1G03)	
3	API 15LR TEE EQUAL (GREP)	200 x 200	MC000006172-(1G03)	
4	GLASS REINFÒRCED PLASTIC (GRP) TEE REDUCING (GREP)	200 x 100	MC000005712-(1G03)	1
5	GLASS REINFORCED PLASTIC (GRP) SADDLE REDUCING SW (GREP)	200 x 80	MC000005857-(1G03)	2
6	GLASS REINFORCED PLASTIC (GRP) FLANGE SW 150LB FF HUBLESS	200	MC000006183-(1G03)	
7	GLASS REINFORCED PLASTIC (GRP) FLANGE SW 150LB FF HUBLESS GLASS REINFORCED PLASTIC (GRP)	80	MC000006127-(1G03)	
	ERECTION MATERIALS			
PT 10	COMPONENT DESCRIPTION	N.S. (MM) 	ITEM CODE	QTY
8	FLANGE BLIND 150LB RF ST.STL. ASTM A182 F316L	80	MC000002230-(1G03)	1
9	GASKET 150LB FF 3.2MM (COMPR) COMP CARBON FIBRE / NBR BINDER	200	MC000006175-(1G03)	1
10	GASKET 150LB FF 3.2MM (COMPR) COMP CARBON FIBRE / NBR BINDER	80	MC000005292-(1G03)	1
11	200 MM LG STUD BOLT C/W 2 NUTS ASTM A193-BBM CL2 & A194-BM	19	PC000000832-(1G03)	8
12	125 MM LG STUD BOLT C/W 2 NUTS ASTM A193-BBM CL2 & A194-BM	16 PC000000357-(1G03)		4
	CUT PIPE LENGTH			
	COI FIFE LENGIN			



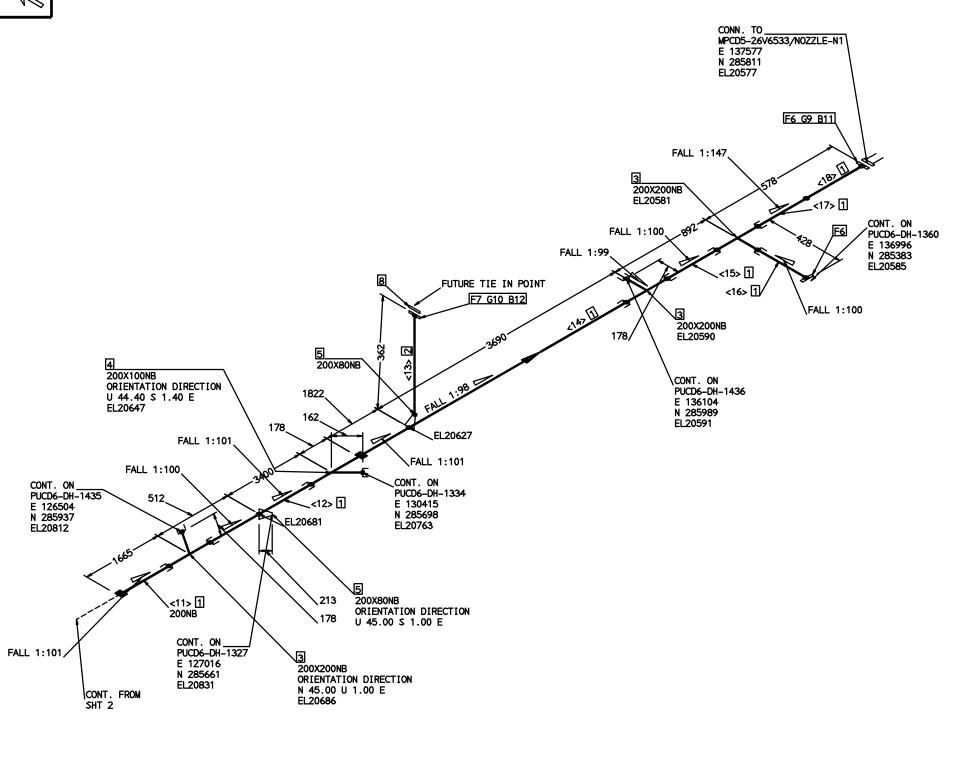

HOLDS				Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL			MATL CODE	COMM. PACK	TEST LOOP N	
					S DEPARTMENT.					
							ISO DATA	\$ bbrzz:		
Reference Drawings								G.A. REFERENC	E : 2602	
FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01								P&ID REFERENCE	E : 3090	
				<u> </u>		Н		DESTINATION CODE : A		
				┼──				AREA	: CD6	
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER				Ш		STRESS RELIEF	: N	
TEST MEDIUM	POT.WATER						WANDOO	CRITICAL LINE	: Y	
INSULATION THICKNESS	NONE							INSULATION CL	- ZZA	
COLOUR CODE	BLACK.W.Y11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN	Alliance	SPECIFICATION	l : 1G3	
PAINT SYSTEM	-		REV	EV DATE	DENTOTONO DV		DRAWING NUMBER	NU 1341 N3		
N.D.T. CLASS	2				REVISIONS	BY	23610	WNB-PUCD6-DH-1361.0		

30-DEC-96 : CD6 LIEF : N LINE : Y : N RFV C1 TION : 1G3 SHT 3 OF 3

TEST LOOP NO.

PRIORITY

6