FABRICATION MATERIALS

PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 4.1MM WT API 15LR	80	MC000007258-(1G03)	6.5M
2	COUPLING FULL (GREP) GLASS REINFORCED PLASTIC (GRP)	80	MC000006131-(1G03)	1
3	ELBOW 45 (GREP) GLASS REINFORCED PLASTIC (GRP)	80	MC000006152-(1G03)	1
4	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	80	MC000006154-(1G03)	1

CUT PIPE LENGTH

PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<1>	1654	80	FF WELD	<2>	259	80	
<3>	4587	80	FF WELD				

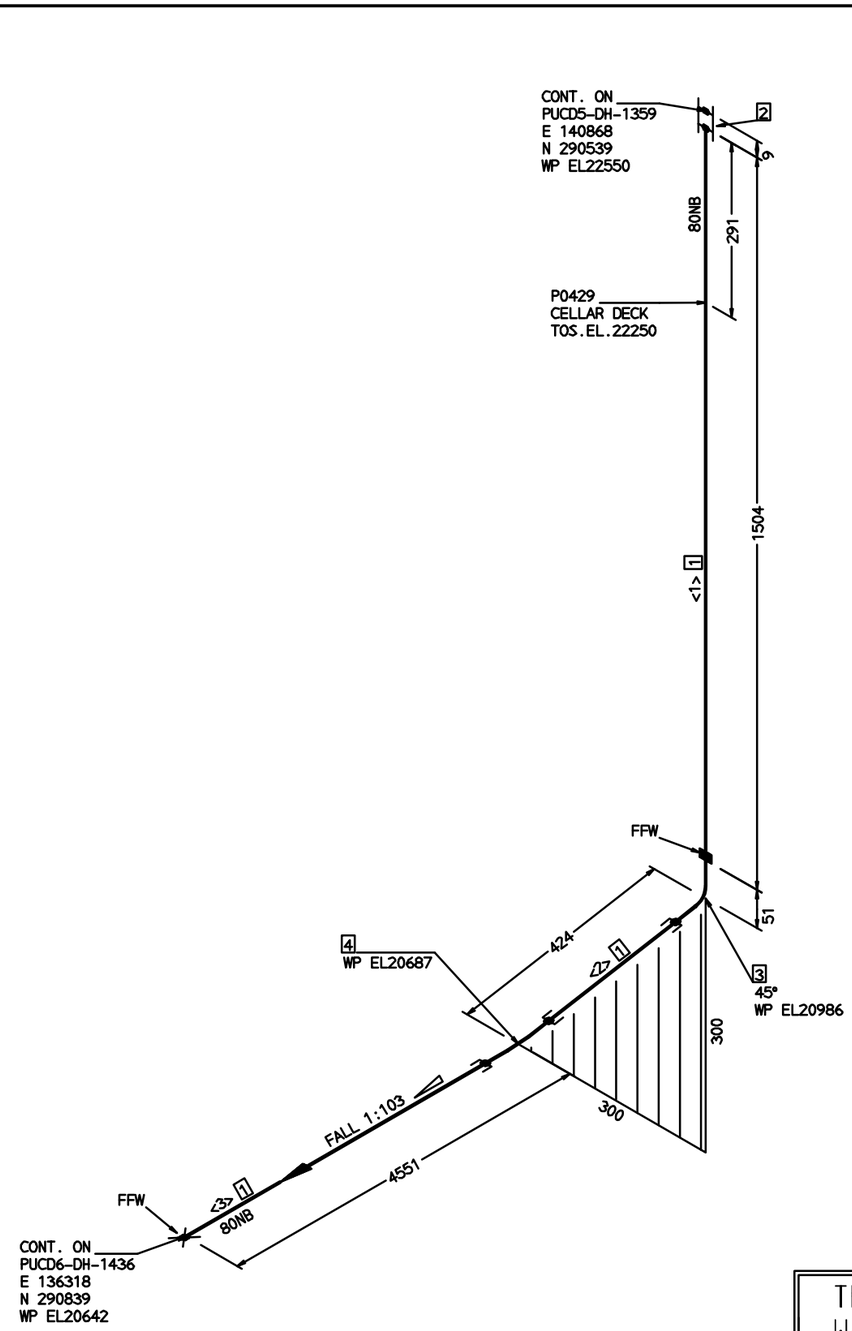

This Line Re-numbered
Was :-

HOLDS

Notes
1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.

Reference Drawings
FOR ISOMETRIC LEGEND SHEET SEE DRAWING :-
WNB-3000-DX-1000.01

TEST PRESSURE KPa g	1800	LAST ITEM NUMBER				
TEST MEDIUM	POT.WATER					
INSULATION THICKNESS	NONE					
COLOUR CODE	X54.W.X.15	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN
PAINT SYSTEM	-		REV	DATE	REVISIONS	BY
N.D.T. CLASS	2					

MATL CODE	COMM. PACK	TEST LOOP NO.	PRIORITY
			6

ISO DATA	: bbr1096	30-DEC-96
G.A. REFERENCE	: 2600.01	
P&ID REFERENCE	: 3090.02/2.02	
DESTINATION CODE	: A	
AREA	: CD6	
STRESS RELIEF	: N	
CRITICAL LINE	: Y	
INSULATION CLASS	:	RFV
SPECIFICATION	: 1G3	C1

DRAWING NUMBER
WNB-PUCD6-DH-1359

WANDOO Alliance
24189