



FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 7.0MM WT API 15LR	200	MC000007306--(1G03)	2.2M
2	PIPE (GREP) 5.2MM WT API 15LR	100	MC000007062--(1G03)	1.0M
3	TEE REDUCING (GREP) GLASS REINFORCED PLASTIC (GRP)	200 x 100	MC000005712--(1G03)	1
4	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	200	MC000006173--(1G03)	1
5	FLANGE SW 150LB FF HUBLESS GLASS REINFORCED PLASTIC (GRP)	200	MC000006183--(1G03)	1
6	FLANGE SW 150LB FF HUBLESS GLASS REINFORCED PLASTIC (GRP)	100	MC000005938--(1G03)	1
ERECTION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
7	FLANGE BLIND 150LB RF ST.STL. ASTM A182 F316L	200	MC000002420--(1G03)	1
8	GASKET 150LB FF 3.2MM (COMPR) COMP CARBON FIBRE / NBR BINDER	200	MC000006175--(1G03)	1
9	GASKET 150LB FF 3.2MM (COMPR) COMP CARBON FIBRE / NBR BINDER	100	MC000005169--(1G03)	1
10	175 MM LG STUD BOLT C/W 2 NUTS ASTM A193-B8M CL2 & A194-8M	19	PC000000832--(1G03)	8
11	145 MM LG STUD BOLT C/W 2 NUTS ASTM A193-B8M CL2 & A194-8M	16	PC000000760--(1G03)	8

CUT PIPE LENGTH				CUT PIPE LENGTH			
PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<1>	222	200		<2>	997	100	FF WELD
<3>	718	200		<4>	1163	200	



HOLDS			Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.			MATL CODE		COMM. PACK		TEST LOOP NO.		PRIORITY	
												6	
Reference Drawings FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01							ISO DATA : bbrzz05 30-DEC-96						
							G.A. REFERENCE : 2604.01						
							P&ID REFERENCE : 3090.02						
							DESTINATION CODE : A						
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER					AREA : CD6						
TEST MEDIUM	POT. WATER						STRESS RELIEF : N						
INSULATION THICKNESS	NONE						CRITICAL LINE : Y						
COLOUR CODE	BLACK.W.Y11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN	INSULATION CLASS : RFV						
PAINT SYSTEM	-						SPECIFICATION : 1G3 C1						
N.D.T. CLASS	2			REV	DATE	REVISIONS	BY	DRAWING NUMBER WNB-PUCD6-DH-1432					

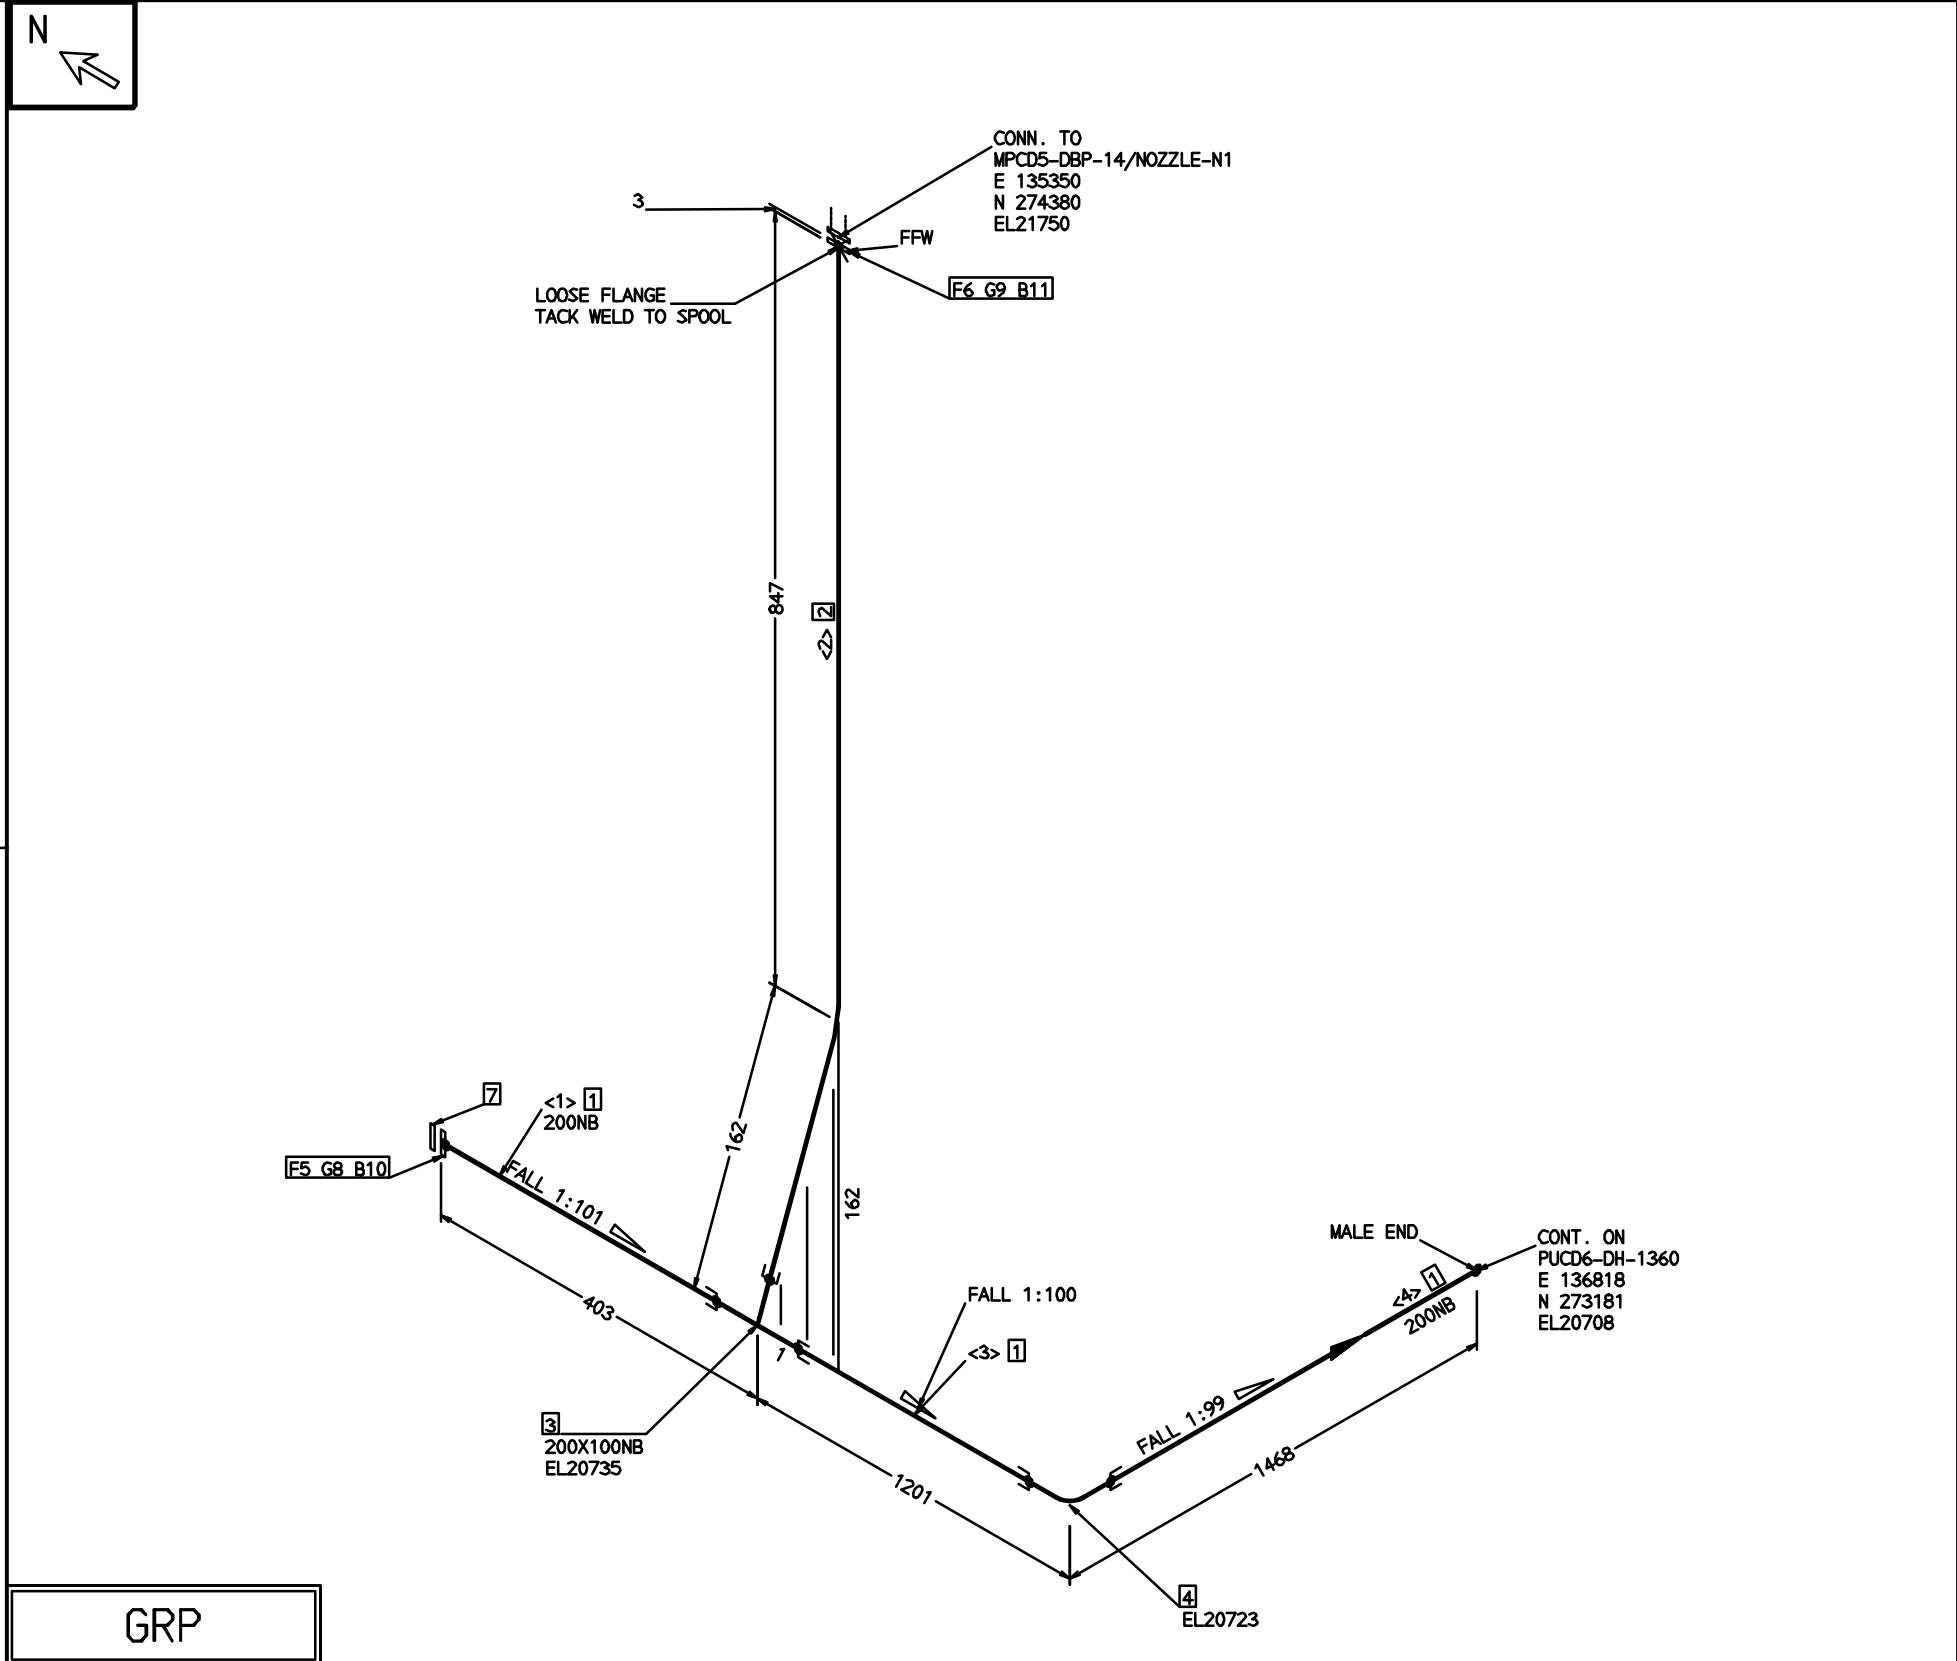