


FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 5.2MM WT API 15LR	100	MC000007062--(1G03)	1.1M
2	REDUCER CONC (GREP) GLASS REINFORCED PLASTIC (GRP)	200 x 100	MC000005713--(1G03)	1

CUT PIPE LENGTH							
PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<1>	1017	100	FF WELD				

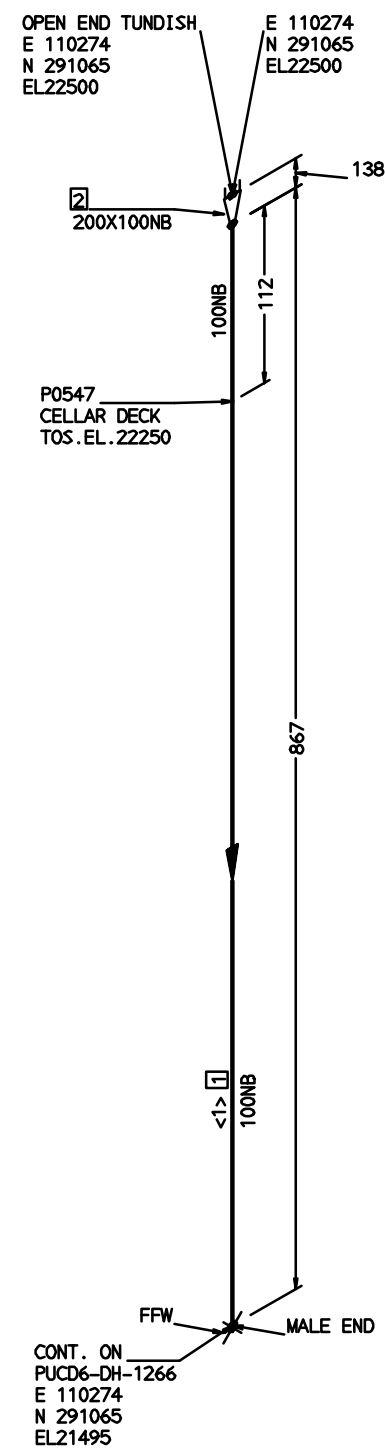

GRP

HOLDS			Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.			MATL CODE	COMM. PACK	TEST LOOP NO.	PRIORITY
<div>Reference Drawings FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01</div>									6
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER					ISO DATA : bbrzz05 30-DEC-96		
TEST MEDIUM	POT. WATER						G.A. REFERENCE : 2602.01		
INSULATION THICKNESS	NONE						P&ID REFERENCE : 3094.01		
COLOUR CODE	BLACK.W.Y11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN	DESTINATION CODE : A		
PAINT SYSTEM	-		REV	DATE	REVISIONS	BY	AREA : CD6		
N.D.T. CLASS	2						STRESS RELIEF : N		
							CRITICAL LINE : N		
							INSULATION CLASS :		
							SPECIFICATION : 1G3		
							DRAWING NUMBER		
							WNB-PUCD6-DH-1263		
							RFV C1		