


FABRICATION MATERIALS				
PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 4.1MM WT API 15LR	50	MC000007249-(1G03)	3.7M
2	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	50	MC000006148-(1G03)	3

CUT PIPE LENGTH							
PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<1>	820	50		<2>	1371	50	
<3>	923	50		<4>	498	50	

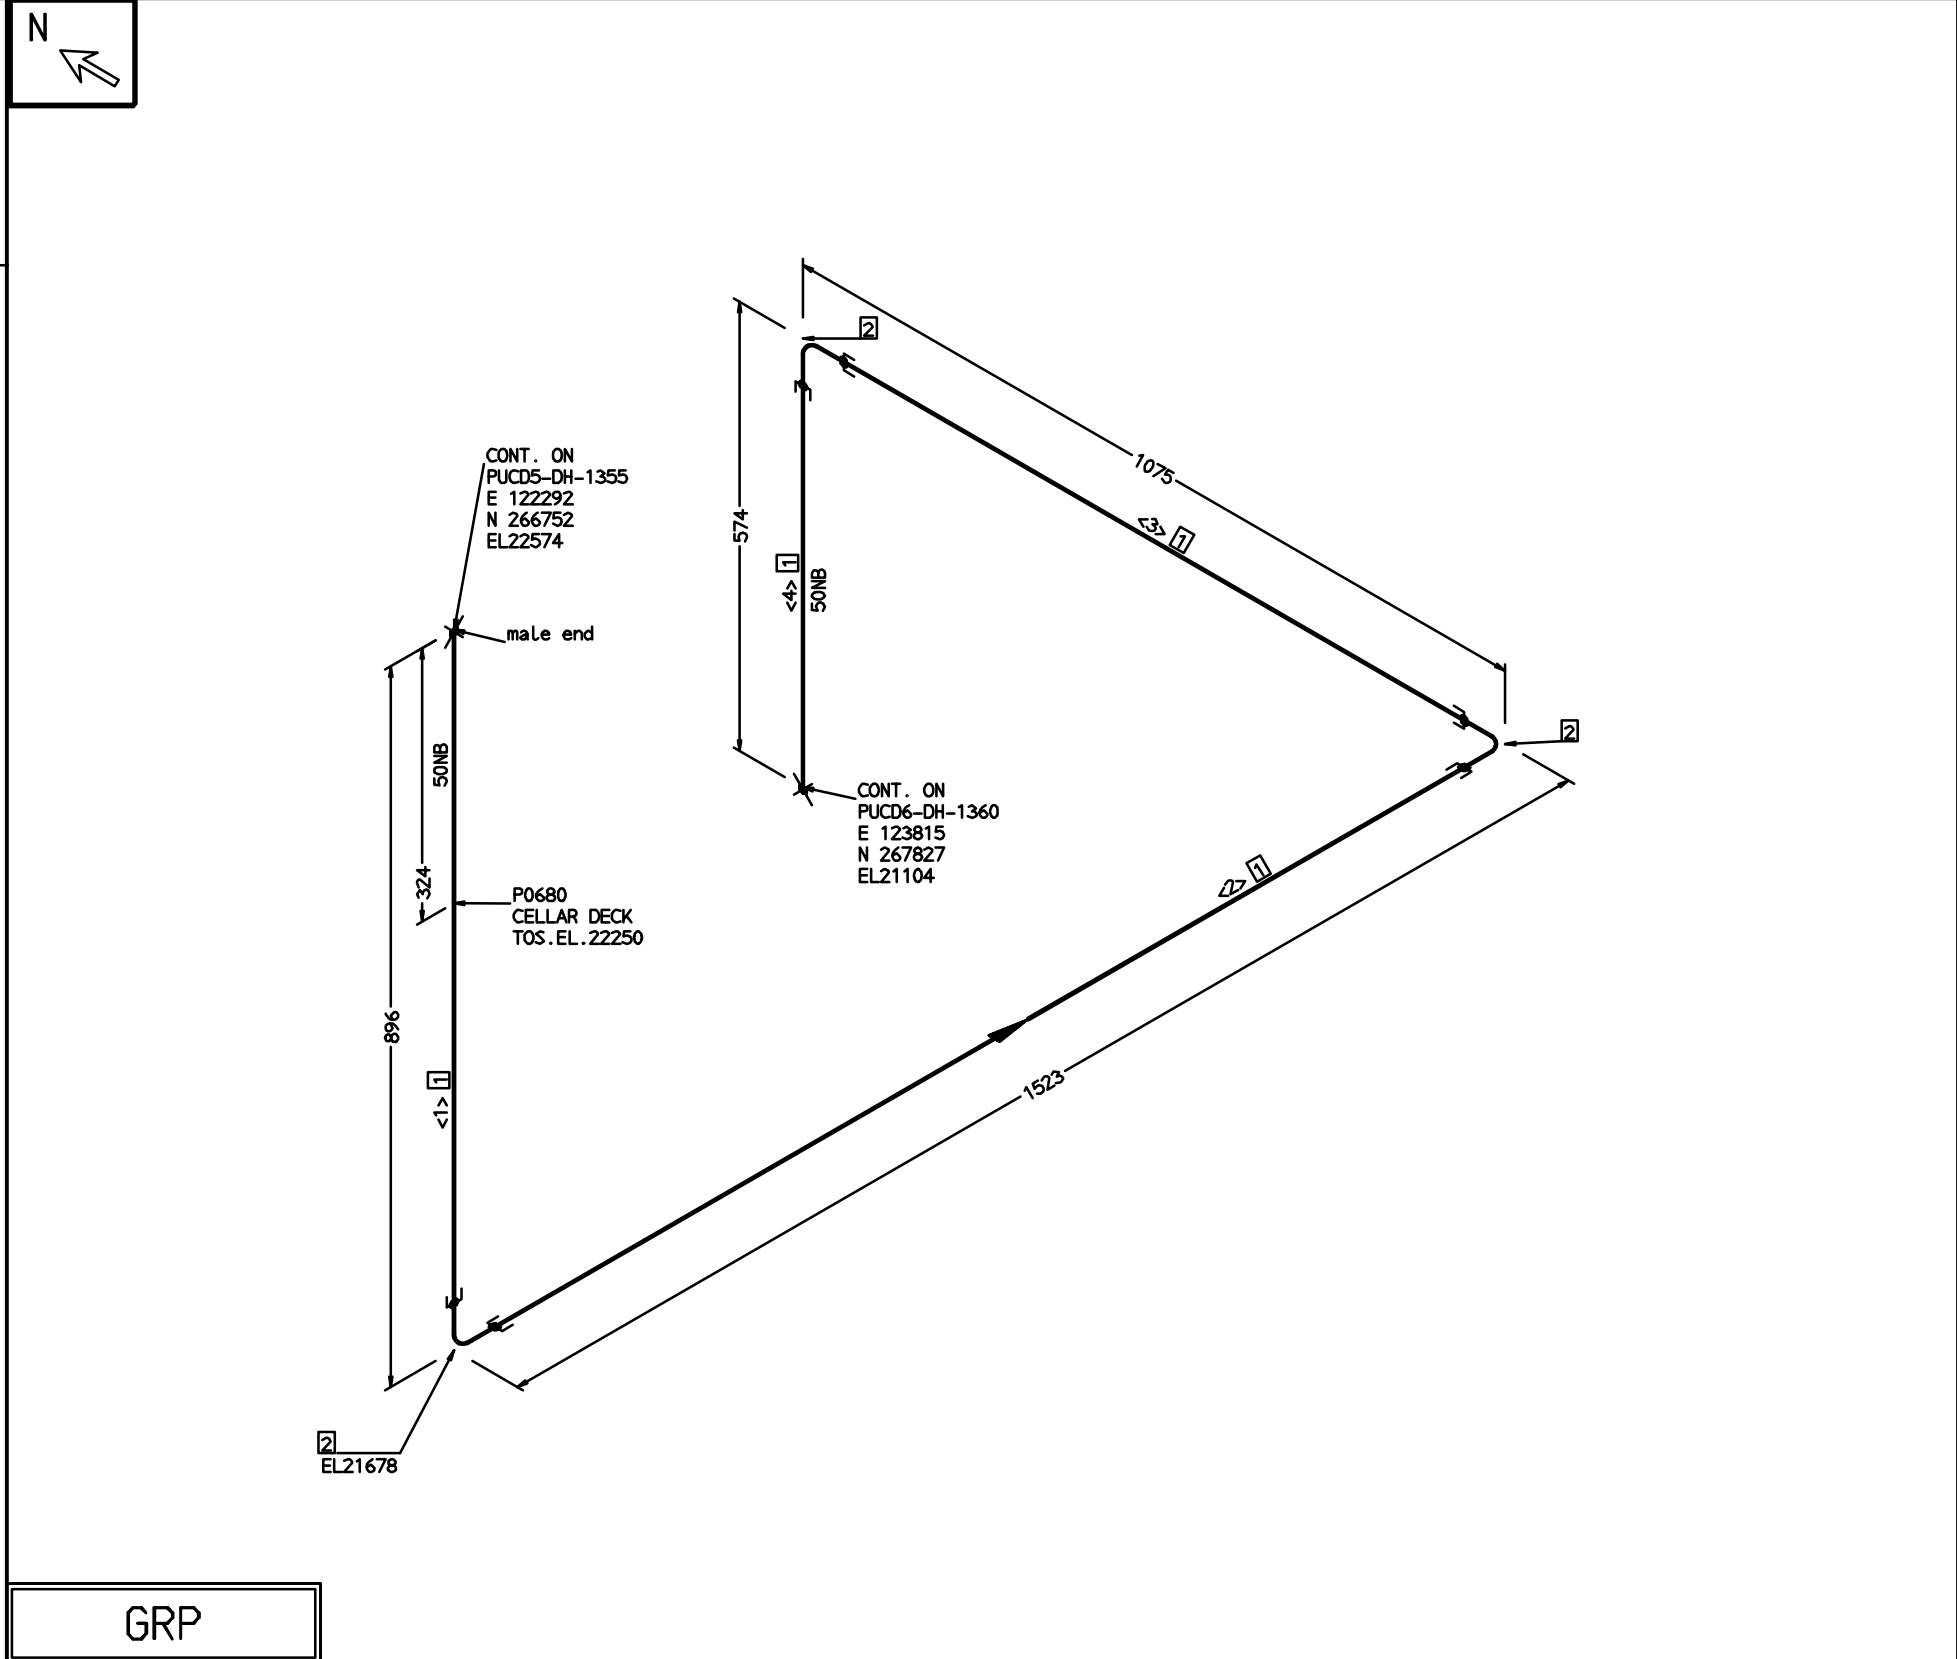

HOLDS 1 Cleared 2 Cleared			Notes 1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.			MATL CODE	COMM. PACK	TEST LOOP NO.	PRIORITY
Reference Drawings FOR ISOMETRIC LEGEND SHEET SEE DRAWING :- WNB-3000-DX-1000.01									6
							ISO DATA : bbrzz05 30-DEC-96		
							G.A. REFERENCE : 2604.01		
							P&ID REFERENCE : 3090.02		
TEST PRESSURE KPa g	1800	LAST ITEM NUMBER					DESTINATION CODE : A		
TEST MEDIUM	POT. WATER						AREA : CD6		
INSULATION THICKNESS	NONE						STRESS RELIEF : N		
COLOUR CODE	BLACK.W.Y 11	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN	CRITICAL LINE : N		
PAINT SYSTEM	-		REV	DATE	REVISIONS	BY	INSULATION CLASS :		
N.D.T. CLASS	2						SPECIFICATION : 1G3		
						23299	DRAWING NUMBER		
							WNB-PUCDG-DH-1355		
							RFV C1		