| FABRICATION MATERIALS |

PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
1	PIPE (GREP) 5.2MM WT API 15LR	100	MC000007062-(1G03)	0.5M
2	PIPE (GREP) 4.1MM WT API 15LR	50	MC000007249-(1G03)	5.4M
3	REDUCER CONC (GREP) GLASS REINFORCED PLASTIC (GRP)	100 x 50	MC000005995-(1G03)	1
4	TEE EQUAL (GREP) GLASS REINFORCED PLASTIC (GRP)	50 x 50	MC000006147-(1G03)	2
5	ELBOW 90 (GREP) GLASS REINFORCED PLASTIC (GRP)	50	MC000006148-(1G03)	1
6	ELBOW 45 (GREP) GLASS REINFORCED PLASTIC (GRP)	50	MC000006146-(1G03)	1
7	FLANGE SW 150LB FF HUBLESS GLASS REINFORCED PLASTIC (GRP)	50	MC000006137-(1G03)	1

| ERECTION MATERIALS |

PT NO	COMPONENT DESCRIPTION	N.S. (MM)	ITEM CODE	QTY
8	GASKET 150LB FF 3.2MM (COMPR) COMP CARBON FIBRE / NBR BINDER	50	MC000005048-(1G03)	1
9	130 MM LG STUD BOLT C/W 2 NUTS ASTM A193-B8M CL2 & A194-8M	16	PC000000858-(1G03)	4

| CUT PIPE LENGTH |

PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS	PIECE NO	CUT LENGTH	N.S. (MM)	REMARKS
<1>	450	100		<2>	809	50	
<3>	388	50		<4>	435	50	
<5>	2192	50		<6>	667	50	
<7>	847	50					

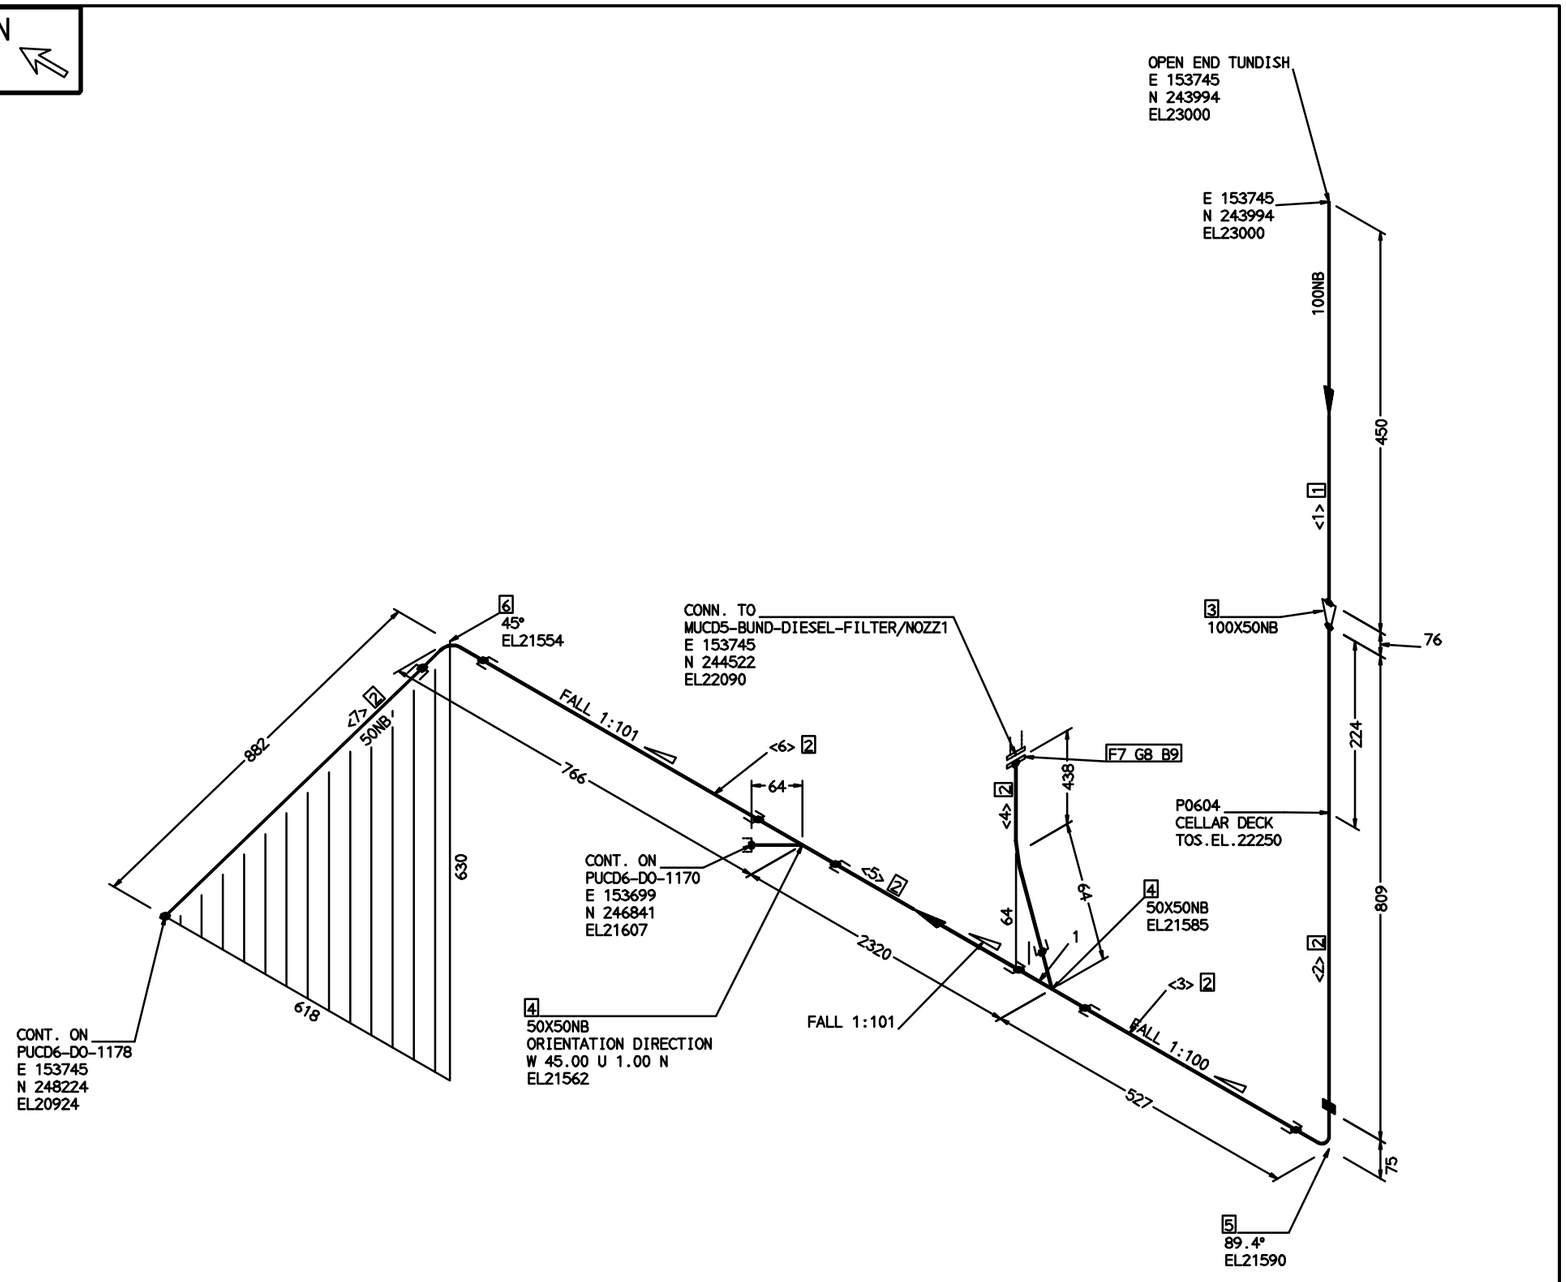

GRP

HOLDS
1 Cleared
2 Cleared

Notes
1. NO MODIFICATIONS TO CRITICAL LINES WITHOUT PRIOR APPROVAL FROM STRESS DEPARTMENT.

Reference Drawings
FOR ISOMETRIC LEGEND SHEET SEE DRAWING :-
WNB-3000-DX-1000.01

TEST PRESSURE KPa g	1800	LAST ITEM NUMBER					
TEST MEDIUM	POT.WATER						
INSULATION THICKNESS	NONE						
COLOUR CODE	BLACK	LAST WELD NUMBER	C1	03/01/97	APPROVED FOR CONSTRUCTION	AN	
PAINT SYSTEM	-		REV	DATE	REVISIONS	BY	
N.D.T. CLASS	2						

MATL CODE	COMM. PACK	TEST LOOP NO.	PRIORITY
			6

ISO DATA	: bbrzz11 30-DEC-96
G.A. REFERENCE	: 2606.01
P&ID REFERENCE	: 3068.01/90.01
DESTINATION CODE	: A
AREA	: CD6
STRESS RELIEF	: N
CRITICAL LINE	: N
INSULATION CLASS	:
SPECIFICATION	: 1G3

RFV C1

WANDOO Alliance

23103

DRAWING NUMBER
WNB-PUCD6-DO-1024