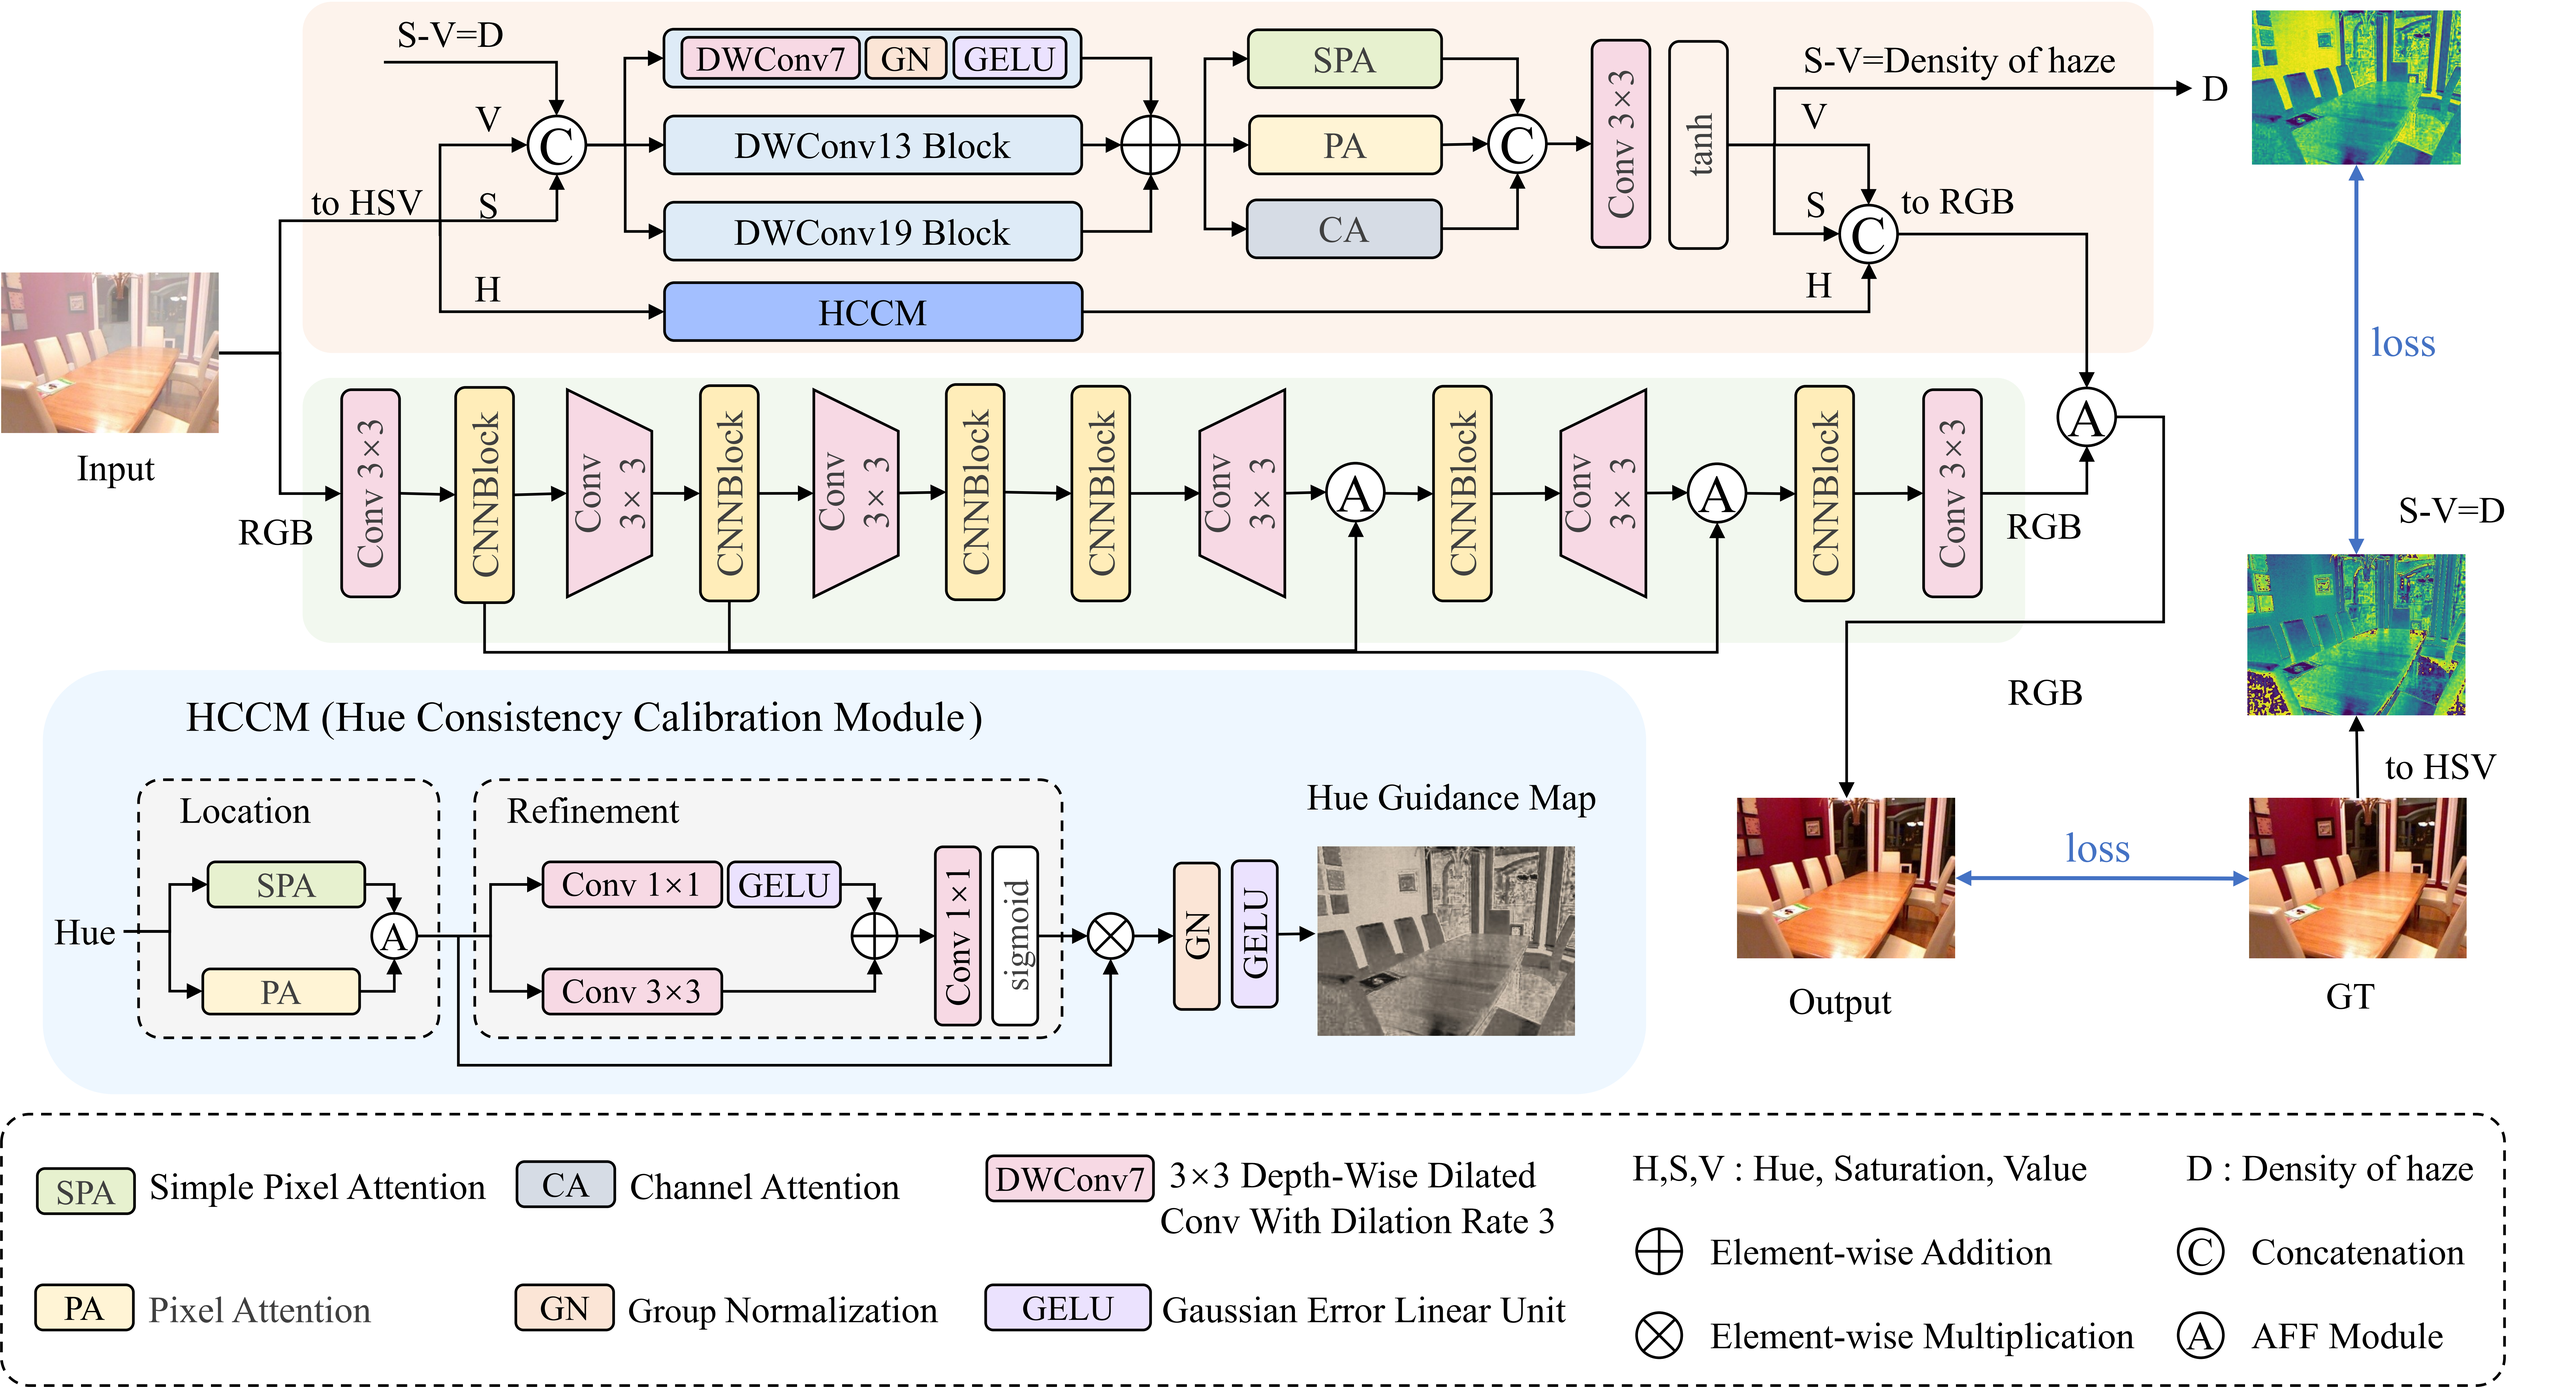

S-V=D
V
to HSV
S
H
DWConv7
GN
GELU
DWConv13 Block
DWConv19 Block
HCCM
SPA
PA
CA
Conv 3×3
tanh
S-V=Density of haze
D
V
S
H
to RGB
Input
RGB
Conv 3×3
CNNBlock
Conv 3× 3
RGB
loss
S-V=D
to HSV
RGB
HCCM (Hue Consistency Calibration Module)
Location
Refinement
Hue
SPA
PA
Conv 1×1
GELU
Conv 3×3
sigmoid
GN
GELU
Hue Guidance Map
Output
loss
GT
SPA Simple Pixel Attention
CA Channel Attention
DWConv7 3×3 Depth-Wise Dilated Conv With Dilation Rate 3
H,S,V : Hue, Saturation, Value
D : Density of haze
PA Pixel Attention
GN Group Normalization
GELU Gaussian Error Linear Unit
Element-wise Addition
Concatenation
Element-wise Multiplication
AFF Module