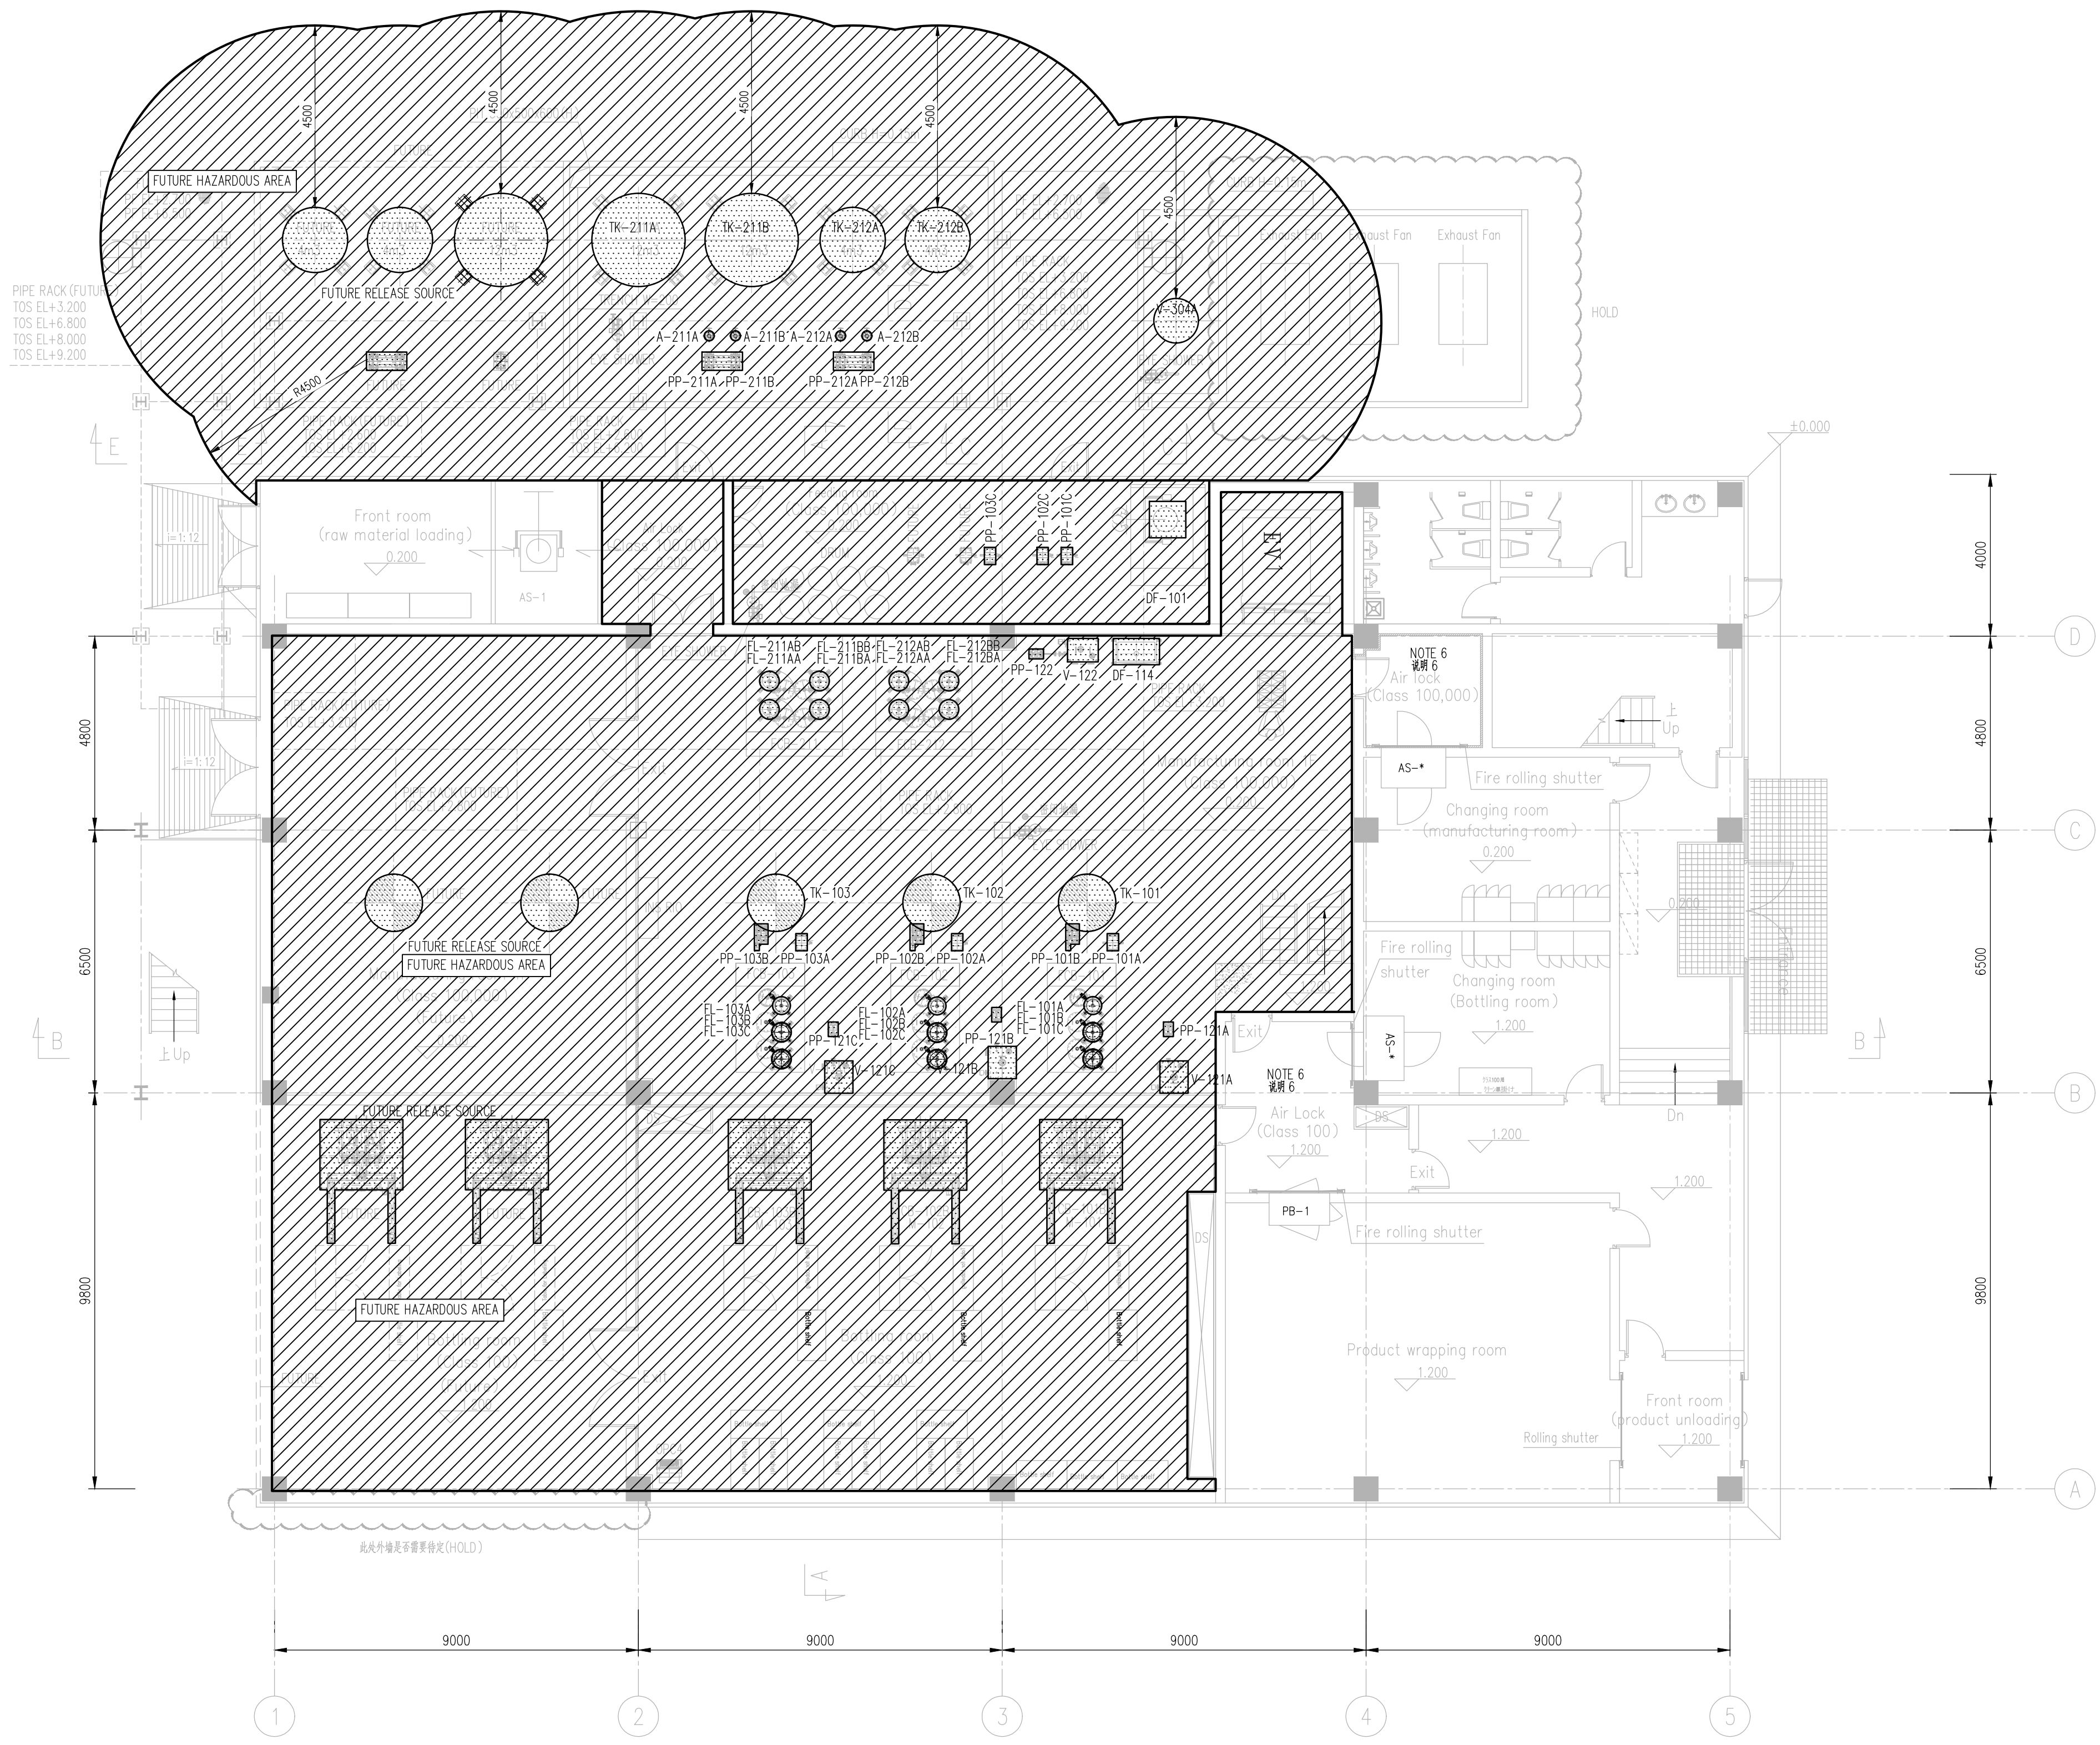


说明 Note:

1. 本图尺寸单位以毫米计。
All dimensions are given in millimeter.

2. 本图根据《爆炸危险环境电力装置设计规范》(GB50058-2014)及工艺提供的相关信息编制。
The drawing is prepared based on «Code for design of electrical installations in explosive atmospheres» (GB 50058-2014) and related information which is provided by process.

3. 本装置内根据工艺条件为通风良好环境, 图中工艺设备的容积不大于95米³, 压力不大于3.5MPa, 流量不大于38L/s, 且为第二级释放源爆炸危险区域划分以释放源为中心, 半径为4.5m的范围划为2区。
According to the process condition, the building is ventilated well. For other process equipment which shown on this drawing, the volume is not more 95m³, the pressure is not more than 3.5MPa, the flow rate is not more than 38L/s, and designed as Class 2 release source, so range with the release source as the center, radius of 4.5m is classified as Zone 2.

4. 安装在气体爆炸危险区域的所有电气设备防爆等级不低于Ex IIB T3 Gb。
All electrical apparatuses in gas hazardous area are certified for at least Ex IIB T3 Gb.


5. 图中危险区划未画出的地坑下沟、沟、井等均划为1区。
All pits, trenches, wells etc. within the hazardous area that are not shown in the drawing shall be classified as Zone 1.

6. 根据暖通专业的输入条件, 此门采用了正压通风的措施, 不能形成爆炸性气体环境, 故划为安全非爆炸危险区域。
According to input information which is provided by HVAC, The Airlocks adopts positive pressure ventilation that it cannot be an explosive gas environment, so this room is a non-hazardous area.


Symbol 图例	Hazardous Substance 危险介质	Gas Group 气体类别	Temp.Class 温度类别	1'specific Gravity /Air 比重
 Zone 1 1区	PGME, AEL, CY, DMF, WASTE SOLVENT, SOLVENT, PON, PRODUCT SOLVENT CONDENSATE, WASTE GAS PGME, PGME1, PGME2, PREMIX LIQUID	IIA & IIB	T2 & T3	H
 Zone 2 2区	Release Source 释放源			
 Non Hazardous Area 非爆炸危险区	Secondary: A-211A FL-102C FL-211BA PP-103B TK-102 A-211B FL-103A FL-211BB PP-121A TK-103 A-212A FL-103B FL-212AA PP-121B TK-211A A-212B FL-103C FL-212AB PP-121C TK-211B DF-117 FL-201 FL-212BA PP-122 TK-212A DF-114 FL-202 FL-212BB PP-211A TK-212B DF-116 FL-203 PP-101A PP-211B V-121A FL-101A FL-204 PP-101B PP-212A V-121B FL-101B FL-205 PP-102A PP-212B V-121C FL-101C FL-206 PP-102B TK-101 M-101 FL-102A FL-211AA PP-103A V-122 M-102 FL-102B FL-211AB V-304A M-103 PP-101C PP-102C PP-103C DCB-111 weighing points Premix liquid drum in DF-101 DCB-113 weighing points DCB-112 weighing points			
 Non Hazardous Area 非爆炸危险区	*1 "L" 表示=轻于空气, "H" 表示=重于空气。 *1 "L" =Lighter than Air, "H" =Heavier than Air			

1FL=EL+0.200

DATE	MADE	*****	TITLE
SCALE	CH*KD	*****	Manufacturing Building Hazardous Area Classification Layout
JOB No.	APP'D	*****	Plan EL+0.200
SECURITY LEVEL	No.	DESCRIPTION	DWG. No.
LEVEL-2	No.	REVISIONS	ED-300-ELE-HAZ-000-0001

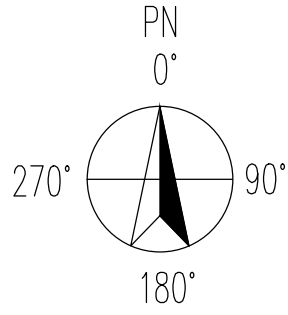



- 说明 Note:**
- 1.本图尺寸单位以毫米计。
All dimensions are given in millimeter.
 - 2.本图根据《爆炸危险环境电力装置设计规范》(GB50058-2014)及工艺提供的相关信息编制。
The drawing is prepared based on 《Code for design of electrical installations in explosive atmospheres》(GB 50058-2014) and related information which is provided by process.
 - 3.本装置内根据工艺条件为通风良好环境,图中工艺设备的容积不大于95米³,压力不大于3.5MPa,流量不大于38L/s,且为第二级释放源或爆炸危险区域划分以释放源为中心,半径为4.5m的范围划为2区。
According to the process condition, the building is ventilated well. For other process equipment which shown on this drawing, the volume is not more 95m³, the pressure is not more than 3.5MPa, the flow rate is not more than 38L/s, and designed as Class 2 release source, so range with the release source as the center, radius of 4.5m is classified as Zone 2.
 - 4.安装在气体爆炸危险区域的所有电气设备防爆等级应不低于Ex IIB T3 Gb。
All electrical apparatuses in gas hazardous area are certified for at least Ex IIB T3 Gb.
 - 5.图中危险区内未画出的地坑下沟、沟、井等均划1区。
All pits, trenches, wells etc. within the hazardous area that are not shown in the drawing shall be classified as Zone 1.
 - 6.根据暖通专业的输入条件,此门未采用了正压通风的措施,不能形成爆炸性气体环境,故此房间为非爆炸危险区域。
According to input information which is provided by HVAC. The Airlocks adopts positive pressure ventilation that it cannot be an explosive gas environment, so this room is a non-hazardous area.

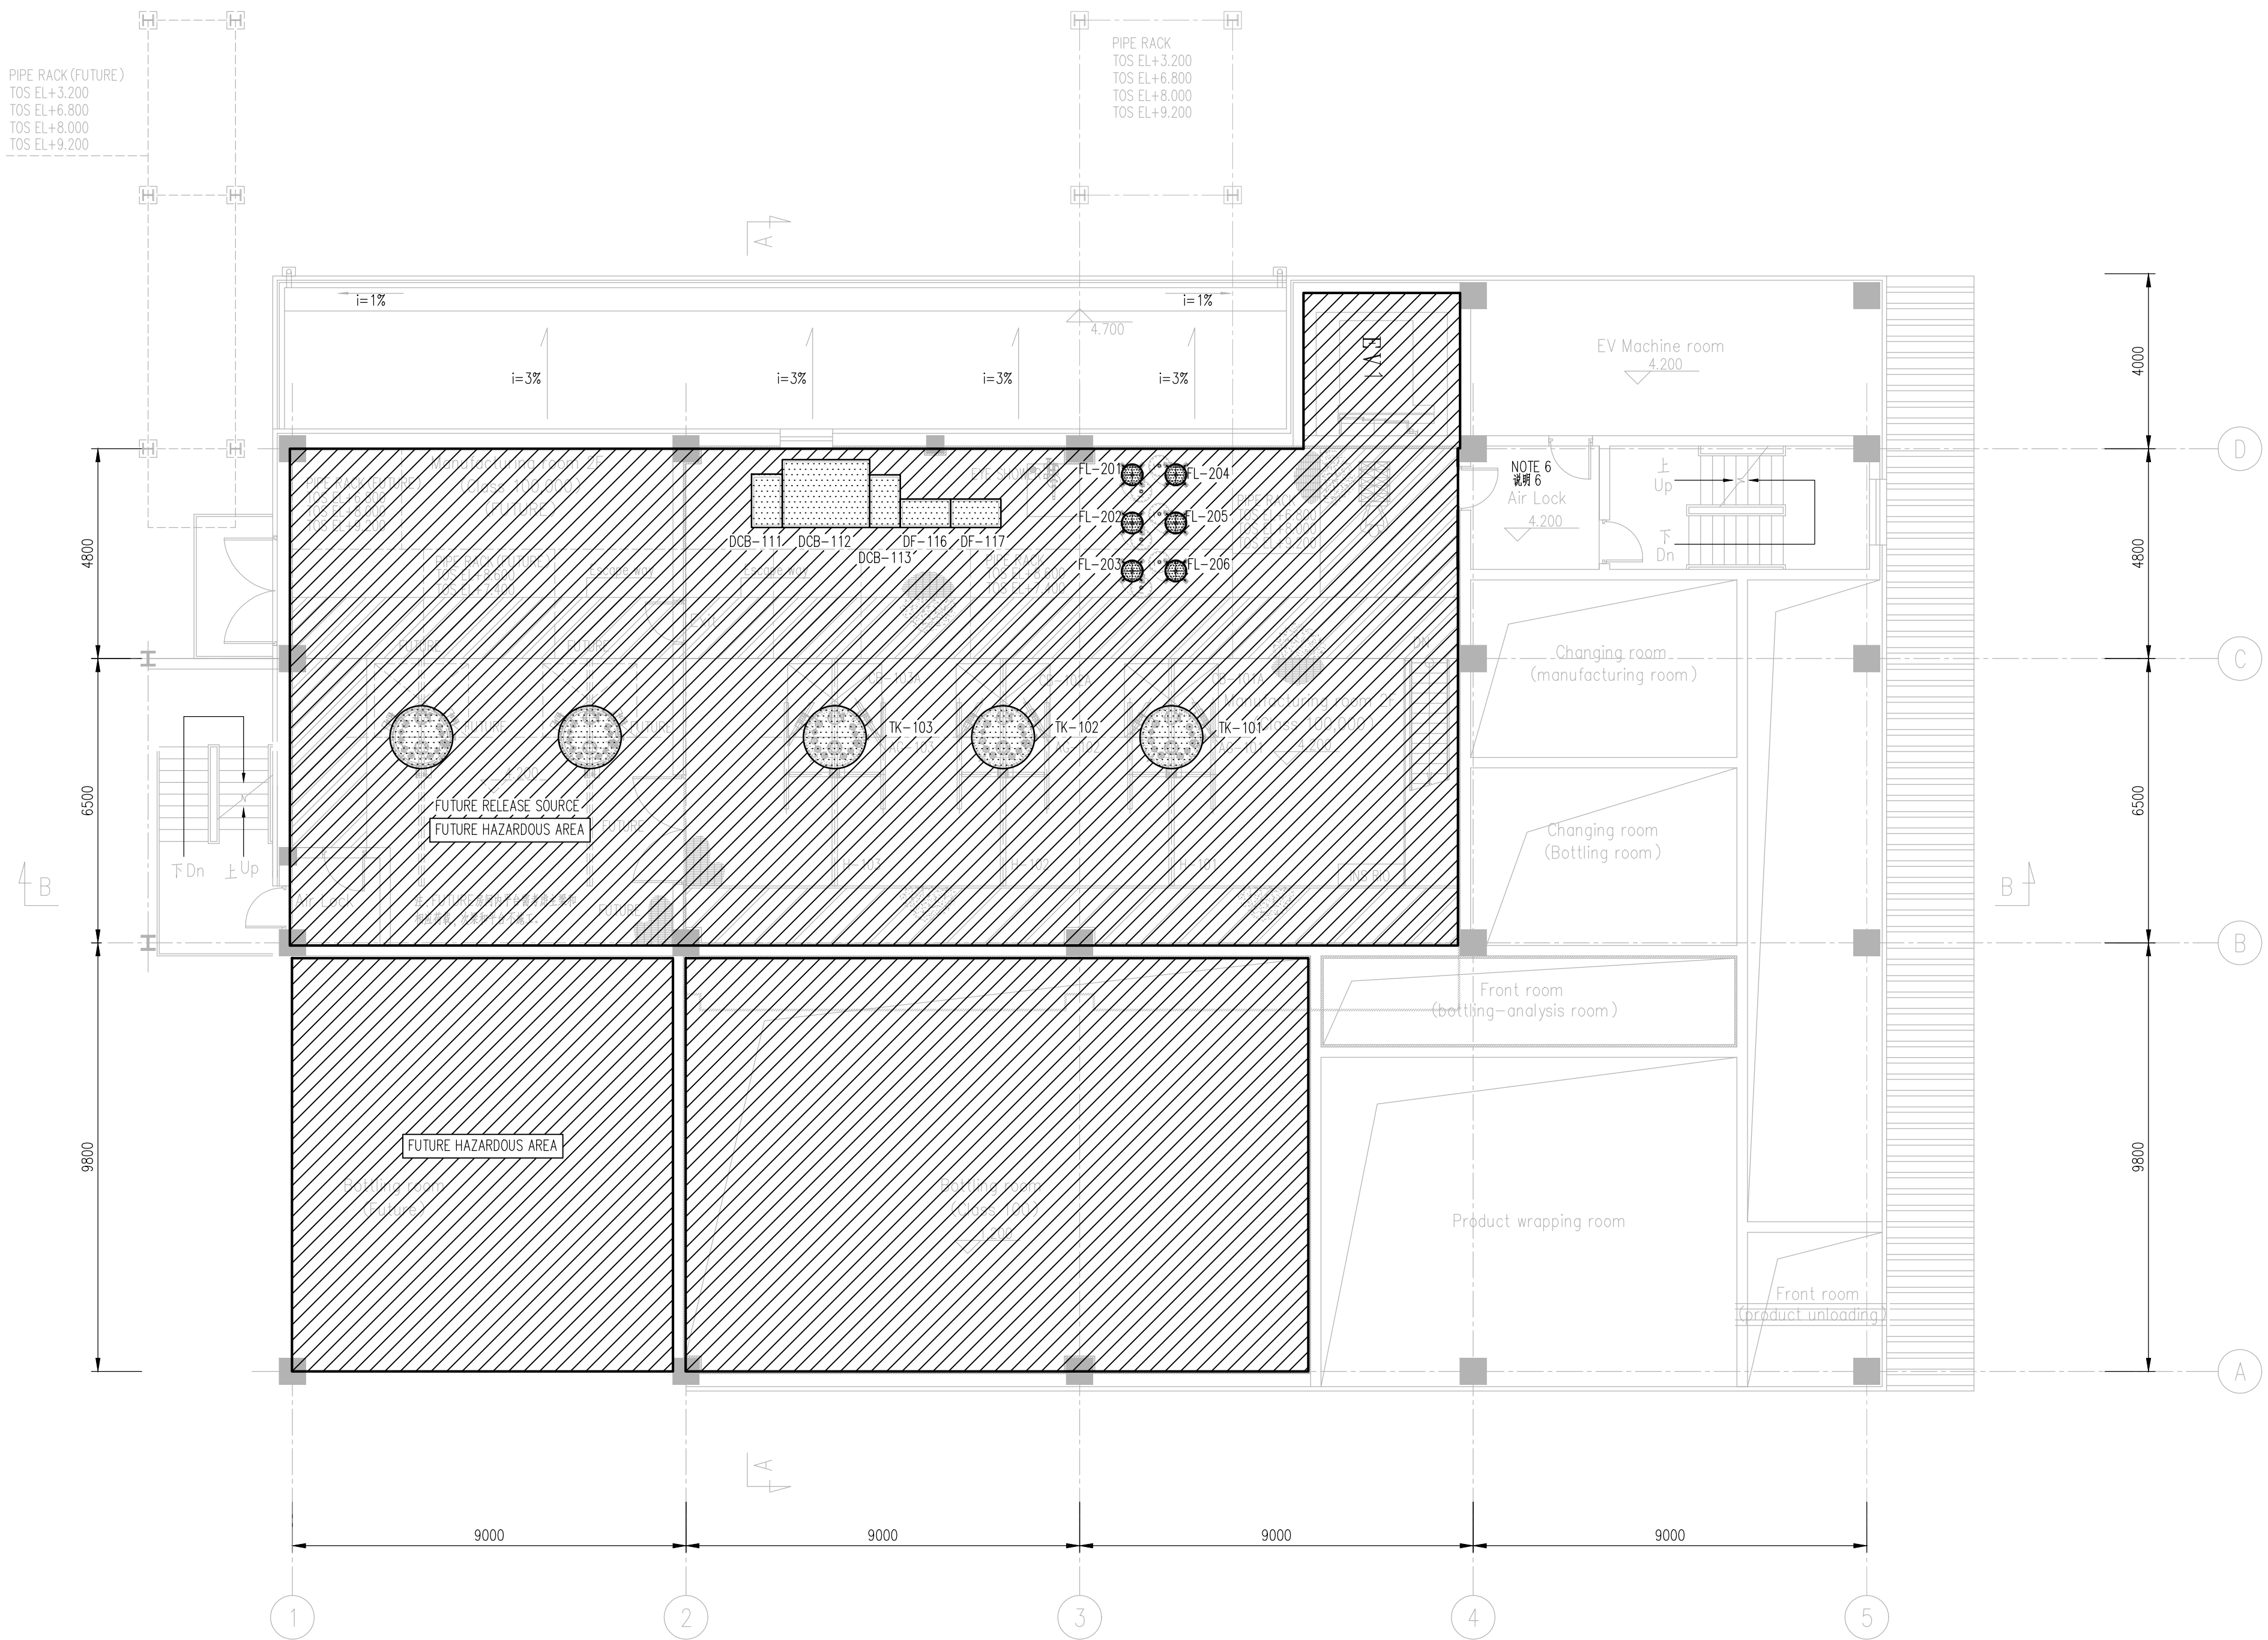

Symbol 图例	Hazardous Substance 危险介质	Gas Group 气体类别	Temp.Class 温度类别	Y ^{Specific Gravity} /Air 比重	
 Zone 1 1区	PGME,A,EL,CY,DMF,WASTE SOLVENT, SOLVENT,PON,PRODUCT SOLVENT CONDENSATE,WASTE GAS PGME,PGME1,PGME2,PREMIX LIQUID	IIA & IIB	T2 & T3	H	
 Zone 2 2区					
	Release Source 释放源				
	二級 Secondary :				
	A-211A	FL-102C	FL-211BA	PP-103B	TK-102
	A-211B	FL-103A	FL-211BB	PP-121A	TK-103
	A-212A	FL-103B	FL-212AA	PP-121B	TK-211A
	A-212B	FL-103C	FL-212AB	PP-121C	TK-211B
	DF-117	FL-201	FL-212BA	PP-122	TK-212A
	DF-114	FL-202	FL-212BB	PP-211A	TK-211B
	DF-116	FL-203	PP-101A	PP-211A	V-121A
	FL-101A	FL-204	PP-101B	PP-212A	V-121B
FL-101B	FL-205	PP-102A	PP-212B	V-121C	
FL-101C	FL-206	PP-102B	TK-101	M-101	
FL-102A	FL-211AA	PP-103A	V-122	M-102	
FL-102B	FL-211AB	V-304A		M-103	
PP-101C	PP-102C	PP-103C			
	DCB-111 weighing points	Premix liquid drum in DF-101			
	DCB-113 weighing points	DCB-112 weighing points			
	Non Hazardous Area 非爆炸危险区				
	*1 "L" 表示=轻于空气, "H" 表示=重于空气。 *1 "L" =Littier than Air, "H" =Heavier than Air				

Interlayer=EL+4.200

SECURITY LEVEL LEVEL-2							DATE		MADE	*****	TITLE Manufacturing Building Hazardous Area Classification Layout Plan EL+4.200 DWG. No. ED-300-ELE-HAZ-000-0002
							SCALE	1 / 100	CH*CD	*****	
		ISSUE FOR REVIEW	4/9/16/06	WJ	YCY	LH	JOB No.		APP*D	*****	
		ISSUE FOR REVIEW	4/9/07/06	WJ	YCY	LH					
	No.	DESCRIPTION	DATE	MADE	CH*CD	APP*D					REV.
	REVISIONS										

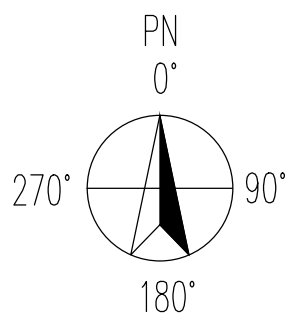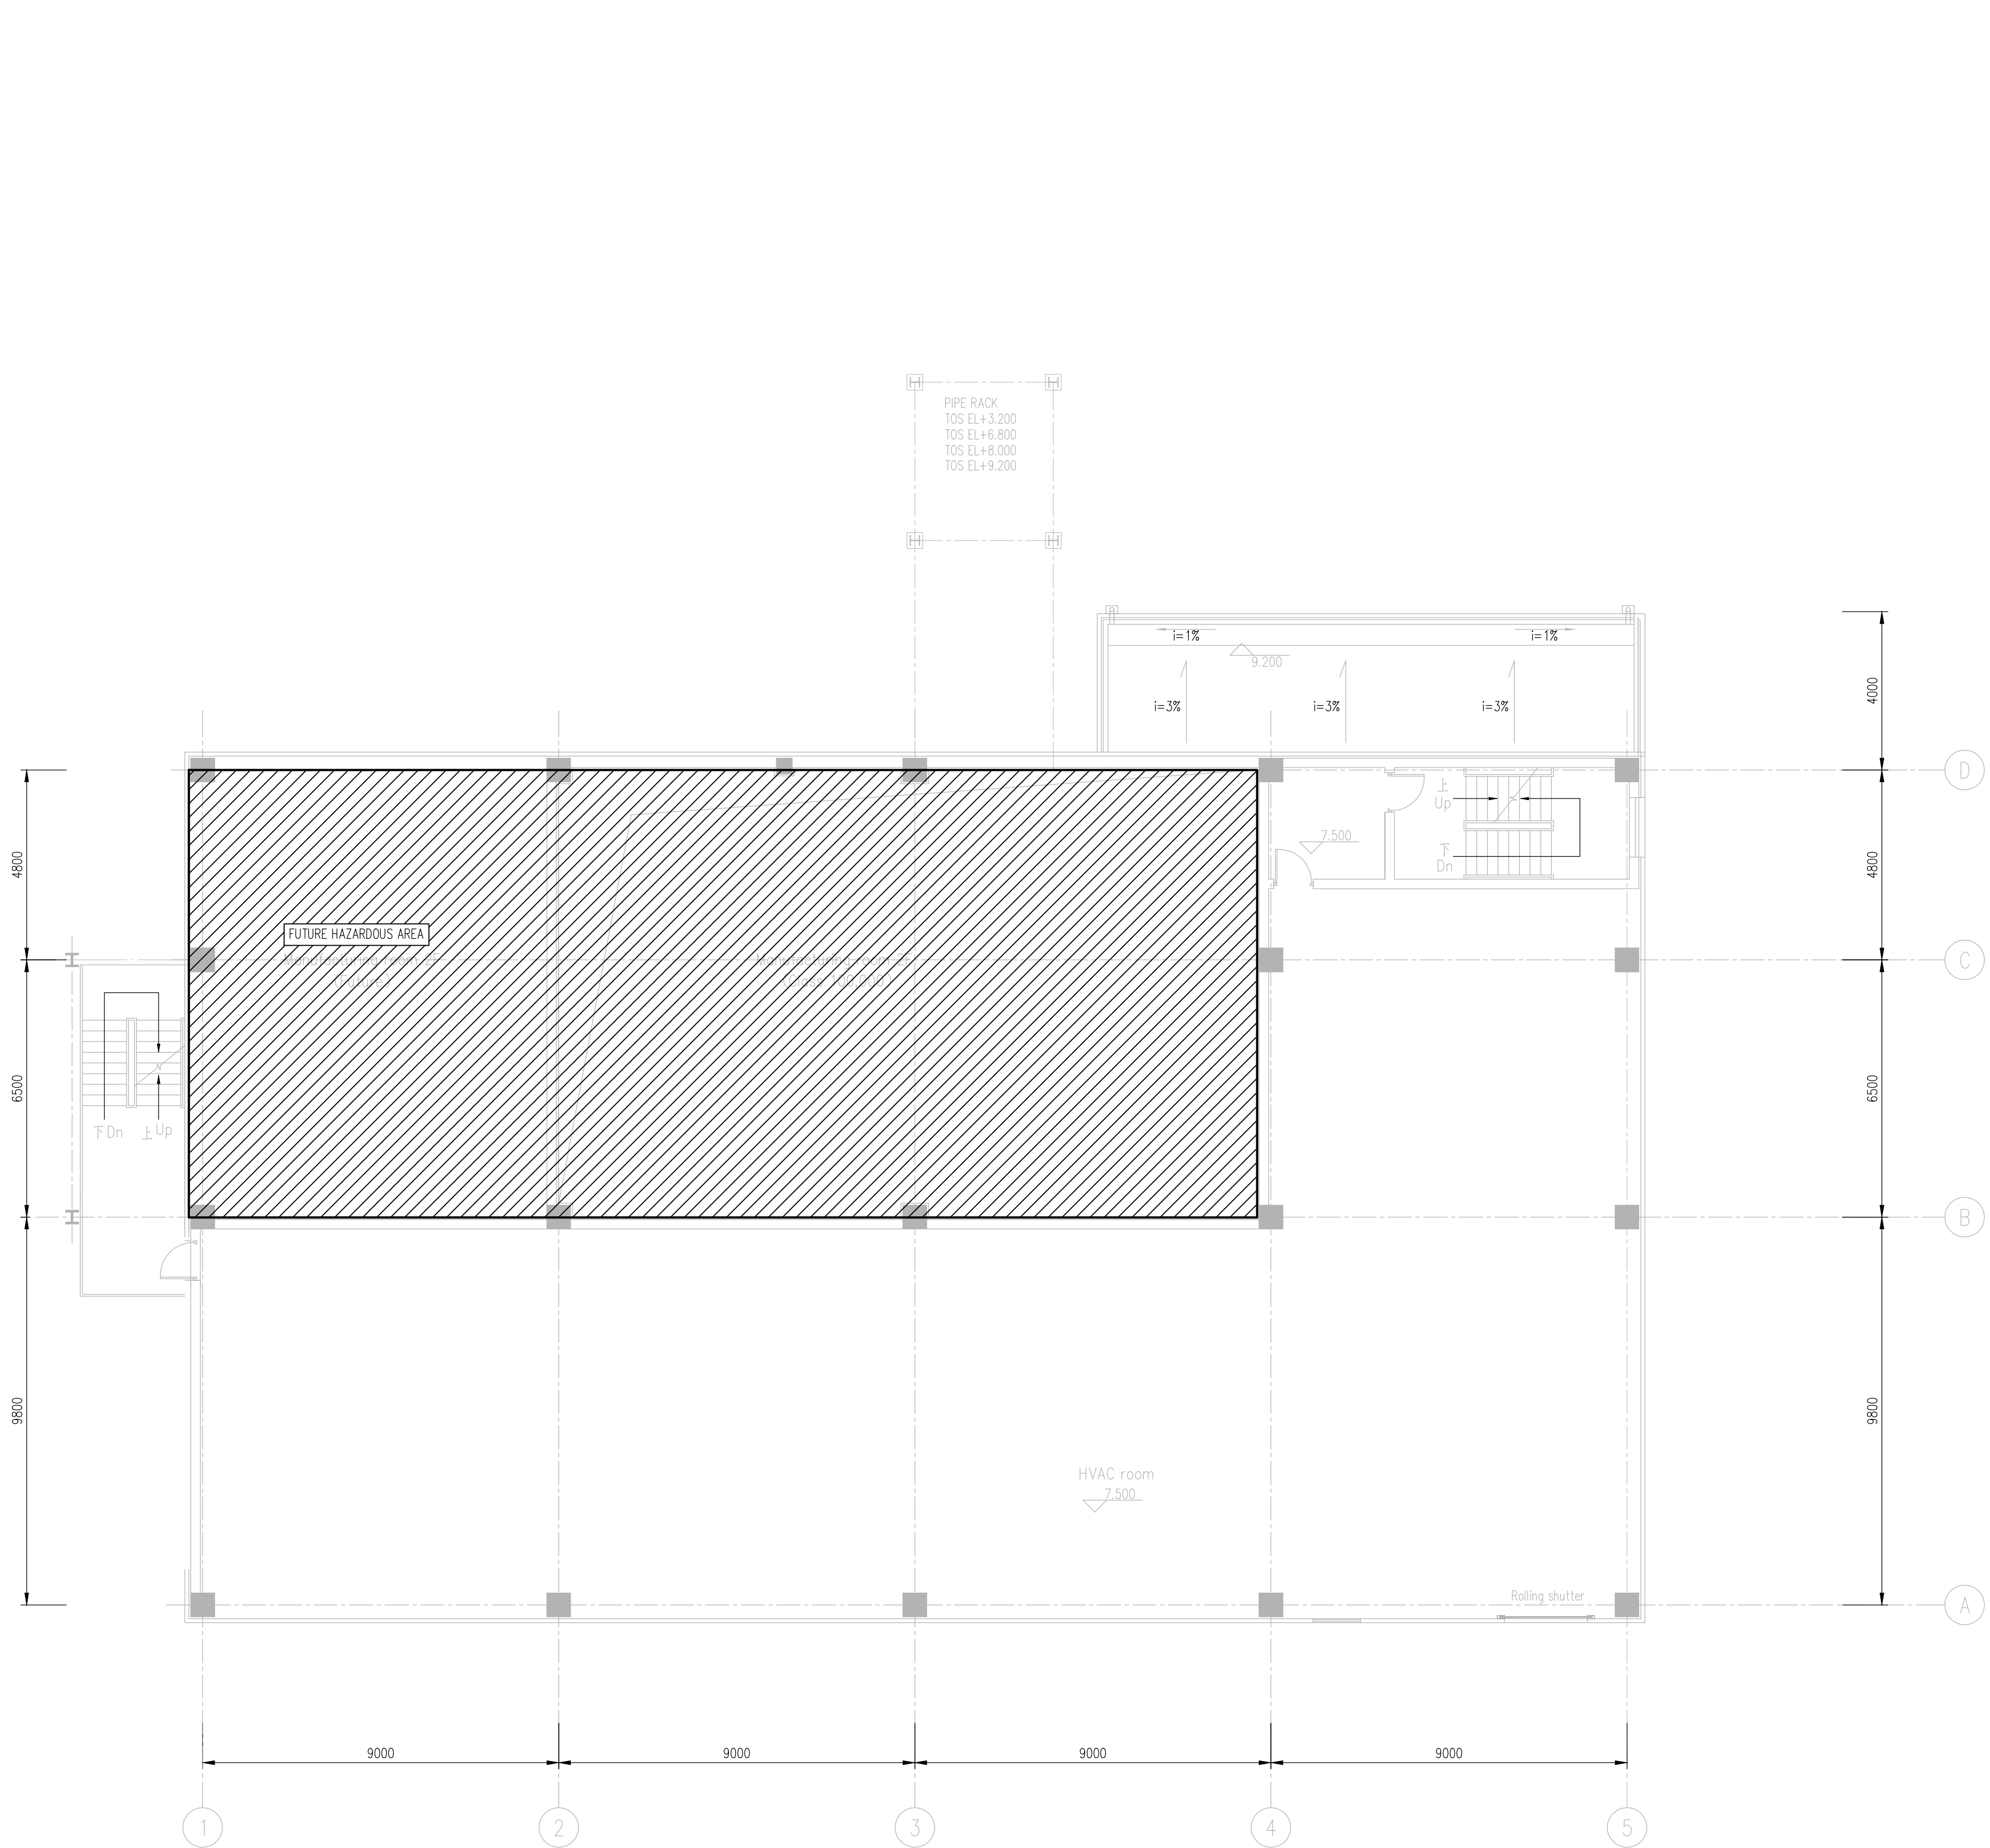

说明 Note:

1. 本图尺寸单位以毫米计。
All dimensions are given in millimeter.

2. 本图根据《爆炸危险环境电力装置设计规范》(GB50058-2014)及工艺提供的相关信息绘制。
The drawing is prepared based on 《Code for design of electrical installations in explosive atmospheres》(GB 50058-2014) and related information which is provided by process.

3. 本装置内根据工艺条件为通风良好环境, 图中工艺设备的容积不大于95米³, 压力不大于3.5MPa, 流量不大于38L/s, 且为第二级释放源或爆炸危险区域划分以释放源为中心, 半径为4.5m的范围划为2区。
According to the process condition, the building is ventilated well. For other process equipment which shown on this drawing, the volume is not more 95m³, the pressure is not more than 3.5MPa, the flow rate is not more than 38L/s, and designed as Class 2 release source, so range with the release source as the center, radius of 4.5m is classified as Zone 2.

4. 安装在气体爆炸危险区域的所有电气设备防爆等级不低于Ex IIB T3 Gb。
All electrical apparatuses in gas hazardous area are certified for at least Ex IIB T3 Gb.


5. 图中危险区内未画出的地坑、沟、井等均划1区。
All pits, trenches, wells etc. within the hazardous area that are not shown in the drawing shall be classified as Zone 1.

6. 根据暖通专业的输入条件, 此门未采用了正压通风的措施, 不能形成爆炸性气体环境, 故此房间为非爆炸危险区域。
According to input information which is provided by HVAC. The Airlocks adopts positive pressure ventilation that it cannot be an explosive gas environment, so this room is a non-hazardous area.


Symbol 图例	Hazardous Substance 危险介质	Gas Group 气体类别	Temp.Class 温度类别	1'specific Gravity /Air 比重
 Zone 1 1区	PGME,A,EL,CY,DMF,WASTE SOLVENT, SOLVENT,PON,PRODUCT SOLVENT CONDENSATE,WASTE GAS PGME,PGME1,PGME2,PREMIX LIQUID	IIA & IIB	T2 & T3	H
 Zone 2 2区	Release Source 释放源			
 Non Hazardous Area 非爆炸危险区	二级 Secondary : A-211A FL-102C FL-211BA PP-103B TK-102 A-211B FL-103A FL-211BB PP-121A TK-103 A-212A FL-103B FL-212AA PP-121B TK-211A A-212B FL-103C FL-212AB PP-121C TK-211B DF-117 FL-201 FL-212BA PP-122 TK-212A DF-114 FL-202 FL-212BB PP-211A TK-212B DF-116 FL-203 PP-101A PP-211B V-121A FL-101A FL-204 PP-101B PP-212A V-121B FL-101B FL-205 PP-102A PP-212B V-121C FL-101C FL-206 PP-102B TK-101 M-101 FL-102A FL-211AA PP-103A V-122 M-102 FL-102B FL-211AB V-304A M-103 PP-101C PP-102C PP-103C DCB-111 weighing points Premix liquid drum in DF-101 DCB-113 weighing points DCB-112 weighing points			
 Non Hazardous Area 非爆炸危险区	*1 "L" 表示=轻于空气, "H" 表示=重于空气。 *1 "L" =Lighter than Air, "H" =Heavier than Air			

2FL=EL+7.500

SECURITY LEVEL LEVEL-2							DATE		MADE	*****	TITLE		
							SCALE	1 / 100	CH-KD	*****	Manufacturing Building Hazardous Area Classification Layout		
		ISSUE FOR REVIEW	4/9/16/06	WJ	YCY	LH	JOB No.		APP-D	*****	Plan EL+7.500		
		ISSUE FOR REVIEW	4/9/07/06	WJ	YCY	LH					DWG. No.		
	No.	DESCRIPTION	DATE	MADE	CH-KD	APP-D						ED-300-ELE-HAZ-000-0003	REV.
	REVISIONS												

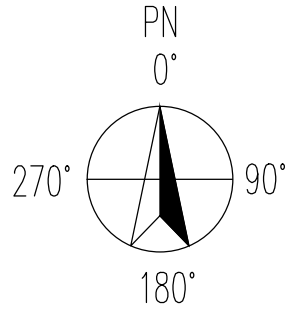

- 说明 Note:
- 1.本图尺寸单位以毫米计。
All dimensions are given in millimeter.
 - 2.本图根据《爆炸危险环境电力装置设计规范》(GB50058-2014)及工艺提供的相关信息编制。
The drawing is prepared based on 《Code for design of electrical installations in explosive atmospheres》(GB 50058-2014) and related information which is provided by process.
 - 3.本装置内所有工艺条件均为通风良好环境，图中工艺设备的容积不大于95米³，压力不大于3.5MPa，流量不大于38L/s，且为第二级释放源或爆炸危险区域划分以释放源为中心，半径为4.5m的范围划为2区。
According to the process condition, the building is ventilated well. For other process equipment which shown on this drawing, the volume is not more 95m³, the pressure is not more than 3.5MPa, the flow rate is not more than 38L/s, and designed as Class 2 release source, so range with the release source as the center, radius of 4.5m is classified as Zone 2.
 - 4.安装在气体爆炸危险区域的所有电气设备防爆等级应不低于Ex IIB T3 Gb。
All electrical apparatuses in gas hazardous area are certified for at least Ex IIB T3 Gb.
 - 5.图中危险区内未画出的地坑、沟、井等均划为1区。
All pits, trenches, wells etc. within the hazardous area that are not shown in the drawing shall be classified as Zone 1.
 - 6.根据暖通专业的输入条件，此门未采用了正压通风的措施，不能形成爆炸性气体环境，故此房间为非爆炸危险区域。
According to input information which is provided by HVAC. The Airlocks adopts positive pressure ventilation that it cannot be an explosive gas environment , so this room is a non-hazardous area.

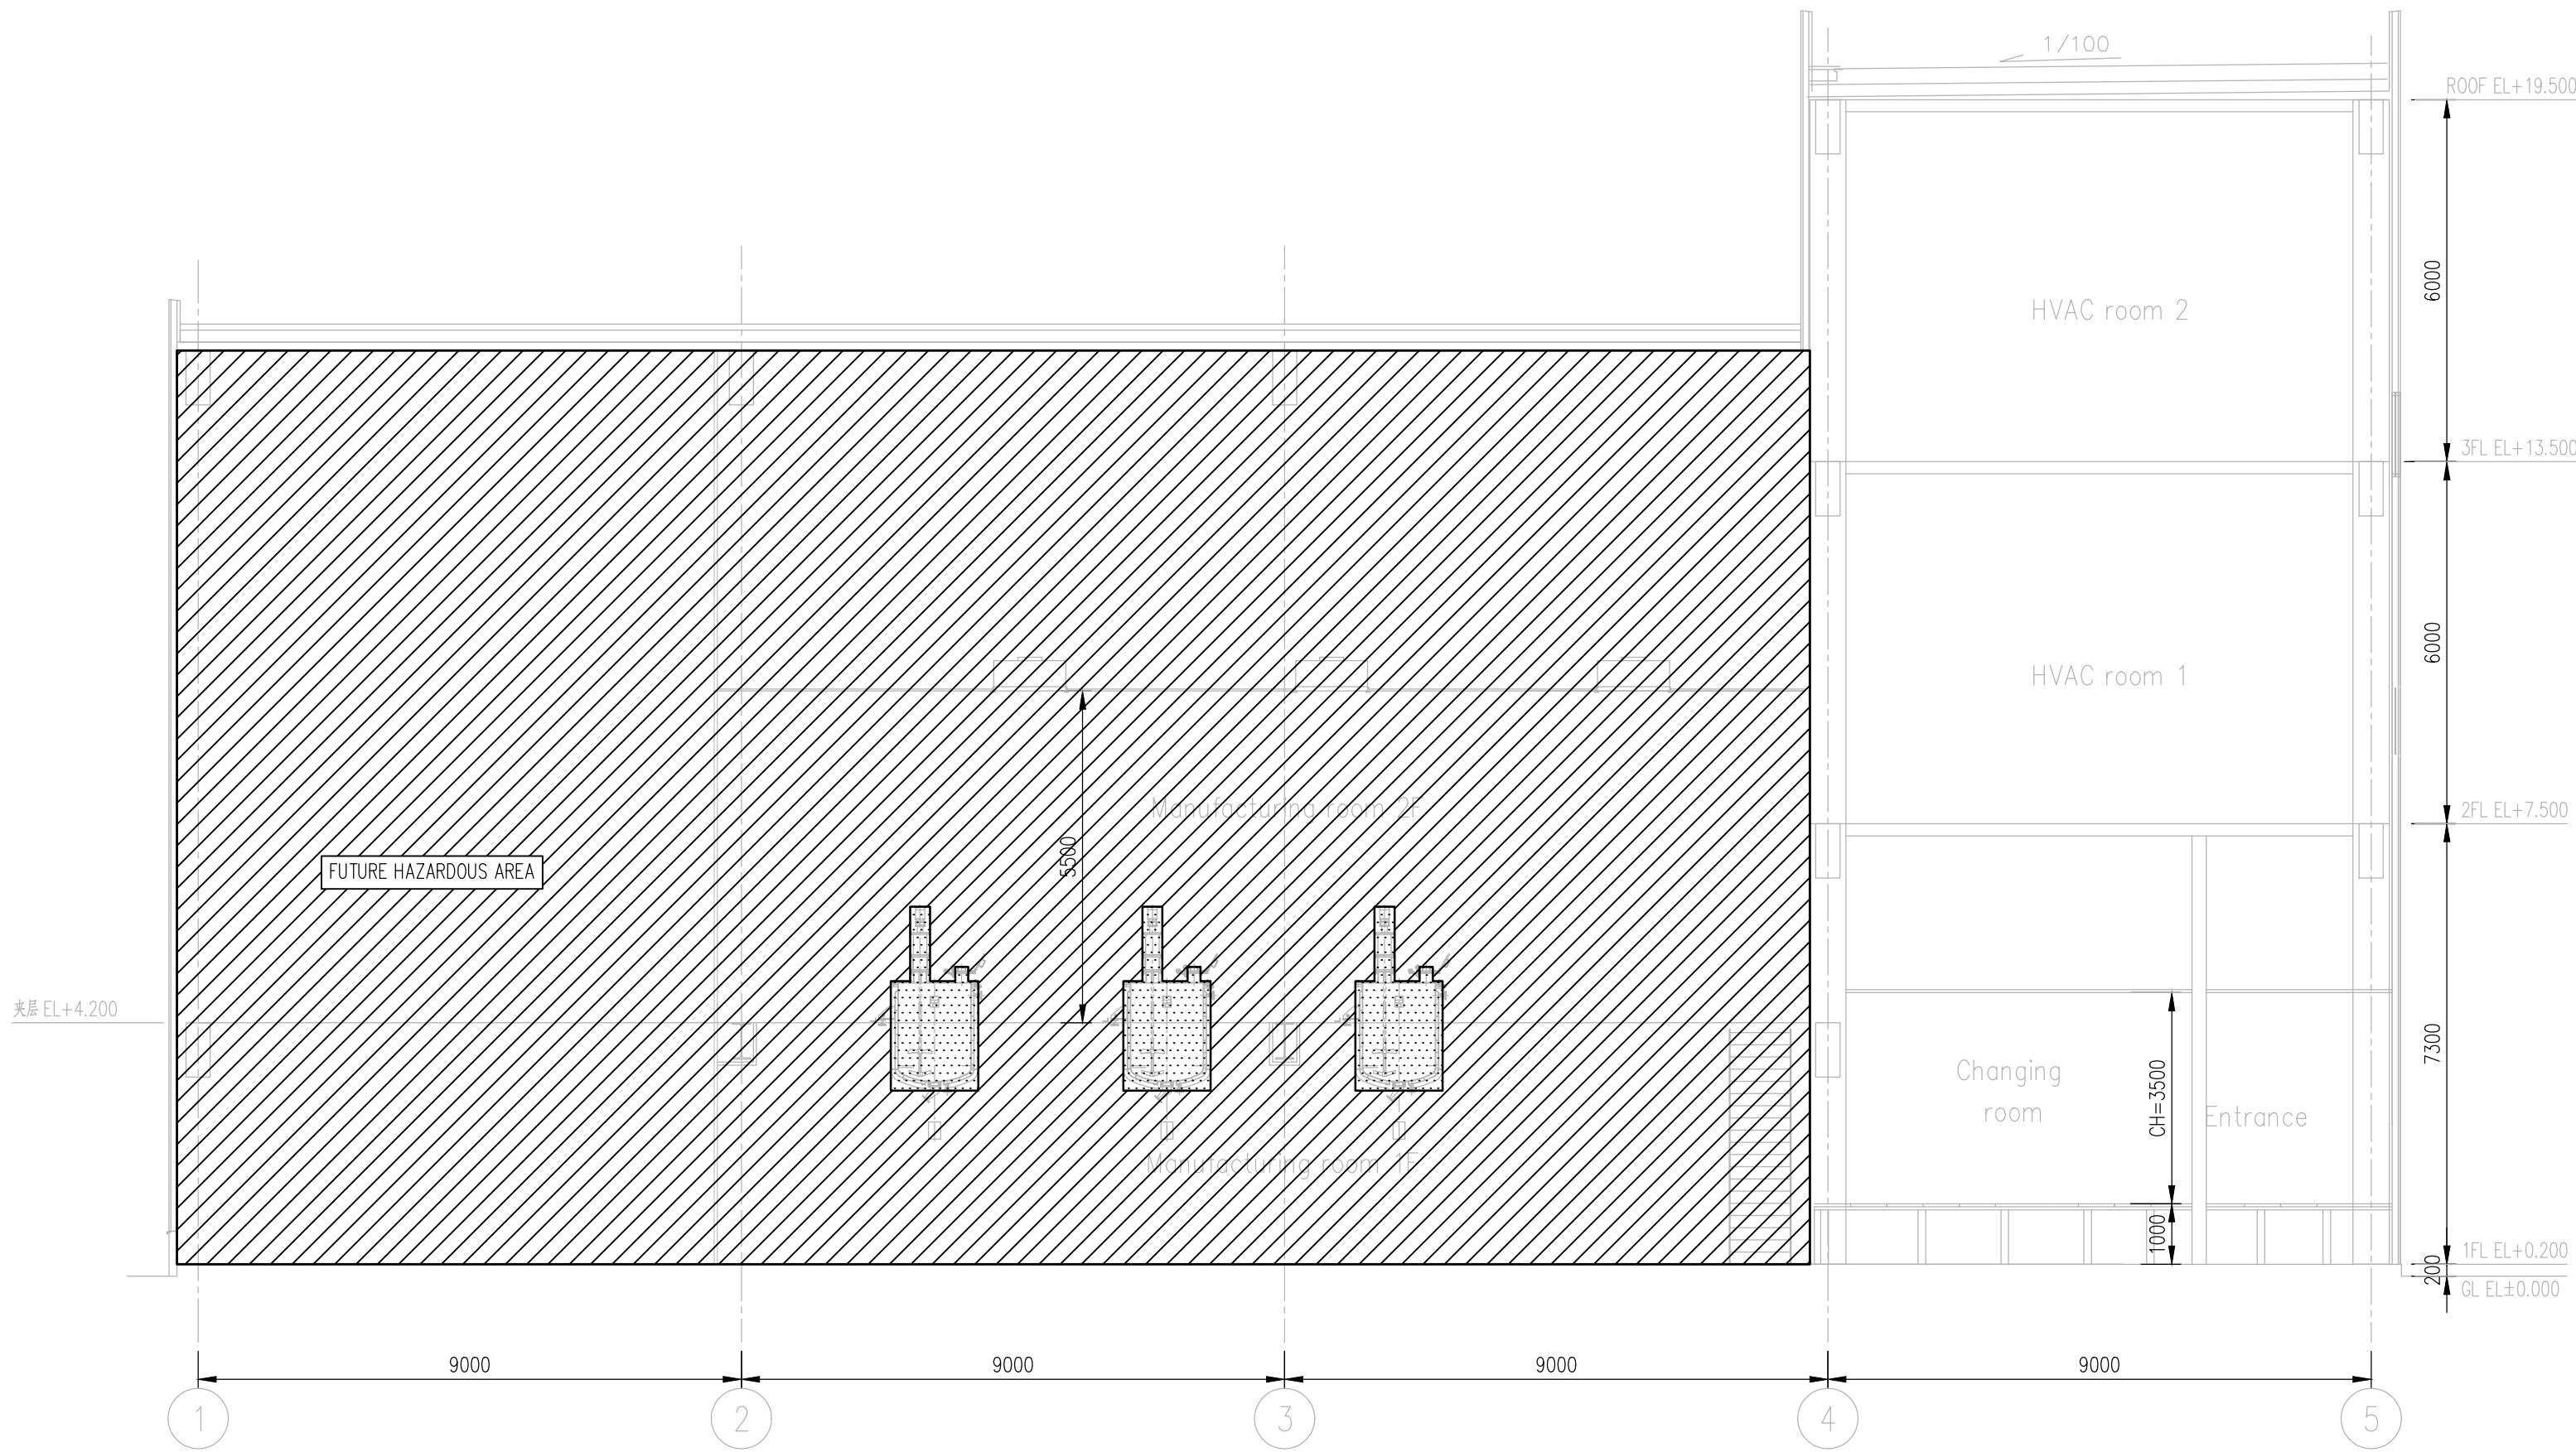

SECTION B-B

Symbol 图例	Hazardous Substance 危险介质	Gas Group 气体类别	Temp.Class 温度类别	1'specific Gravity /Air 比重
Zone 1 1E	PGME,A,EL,CY,DMF,WASTE SOLVENT, SOLVENT,PON,PRODUCT SOLVENT CONDENSATE,WASTE GAS PGME,PGME1,PGME2,PREMIX LIQUID	IIA & IIB	T2 & T3	H
Zone 2 2E				
	Release Source 释放源			
	二级 Secondary : A-211A FL-102C FL-211BA PP-103B TK-102 A-211B FL-103A FL-211BB PP-121A TK-103 A-212A FL-103B FL-212AA PP-121B TK-211A A-212B FL-103C FL-212AB PP-121C TK-211B DF-117 FL-201 FL-212BA PP-122 TK-212A DF-114 FL-202 FL-212BB PP-211A TK-212B DF-116 FL-203 PP-101A PP-211B V-121A FL-101A FL-204 PP-101B PP-212A V-121B FL-101B FL-205 PP-102A PP-212B V-121C FL-101C FL-206 PP-102B TK-101 M-101 FL-102A FL-211AA PP-103A V-122 M-102 FL-102B FL-211AB V-304A M-103 PP-101C PP-102C PP-103C DCB-111 weighing points Premix liquid drum in DF-101 DCB-113 weighing points DCB-112 weighing points			
	Non Hazardous Area 非爆炸危险区			
	*1 "L" 表示=轻于空气=, "H" 表示=重于空气=。 *1 "L" =Lighter than Air=, "H" =Heavier than Air=			

SECURITY LEVEL LEVEL-2	No.	DESCRIPTION	DATE	MADE	CH-KD	APP-D	TITLE	DWG. No. ED-300-ELE-HAZ-000-0004	REV.