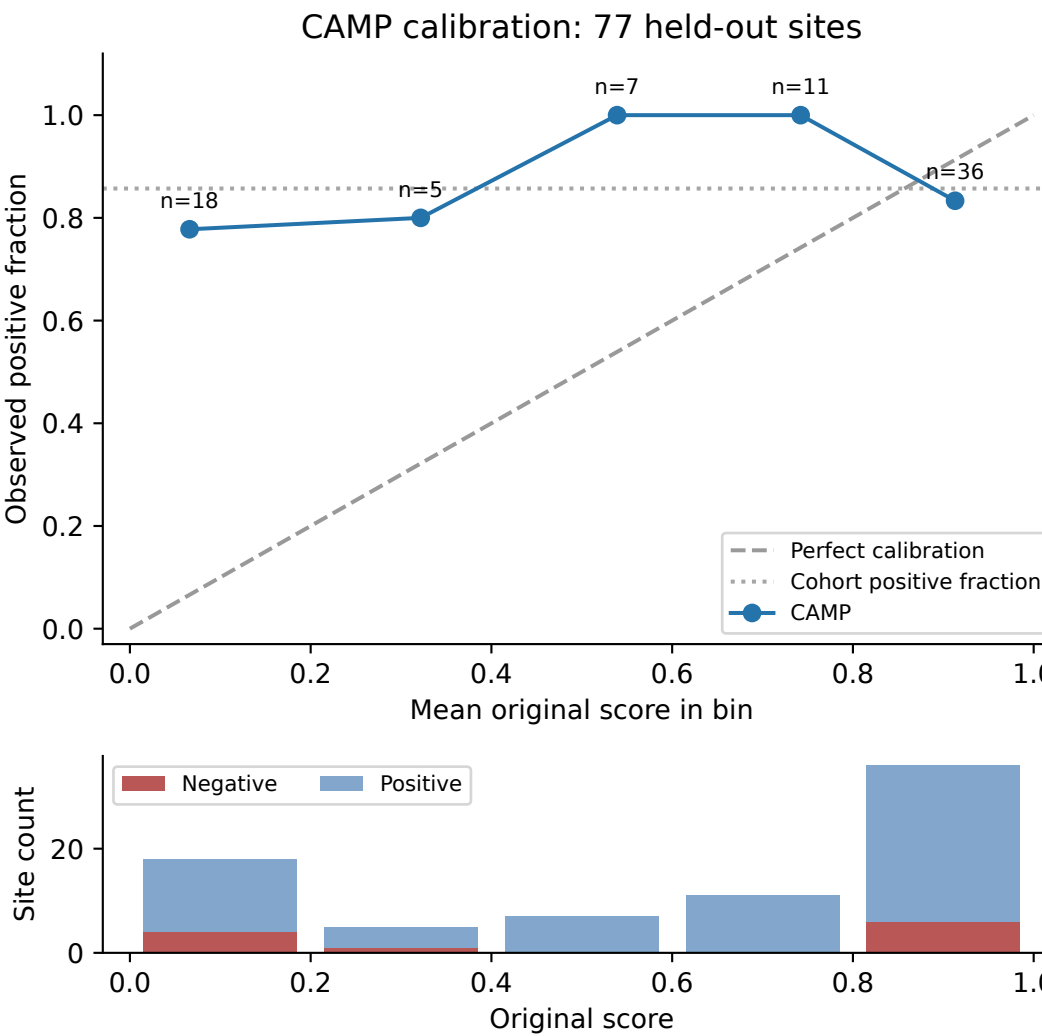

Five fixed bins; no refitting. Calibration in this selected cohort is not proteome calibration.