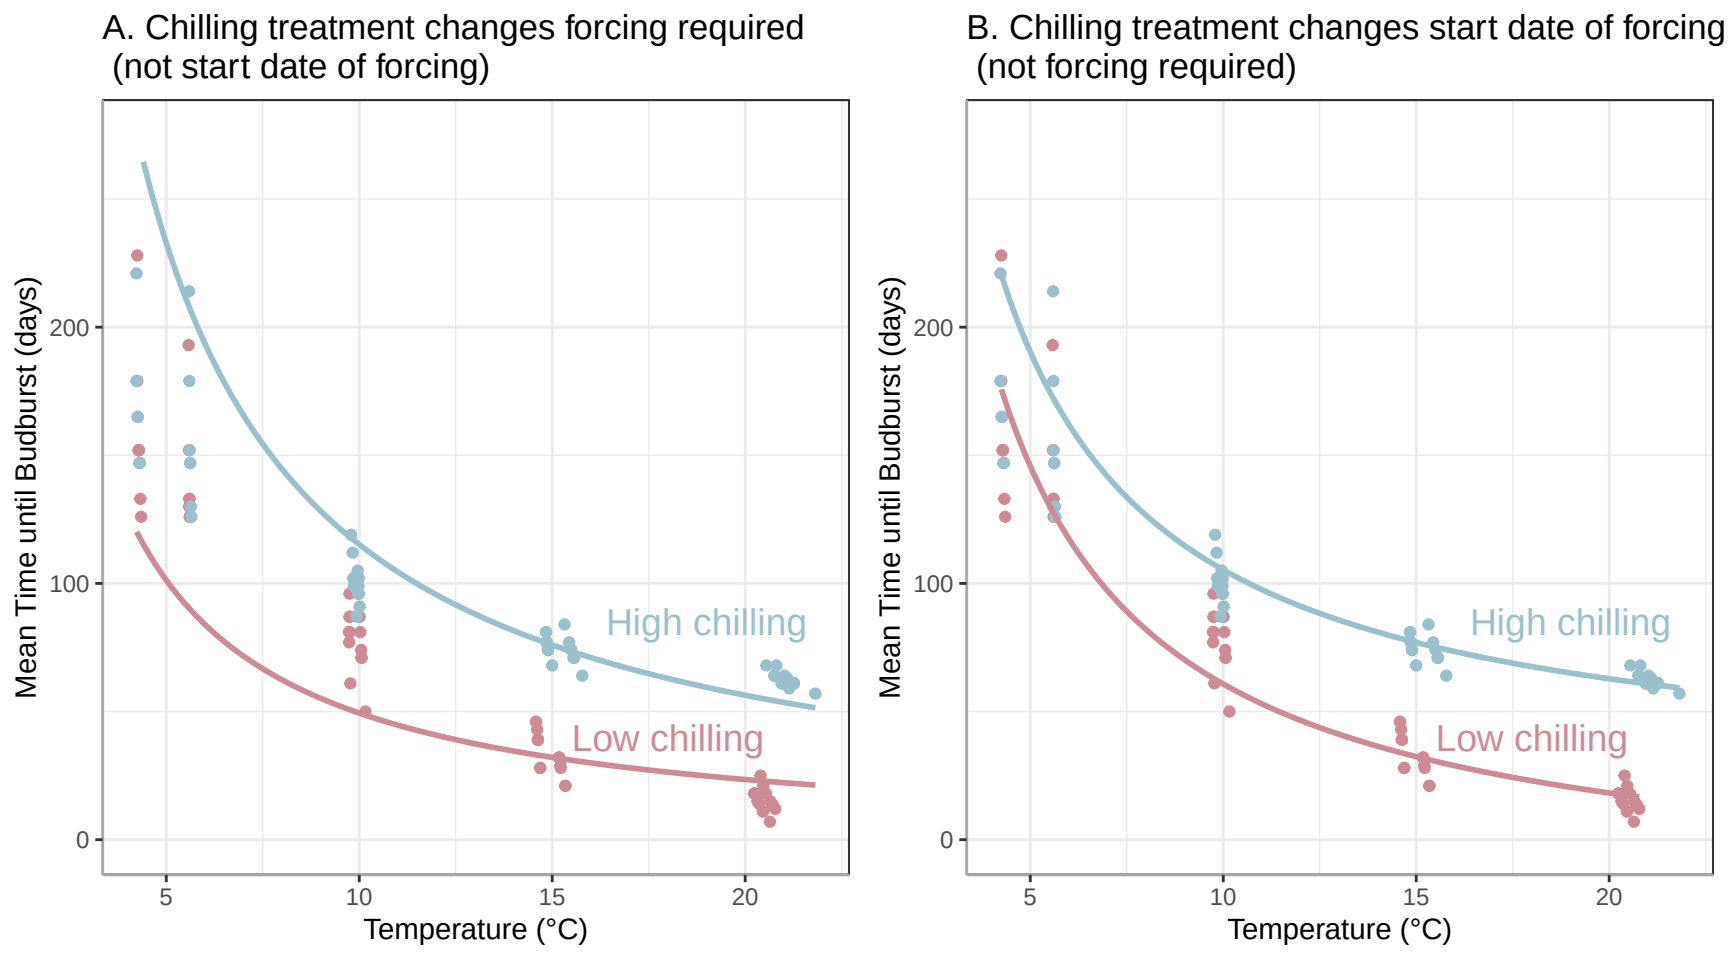
A. Chilling treatment changes forcing required
(not start date of forcing)
B. Chilling treatment changes start date of forcing
(not forcing required)
Mean Time until Budburst (days)
0
100
200
5
10
15
20
Temperature (°C)
High chilling
Low chilling