


Fourth order low pass filter

Date/Time run: 04/13/13 21:50:41

Temperature: 27.0

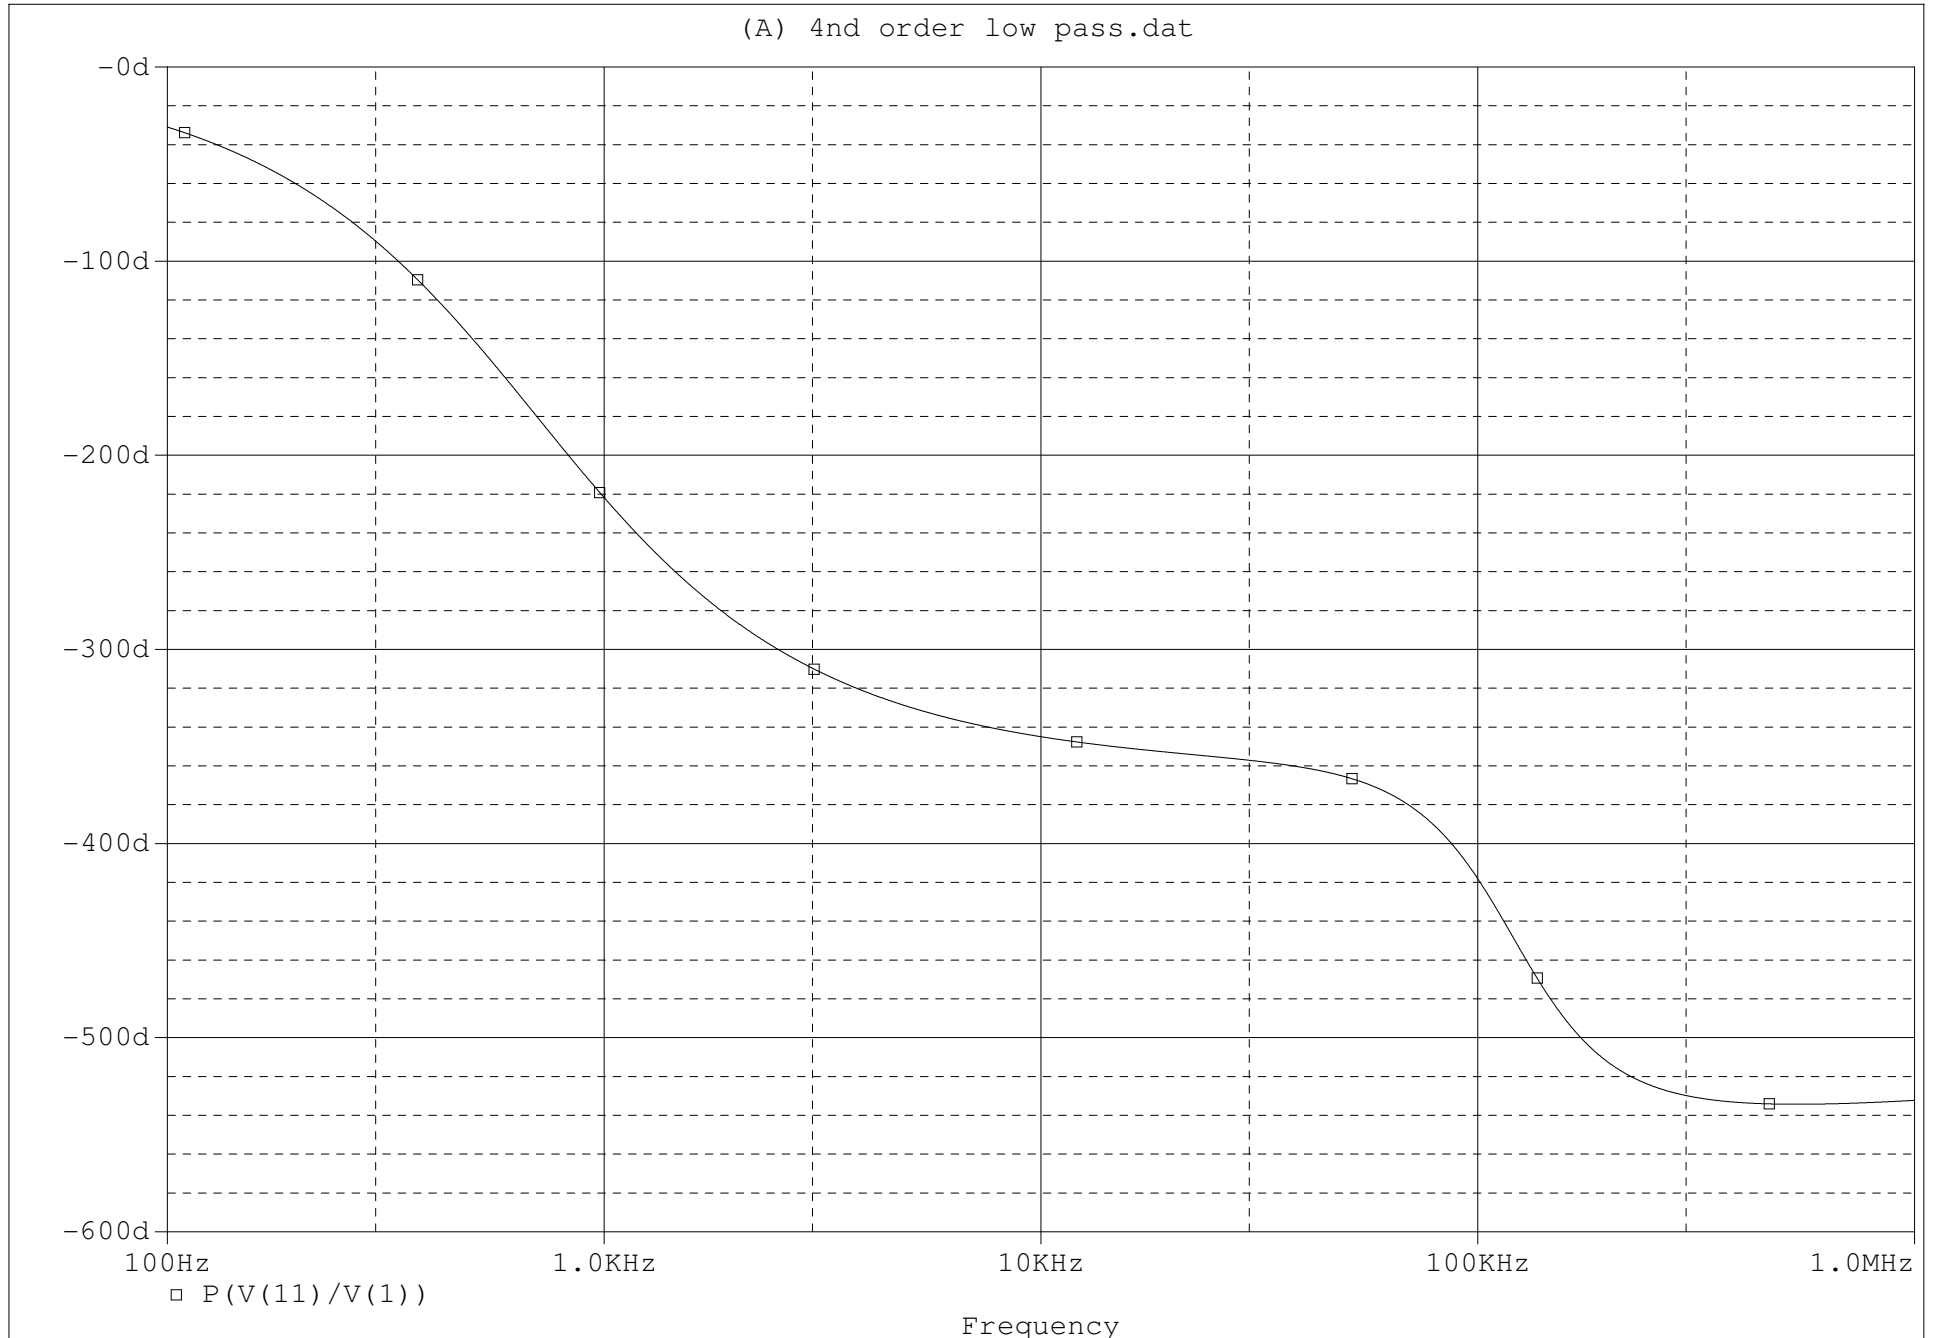


4th order high pass filter


Date/Time run: 04/13/13 21:52:38

Temperature: 27.0

(B) 4nd order high pass.dat (active)

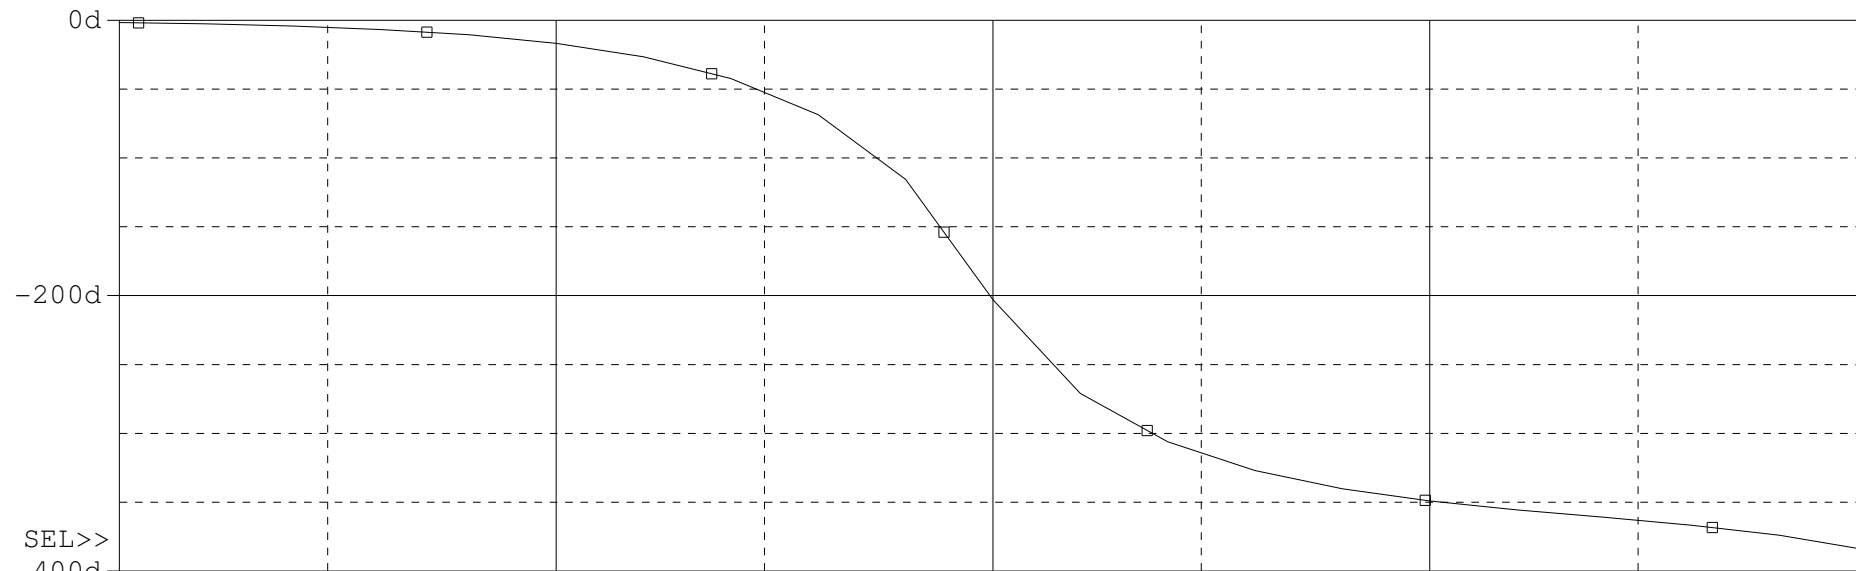

□ P(V(11)/ V(1))

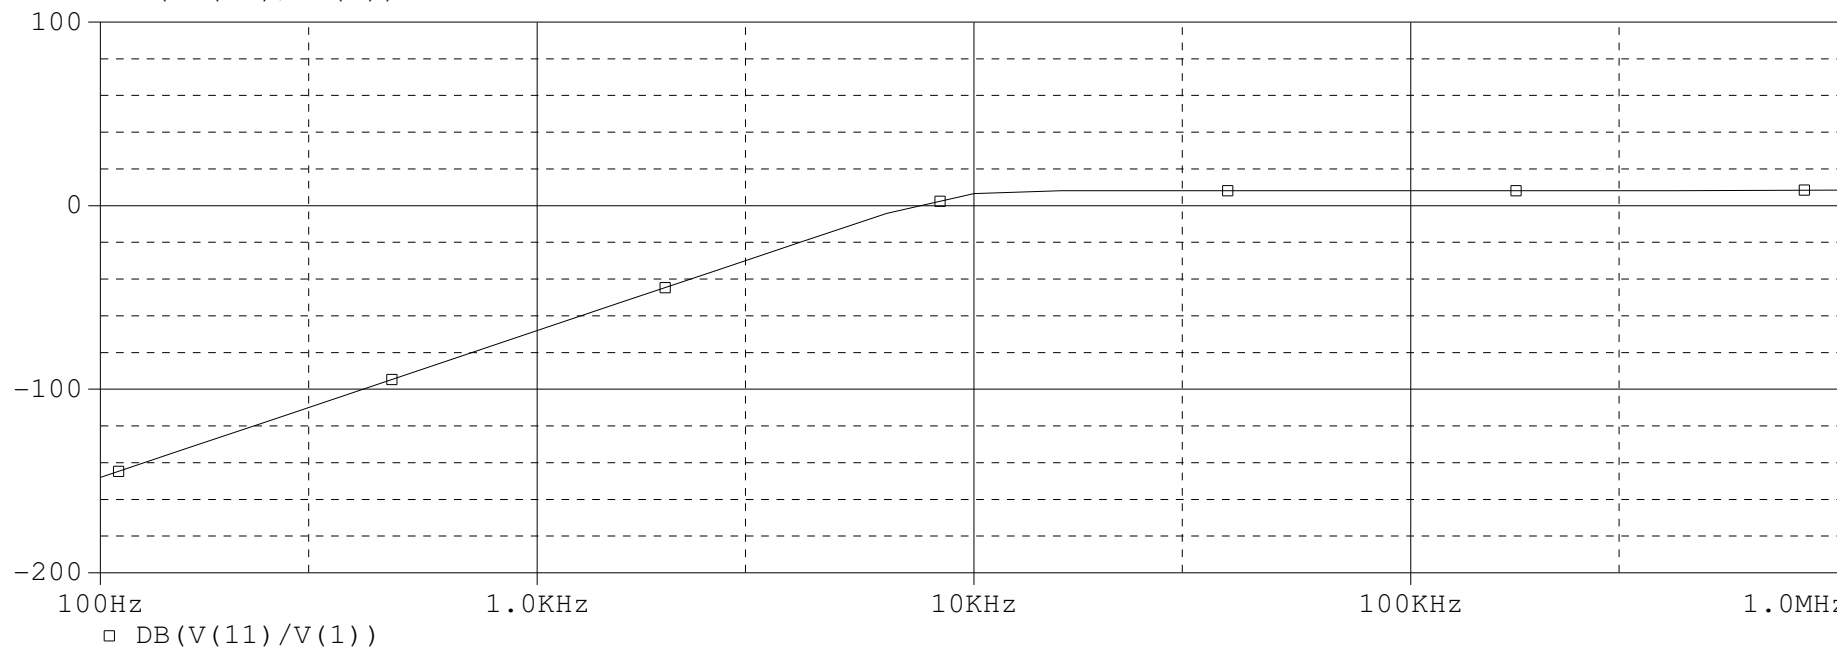

□ DB(V(11)/V(1))

Frequency