
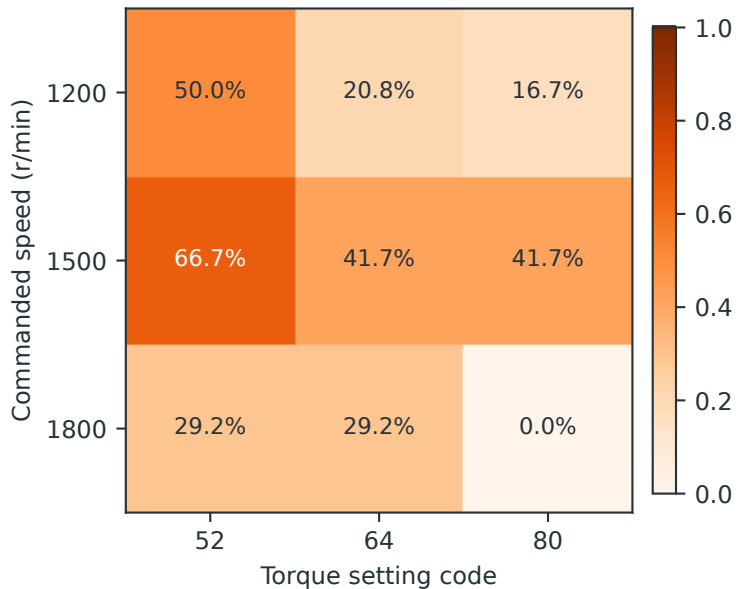


The frozen detector confused operating condition with health

(a) Fault-record detection

(b) Pre-fault session FAR

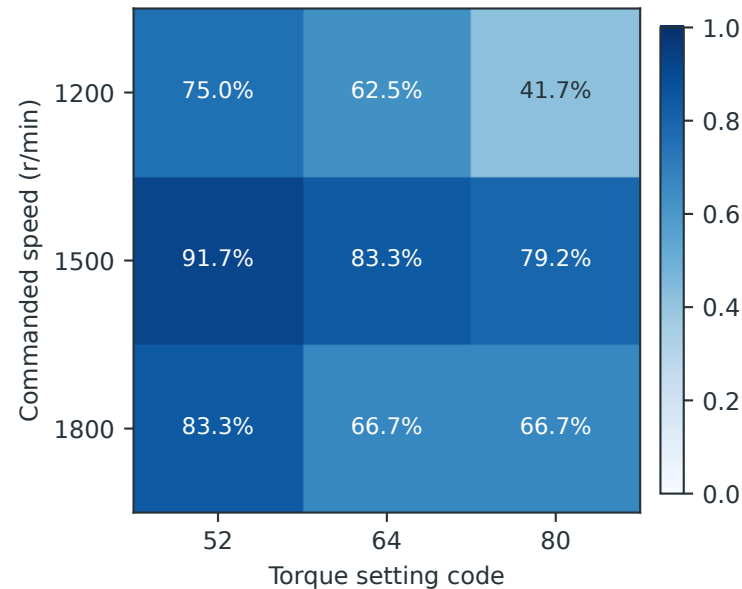

Independent PMSG confirmation; 24 sessions per cell. Torque values are dataset setting codes, not verified N m.