


Proposed fault-record detection across turn-phase conditions and load

Each cell is the fraction of eight ordered 3 s macroblocks alarmed within one dual-three-phase fault record.

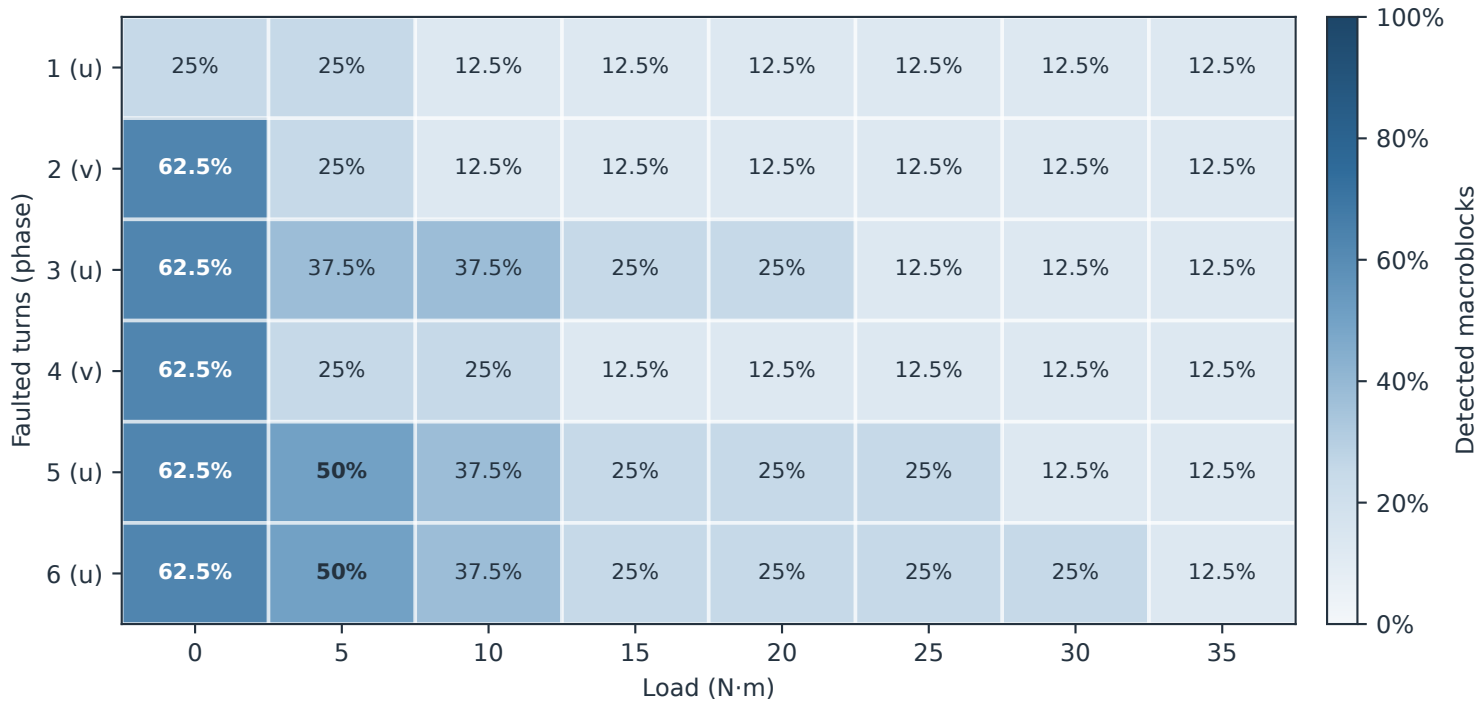

12.5% = 1/8 blocks. Phase is fixed by turn count (U: 1, 3, 5, 6; V: 2, 4), so turn and phase effects are not separable. Blocks within a record are ordered operating points, not independent repetitions.