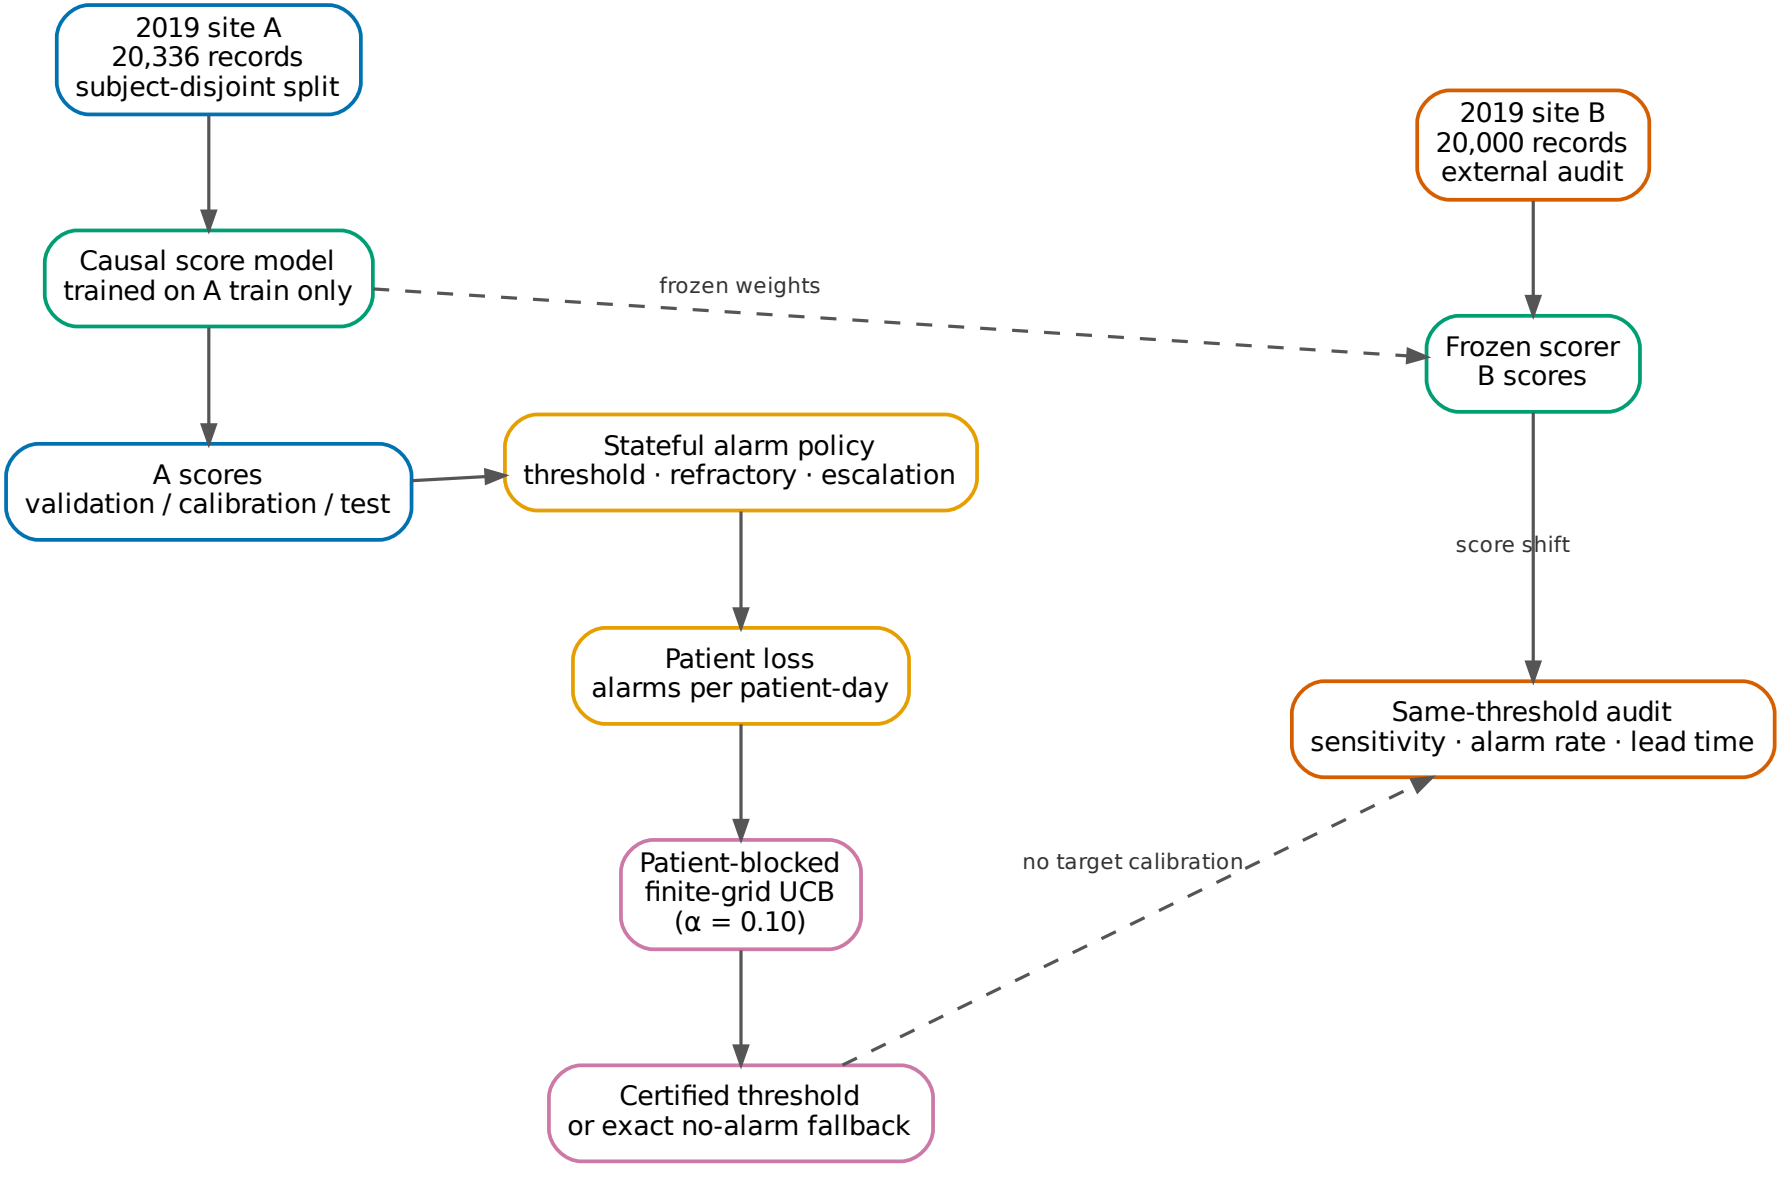
2019 site A
20,336 records
subject-disjoint split
Causal score model
trained on A train only
A scores
validation / calibration / test
Stateful alarm policy
threshold · refractory · escalation
Patient loss
alarms per patient-day
Patient-blocked
finite-grid UCB
(α = 0.10)
Certified threshold
or exact no-alarm fallback
frozen weights
2019 site B
20,000 records
external audit
Frozen scorer
B scores
score shift
Same-threshold audit
sensitivity · alarm rate · lead time
no target calibration