Harbor Water Pilot

Synthetic evidence packet. All entities and numbers are fictional.

Trial results

The fictional Harbor water pilot compared the Cedar and Birch treatment systems over 30 days. Cedar delivered 1200 liters per day; Birch delivered 900 liters per day. Both met the drinking-water quality target. Cedar used 6 kWh per day and Birch used 3 kWh per day. Figures refer to the same operating conditions, not annual forecasts.

Maintenance and limitations

Cedar requires filter inspection every 7 days; Birch requires it every 14 days. The pilot measured no winter performance. Neither system has established annual reliability from this short pilot. Do not treat a 30-day result as an annual guarantee.

Figure 1: Treatment routing
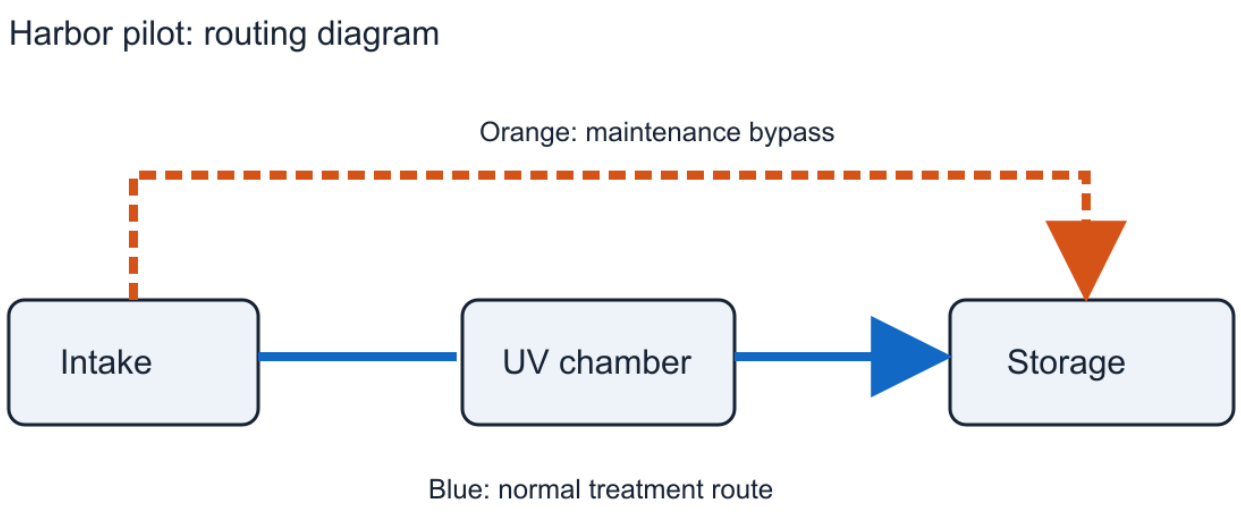
The diagram below records normal and maintenance routes. Inspect its arrows and component labels to explain the bypass.