

Manual. The proposal is assessed on merits and where appropriate, referred by Council to the relevant Government department for an access licence.

- (h) Applications for roof water and stormwater harvesting and reuse and grey water or black water treatment systems will be assessed on merit in accordance with the WM Technical Manual.
- (i) Methods of disposal of stormwater from the site must be provided using one or a combination of the following:
 - (i) Infiltration;
 - (ii) Gravity connection to Council's stormwater system;
 - (iii) Charged system; and / or
 - (iv) Pump system.

Note: A stormwater system must be constructed in accordance with *AS/NZS 3500.3:2021 Plumbing and drainage*

- (j) Depending on the extent of disturbed area, the following plans to manage erosion and sedimentation must be submitted with the development application:
 - (i) For areas of disturbance less than 250m², a marked up plan of proposed works and control measures is required;
 - (ii) For disturbed areas between 250m² and 2,500m², an erosion and sediment control plan is required; and
 - (iii) For disturbed areas greater than 2,500m² soil and water management plan is required.

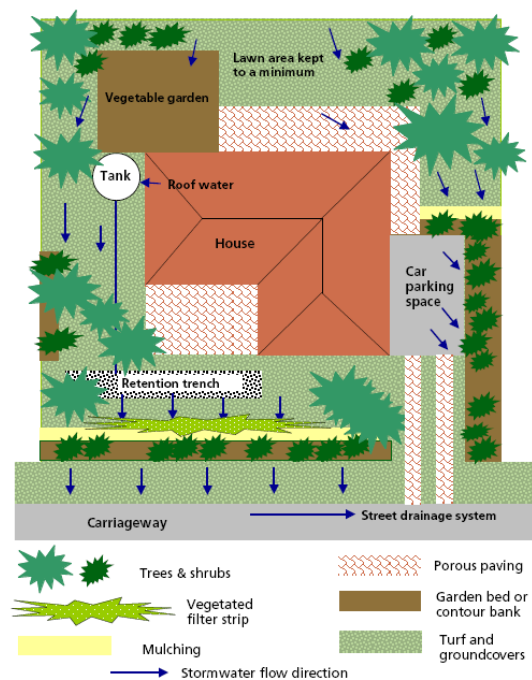


Figure 1 Example of an integrated stormwater strategy for a dwelling

5.2 FLOOD PLANNING