



**A Residual diagnostics per measurement (sum / n, n = 10/(Delta/tau); bars = 95% bootstrap CI)**

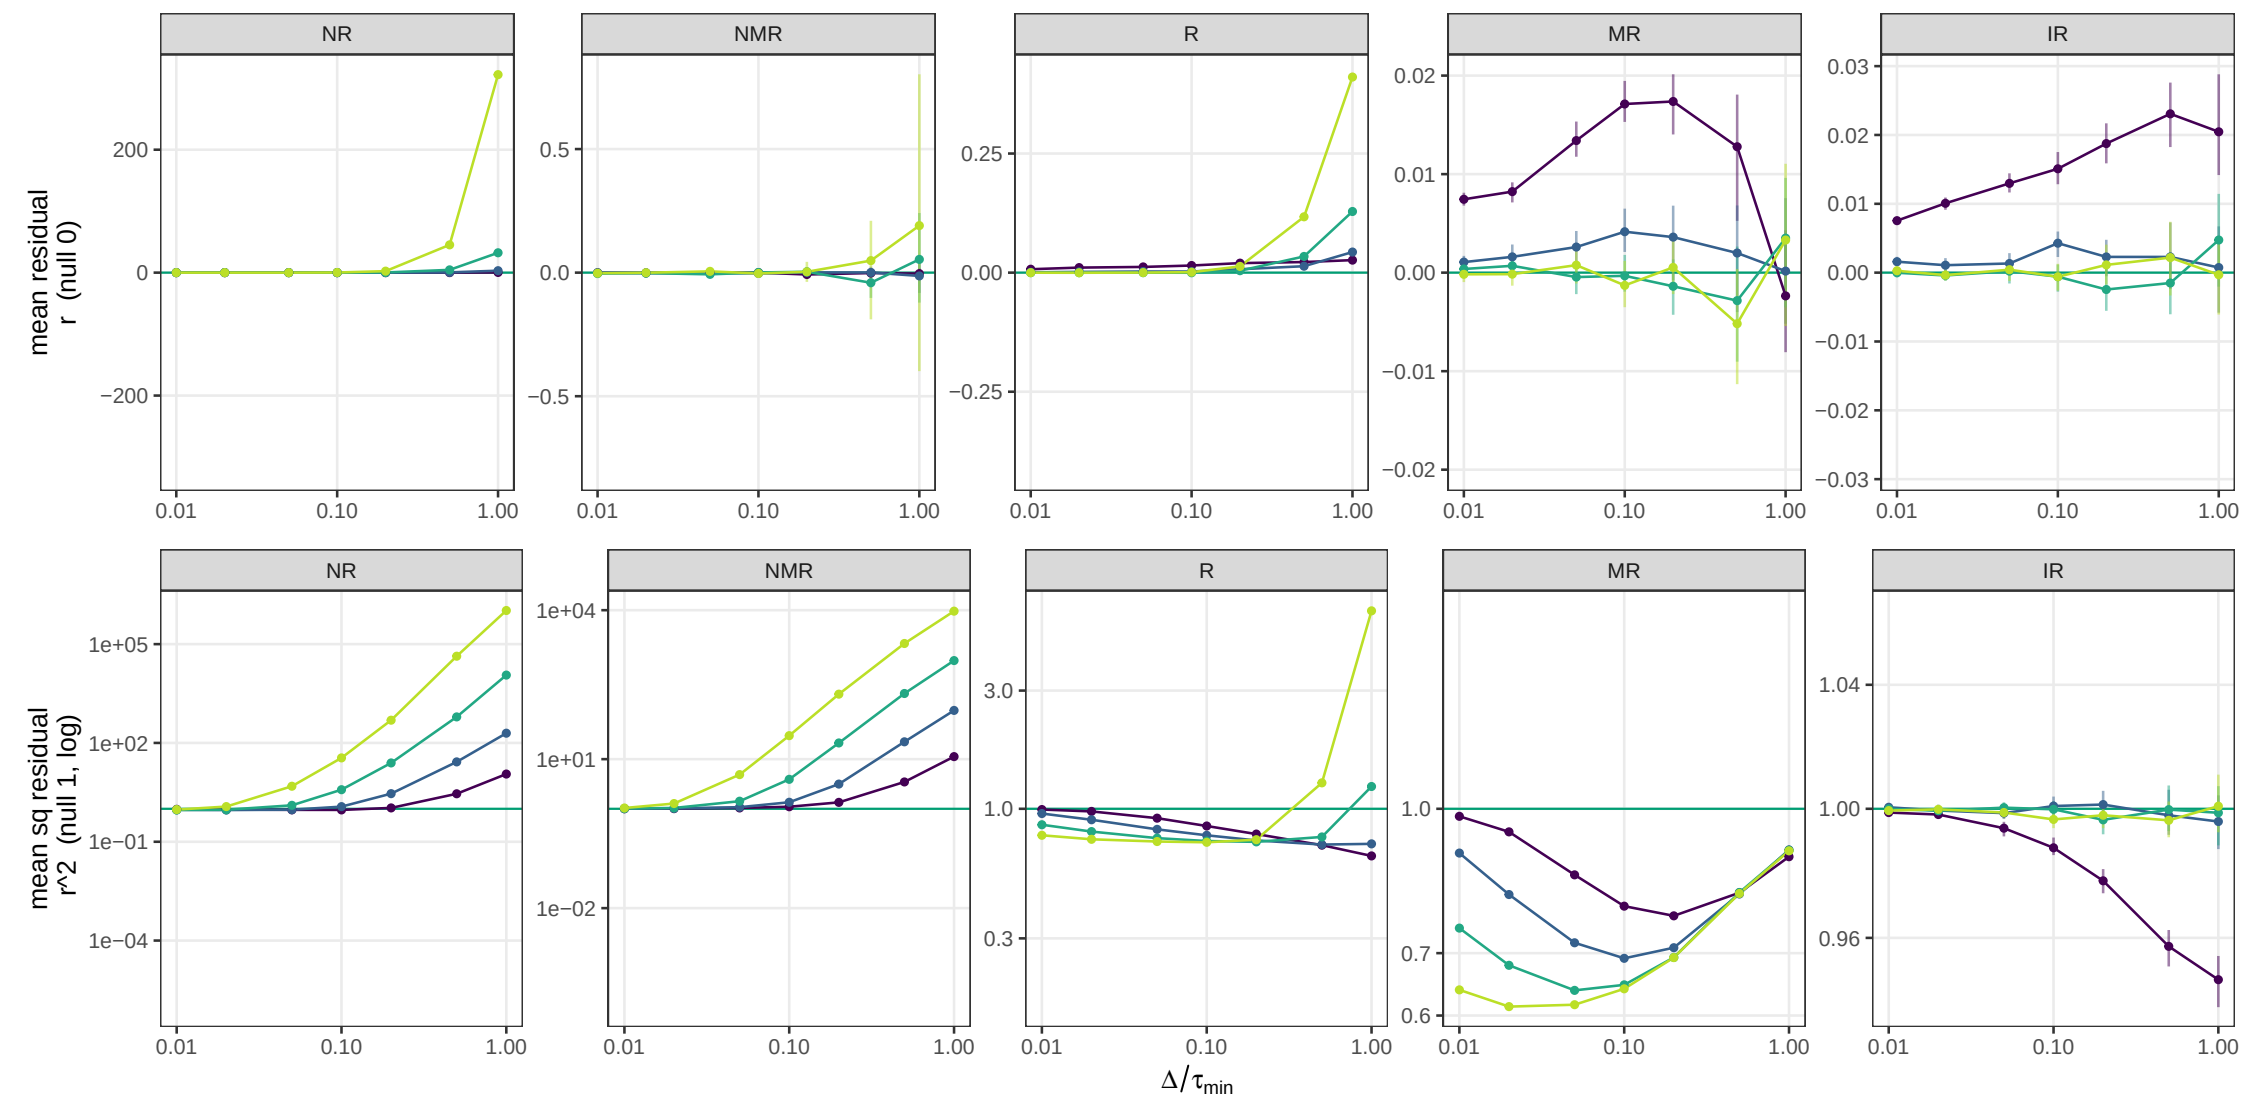


**B Expected score ~ 0 at the true parameters (standardized)**

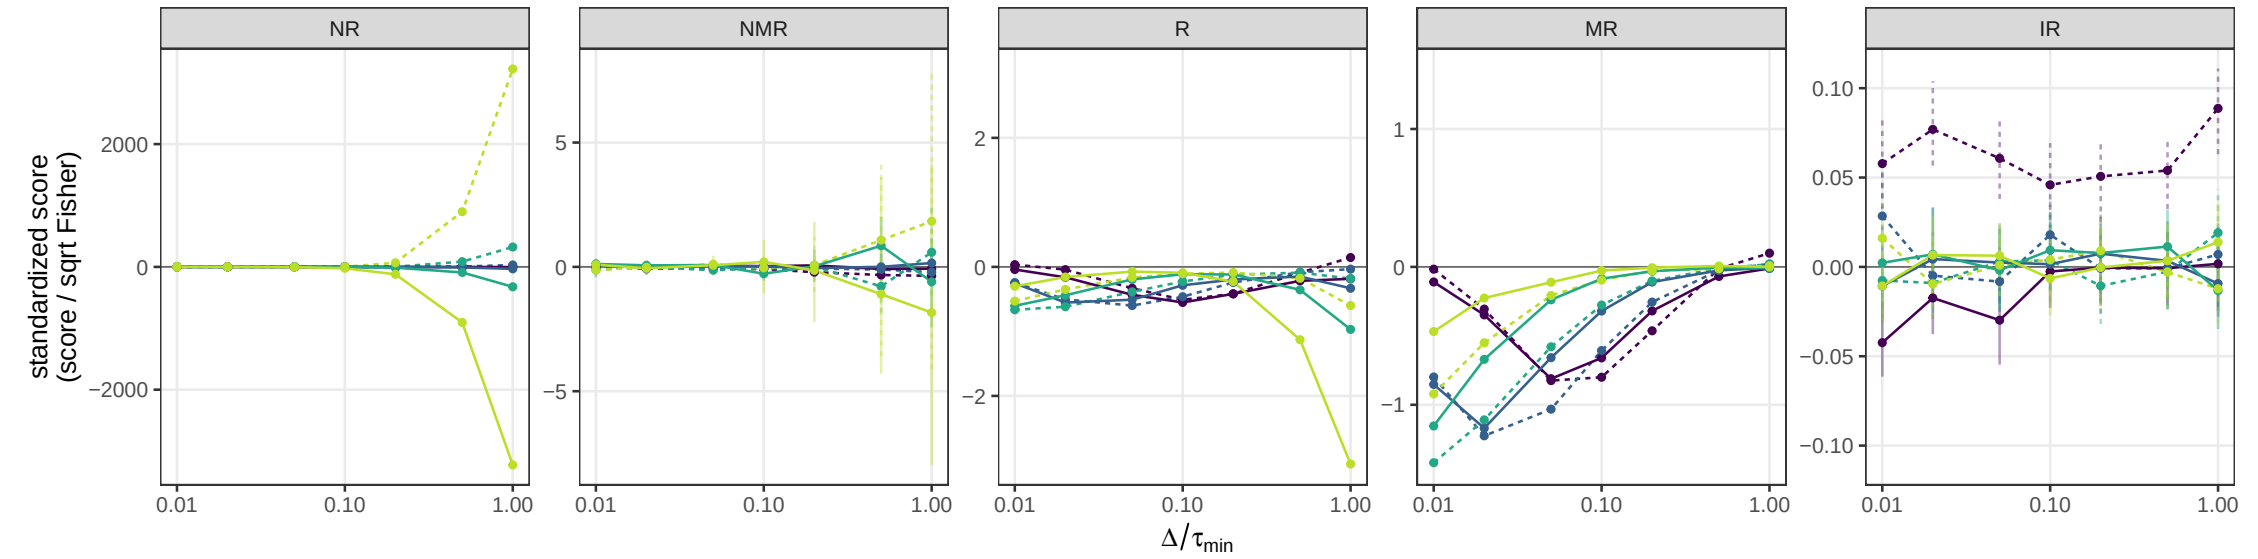

**C Measured bias (points, 68%/95% bootstrap CI) vs predicted DIB (dashed)**

one panel per algorithm; measured keeps every  $N_{\text{ch}}$ ; DIB shown only where the numerical FD-Fisher is well-conditioned

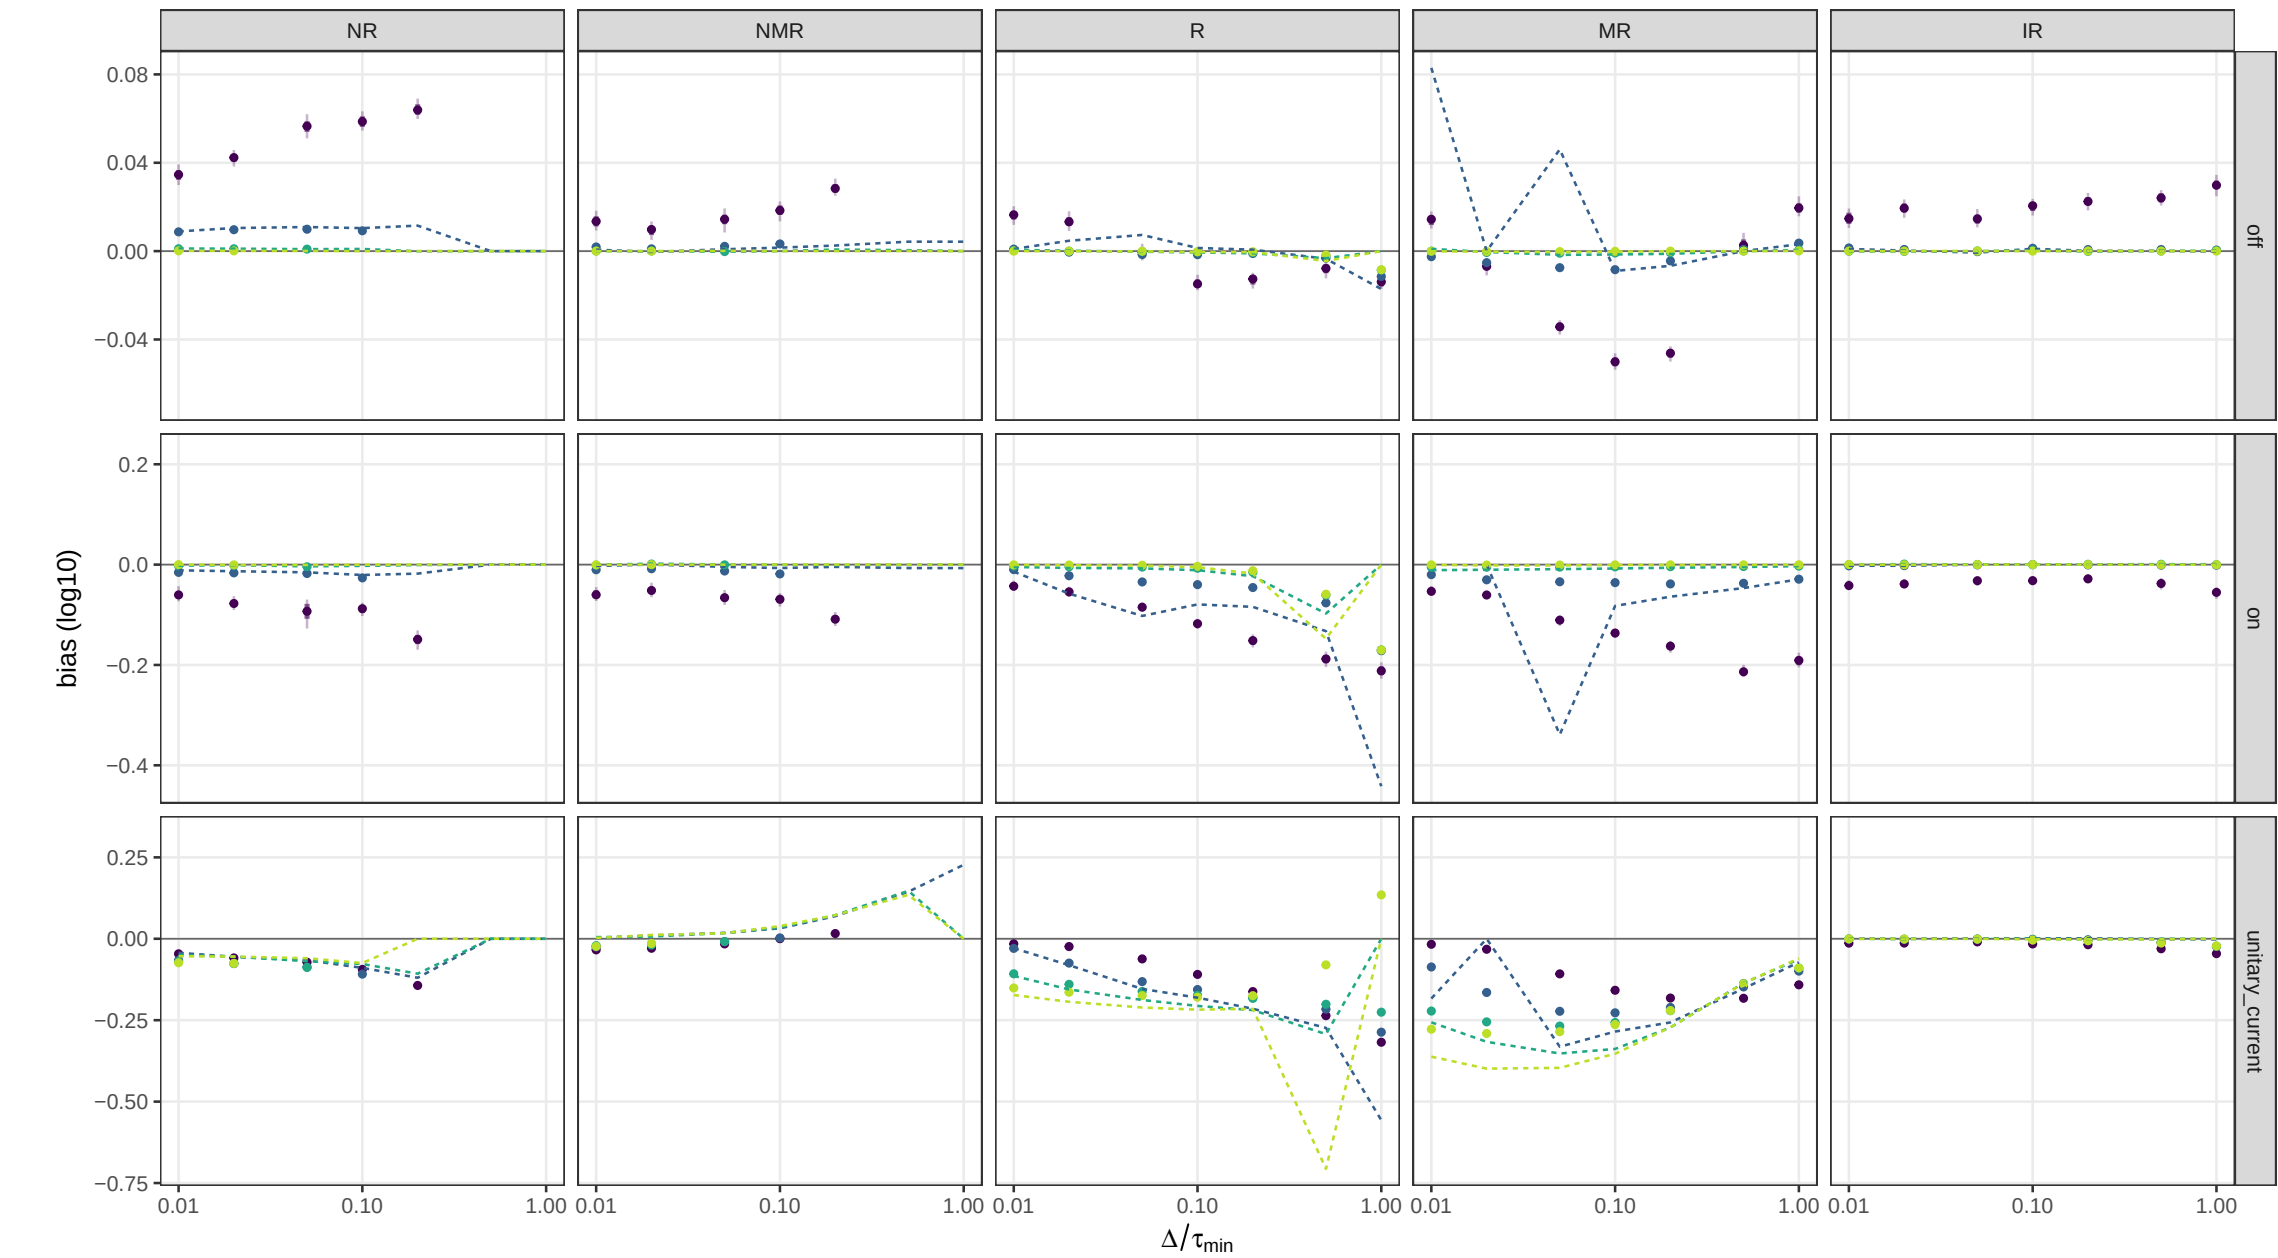

$N_{\text{ch}}$  10 100 1000 10000 -- off + on  $N_{\text{ch}}$  10 100 1000 10000  $N_{\text{ch}}$  10 100 1000 10000