

Description of C6 controller Modbus

This manual is compatible with C6 controller firmware version X.X.X.6 and above (X - does not matter).

C6 controller supports **Modbus RTU** and **Modbus TCP** protocols. Both protocols are using main commands to read and preset registers. Supported Modbus commands are presented in Table 1.

Table 1. Supported Modbus commands

Function code	Description
03	Read Holding Registers
06	Preset Single Register
16	Preset Multiple Registers

Modbus RTU protocol works via RS-485 interface. Default interface settings are presented in Table 2. Default interface settings and Modbus RTU protocol ID can be changed using the website. To change settings, connect air handling unit (AHU) to your network. Default AHU IP address is 192.168.0.60. Go to your browser and type default AHU IP address. You should see „Login“ window (Fig. 1). To login type username and password. Default username: „user“ and password: „user“.

Table 2. Default settings of RS485 interface

Baudrate	19200
Word length	8
Parity	EVEN
Stop bits	1

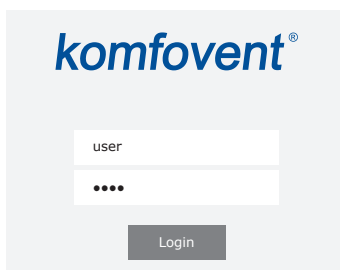


Fig. 1. Website login window

To find RS-485 interface settings and Modbus RTU protocol ID go to „SETTINGS“ and „CONNECTIVITY“ (Fig. 2). If you logged in, but can't open „SETTINGS“ window make sure, that JavaScript in your web browser is enabled (activated).

Fig. 2. Connectivity settings

If you can't see „Login“ window, make sure that:


- your device and air handling unit are connected in the same network;
- your device and air handling unit are in the same subnet;
- your proxy server and firewall isn't blocking connection;
- you typed correct IP address.

If your device is connected directly to C6 controller, make sure, that you DHCP server is disabled and your static IP is in same subnet. If you are using PC and Windows operating system, go to „Local Area Connection Properties“, go to „Internet Protocol Version 4 (TCP/IPv4) Properties“ (Fig. 3), check „Use the following IP address“ and type your static parameters, for example:

- IP address: 192.168.0.61;
- Subnet Mask: 255.255.255.0;
- Default gateway: 192.168.0.1.

Fig. 3. Personal computer static IP address configuration

The air handling unit has external connection terminals in the control box, inside the air handling unit. Modbus A and B communication wires can be connected to 1 and 2 terminals of connection for external elements (Fig. 4, Fig. 5). To connect devices use twisted pair cable. Maximum cable length is 150 m. C6 controller ground point (any GND terminal from connection too external elements – 4, 7, 10, 29, 32, 35, 38) and other device should be connected together, if distance between the RS-485 interfaces is more than 10 m. (Fig. 4, Fig. 5).

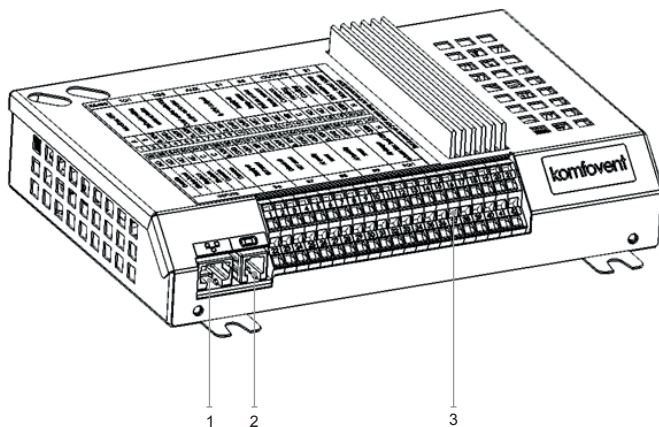

1. Ethernet connection of computer network or Internet
2. Controller panel connection
3. Connection of external elements

Fig. 4. Controller with the connection terminals

RS485		TG1		DX		AUX		B1		B5		OUTPUTS		S1	
Modbus RTU		Water mixing valve actuator		External DX unit		24V DC; 0-10V output		Supply air temp. sensor		Return water temp. sensor		Common Heating Cooling Alarm		Water pump Max. load 100W	
A	B	0..10V	GND	+24V	0..10V	GND	+24V	NTC	10k	NTC	10k	C	NO	NO	N
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37
NO	NO	NO	NC	C	C	0..10V	GND	+24V	0..10V	GND	+24V	0..10V	GND	+24V	0..10V
Override	Kitchen hood	Fireplace	Fire alarm	Common	Common	Supply air VAV sensor	Exhaust air VAV sensor	Air quality or humidity sensor 1	Air quality or humidity sensor 2	Air damper actuator	Max. load 15W				
INPUTS						B6	B7	B8	B9	FG1					

Fig. 5. Connection diagram for external elements

Modbus TCP protocol works via Ethernet interface, connection is provided to RJ-45 socket on the C6 controller (Fig. 4). Default IP address is 192.168.0.60, and port is 502. To connect C6 controller via Modbus TCP make sure, that proxy servers or firewall isn't blocking device destination IP address and 502 port is opened. Controller IP address can be changed using the website (Fig. 2). Instructions how to connect and login to website was presented at Modbus RTU section. IP address and subnet mask also can be changed using C6.1 touch panel. To find these settings click touch C6.1 panel screen, click „Menu“ button, click „Settings“ button and don't release it, for more than 5 seconds, after that „Advanced settings“ window will pop-up. Click „Connectivity“ button and here you will find IP address and subnet mask (Fig. 6). If you want to change one of these parameters, just click on it and edit.

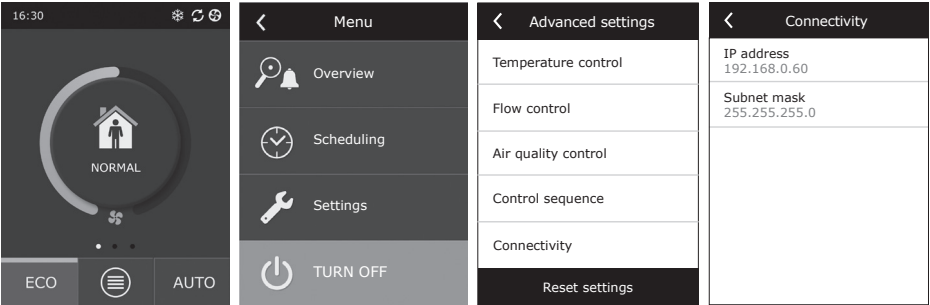


Fig. 6. C6.1 touch panel connectivity settings

For connection the CAT5 category cable should be used. The maximum cable length between device and controller C6 is 100 m.

C6 controller Modbus registers with descriptions are presented in Table 3.

Table 3

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Main control	Modes	1	ON/OFF status	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		2	Auto mode control	RO	unsigned char	0 - 1	Scheduling = 0, Air Quality = 1	
		3	ECO mode	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		4	AUTO mode	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		5	Current mode	R/W	unsigned char	0 - 10	READ ONLY: Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4, Kitchen = 5, Fireplace = 6, Override = 7, Holiday = 8, Air quality = 9, Off = 10 WRITE ONLY: Away = 1, Normal = 2, Intensive = 3, Boost = 4	
		6	Scheduler operation mode	R/W	unsigned char	0 - 3	StayAtHome = 0, WorkingWeek = 1, Office = 2, Custom = 3	
		7	Next mode	RO	unsigned char	0 - 8	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4, Kitchen = 5, Fireplace = 6, Override = 7, Holidays = 8	
		8	Next mode start time	RO	unsigned short	0 - 1439	Minutes	(0 - 1439 => 0:00 - 23:59); 130 => 2:10
		9	Next mode weekday	RO	unsigned char	0 - 7	Week days: None = 0, Mo = 1, Tu = 2, We = 3, Th = 4, Fr = 5, Sa = 6, Su = 7	
		10	Before been mode mask	RO	Unsigned char	0 - 31	Standby => 0, Away => 1 bit, Normal => 2 bit, Intensive => 3 bit, Boost => 4 bit	
	Temperature and flow control	11	Temperature control	R/W	unsigned char	0 - 3	Supply = 0, Extract = 1, Balance = 2, Room = 3	
		12	Flow control	R/W	unsigned char	0 - 2	CAV = 0, VAV = 1, DCV = 2	
		13-14	Maximum supply flow	RO	unsigned int	0 - 200000	m3/h, l/s	
		15-16	Maximum extract flow	RO	unsigned int	0 - 200000	m3/h, l/s	
		17	Max supply pressure	R/W	unsigned short	0 - 1000	Pa	
		18	Max extract pressure	R/W	unsigned short	0 - 1000	Pa	

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Main control	Control sequence	19	Stage 1	R/W	unsigned char	0 - 3	None = 0, External coil = 1, Electric heater = 2, External Dx unit = 3 ,	
		20	Stage 2	R/W	unsigned char	0 - 3	None = 0, External coil = 1, Electric heater = 2, External Dx unit = 3 ,	
		21	Stage 3	R/W	unsigned char	0 - 3	None = 0, External coil = 1, Electric heater = 2, External Dx unit = 3 ,	
		22	Coil type	R/W	unsigned char	0 - 1	Hot water = 0, Cold water = 1, Combi = 2,	
	Connectivity	23-24	IP	R/W	unsigned int		default 192.168.0.60	
		25-26	Mask	R/W	unsigned int		default 255.255.255.0	
	Settings	27	Language	R/W	unsigned char	0-255	English = 0, Lithuanian = 1, Russian = 2, ...	
		28	Flow units	R/W	unsigned char	0 - 1	m ³ /h = 0, l/s = 1	
	Time and date	29	Time, HH:MM	R/W	unsigned short	MSB 0x00 - 0x17, LSB 0x00 - 0x3B	MSB - hours, LSB - minutes	0x0B36 => 11:54
		30	Year	R/W	unsigned short	2017 - 2035	Year	0x07E0 => 2016
		31	Month/Day	R/W	unsigned short	MSB 0x01 - 0x0C, LSB 0x01 - 0x1F	MSB - month, LSB - day	0x020C => Feb12
		32	Week day	RO	unsigned char	1 - 7	Mo = 1, Tu = 2, We = 3, Th = 4, Fr = 5, Sa = 6, Su = 7	
		33-34	Time since 1970	RO	unsigned int	1483228800 - 2051222400	based on seconds since standard epoch of 1/1/1970	1456329600 => 2016.02.24 16:00:00
Mode settings	Away	100-101	Supply flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		102-103	Extract flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		104	Setpoint	R/W	signed short	50 - 400	x10 C	
		105	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
	Normal	106-107	Supply flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		108-109	Extract flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		110	Setpoint	R/W	signed short	50 - 400	x10 C	
		111	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
	Intensive	112-113	Supply flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		114-115	Extract flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		116	Setpoint	R/W	signed short	50 - 400	x10 C	
		117	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
	Boost	118-119	Supply flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		120-121	Extract flow	R/W	unsigned int	0 - 200000	m ³ /h, l/s, Pa	
		122	Setpoint	R/W	signed short	50 - 400	x10 C	
		123	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Mode settings	Kitchen	124-125	Supply flow	R/W	unsigned int	0 - 200000	m3/h, l/s	
		126-127	Extract flow	R/W	unsigned int	0 - 200000	m3/h, l/s	
		128	Setpoint	R/W	signed short	50 - 400	x10 C	
		129	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		130	Timer time	R/W	unsigned short	0 - 300	Minutes	
	Fireplace	131-132	Supply flow	R/W	unsigned int	0 - 200000	m3/h, l/s	
		133-134	Extract flow	R/W	unsigned int	0 - 200000	m3/h, l/s	
		135	Setpoint	R/W	signed short	50 - 400	x10 C	
		136	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
	Override	137	Timer time	R/W	unsigned short	0 - 300	Minutes	
		138-139	Supply flow	R/W	unsigned int	0 - 200000	m3/h, l/s	
		140-141	Extract flow	R/W	unsigned int	0 - 200000	m3/h, l/s	
		142	Setpoint	R/W	signed short	50 - 400	x10 C	
		143	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		144	Mode	R/W	unsigned char	0 - 2	All time = 0, If on = 1, If off = 2	
	Holidays	145	Timer time	R/W	unsigned short	0 - 300	Minutes	
		146	Microventilation	R/W	unsigned char	1 - 4	Once per day = 1, Twice per day = 2, Thrice per day = 3, Four times per day = 4,	
		147	Setpoint	R/W	signed short	50 - 400	x10 C	
		148	Heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		149-150	From Day/Month	R/W	unsigned int	1483228800 - 2051222400	based on seconds since standard epoch of 1/1/1970	1456329600 => 2016.02.24 16:00:00
		151-152	Till Day/Month	R/W	unsigned int	1483228800 - 2051222400	based on seconds since standard epoch of 1/1/1970	1456329600 => 2016.02.24 16:00:00
		153	Year, from	R/W	unsigned short	2017 - 2035		
		154	Month/Day, from	R/W	unsigned short	MSB 0x01 - 0x0C, LSB 0x01 - 0x1F	MSB = month, LSB = day	0x020C => Feb12
		155	Year, till	R/W	unsigned short	2017 - 2035		
		156	Month/Day, till	R/W	unsigned short	MSB 0x01 - 0x0C, LSB 0x01 - 0x1F	MSB = month, LSB = day	0x020C => Feb12
Eco	Eco	200	Minimum supply air temperature	R/W	unsigned short	50 - 400	x10 C	
		201	Maximum supply air temperature	R/W	unsigned short	50 - 400	x10 C	
		202	Free heating/cooling	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		203	Heating enable denied	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		204	Cooling enable denied	R/W	unsigned char	0 - 1	Off = 0, On = 1	
Air quality	Air quality	205	Air quality Enable	R/W	unsigned char	0 - 1	Disabled = 0, Enabled = 1	
		206	Temperature setpoint	R/W	signed short	50 - 400	x10 C	
		207	Air quality setpoint	R/W	unsigned short	C02: 0 - 2000, VOC: 0 - 100,	ppm, %	
		208	Humidity setpoint	R/W	unsigned short	RH: 0 - 100,	%	
		209	Air quality minimum intensity	R/W	unsigned char	0, 20 - 100	%	
		210	Air quality maximum intensity	R/W	unsigned char	0, 20 - 100	%	
		211	Air quality heating	R/W	unsigned char	0 - 1	Off = 0, On = 1	
		212	Air quality check period	R/W	unsigned char	1 - 24	Hours	

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Air quality	Air quality	213	Air quality sensor type B8	R/W	unsigned char	0 - 3	None = 0, CO2 = 1, VOC = 2, RH = 3	
		214	Air quality sensor type B9	R/W	unsigned char	0 - 3	None = 0, CO2 = 1, VOC = 2, RH = 3	
Scheduler	Stay at home	Weekday mask	300 Weekday mask	R/W	unsigned char	0b00000000 - 0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit	
		Event 1	301 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4	
			302 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			303 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 2	304 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4	
			305 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			306 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 3	307 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4	
			308 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			309 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 4	310 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4	
			311 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			312 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 5	313 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4	
			314 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			315 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Weekday mask	316 Weekday mask	R/W	unsigned char	0b00000000 - 0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit	
		Event 1	317 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4	
			318 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			319 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Scheduler	Stay at home	Event 2	320 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			321 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			322 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 3	323 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			324 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			325 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 4	326 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			327 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			328 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 5	329 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			330 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			331 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Weekday mask	332 Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit	
		Event 1	333 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			334 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			335 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
	Operation program 3	Event 2	336 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			337 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			338 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 3	339 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			340 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			341 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 4	342 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			343 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			344 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments		
				Access	Type	Range				
Scheduler	Stay at home	Operation program 3	Event 5	345	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				346	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
				347	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
		Operation program 4	Weekday mask	348	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit	
				Event 1	349	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4
					350	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes
			351		Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			Event 2	352	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				353	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
				354	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			Event 3	355	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				356	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
				357	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			Event 4	358	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				359	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
				360	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
	Event 5	361	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4			
		362	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
		363	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
	Working week	Operation program 1	Weekday mask	364	Weekday mask	R/W	unsigned char	0b00000000 - 0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit	
				Event 1	365	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4
			366		Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			367		Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments		
				Access	Type	Range				
Scheduler	Working week	Operation program 1								
		Event 2	368	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			369	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			370	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Event 3	371	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			372	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			373	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Event 4	374	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			375	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			376	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Event 5	377	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			378	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			379	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Operation program 2	Weekday mask	380	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit	
				Event 1	381	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4
					382	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes
			383		Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			Event 2	384	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				385	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				386	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			Event 3	387	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				388	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				389	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			Event 4	390	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				391	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				392	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments			
				Access	Type	Range					
Scheduler	Working week	Operation program 2		Event 5	393	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
		394	Start time		R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
		395	Stop time		R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
		Operation program 3		Weekday mask	Event 1	396	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit
		397	Mode			R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
		Event 1	398	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
			399	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
			Event 2		Event 2	400	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4
		401	Start time	R/W		unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
		402	Stop time	R/W		unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05		
		Event 3	Event 3	403	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				404	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				405	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
		Event 4	Event 4	406	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				407	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				408	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
		Event 5	Event 5	409	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				410	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				411	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
		Operation program 4		Weekday mask	Event 1	412	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit
		413	Mode			R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				Event 1	414	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
					415	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Scheduler	Working week	Event 2	416 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			417 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			418 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 3	419 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			420 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			421 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 4	422 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			423 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			424 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 5	425 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			426 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			427 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
	Office	Weekday mask	428 Weekday mask	R/W	unsigned char	0b00000000 - 0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit	
		Event 1	429 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			430 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			431 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 2	432 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			433 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			434 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 3	435 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			436 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			437 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
		Event 4	438 Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			439 Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			440 Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05

Group	Subgroups		Register number	Register name	Data			Values and Units	Examples and comments		
					Access	Type	Range				
Scheduler	Office	Operation program 1	Event 5	441	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				442	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				443	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
	Office	Operation program 2	Weekday mask	444	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit		
				Event 1	445	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
					446	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			447		Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
			Event 2	448	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				449	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				450	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
			Event 3	451	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				452	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				453	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
			Event 4	454	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				455	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				456	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
			Event 5	457	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				458	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
				459	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
			Office	Operation program 3	Weekday mask	460	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit
						Event 1	461	Mode	R/W	unsigned char	0 - 4
	462	Start time			R/W		unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	
	463	Stop time			R/W		unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05	

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments		
				Access	Type	Range				
Scheduler	Office	Operation program 3								
		Event 2	464	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			465	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			466	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Event 3	467	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			468	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			469	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Event 4	470	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			471	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			472	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Event 5	473	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
			474	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			475	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
		Operation program 4	Weekday mask	476	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit	
			Event 1	477	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				478	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				479	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			Event 2	480	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				481	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				482	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			Event 3	483	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				484	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				485	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			Event 4	486	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
				487	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
				488	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05

Group	Subgroups		Register number	Register name	Data			Values and Units	Examples and comments
					Access	Type	Range		
Scheduler	Custom	Operation program 4	Event 5	489	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				490	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				491	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
		Weekday mask		492	Weekday mask	R/W	unsigned char	0b00000000 - 0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit
				493	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				494	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
		Event 1		495	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				496	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				497	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
		Event 2		498	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				499	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				500	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
		Event 3		501	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				502	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				503	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
		Event 4		504	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				505	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				506	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
		Event 5		507	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				508	Weekday mask	R/W	unsigned char	0b00000000 - 0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit
		Event 1		509	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal = 2, Intensive = 3, Boost = 4
				510	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05
				511	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes 0x0805 => 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments			
				Access	Type	Range					
Scheduler	Custom	Operation program 2									
		Event 2	512	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4			
			513	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
			514	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
		Event 3	515	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4			
			516	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
			517	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
		Event 4	518	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4			
			519	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
			520	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
		Event 5	521	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4			
			522	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
			523	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05		
		Operation program 3	Weekday mask	524	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo => 0 bit, Tu => 1 bit, We => 2 bit, Th => 3 bit, Fr => 4 bit, Sa => 5 bit, Su => 6 bit		
				Event 1	525	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
					526	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05
			527		Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			Event 2	528	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				529	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
				530	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			Event 3	531	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				532	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
				533	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
			Event 4	534	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4		
				535	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	
				536	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 => 8:05	

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments	
				Access	Type	Range			
Scheduler	Operation program 3	Event 5	537	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			538	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			539	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
	Operation program 4	Weekday mask	540	Weekday mask	R/W	unsigned char	0b00000000-0b01111111	Mo ==> 0 bit, Tu ==> 1 bit, We ==> 2 bit, Th ==> 3 bit, Fr ==> 4 bit, Sa ==> 5 bit, Su ==> 6 bit	
			Event 1	541	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4
				542	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes
		543		Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
		Event 2	544	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			545	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			546	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
		Event 3	547	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			548	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			549	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
		Event 4	550	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			551	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			552	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
		Event 5	553	Mode	R/W	unsigned char	0 - 4	Standby = 0, Away = 1, Normal =2, Intensive =3, Boost = 4	
			554	Start time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
			555	Stop time	R/W	unsigned short	0:00 - 23:59	MSB - hours, LSB - minutes	0x0805 ==> 8:05
		Alarms	Active alarms	600	Active alarms count	R/W	unsigned char	0 - 10	Writing 0x99C6 - Active alarms reset and restore previous mode
601	Active alarm 1 code (newest)			RO	unsigned char	0x01 - 0xFF	0x02 ==> 2F (MSb = 0), 0x82 ==> 2W (MSb = 1)		
602	Active alarm 2 code			RO	unsigned char	0x01 - 0xFF	0x02 ==> 2F (MSb = 0), 0x82 ==> 2W (MSb = 1)		
603	Active alarm 3 code			RO	unsigned char	0x01 - 0xFF	0x02 ==> 2F (MSb = 0), 0x82 ==> 2W (MSb = 1)		

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Active alarms	604	Active alarm 4 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
		605	Active alarm 5 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
		606	Active alarm 6 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
		607	Active alarm 7 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
		608	Active alarm 8 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
		609	Active alarm 9 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
		610	Active alarm 10 code	RO	unsigned char	0x01 - 0xFF		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
	Alarms history	Alarm 1	611	Alarm history count	RO	unsigned char	0 - 50	
			612	Alarm (newest) year	RO	unsigned short	2016 - 2250	Year
			613	Alarm (newest) month-day	RO	unsigned short	01.01 - 12.31	Month and day
			614	Alarm (newest) time	RO	unsigned short	0:00 - 23:59	Hours and minutes
			615	Alarm (newest) seconds	RO	unsigned char	0 - 59	Seconds
		Alarm 2	616	Alarm (newest) code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms	0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			617	Alarm year	RO	unsigned short	2016 - 2250	Year
			618	Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day
			619	Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes
			620	Alarm seconds	RO	unsigned char	0 - 59	Seconds
		Alarm 3	621	Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms	0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			622	Alarm year	RO	unsigned short	2016 - 2250	Year
			623	Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day
			624	Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes
			625	Alarm seconds	RO	unsigned char	0 - 59	Seconds
		Alarm 4	626	Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms	0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			627	Alarm year	RO	unsigned short	2016 - 2250	Year
			628	Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day
			629	Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes
			630	Alarm seconds	RO	unsigned char	0 - 59	Seconds
			631	Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms	0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 5	632 Alarm year	RO	unsigned short	2016 - 2250	Year	
			633 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			634 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			635 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 6	636 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			637 Alarm year	RO	unsigned short	2016 - 2250	Year	
			638 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			639 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			640 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 7	641 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			642 Alarm year	RO	unsigned short	2016 - 2250	Year	
			643 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			644 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			645 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 8	646 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			647 Alarm year	RO	unsigned short	2016 - 2250	Year	
			648 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			649 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			650 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 9	651 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			652 Alarm year	RO	unsigned short	2016 - 2250	Year	
			653 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			654 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			655 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 10	656 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			657 Alarm year	RO	unsigned short	2016 - 2250	Year	
			658 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			659 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			660 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 11	661 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			662 Alarm year	RO	unsigned short	2016 - 2250	Year	
			663 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			664 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			665 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 11	666 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 12	667 Alarm year	RO	unsigned short	2016 - 2250	Year	
			668 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			669 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			670 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 13	671 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			672 Alarm year	RO	unsigned short	2016 - 2250	Year	
			673 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			674 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			675 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 14	676 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			677 Alarm year	RO	unsigned short	2016 - 2250	Year	
			678 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			679 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			680 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 15	681 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			682 Alarm year	RO	unsigned short	2016 - 2250	Year	
			683 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			684 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			685 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 16	686 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			687 Alarm year	RO	unsigned short	2016 - 2250	Year	
			688 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			689 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			690 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 17	691 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			692 Alarm year	RO	unsigned short	2016 - 2250	Year	
			693 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			694 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
		Alarm 18	695 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
			696 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			697 Alarm year	RO	unsigned short	2016 - 2250	Year	
			698 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
		Alarm 18	699 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			700 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
			701 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 19	702 Alarm year	RO	unsigned short	2016 - 2250	Year	
			703 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			704 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			705 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 20	706 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			707 Alarm year	RO	unsigned short	2016 - 2250	Year	
			708 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			709 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			710 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 21	711 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			712 Alarm year	RO	unsigned short	2016 - 2250	Year	
			713 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			714 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			715 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 22	716 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			717 Alarm year	RO	unsigned short	2016 - 2250	Year	
			718 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			719 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			720 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 23	721 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			722 Alarm year	RO	unsigned short	2016 - 2250	Year	
			723 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			724 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			725 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 24	726 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			727 Alarm year	RO	unsigned short	2016 - 2250	Year	
			728 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			729 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			730 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 25	731 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			732 Alarm year	RO	unsigned short	2016 - 2250	Year	
			733 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			734 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			735 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 25	736 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 26	737 Alarm year	RO	unsigned short	2016 - 2250	Year	
			738 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			739 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			740 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 27	741 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			742 Alarm year	RO	unsigned short	2016 - 2250	Year	
			743 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			744 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			745 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 28	746 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			747 Alarm year	RO	unsigned short	2016 - 2250	Year	
			748 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			749 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			750 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 29	751 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			752 Alarm year	RO	unsigned short	2016 - 2250	Year	
			753 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			754 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			755 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 30	756 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			757 Alarm year	RO	unsigned short	2016 - 2250	Year	
			758 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			759 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			760 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 31	761 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			762 Alarm year	RO	unsigned short	2016 - 2250	Year	
			763 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			764 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
		Alarm 32	765 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
			766 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			767 Alarm year	RO	unsigned short	2016 - 2250	Year	
			768 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
		Alarm 32	769 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			770 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
			771 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 33	772 Alarm year	RO	unsigned short	2016 - 2250	Year	
			773 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			774 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			775 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 34	776 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			777 Alarm year	RO	unsigned short	2016 - 2250	Year	
			778 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			779 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			780 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 35	781 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			782 Alarm year	RO	unsigned short	2016 - 2250	Year	
			783 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			784 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			785 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 36	786 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			787 Alarm year	RO	unsigned short	2016 - 2250	Year	
			788 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			789 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			790 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 37	791 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			792 Alarm year	RO	unsigned short	2016 - 2250	Year	
			793 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			794 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			795 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 38	796 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			797 Alarm year	RO	unsigned short	2016 - 2250	Year	
			798 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			799 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
		Alarm 39	800 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
			801 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			802 Alarm year	RO	unsigned short	2016 - 2250	Year	
			803 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
		Alarm 39	804 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			805 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
			806 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 40	807 Alarm year	RO	unsigned short	2016 - 2250	Year	
			808 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			809 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			810 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 41	811 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			812 Alarm year	RO	unsigned short	2016 - 2250	Year	
			813 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			814 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			815 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 42	816 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			817 Alarm year	RO	unsigned short	2016 - 2250	Year	
			818 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			819 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			820 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 43	821 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			822 Alarm year	RO	unsigned short	2016 - 2250	Year	
			823 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			824 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			825 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 44	826 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			827 Alarm year	RO	unsigned short	2016 - 2250	Year	
			828 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			829 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			830 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 45	831 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			832 Alarm year	RO	unsigned short	2016 - 2250	Year	
			833 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			834 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			835 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 46	836 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			837 Alarm year	RO	unsigned short	2016 - 2250	Year	
			838 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			839 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			840 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 47	841 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			842 Alarm year	RO	unsigned short	2016 - 2250	Year	
			843 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			844 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Alarms	Alarms history	Alarm 47	842 Alarm year	RO	unsigned short	2016 - 2250	Year	
			843 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			844 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			845 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 48	846 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			847 Alarm year	RO	unsigned short	2016 - 2250	Year	
			848 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			849 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			850 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 49	851 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			852 Alarm year	RO	unsigned short	2016 - 2250	Year	
			853 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			854 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			855 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 50	856 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
			857 Alarm year	RO	unsigned short	2016 - 2250	Year	
			858 Alarm month-day	RO	unsigned short	01.01 - 12.31	Month and day	0x020C => Feb12
			859 Alarm time	RO	unsigned short	0:00 - 23:59	Hours and minutes	0x0805 => 8:05
			860 Alarm seconds	RO	unsigned char	0 - 59	Seconds	
		Alarm 50	861 Alarm code	RO	unsigned char	1 - 127 F alarms, 129 - 255 W alarms		0x02 => 2F (MSb = 0), 0x82 => 2W (MSb = 1)
Monitoring	Detailed information	900	Status icon bit mask	RO	unsigned short	0 - 8191	Starting => 0 bit, Stopping => 1 bit, Fan => 2 bit, Rotor => 3 bit, Heating => 4 bit, Cooling => 5 bit, HeatingDenied => 6 bit, CoolingDenied => 7 bit, FlowDown => 8 bit, FreeHeating => 9 bit, FreeCooling => 10 bit, AlarmF => 11 bit, AlarmW => 12 bit	
			901 Heating/cooling config	RO	unsigned char	0 - 7	Electric heater => 0 bit, Water cooler/heater => 1 bit, DX unit => 2 bit	
		902	Supply temperature	RO	signed short	-500 - 1200	x10 C	
		903	Extract Temperature	RO	signed short	-500 - 1200	x10 C	
		904	Outdoor temp	RO	signed short	-500 - 1200	x10 C	
		905	Water temperature	RO	signed short	-500 - 1200	x10 C	
		906-907	Current supply flow	RO	unsigned int	0 - 200000	m3/h, l/s	
		908-909	Current extract flow	RO	unsigned int	0 - 200000	m3/h, l/s	
		910	Current supply fan intensity	RO	unsigned short	0 - 1000	x10 %	
		911	Current extract fan intensity	RO	unsigned short	0 - 1000	x10 %	
		912	Heat exchanger	RO	unsigned short	0 - 1000	x10 %	

Group	Subgroups	Register number	Register name	Data			Values and Units	Examples and comments
				Access	Type	Range		
Monitoring	Detailed information	913	Electric heater	RO	unsigned short	0 - 1000	x10 %	
		914	Water heater	RO	unsigned short	0 - 1000	x10 %	
		915	Water cooler	RO	unsigned short	0 - 1000	x10 %	
		916	DX unit	RO	signed short	-1000 - +1000	x10 %	
		917	Filters Impurity	RO	unsigned char	0 - 100	%	
		918	Air dampers	RO	unsigned char	0 - 100	%	
		919	Supply pressure	RO	unsigned short	0 - 1000	Pa	
		920	Extract pressure	RO	unsigned short	0 - 1000	Pa	
	Efficiency status	921	Power consumption	RO	unsigned char	0 - 65535	W	
		922	Heater power	RO	unsigned short	0 - 65535	W	
		923	Heat exchanger recovery	RO	unsigned short	0 - 65535	W	
		924	Heat exchanger efficiency	RO	unsigned char	0 - 100	%	
		925	Energy saving	RO	unsigned char	0 - 100	%	
	Consumption	926	SPI	RO	unsigned short	0 - 65535	W/(m3/h)	
		927-928	AHU consumption, Day	RO	unsigned int	0 - 4294967296	Wh	
		929-930	AHU consumption, Month	RO	unsigned int	0 - 4294967296	Wh	
		931-932	AHU consumption, Total	RO	unsigned int	0 - 4294967296	Wh	
		933-934	Add. air heater consumption, Day	RO	unsigned int	0 - 4294967296	Wh	
		935-936	Add. air heater consumption, Month	RO	unsigned int	0 - 4294967296	Wh	
		937-938	Add. air heater consumption, Total	RO	unsigned int	0 - 4294967296	Wh	
		939-940	Recovered energy, Day	RO	unsigned int	0 - 4294967296	Wh	
		941-942	Recovered energy, Month	RO	unsigned int	0 - 4294967296	Wh	
		943-944	Recovered energy, Total	RO	unsigned int	0 - 4294967296	Wh	
	Panel	945	SPI per day	RO	unsigned short	0 - 65535	W/(m3/h)	
		946	Panel 1 temperature	RO	signed short	-500 - 1200	x10 C	
		947	Panel 1 humidity	RO	signed char	0 - 100	%	
		948	Panel 1 air quality	RO	unsigned short	0 - 65535	ppm, ppb	
		949	Panel 2 temperature	RO	signed short	-500 - 1200	x10 C	
		950	Panel 2 humidity	RO	signed char	0 - 100	%	
		951	Panel 2 air quality	RO	unsigned short	0 - 65535	ppm, ppb	
Others		1000-1001	Firmware version	RO	unsigned int	1 - 4294967295	1st number 8bit <<24, 2nd number 4bit <<20, 3rd number 8bit <<12, 4th number 12bit<<0	18886660 => 1.2.3.4
		1002-1003	Panel 1 firmware version	RO	unsigned int	1 - 4294967295	1st number 8bit <<24, 2nd number 4bit <<20, 3rd number 8bit <<12, 4th number 12bit<<0	18886660 => 1.2.3.4
		1004-1005	Panel 2 firmware version	RO	unsigned int	1 - 4294967295	1st number 8bit <<24, 2nd number 4bit <<20, 3rd number 8bit <<12, 4th number 12bit<<0	18886660 => 1.2.3.4
		1050	Reset settings	R/W	unsigned short	0 - 11	Reset Away settings = 1, Reset Normal settings = 2, Reset Intensive settings = 3, Reset Boost settings = 4, Reset Holidays settings = 5, Reset Override settings = 6, Reset Kitchen settings = 7, Reset Fireplace settings = 8, Reset Air quality settings = 9, Reset Eco settings = 10, Reset Advanced settings = 11	



UAB AMALVA

VILNIUS Ozo g. 10, LT-08200
Tel. +370 (5) 2779 701
Mob. tel. 8-685 44658
el. p. info@amalva.lt

KAUNAS Taikos pr. 149, LT-52119
Tel.: (8-37) 473 153, 373 587
Mob. tel. 8 685 63962
el. p. kaunas@amalva.lt

KLAIPĖDA Dubysos g. 25, LT-91181
Mob. tel.: 8 685 93706, 8 685 93707
el. p. klaipeda@amalva.lt

ŠIAULIAI Metalistų g. 6H, LT-78107
Tel. (8-41) 500090, mob. tel. 8 699 48787
el. p. siauliai@amalva.lt

PANEVĖŽYS Beržų g. 44, LT-36144
Mob. tel. 8 640 55988
el. p. panevezys@amalva.lt

EXPORT & SALES DEPARTMENT
Ph.: +370 (5) 205 1579, 231 6574
Fax +370 (5) 230 0588
export@komfovent.com

GARANTINIO APTARNAVIMO SK. / SERVICE AND SUPPORT
Tel. / Ph. +370 (5) 200 8000,
mob. tel. / mob. ph.: +370 652 03180
service@amalva.lt

www.komfovent.lt

ООО «АМАЛВА-Р»
Россия, Москва
ул. Выборгская д. 16,
стр. 1, 2 этаж, 206 офис
тел./факс +7 495 640 6065,
info@amalva.ru
www.komfovent.ru

ООО «АМАЛВА-ОКА»
390017 г. Рязань
Рязское шоссе, 20, Н6, литера Е
тел. +7 4912 950575, +7 4912 950672,
+7 4912 950648
info@amalva-oka.ru
www.komfovent.ru

ИООО «Комфoвент»
Республика Беларусь, 220125 г. Минск,
ул. Уручская 21 – 423
Тел. +375 17 266 5297, 266 6327
minsk@komfovent.by
www.komfovent.by

Komfovent AB
Ögärdesvägen 12B
433 30 Partille, Sverige
Phone +46 31 487752
info_se@komfovent.com
www.komfovent.se

Komfovent GmbH
Konrad-Zuse-Str. 2a, 42551 Velbert,
Deutschland
Mob. ph. +49 (0) 2051/6051180
info@komfovent.de
www.komfovent.de

PARTNERS

AT	J. PICHLER Gesellschaft m. b. H.	www.pichlerluft.at
BE	Ventilair group	www.ventilairgroup.com
	ACB Airconditioning	www.acbairco.be
CZ	REKUVENT s.r.o.	www.rekuvent.cz
CH	WESCO AG	www.wesco.ch
	SUDCLIMATAIR SA	www.sudclimatair.ch
DK	KAPAG Kälte-Wärme AG	www.kapag.ch
	UNIQ COMFORT ApS	www.uniqcomfort.dk
EE	AIR2TRUST	www.air2trust.com
EE	BVT Partners	www.bvtpartners.ee
FI	MKM-Trade Oy	www.mkm-trade.fi
FR	AERIA	www.aeria-france.fr
GB	Supply Air Ltd	www.supplyair.co.uk
	ELTA FANS	www.eltafans.com
IR	Fantech Ventilation Ltd	www.fantech.ie
IS	Hitataekni ehf	www.hitataekni.is
NL	Ventilair group	www.ventilairgroup.com
	Vortvent B.V.	www.vortvent.nl
NO	Ventistål AS	www.ventistal.no
	Thermo Control AS	www.thermocontrol.no
PL	Ventia Sp. z o.o.	www.ventia.pl
SE	Caverion Sverige AB	www.caverion.se
SI	Agregat d.o.o	www.agregat.si
SK	TZB produkt, s.r.o.	www.tzbprodukt.sk