




EP-A EAST BAY R9-R11 + NE CORNER

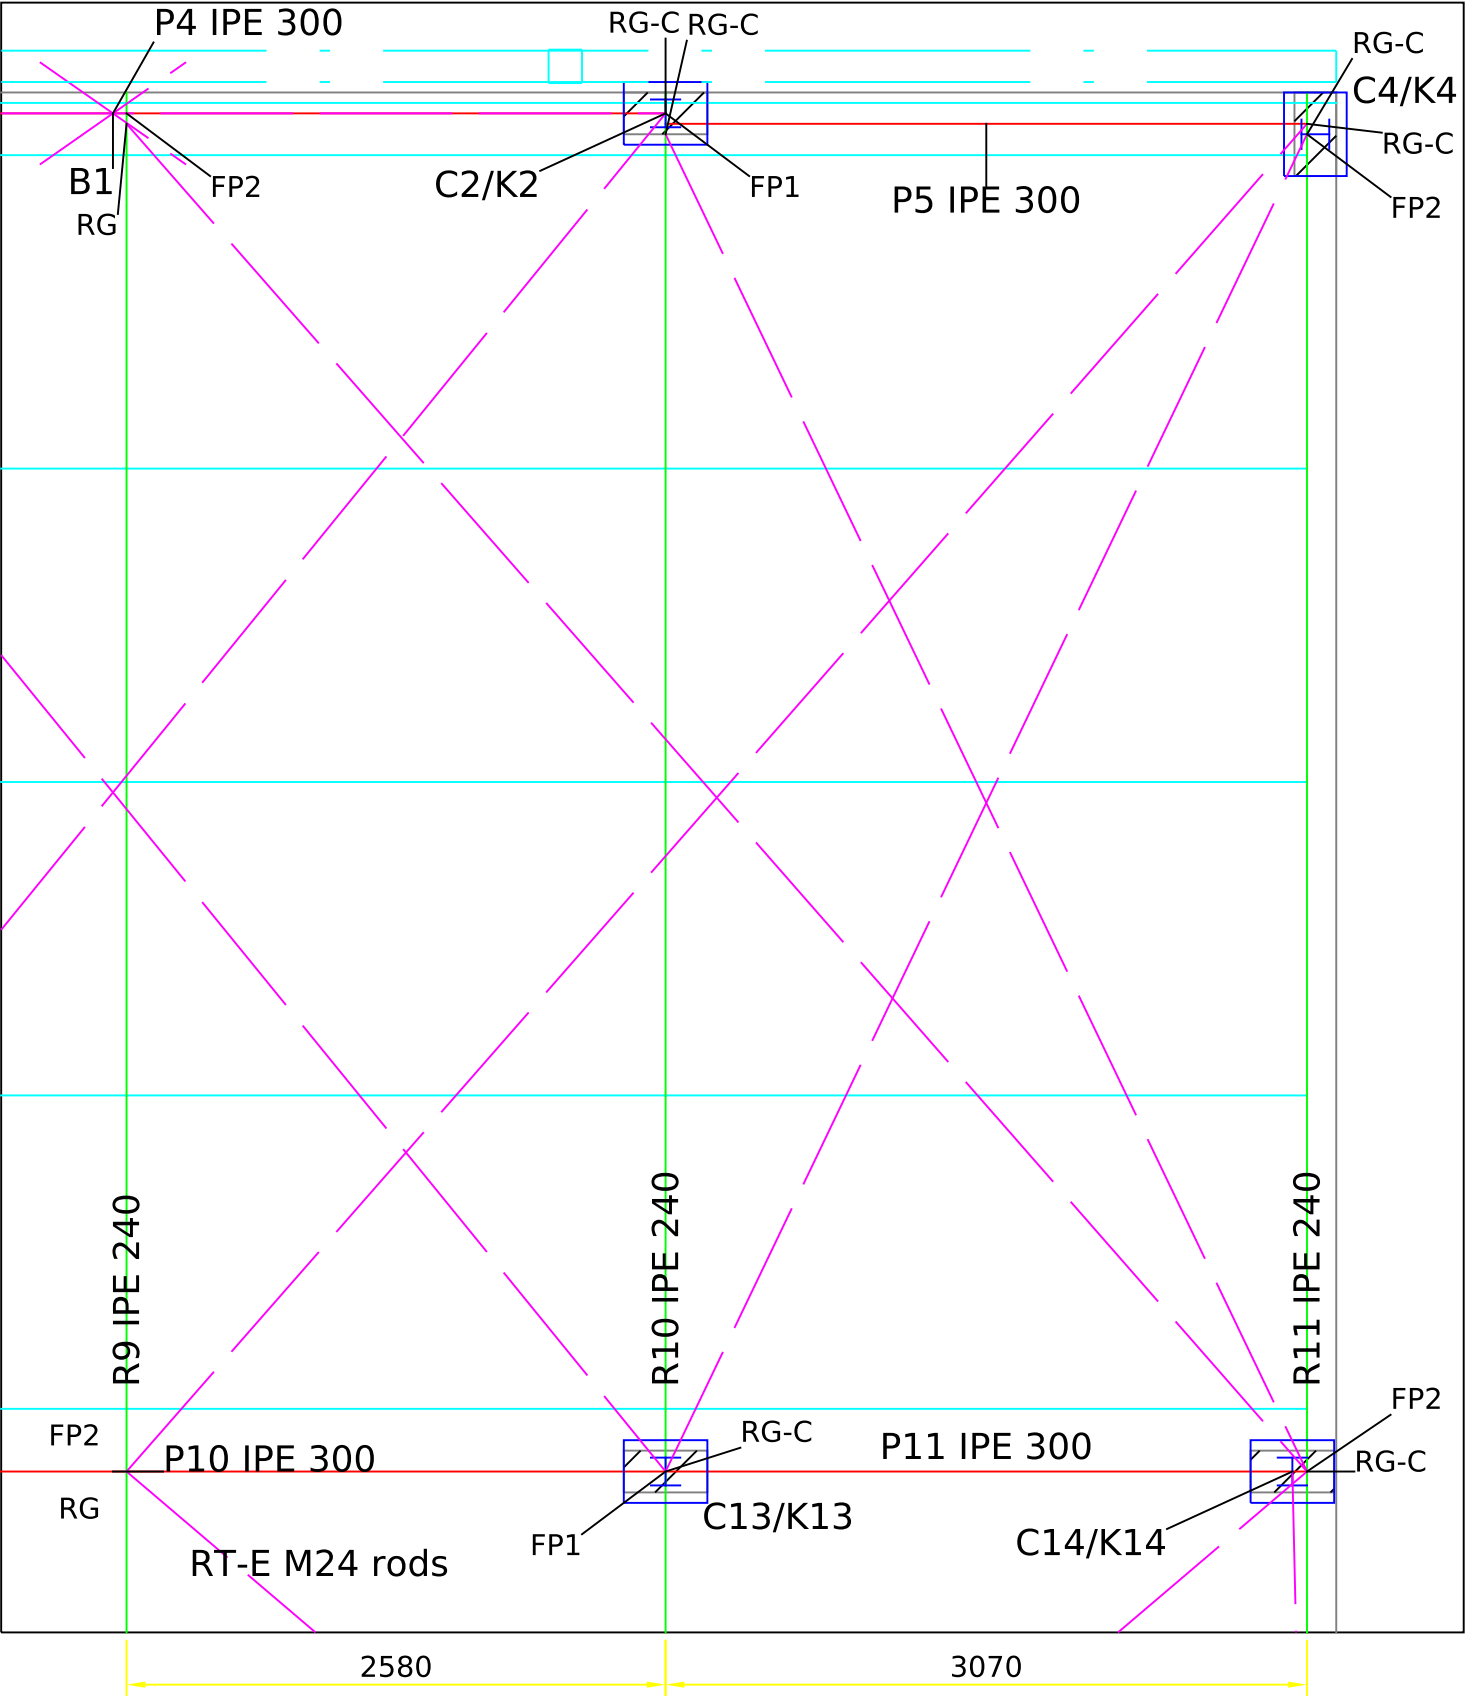


EP-D NORTH JOG, HEADER, RETURN

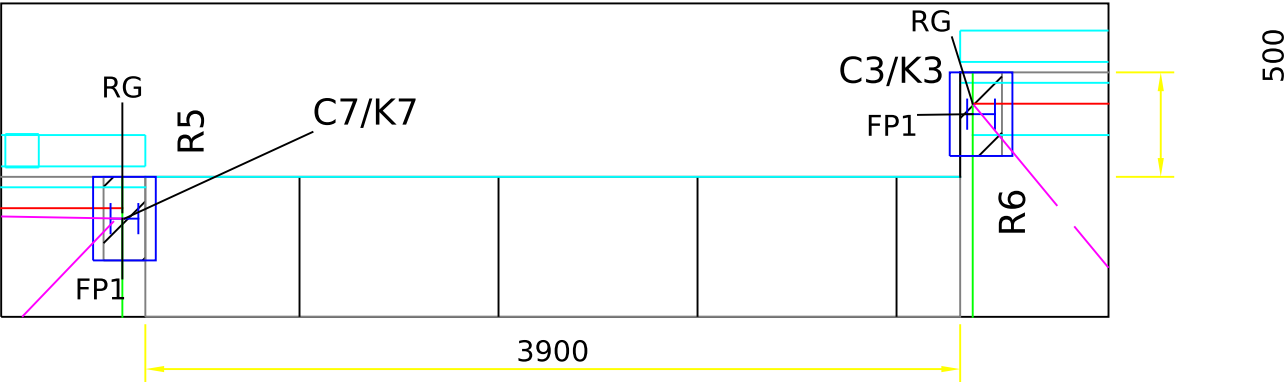

EP-B JOG PANEL, T2, P12

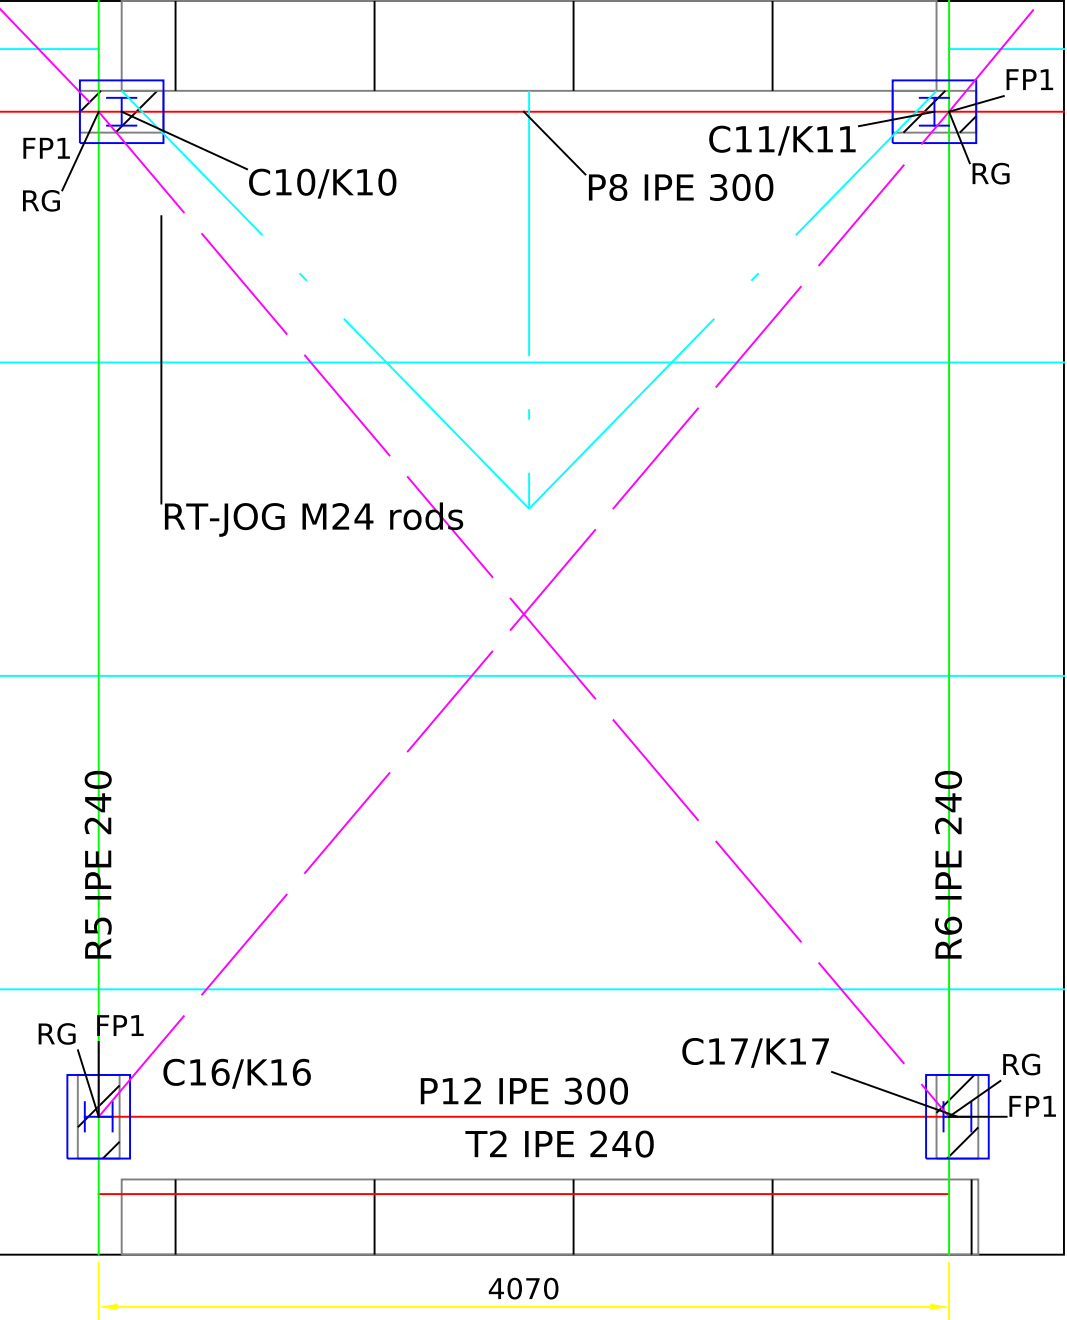

EP-C NOTCH CORNER, WP1, K21

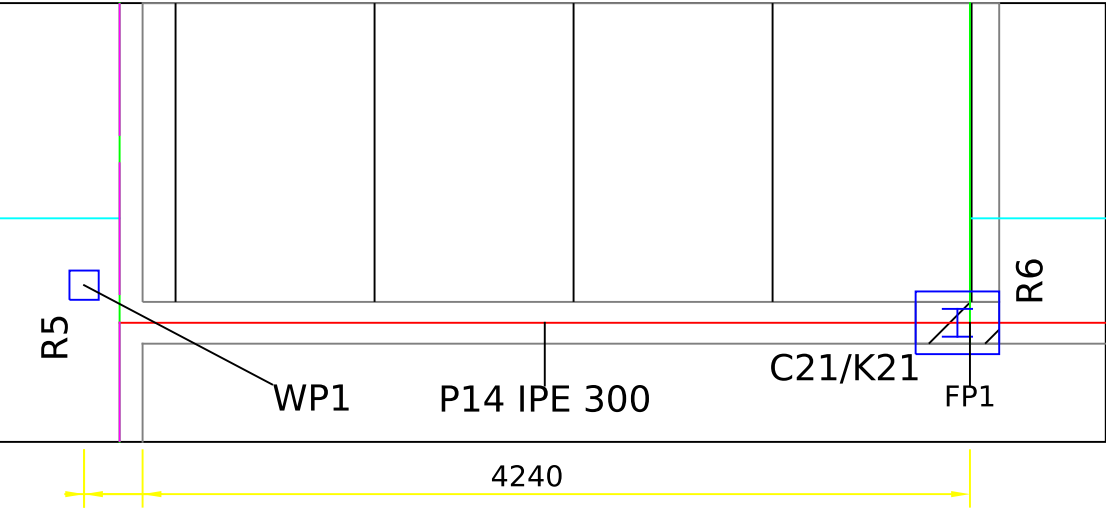

NOTES TO THE PARTIAL PLANS
FP1: fin plate 100 x 150 x 10, 2 M20 8.8 (pitch 70, e1 = e2 = 40), bolt line 50 from the primary web, welds 2 x a6 (D1). FP2: 160 x 150 x 10, 2 x 2 M20 (p2 60) at the strip-chord splices of R1 / R3 / R9 / R11 (D1). R5 strut fin: FP1 (2 M20, 0.55).
RG: rod gusset 8 mm shop-welded to the primary web, bolted 2 M16 to the rafter web, at every corner of the 13 rod panels (D5). RG-C: combined gusset at C2, C4, C13, C14 where the north strip and the east strip share the NE corner cell (both rod sets, D5).
Rods M24 8.8 with turnbuckles; on RT-W (R1/R3) and RT-E (R9/R11) the rods span two rafter cells and pass R2 / R10 through a bolted web clip (D5).
EP-C: WP1 at (77.61, 20.25); P14 IPE 300 eave beam from R5 (fin plate) to C21; K21 pier 200 thick between the notch edge y 19.97 and the shaft opening y 20.17 (base P, S05).
EP-D: the stair well is open to the north face; wall header 2 x C200x60x2.5 boxed between C7 and the return post; 0.5 m wall return at x 81.79 on brackets from C3; gutter G-W stops at x 77.89, G-E starts at x 81.79 (stop ends + overflow spouts).
Marks: Rn rafters IPE 240, Pn primaries IPE 300 (P13 IPE 330), Cn/Kn columns HEA 140 on concrete column Kn, RT-* rod strips, Bn wall X bays. Sections and lengths on S06.

LEGEND	
—	Primaries IPE 300
—	Rafters IPE 240
	Columns HEA 140
—	Roof rods M24
—	FP1/FP2 fin plates, RG gussets

PROJECT
Steel roof - Administration Building, Regatta Tourist Village, Tripoli
ALTERNATIVE C - POST-AND-BEAM BRACED STEEL ROOF, SANDWICH PANELS
Client: Regatta Tourist Village, Tripoli Issued by: Eng. MALEK ABOZRAIG (malek.abozraig@gmail.com) Units: m

SHEET TITLE
ENLARGED PARTIAL PLANS EP-A TO EP-D (2x)
Partial plans at 2x (1 m model = 500 mm); dimension text in mm (dimlfac 500)
Status: ISSUED FOR CONSTRUCTION subject to the site verification of S00 section 9

REVISIONS			
3	2026-09-29	Rev 6a (IPE 300/240, HEA 140), bases Rev 8, bracing Rev 5a	
2	2026-09-28	Design Rev 3 / bases Rev 4b (critique C1-C15)	
1	2026-09-27	First issue: design Rev 2, bases Rev 3	

CURRENT REVISION
Rev 6a superstructure
Rev 8 bases / bracing Rev 5a
DATE 2026-09-29
Drawn: Designed:
Checked: Approved:

DRAWING No.
RTV-ST-S01a
S01a