

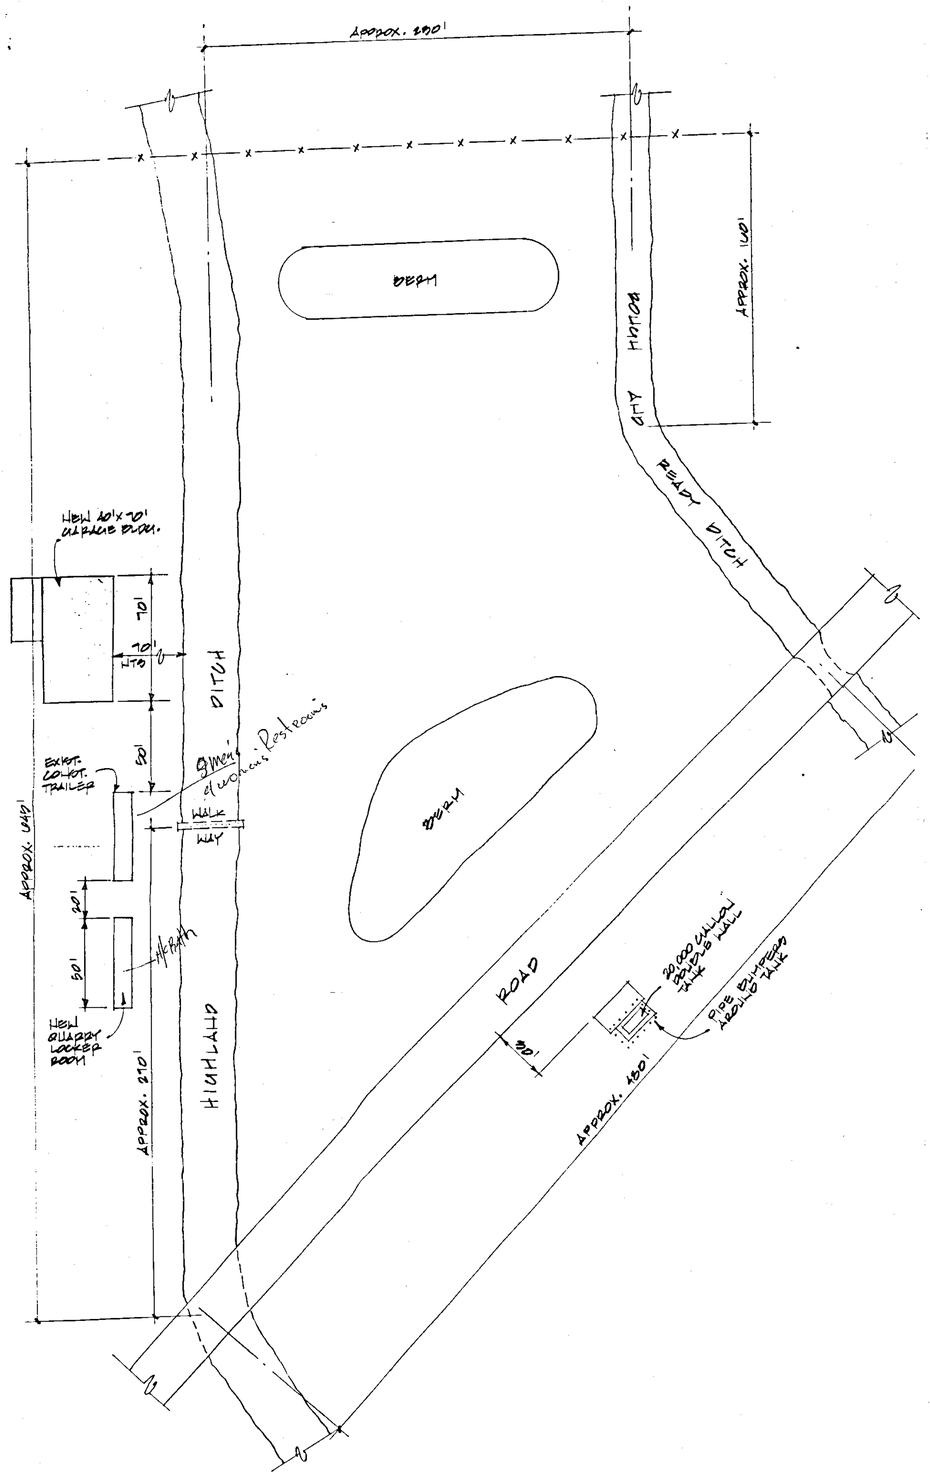


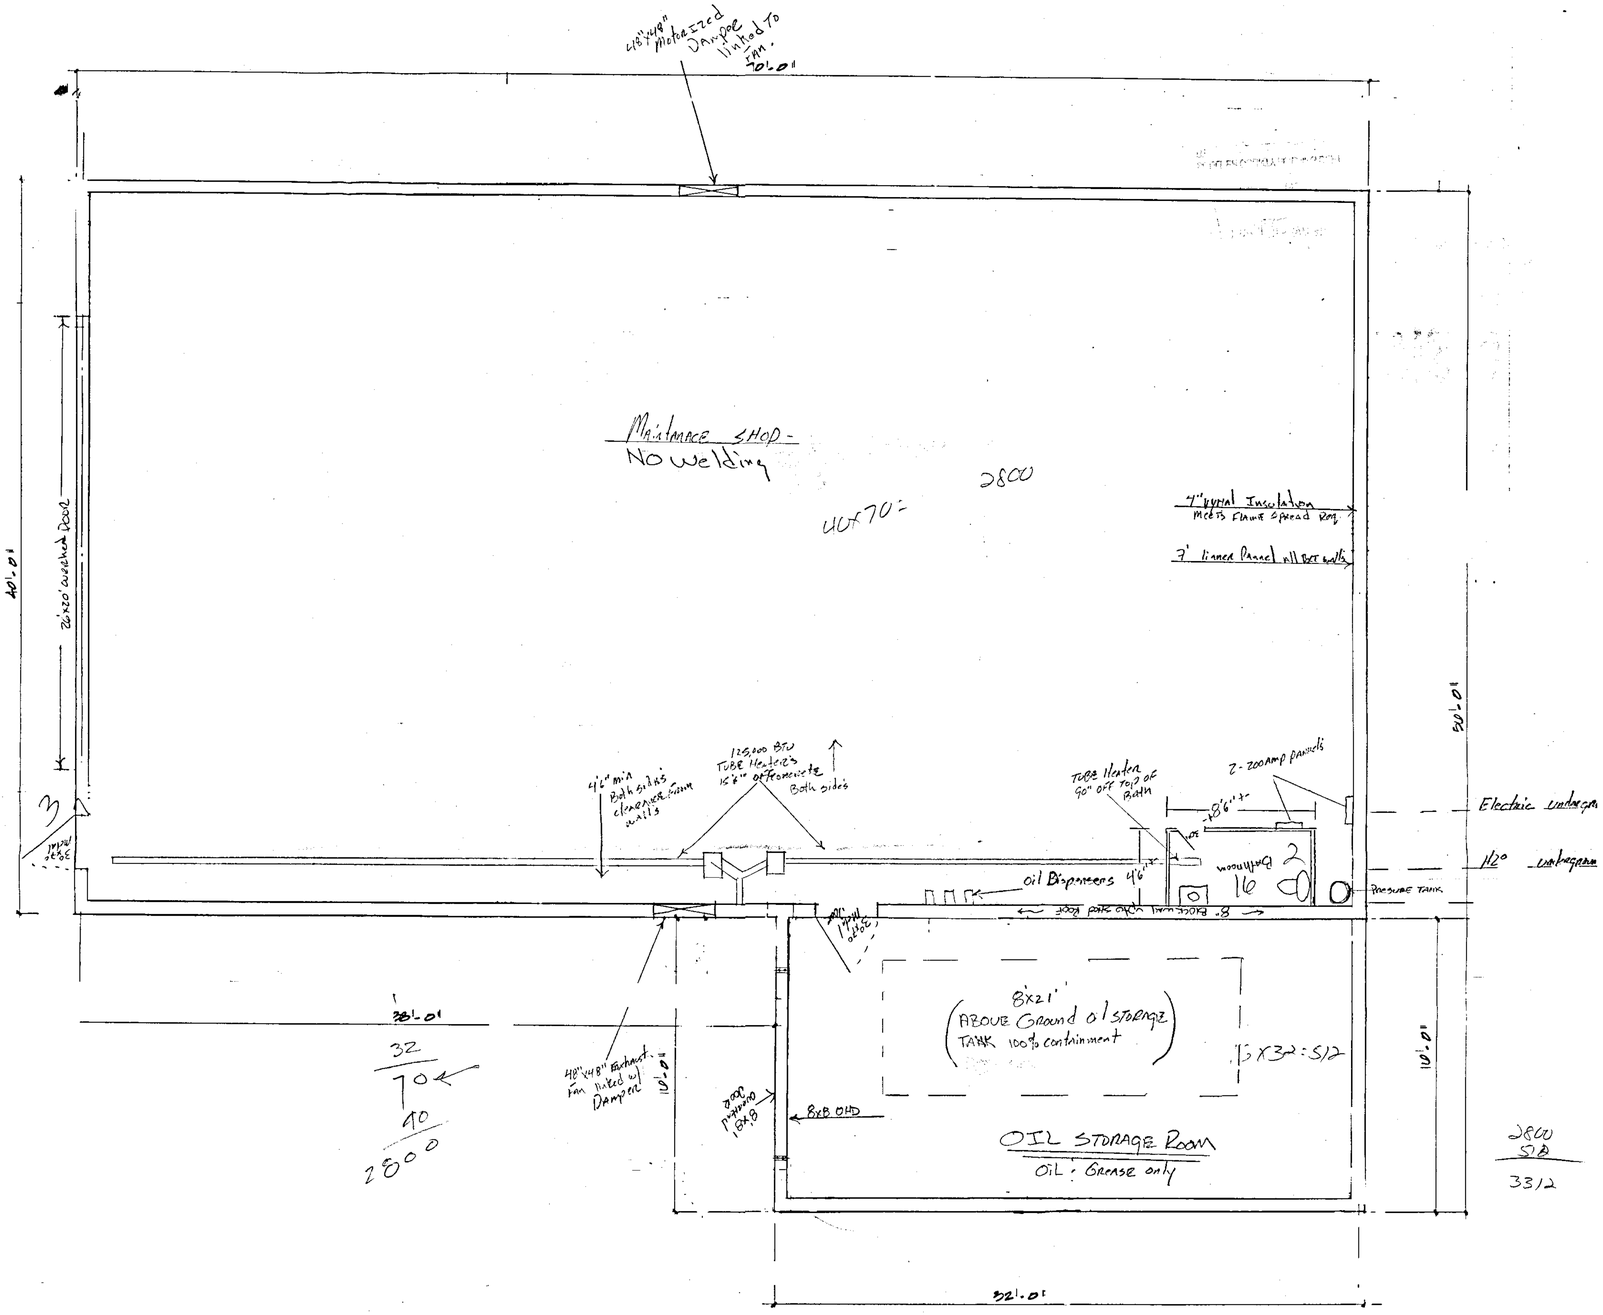

Dow Flats
Maintance SHOP
Lyon's Plant


Site

Revised

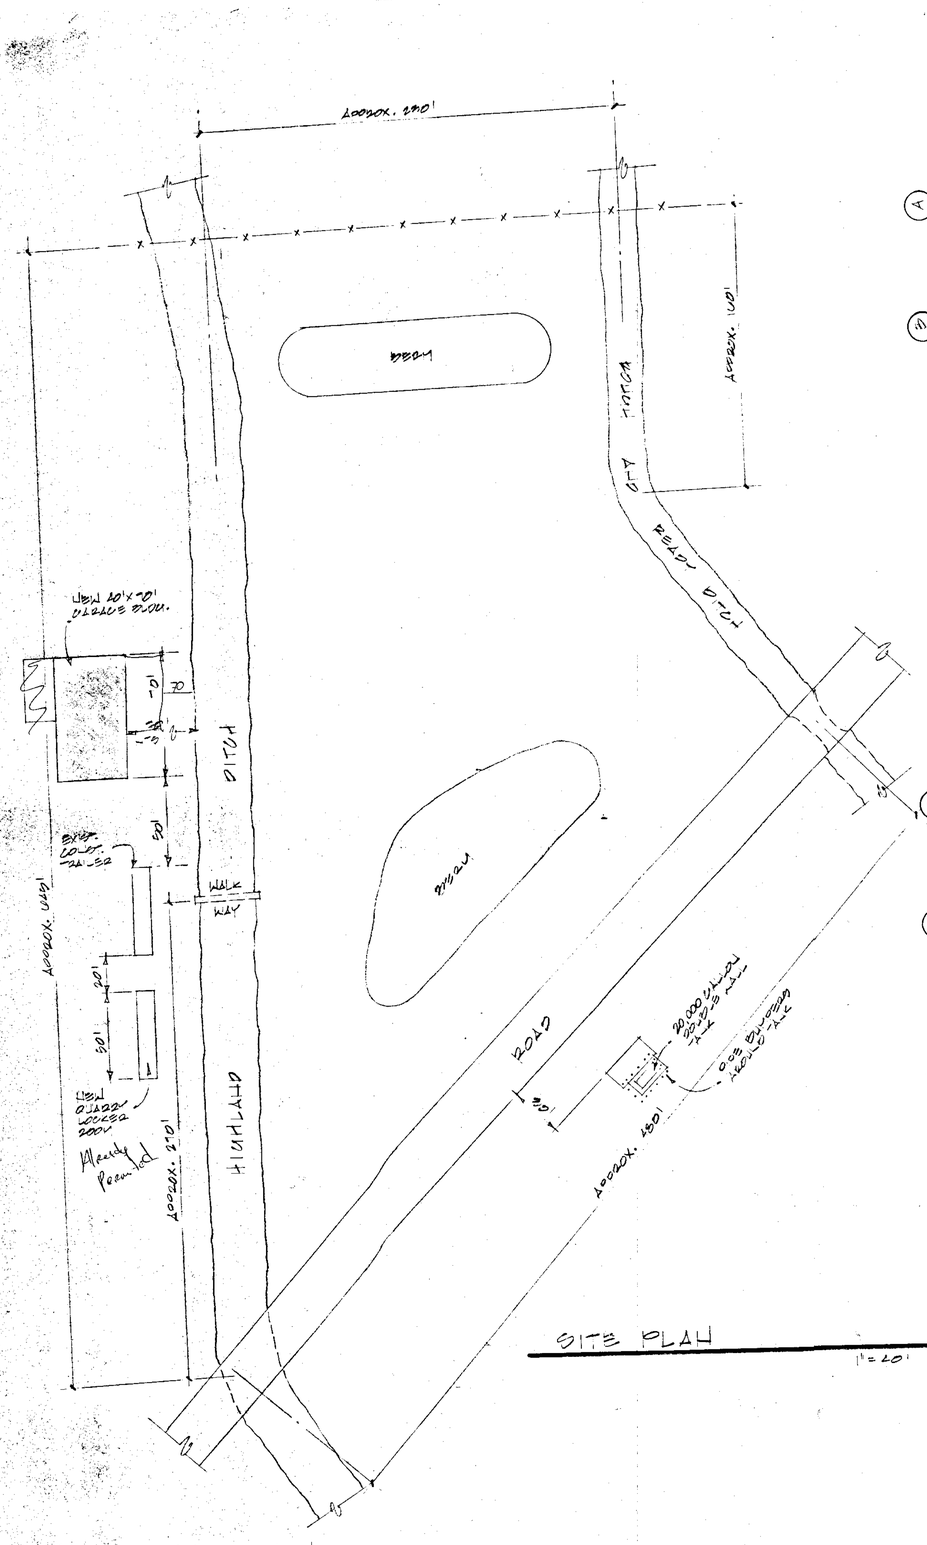

SITE PLAN

1" = 40'

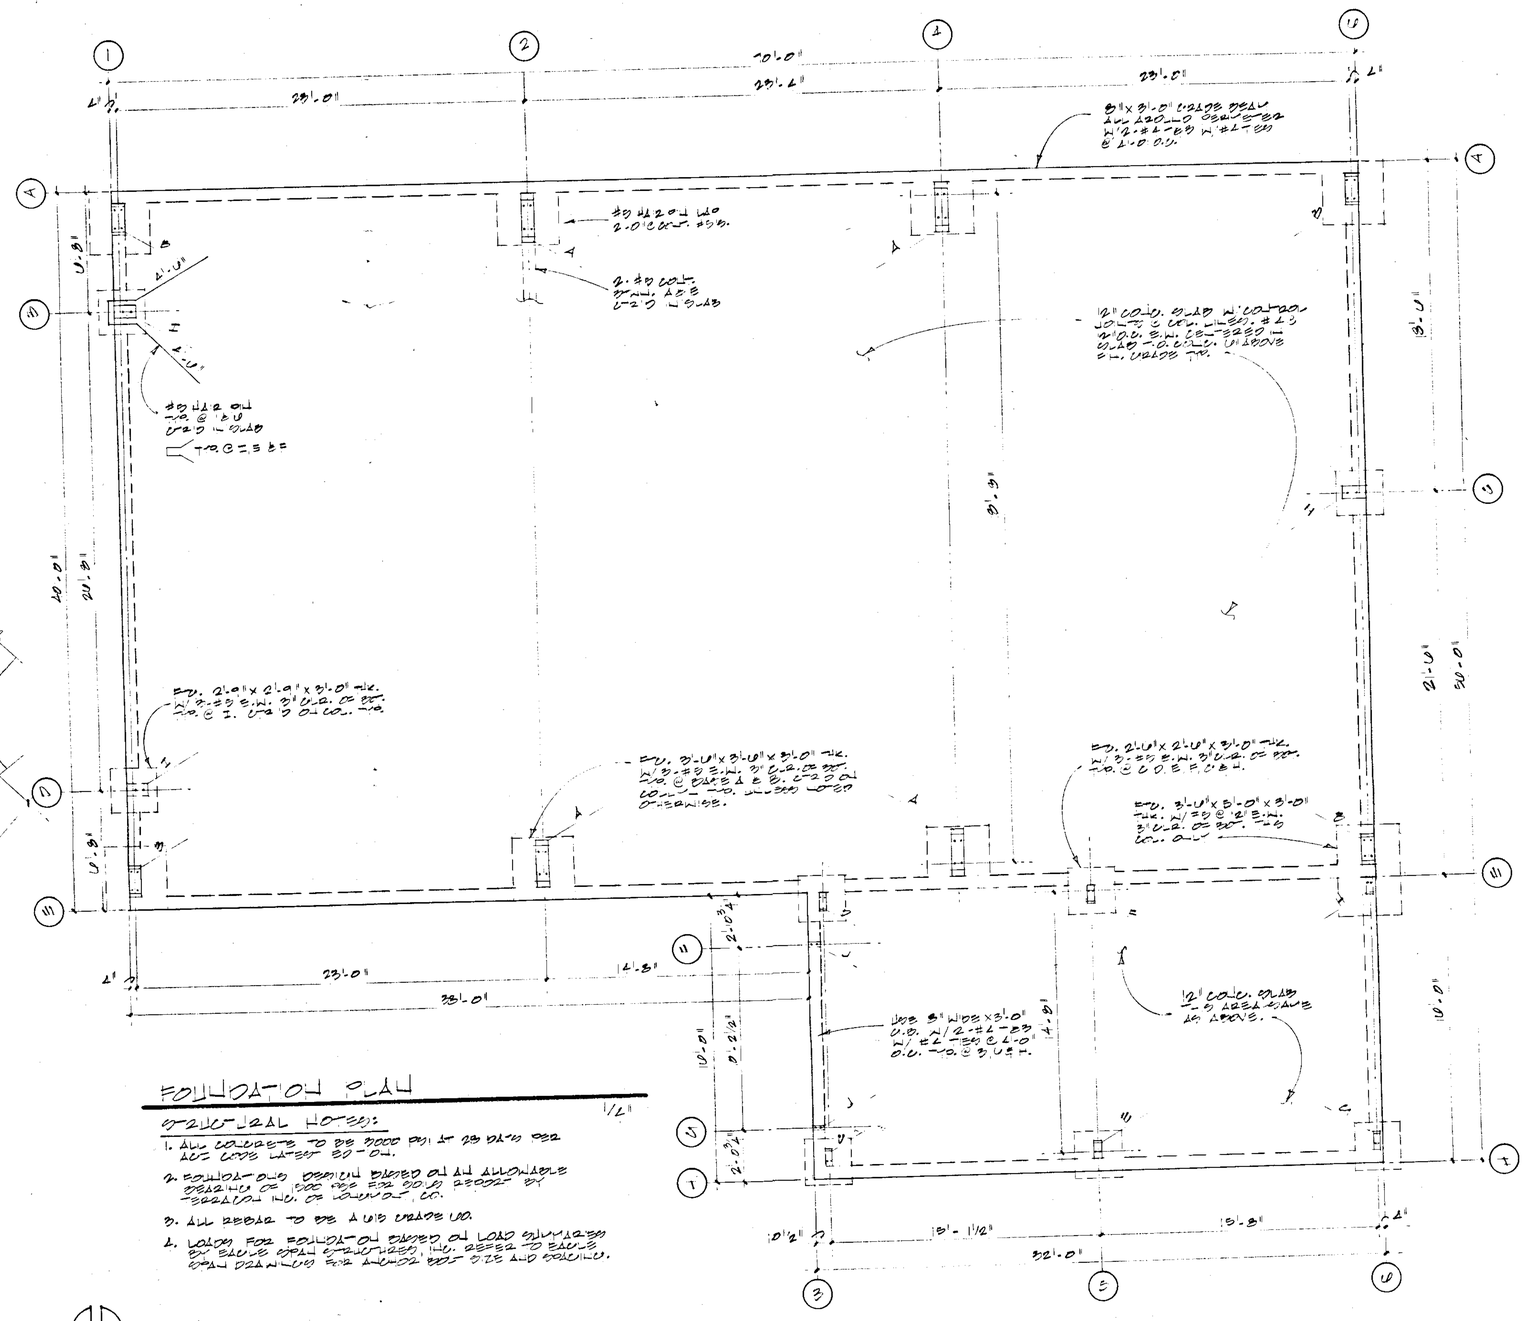

FOUNDATION PLAN

1/7"

GENERAL NOTES:


1. ALL CONCRETE TO BE 3000 PSI AT 28 DAYS SEE ACI CODE LATEST ED.-OU.
2. FOUNDATION DESIGN BASED ON AN ALLOWABLE BEARING OF 1500 PSF FOR SOILS REPORT BY SOILTECH INC. OF LOVELAND, CO.
3. ALL REBAR TO BE #4 GRADE 60.
4. LOADS FOR FOUNDATION BASED ON LOAD CALCULATIONS BY STEVE POLL ENGINEERED, INC. REFER TO ENG'S FINAL DRAWING FOR ANCHOR BOLT SIZE AND SPACING.


SOUTH DOWN CONCRETE
DOME FLATS SHOP PROJECT
LYONS, COLORADO
DATE: JANUARY 8, 1998

STEVEN D. POLL # 7157 REGISTERED PROFESSIONAL ENGINEER
1/16/98

Site

S Down

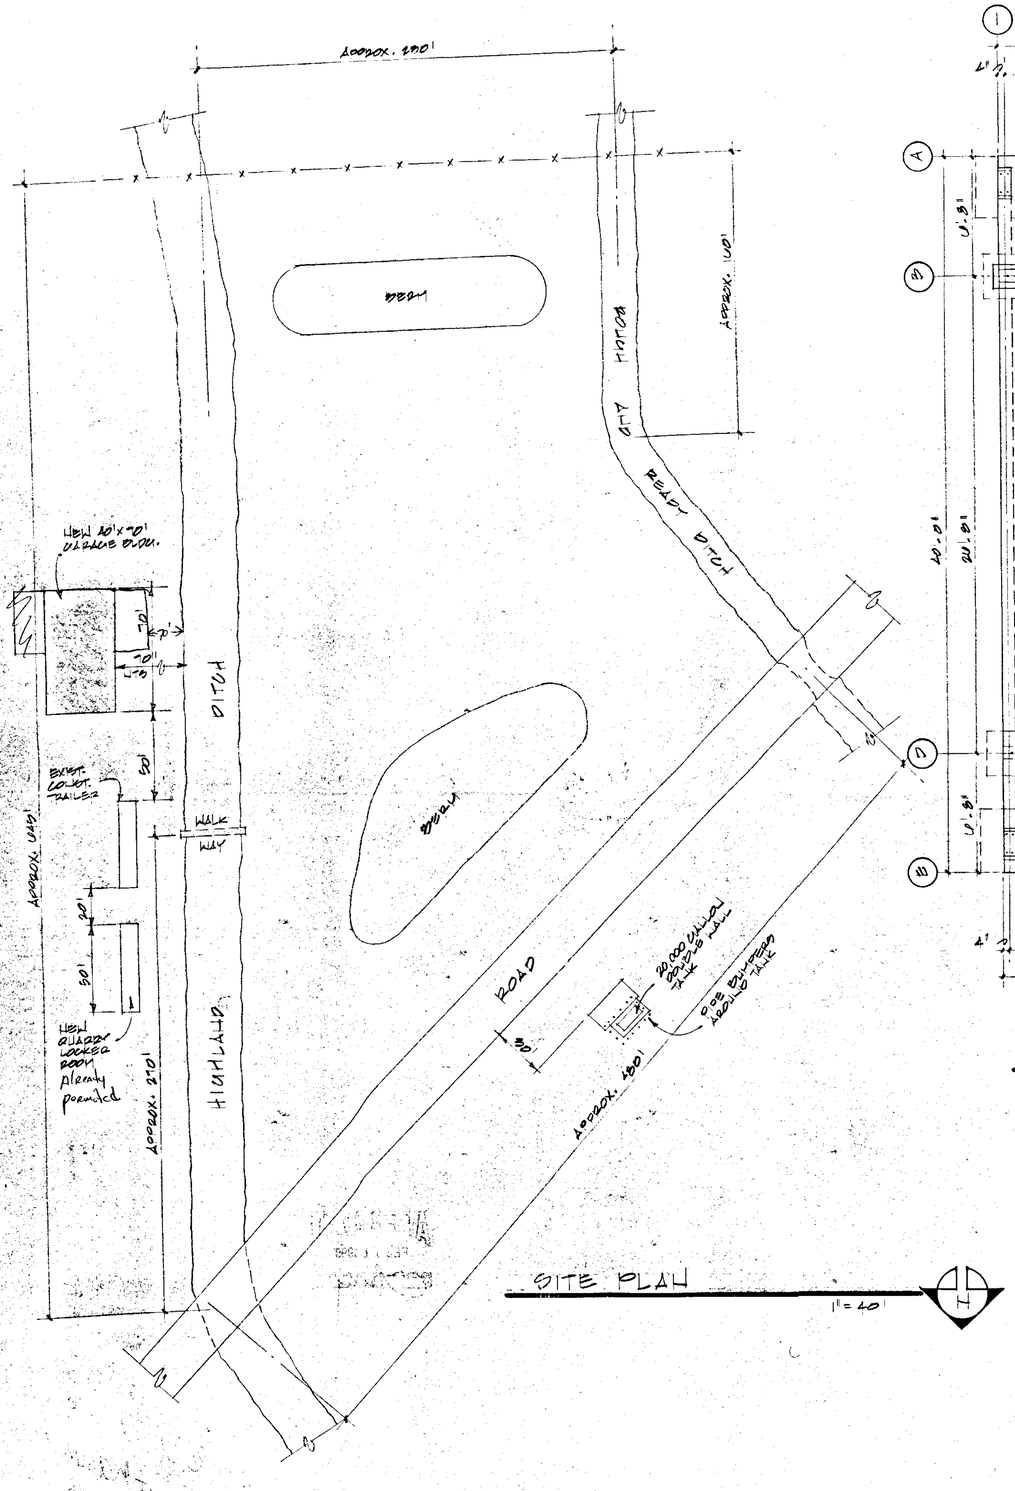

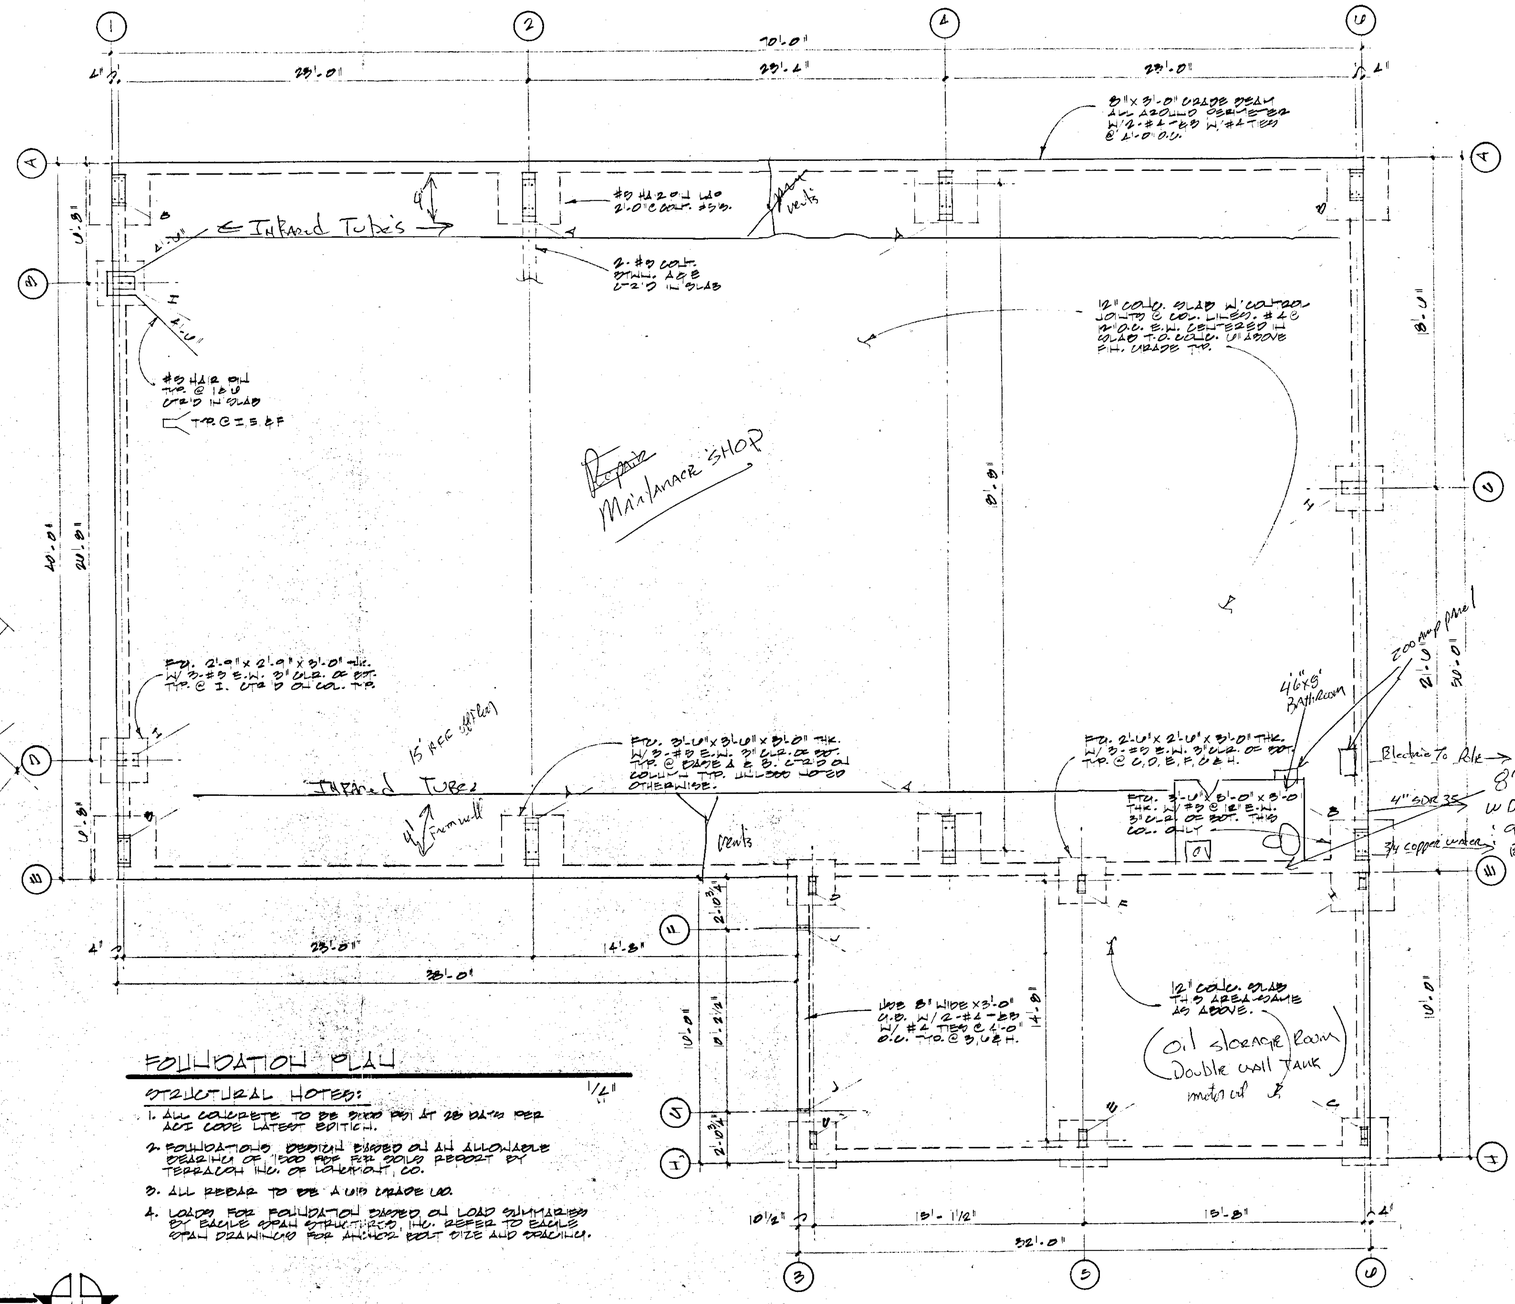

FOUNDATION PLAN

1/4"

STRUCTURAL NOTES:

1. ALL CONCRETE TO BE MIXED FOR AT 28 DAYS PER ACI CODE LATEST EDITION.
2. FOUNDATIONS DESIGN BASED ON AN ALLOWABLE BEARING OF 1500 PSF PER SOILS REPORT BY TERRACON INC. OF LOVELAND, CO.
3. ALL REBAR TO BE A 615 GRADE 60
4. LOADS FOR FOUNDATION BASED ON LOAD SUMMARIES BY EAGLE STEEL STRUCTURES INC. REFER TO EAGLE STEEL DRAWINGS FOR ANCHOR BOLT SIZE AND SPACING.

SOUTH DOWN CONCRETE
DOWE FLATS SHOP PROJECT
LYONS, COLORADO
DATE: JANUARY 8, 1998

COLORADO REGISTERED PROFESSIONAL ENGINEER # 7157
1/10/98

S