



TRANSPORTATION DEPARTMENT
2525 13th Street • Boulder CO 80304
PO Box 471 • Boulder CO 80306
Phone: 303-441-3900
Fax: 303-441-4594

OFFICE USE

Floodplain Permit Number: FDP-14-117F
Building Permit Number: BP-14-0797
Docket Number:
Effective Date: 12/19/2014

FLOODPLAIN DEVELOPMENT PERMIT

OWNER AND PROPERTY INFORMATION

Applicant/Owner Name: CEMEX CONSTRUCTION MATERIALS SOUTH LLC		Phone: 303-823-2101
Address: 1501 BELVEDERE RD		Fax:
City: WEST PALM BEACH	State: FL	Zip: 33406-1501
Engineer/Contractor Name: Alliance Engineering Ltd.		Phone: 7208980660
Address: 9737 Wadsworth Pkwy		Fax:
City: Westminster	State: CO	Zip: 80021

PROJECT INFORMATION

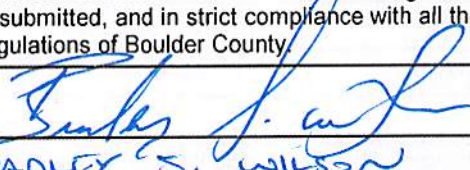

Location of Development: 5134 Ute Highway		City: Lyons			
Section/Township/Range: 28/3N/70					
Proposed Project:	☐ new structure	☐ addition	☐ remodel	☐ mobile home	
	☐ attached garage	☐ accessory structure	☐ fill	☐ excavation	☐ change of use
☒ Other (describe): Flood Inundation Repairs					
Description of Development: Repair CEMEX administration building damaged during flood of September 2013.					

REMODELS AND REDEVELOPMENT ONLY

Cost of Improvement for this project:	\$570,742.00		
Value of Structure: (submit current (within 1 year) appraiser's valuation of structure)	\$404,000.00		
Percent Improvement:	141.27		
Substantial Improvement:	☒ Yes	☐ No	(Yes, if cost of project $\geq$ 50% of appraised valuation)
If no, have other improvements been made to the structure since Sept. 11, 2013?	☐ Yes	☒ No	
Cumulative Percent of All Improvements:	141.27		
Substantial Improvement:	☒ Yes	☐ No	(Yes, if cost of improvements since Sept. 11, 2013 $\geq$ 50% of appraised valuation)

FLOODPLAIN INFORMATION

Floodplain Name: Floodplain Reanalysis and Floodway Delineation North St Vrain and St Vrain Creek, Love and Associate		Station No.: Station 161346 taken at the upstream-most corner (furthest western corner) of the administration building.		
FEMA Flood Zone Designation:	A, AE, AO - 1% annual chance floodplain			
Base Flood Elevation: 5215.6 ft.	☒ NGVD (29)	☐ NAVD (88)		
Flood Protection Elevation: 5217.6 ft.	☒ NGVD (29)	☐ NAVD (88)		
Floodway:	☐ Yes	☒ No	(If yes, please submit Engineers report addressing those standards set forth in Article 4-407)	
	☒ Title Report	☐ Floodway Analysis	☐ Permit Advertised	☐ Cross Section
☐ Description of extent to which water course will be altered				

REGULATORY REQUIREMENTS				
Structure is:	☐ Elevated	☒ Floodproofed	☐ Vented	☐ n/a
Elevation and/or Floodproofing Certificate:	☒ Yes	☐ No		
If floodproofed, describe method:				
Lowest floor elevation: 5214.53	☒ NGVD (29)		☐ NAVD (88)	
Elevation of garage slab:	☐ NGVD (29)		☐ NAVD (88)	
Lowest elevation of HVAC equipment (and other mechanical equipment):	☐ NGVD (29)		☐ NAVD (88)	
Enclosed area (not floodproof or elevated): square feet				
Number of Vents:		Area of vents: square inches		
FOR STRUCTURES: Attach building plans showing foundation design, flood elevation, floor elevations, HVAC and other mechanical equipment elevations, size and location of vents, floodproofing design and other relevant information that address those standards set forth in Article 4-407.				
FOR SITE WORK: Attach site and grading plans and other relevant information. All plans must be stamped and signed by a Colorado Registered Professional Engineer				
Certification: I certify that the above information is correct and agree to construct this building in accordance with the plat, building plans and specifications submitted, and in strict compliance with all the provisions of the Zoning Ordinance, Building Code, and Health and Plumbing Regulations of Boulder County.				
Signature of applicant: 			Date: 1-22-2015	
Printed Name: BRADLEY S. WILSON				
Signature of floodplain administrator: 			Date: 12/19/14	
Conditions:	1. The project shall be constructed in accordance with the final submitted construction drawings for the "CEMEX Administration Building" stamped by David Moore, P.E.; Chesley Alexander, Architect; and Arwin Priest, P.E. 2. CEMEX Construction Materials South, LLC, the owner and operator of this facility, must adhere to the Emergency Operations Plan (Flood), the Inspection & Maintenance Plan and Report, and associated annual training specified in Drawing A-203, stamped December 5, 2014 by Chesley Alexander, Architect. 3. Prior to final inspections being scheduled, the applicant shall submit a second Floodproofing Certificate, prepared by a Colorado-registered Professional Engineer, certifying that the structure has been floodproofed at or above the flood protection elevation (5217.6' NGVD29). This certification shall be provided on a standard Federal Emergency Management Agency (FEMA) Floodproofing Certificate for Non-Residential Structures. The FEMA Floodproofing Certificate (for Finished Construction) must be accompanied with a written statement certifying the following: (a) the building envelope is watertight, (b) the Engineer of Record's design and construction are in accordance with ASCE 24-05, and (c) written certification that all components and systems when installed meet the requirements of ASCE 24-05. No final inspections will be scheduled until this provision has been satisfied. 4. The applicant shall obtain approval for all necessary local, state, and federal permits from the appropriate permitting authority prior to beginning work. Note: 1. Structures located within the 100-year floodplain that receive damage of any origin, whereby the cost of restoring the structure would equal or exceed 50% of the pre-damage market value of the structure, are considered Substantially Damaged. The revised damage percentage for the proposed restoration work on this building (BP-14-0797) is 141.27% using the submitted appraisal and damage repair costs. Based on this percentage, we have determined that the Administration Building sustained Substantial Damage and must be brought into compliance with requirements for new construction. This floodplain development permit (FDP-14-117F) is being issued for non-residential floodproofing and other measures that will effectively address the Substantial Damage.			