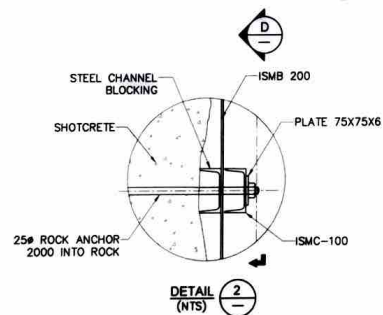
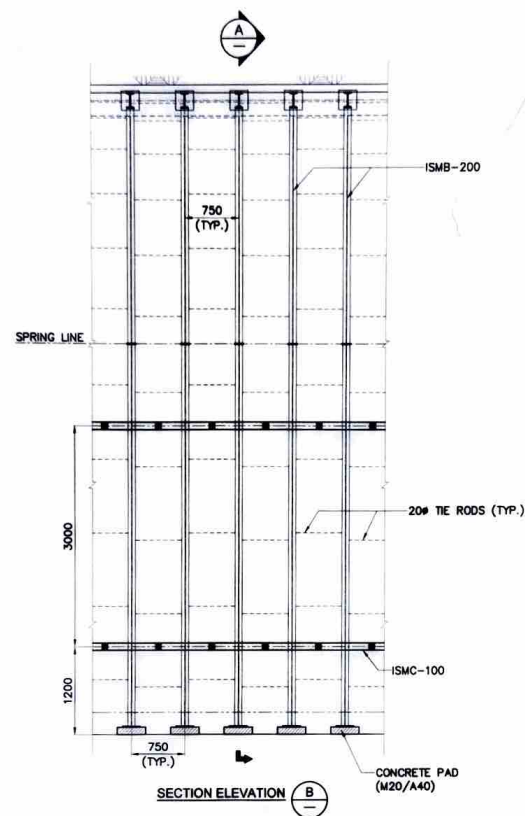

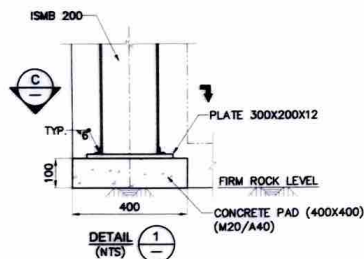
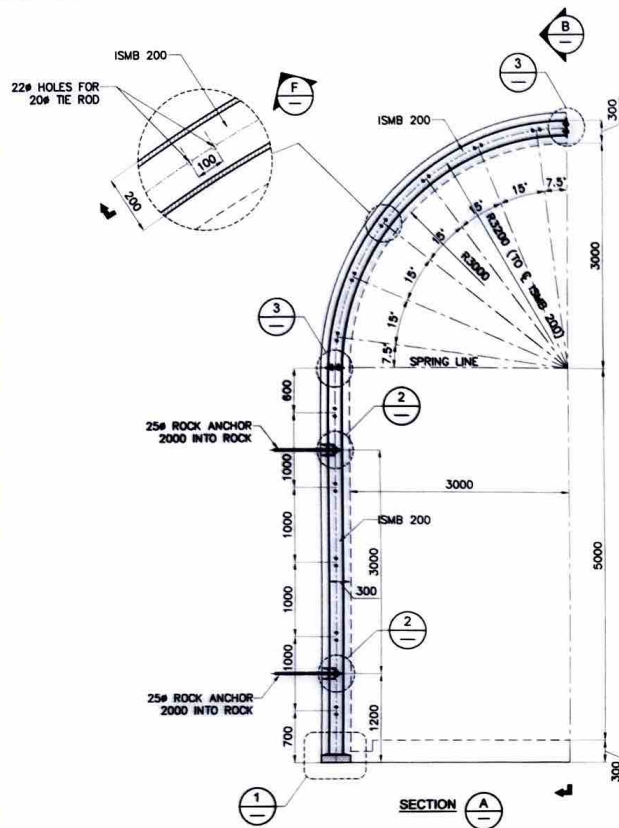



NOTES:-

1. सभी स्टील गीसीटिंग में ज्वल ज्वलिंग स्टील में दिए गए हैं।
ALL DIMENSIONS ARE IN MILLIMETERS AND LEVELS IN METERS.
2. ALL STEEL SECTIONS AND PLATES FOR RIB AND ACCESSORIES SHALL CONFORM TO SECTION B-4 OF DRAWING SPECIFICATIONS.
3. STEEL FOR BOLTS, NUTS AND WASHERS SHALL CONFORM TO IS: 8500.
4. ALL WELDING, WELDING ELECTRODES AND WORKMANSHIP SHALL CONFORM TO IS: 8161 AND IS: 8161.
5. FOOTING FOR STEEL RIBS SHALL BE PLACED ON IN-SITU CONCRETE PAD OF M20/A40 GRADE. THE CONCRETE PAD SHALL BE FOUNDATION ON FIRM ROCK.
6. THE SPACING OF RIBS SHALL BE 8750 C/C. THE SPACING OF RIBS SHALL BE MODIFIED TO SUIT THE SITE CONDITIONS WITH THE APPROVAL OF ENGINEER-IN-CHARGE.
7. THE LOCATION OF STEEL RIB JOINT, THE ROD, LOCATION OF ANCHORING BARS BE MODIFIED MARCATION TO SUIT THE SITE CONDITION.

REFERENCE DRAWINGS:

1. NHDB-4CC4-41-DD-1032 & 1033.

SCALE:



एन एच पी सी लिमिटेड
(एक नगर वा एक नगर नगर)
NHPC Limited
(A GOVT. OF INDIA UNDERTAKING ENTERPRISE)
दिवांग बहुउद्देशीय परियोजना
ANG MULTIPURPOSE PROJECT

**POWER HOUSE
BUS DUCTS (6Mx8M D-SHAPE)
STEEL RIB DETAILS**

[illegible]