
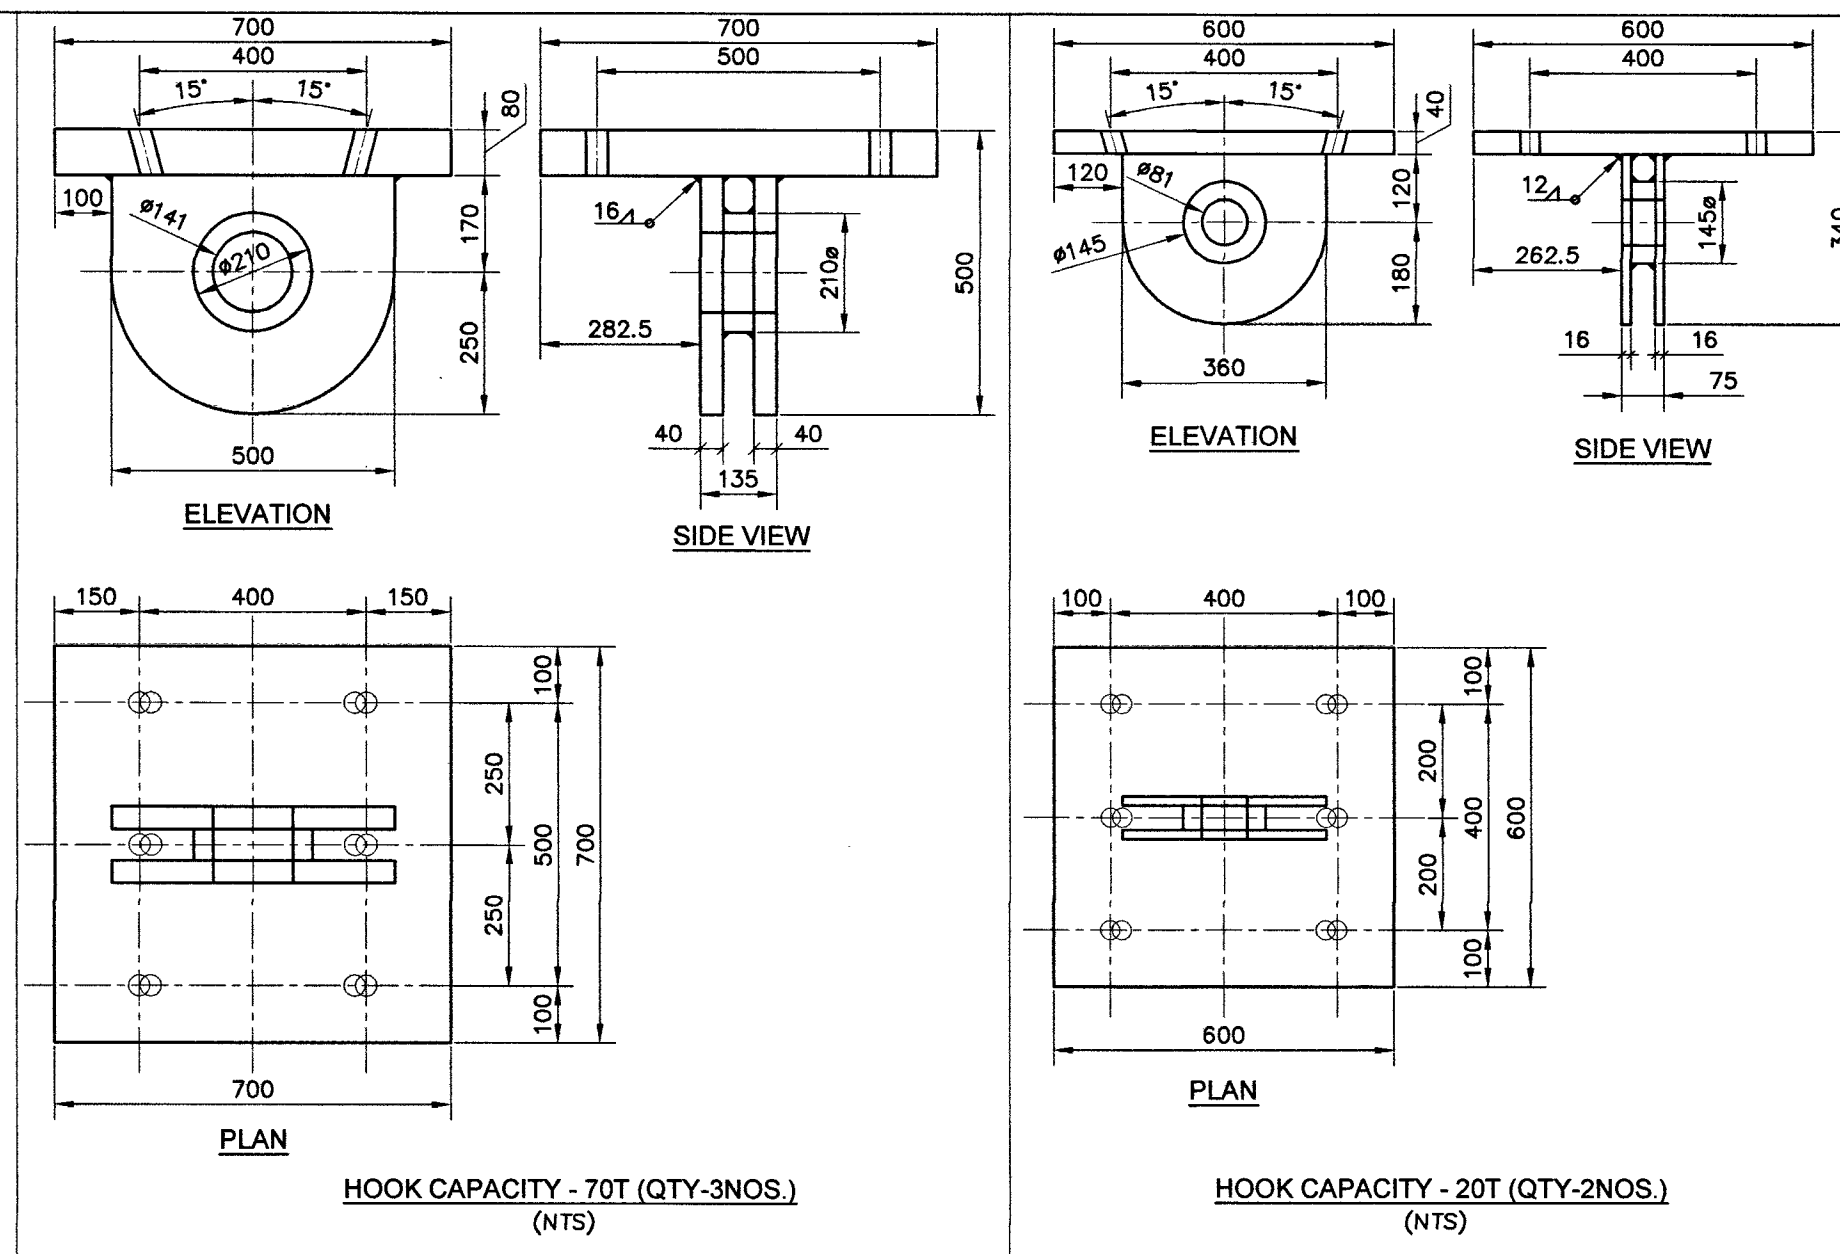


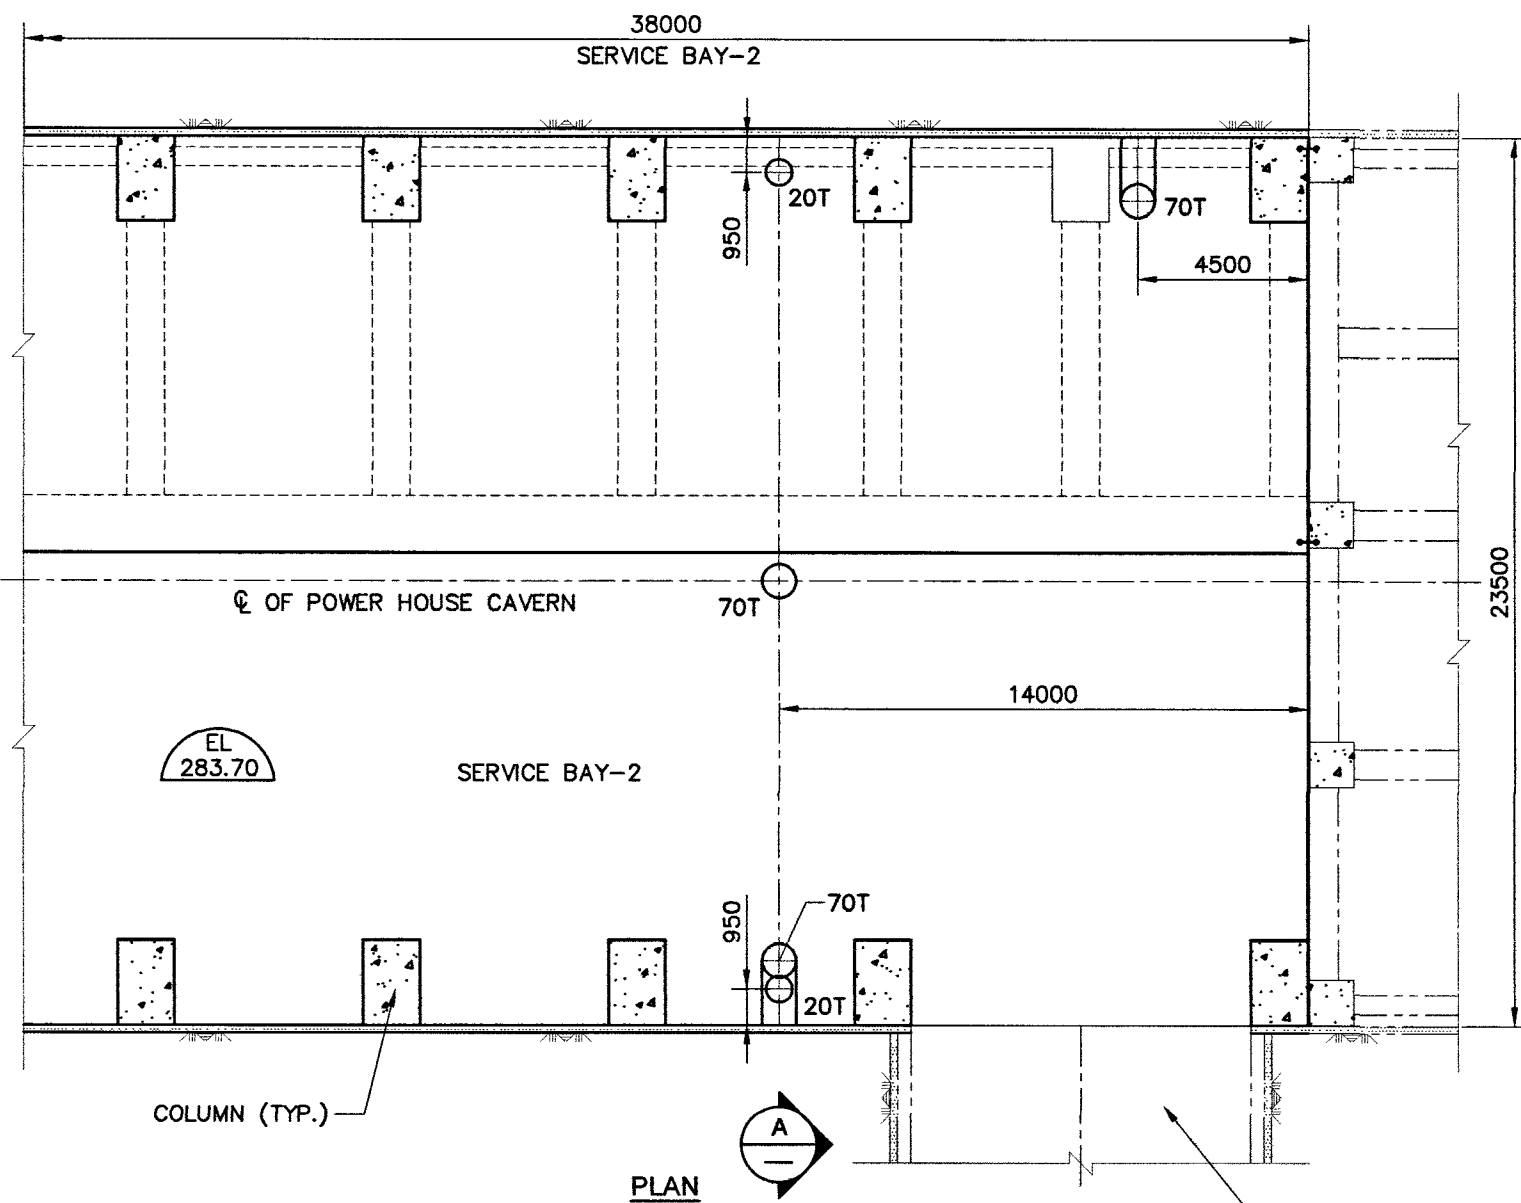







NOTES: —

1. सजी माप मिलीमीटर में तथा ऊंचाई मीटर में दिए गए हैं।
ALL DIMENSIONS ARE IN MILLIMETERS AND LEVELS IN METERS.
2. THIS DRAWING HAS BEEN DEVELOPED BASED UPON E&M DRG. NO.-PE-DC-507-501-A001A.
3. ROCK ANCHORS, THEIR INSTALLATION, TENSIONING AND TESTING SHALL CONFORM TO SECTION B.4 OF TECHNICAL SPECIFICATION.
4. THE ROCK ANCHORS SHALL BE OF HIGH YIELD STRENGTH STEEL CONFORMING TO IS:1786. THE ANCHORAGE FOR THE FULLY GROUTED ROCK ANCHORS SHALL BE OF RESIN TYPE.
5. EACH ROCK ANCHORS SHALL BE PROVIDED WITH AT LEAST 2 NOS. NUTS AND MINIMUM FREE LENGTH OF 500MM WITH THREADING.
6. IF NECESSARY THE FREE LENGTH OF ROCK ANCHORS SHALL BE CUT OR BENT FOR PROPER PLACING OF ERECTION HOOK PLATE ASSEMBLY.
7. THE EFFECTIVENESS OF EACH 36# ANCHORS & 32# ANCHORS SHALL BE CHECKED FOR A LOAD OF 18T & 9T RESPECTIVELY BY CARRYING OUT PULL OUT TESTS BEFORE INSTALLING ERECTION HOOKS ASSEMBLY AND SUBJECTING IT TO THE FINAL LOADING.
8. THE CONCRETING SHALL BE DONE AS PER SECTION B.9 OF TECHNICAL SPECIFICATIONS.
9. DESIGN OF ERECTION HOOK IS IN E&M SCOPE. SUPPLY, FABRICATION & INSTALLATION OF ALL ERECTION HOOKS TO BE DONE BY CIVIL CONTRACTOR IN CLOSE COORDINATION WITH E&M CONTRACTOR.

REFERENCE DRAWINGS:-

1. NHDB-4CC4-41-DD-1002.
2. E&M DRG. NO.-PE-DC-507-501-A001A.

SCALE :

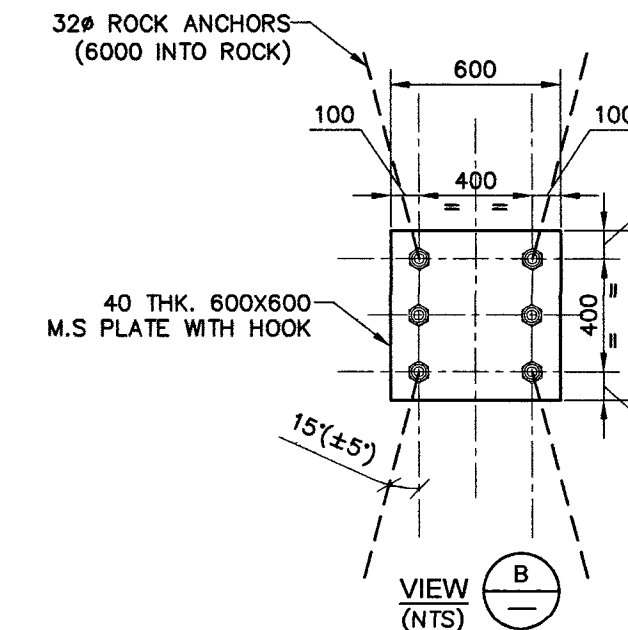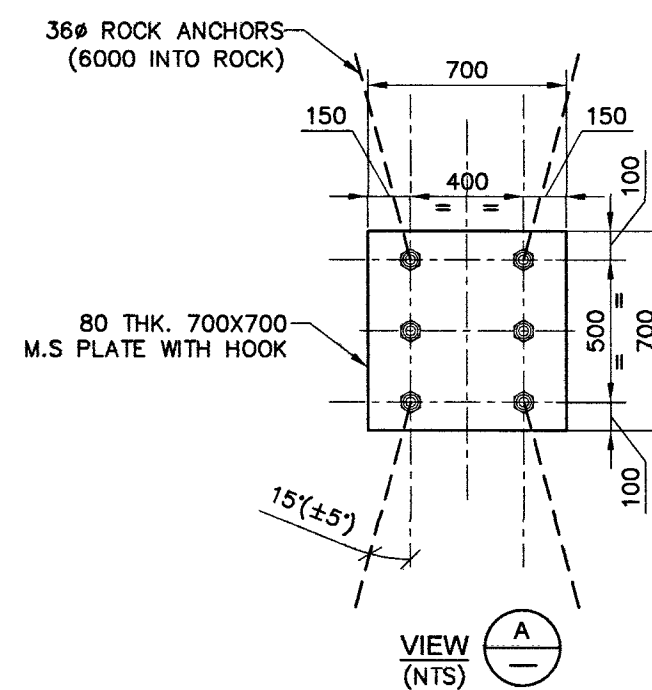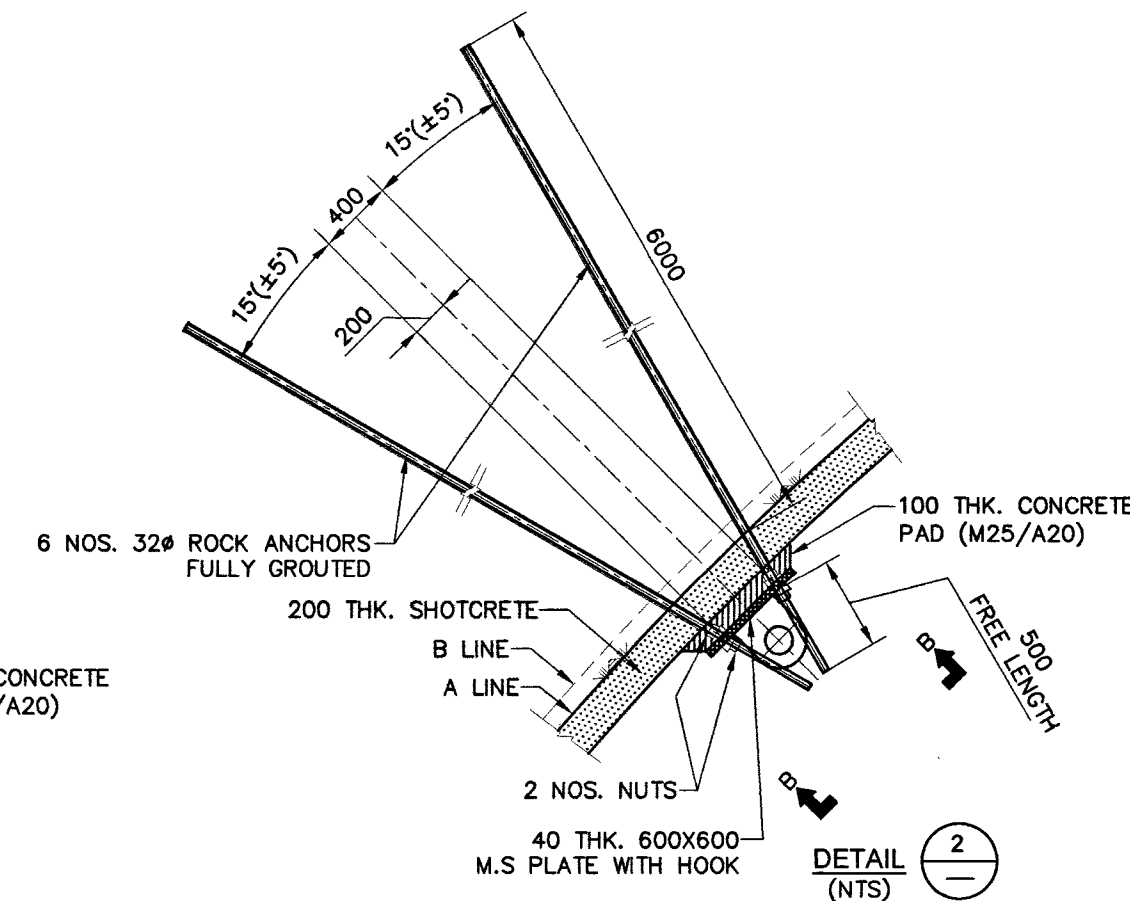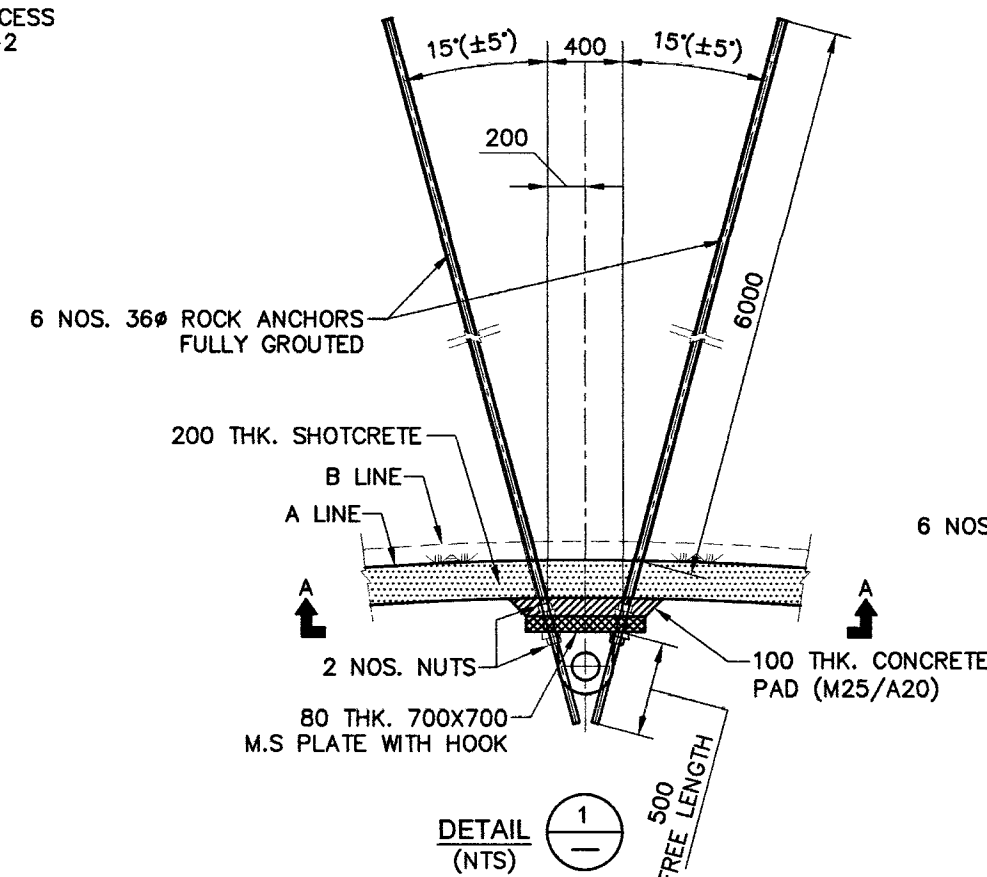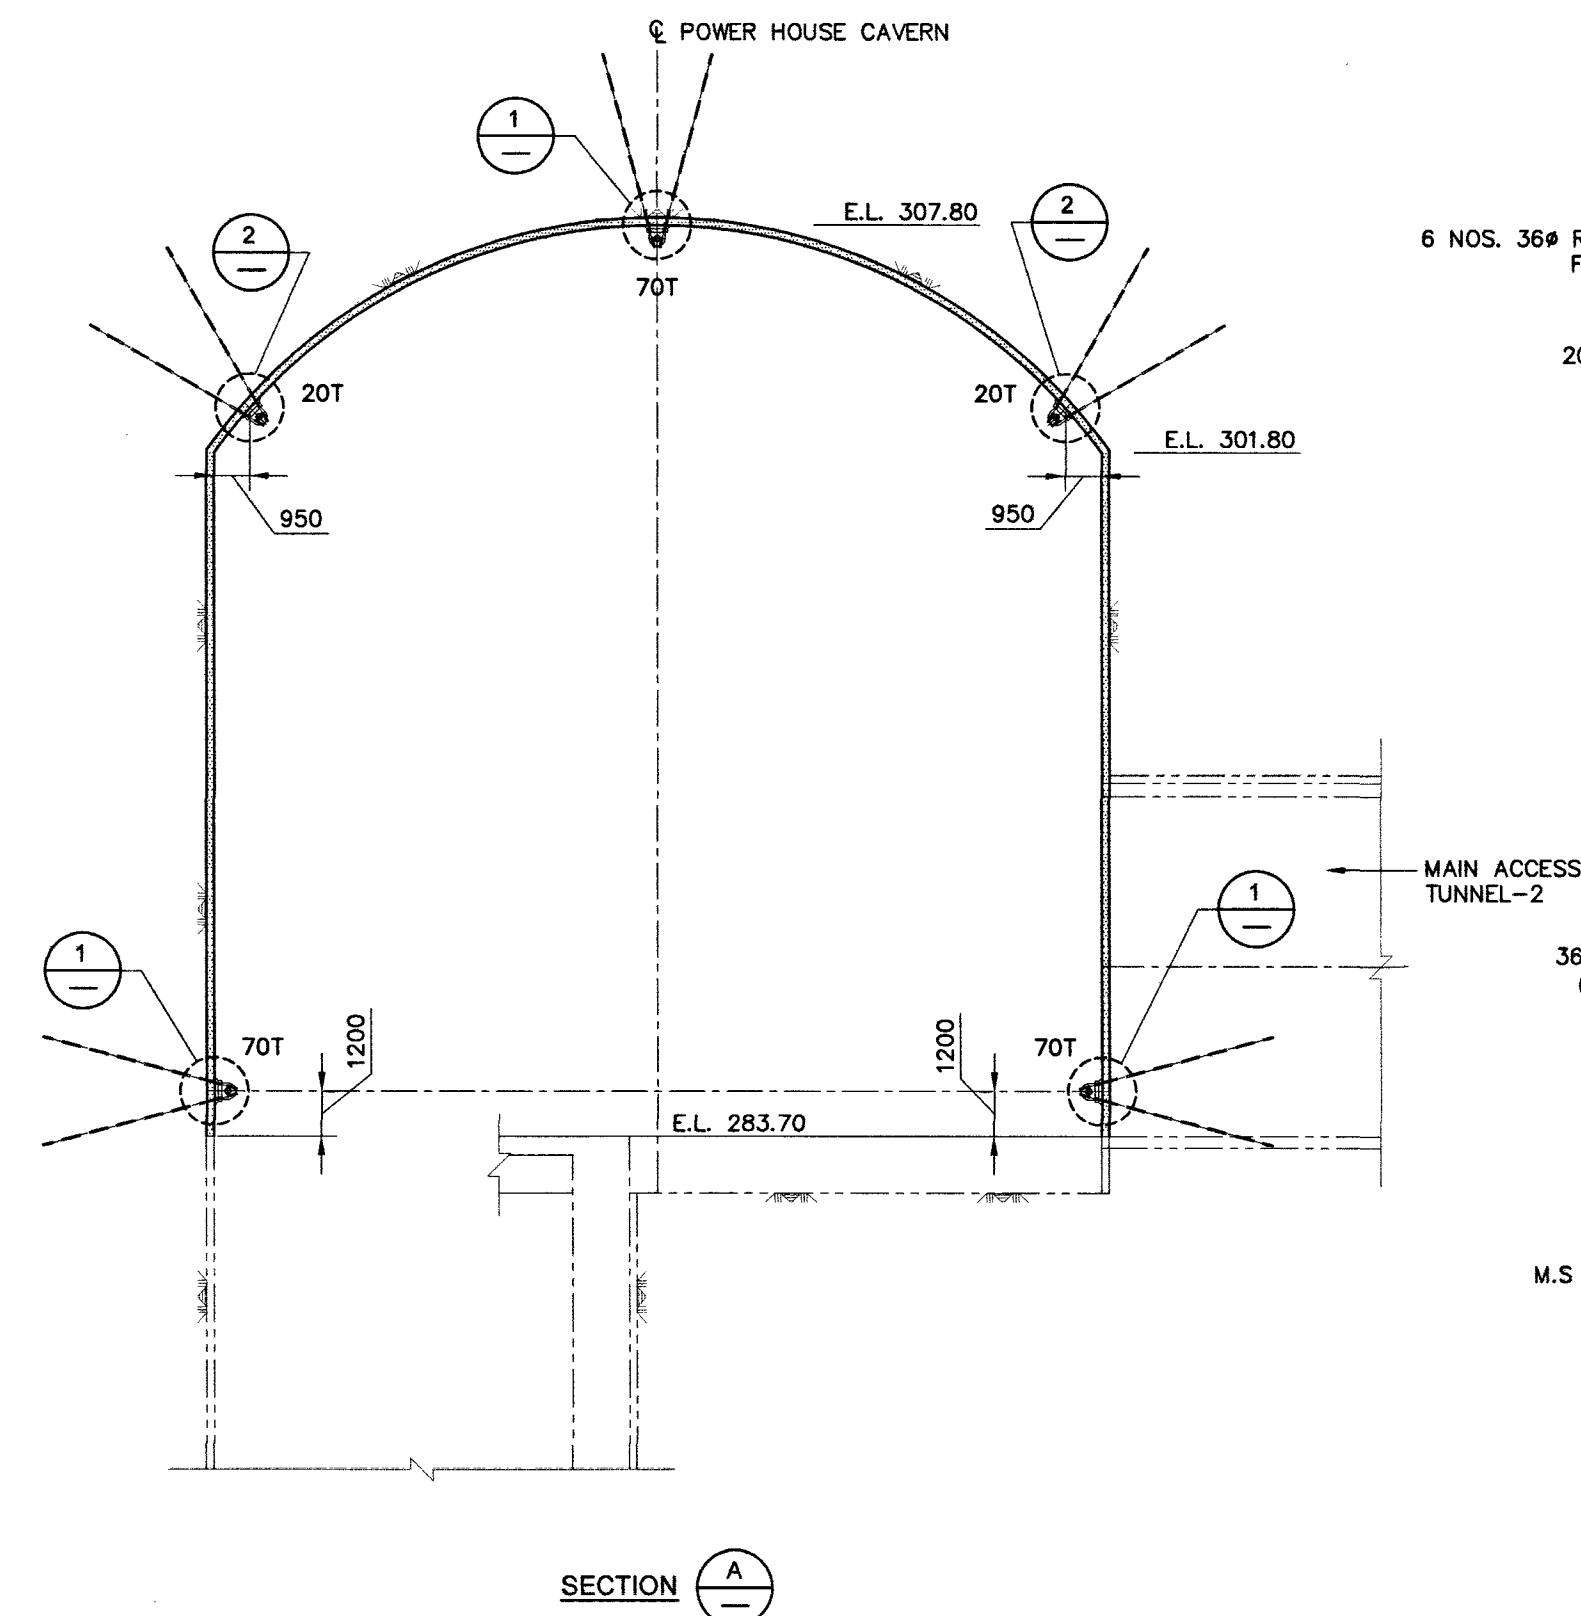

ANCHORAGE DETAILS									
15.10.2025	00	ISSUED FOR CONSTRUCTION	BY CHIEF	DEEPAK	SUBMITTED	RECOMMENDED	APPROVED		
DATE	NO.	REVISION OR ISSUES	BY	CHIEF	DEEPAK	PRABHAT ASINAI	RUNJIT KUMAR	DEVI	CHANDHURY
DESIGN MEMO NO.			DATE	OCT 2025	DRG. NO.	NHDB	4CC4 41 DD	1009	00