

SITE OCULAR REPORT

LAMPARA ELECTRICAL INSTALLATION SERVICES




CLIENT DETAILS

Name : Carlo Abanilla Date: August 8, 2026
Address : Persan Village, Tanza Cavite
Coordinates : 14.378573277485053, 120.85588935250186

Consumption / Usage Habits: ☐ Morning ☒ Evening ☐ Both

Monthly consumption(kWh): 666~ Monthly Electric Bill : 10,000~

Appliances: ☒ Air condition Unit ☒ Washing Machine
☒ Television ☐ Others:
☒ Refrigerator

Roof Type: N/A (structural support)		Support / Purlins: ☐ Wood ☐ Steel ☐ Concrete	
Roof Area: <u>36.8m^2</u>		Width <u>8</u>	Length <u>4.6</u>
Roof Access: ☒ Ladder ☐ Scaffolding ☐ Both	Mounting: ☒ L-Foot ☐ U-Type ☐ Tegula ☐ Hanger Bolt	ROOF FACING / ORIENTATION: ☒ NORTH ☐ EAST ☐ WEST ☐ SOUTH 	
EST. DC <u>25m</u>	EST. AC <u>5m</u>		
Electric Meter:	☒ Single Phase ☐ Three Phase		No. of Transformer: <u> </u>
	☒ Main Meter ☐ Sub-Meter		
	☐ Round ☐ ST5/7 ☐ CT Rated		
	Service Disconnect: ☐ Yes ☐ No Rating: <u> </u>		

SITE OCULAR REPORT

LAMPARA ELECTRICAL INSTALLATION SERVICES



		Grounding: ☐ Yes ☐ No	
Main Distribution Panel:		CB Size or Rating:	Wire Size:
Network / Connection Type: ☐ GPRS (Cellular) ☒ WiFi			No. of Floors: 2

SYSTEM PACAKAGE/DETAILS

System Capacity/Size: ☐ 3kWp ☒ 6kWp ☐ 8kWp ☐ 12kWp ☐ 16kWp	
Package: ☒ W/ Battery_ ☐ No Battery	Battery: ☐ 100Ah 5kWh ☒ 16kWh 314Ah
Panels: ☒ 610 – 630Wp ☐ 710 – 730Wp	

Notes:

*6kw inverter
*12pcs panels
*314AH battery
*Use EMT conduit for outdoor

SITE OCULAR REPORT

LAMPARA ELECTRICAL INSTALLATION SERVICES



BUILDING FRONT VIEW



ROOF VIEW (DRONE SHOT/GOOGLE EARTH)



SITE OCULAR REPORT

LAMPARA ELECTRICAL INSTALLATION SERVICES



MAIN PANEL BOARD

MERALCO METER

Please, Insert image here



MAIN CIRCUIT BREAKER

Please, Insert image here



MERALCO BILL

Please, Insert image here



ROOF WITH PANEL DESIGN




SITE OCULAR REPORT

LAMPARA ELECTRICAL INSTALLATION SERVICES




INVERTER AND BATTERY LOCATION (W or W/O BATTERY)

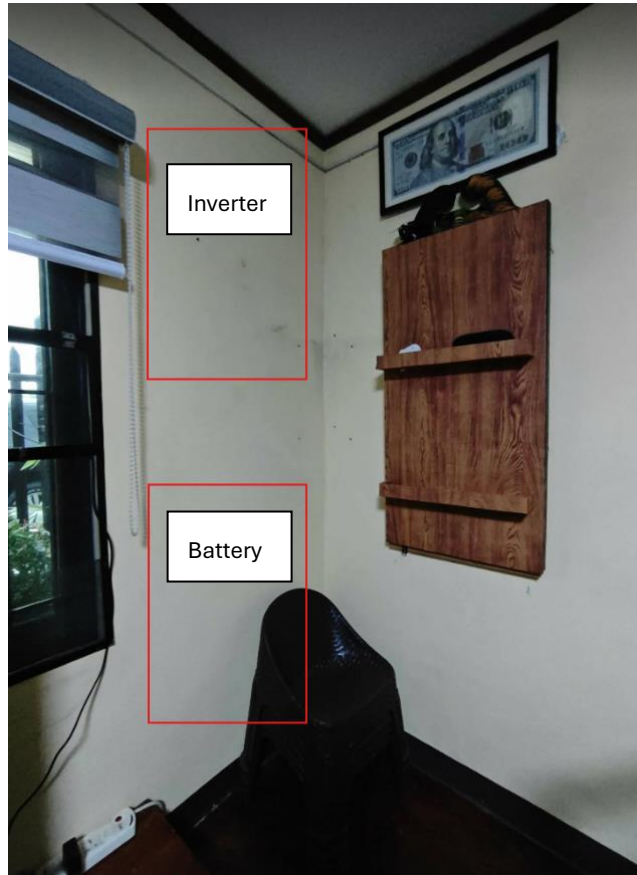

DC CONDUIT LINES

FROM PV MODULES TO INVERTER

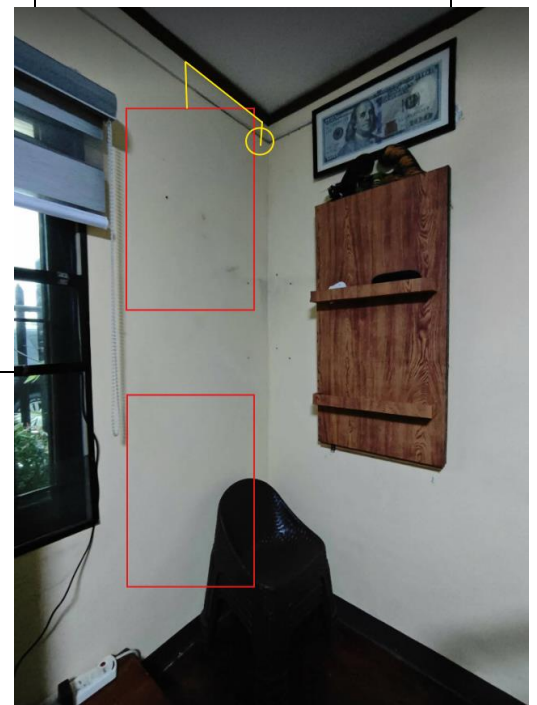

SITE OCULAR REPORT

LAMPARA ELECTRICAL INSTALLATION SERVICES



AC CONDUIT LINES

FROM INVERTER TO SOLAR DISCONNECT TO SERVICE DISCONNECT



Prepared by:	Carlo Fernan P. Abanilla	Approved by :	
Date & Signature:	August 8, 2026	Date & Signature :	