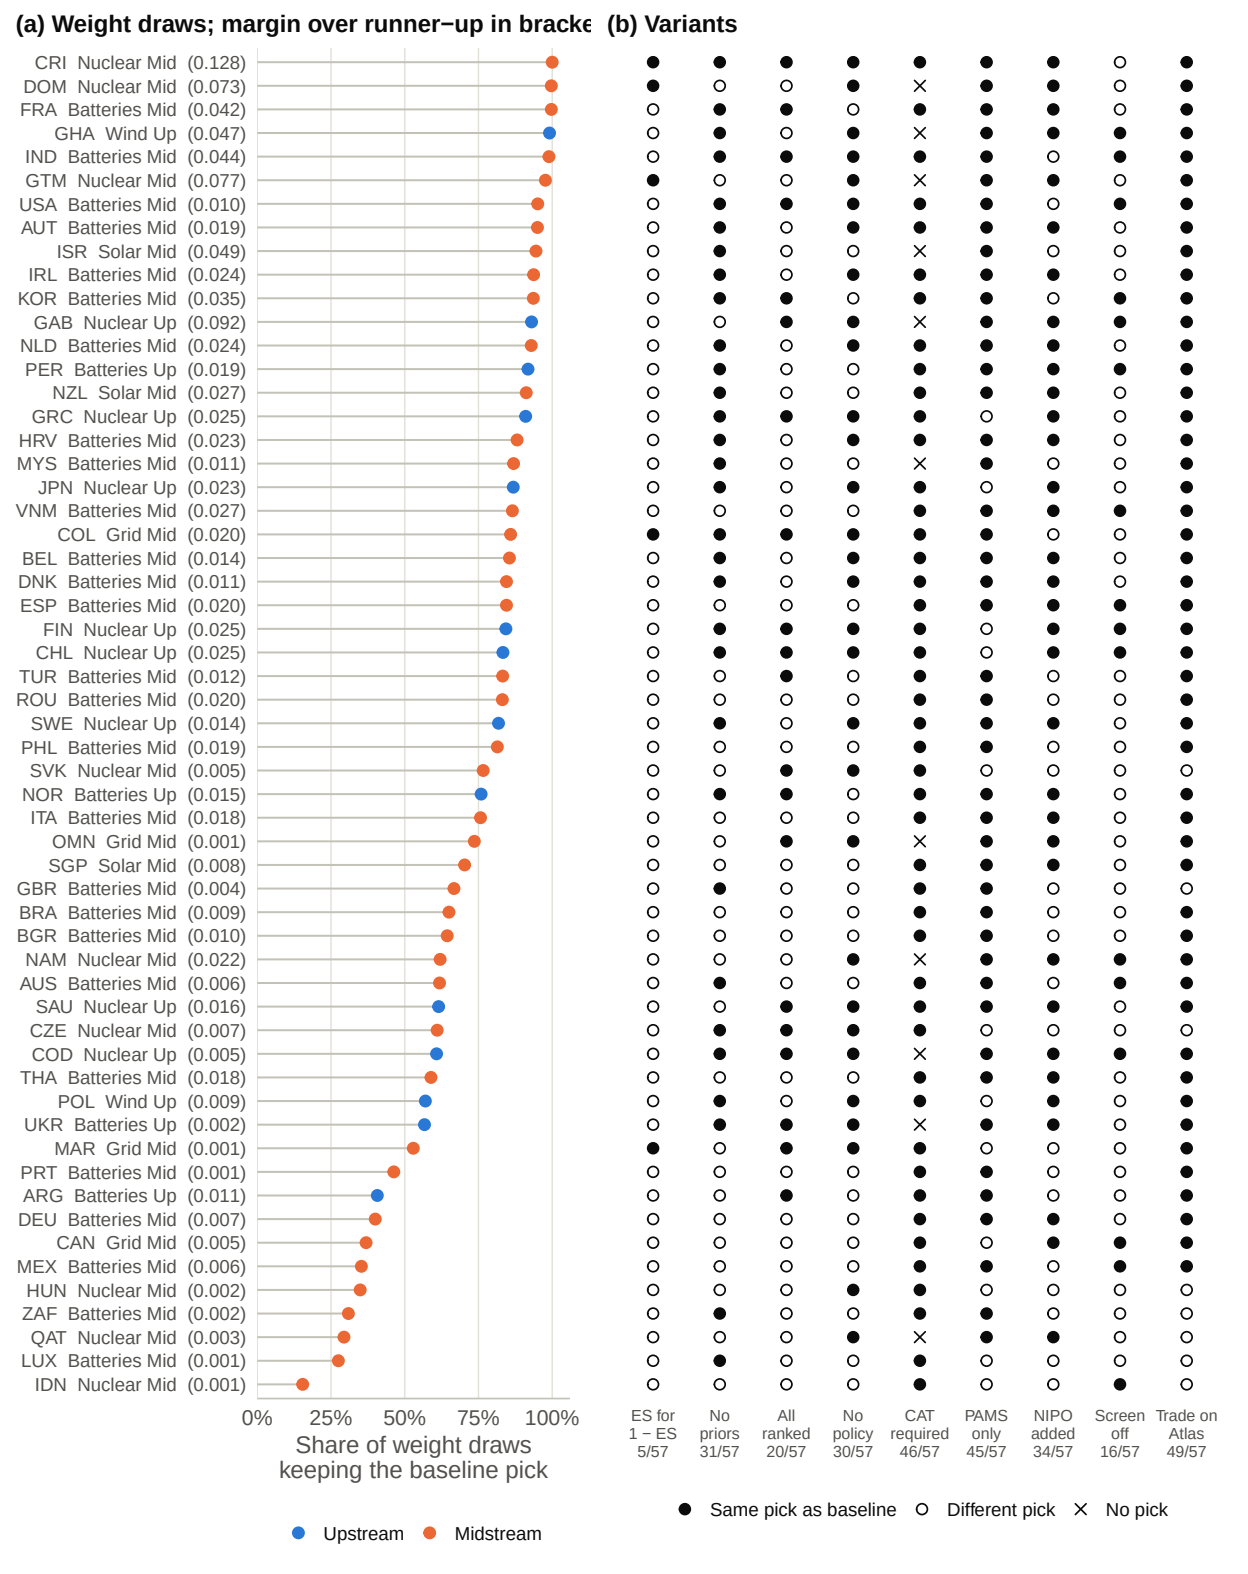
(a) Weight draws; margin over runner−up in bracke
(b) Variants
CRI Nuclear Mid (0.128)
DOM Nuclear Mid (0.073)
FRA Batteries Mid (0.042)
GHA Wind Up (0.047)
IND Batteries Mid (0.044)
GTM Nuclear Mid (0.077)
USA Batteries Mid (0.010)
AUT Batteries Mid (0.019)
ISR Solar Mid (0.049)
IRL Batteries Mid (0.024)
KOR Batteries Mid (0.035)
GAB Nuclear Up (0.092)
NLD Batteries Mid (0.024)
PER Batteries Up (0.019)
NZL Solar Mid (0.027)
GRC Nuclear Up (0.025)
HRV Batteries Mid (0.023)
MYS Batteries Mid (0.011)
JPN Nuclear Up (0.023)
VNM Batteries Mid (0.027)
COL Grid Mid (0.020)
BEL Batteries Mid (0.014)
DNK Batteries Mid (0.011)
ESP Batteries Mid (0.020)
FIN Nuclear Up (0.025)
CHL Nuclear Up (0.025)
TUR Batteries Mid (0.012)
ROU Batteries Mid (0.020)
SWE Nuclear Up (0.014)
PHL Batteries Mid (0.019)
SVK Nuclear Mid (0.005)
NOR Batteries Up (0.015)
ITA Batteries Mid (0.018)
OMN Grid Mid (0.001)
SGP Solar Mid (0.008)
GBR Batteries Mid (0.004)
BRA Batteries Mid (0.009)
BGR Batteries Mid (0.010)
NAM Nuclear Mid (0.022)
AUS Batteries Mid (0.006)
SAU Nuclear Up (0.016)
CZE Nuclear Mid (0.007)
COD Nuclear Up (0.005)
THA Batteries Mid (0.018)
POL Wind Up (0.009)
UKR Batteries Up (0.002)
MAR Grid Mid (0.001)
PRT Batteries Mid (0.001)
ARG Batteries Up (0.011)
DEU Batteries Mid (0.007)
CAN Grid Mid (0.005)
MEX Batteries Mid (0.006)
HUN Nuclear Mid (0.002)
ZAF Batteries Mid (0.002)
QAT Nuclear Mid (0.003)
LUX Batteries Mid (0.001)
IDN Nuclear Mid (0.001)
0%
25%
50%
75%
100%
Share of weight draws keeping the baseline pick
ES for 1 − ES 5/57
No priors 31/57
All ranked 20/57
No policy 30/57
CAT required 46/57
PAMS only 45/57
NIPO added 34/57
Screen off 16/57
Trade on Atlas 49/57
Upstream
Midstream
Same pick as baseline
Different pick
No pick