


2026 TORA remain — saved 12-box whole-step tube projection

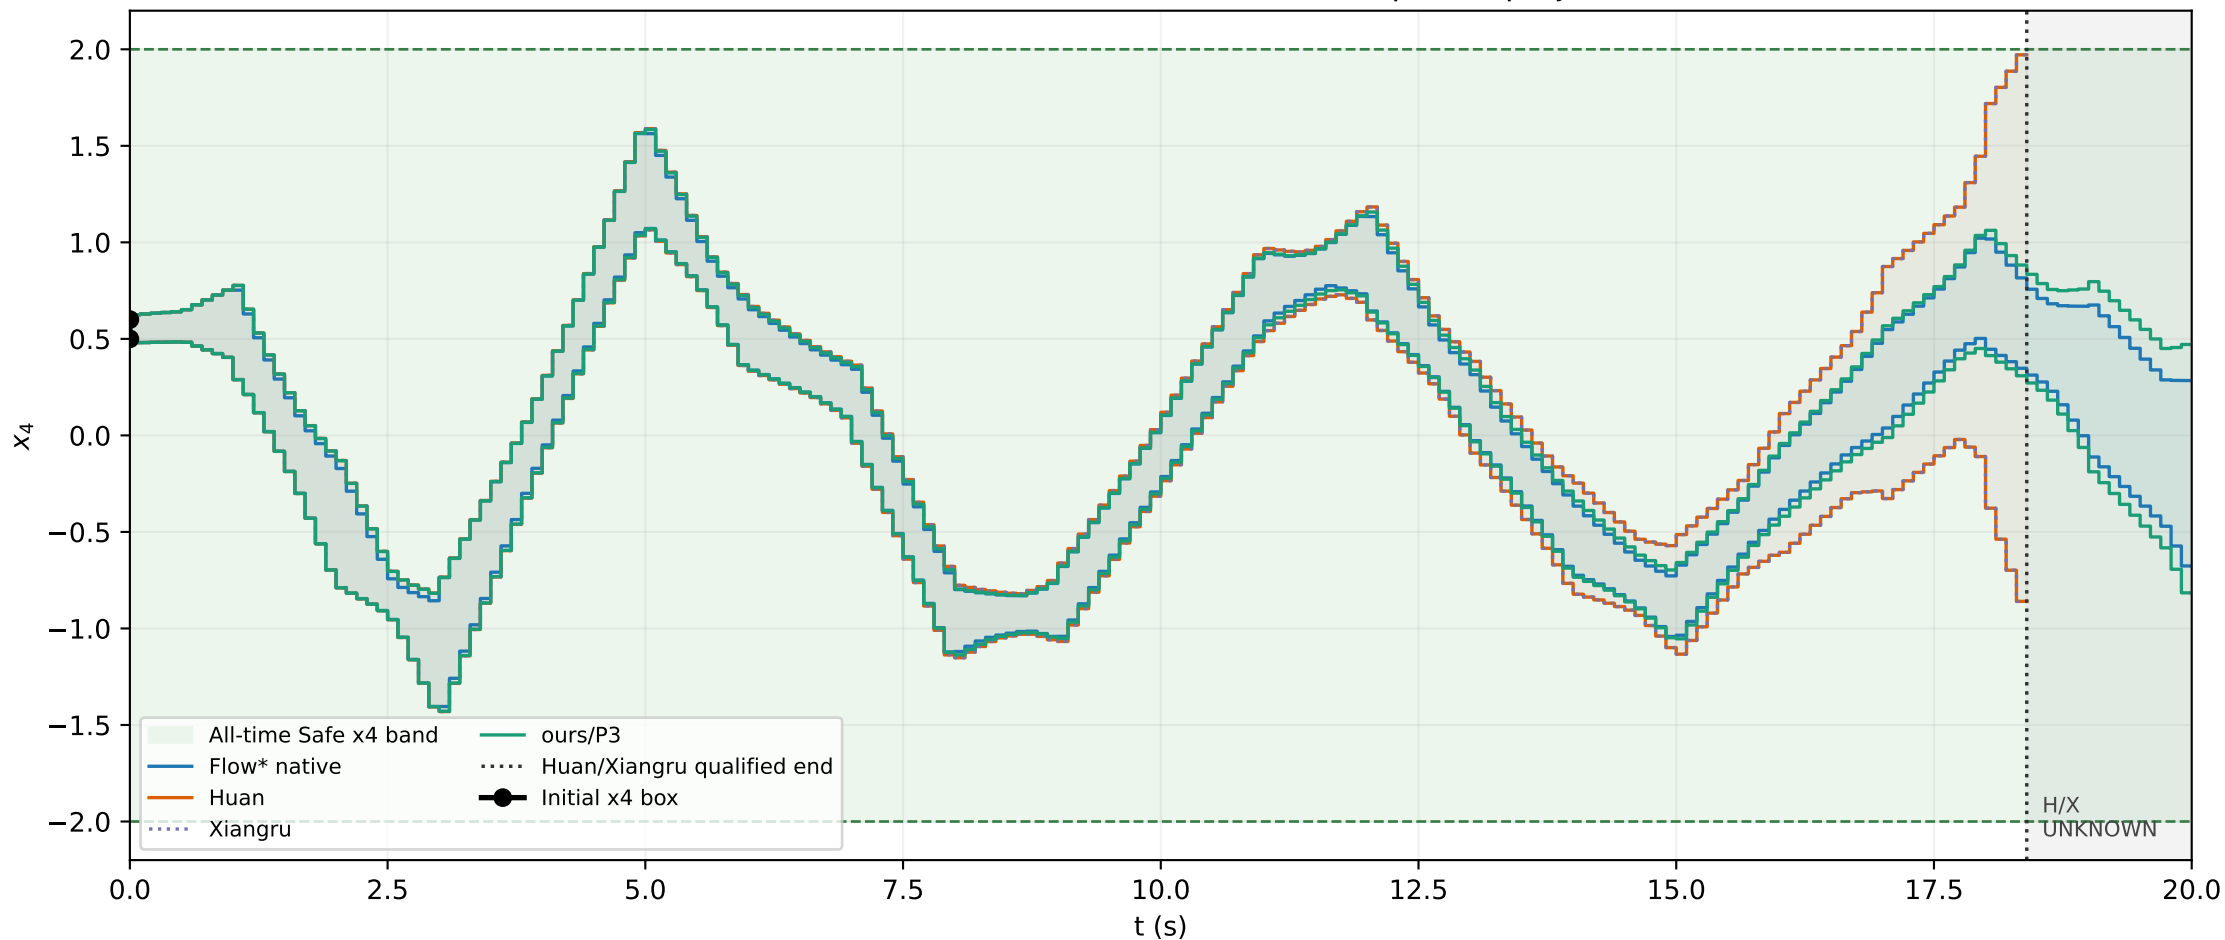

Native/P3: 12 boxes $\times$ 200 steps to $T=20$. Huan/Xiangru: qualified all-12 accepted/safe tube only through $t=18.4$; plotted bounds coincide. For Huan/Xiangru, step 185 first saved tube out of Safe; step 190 first rejection; checker Unknown. No qualified $T=20$ endpoint. Axis-aligned saved tube unions; native ranges lack accepted field. Adjacent outcomes are unbound; no end-to-end NNCS certificate.