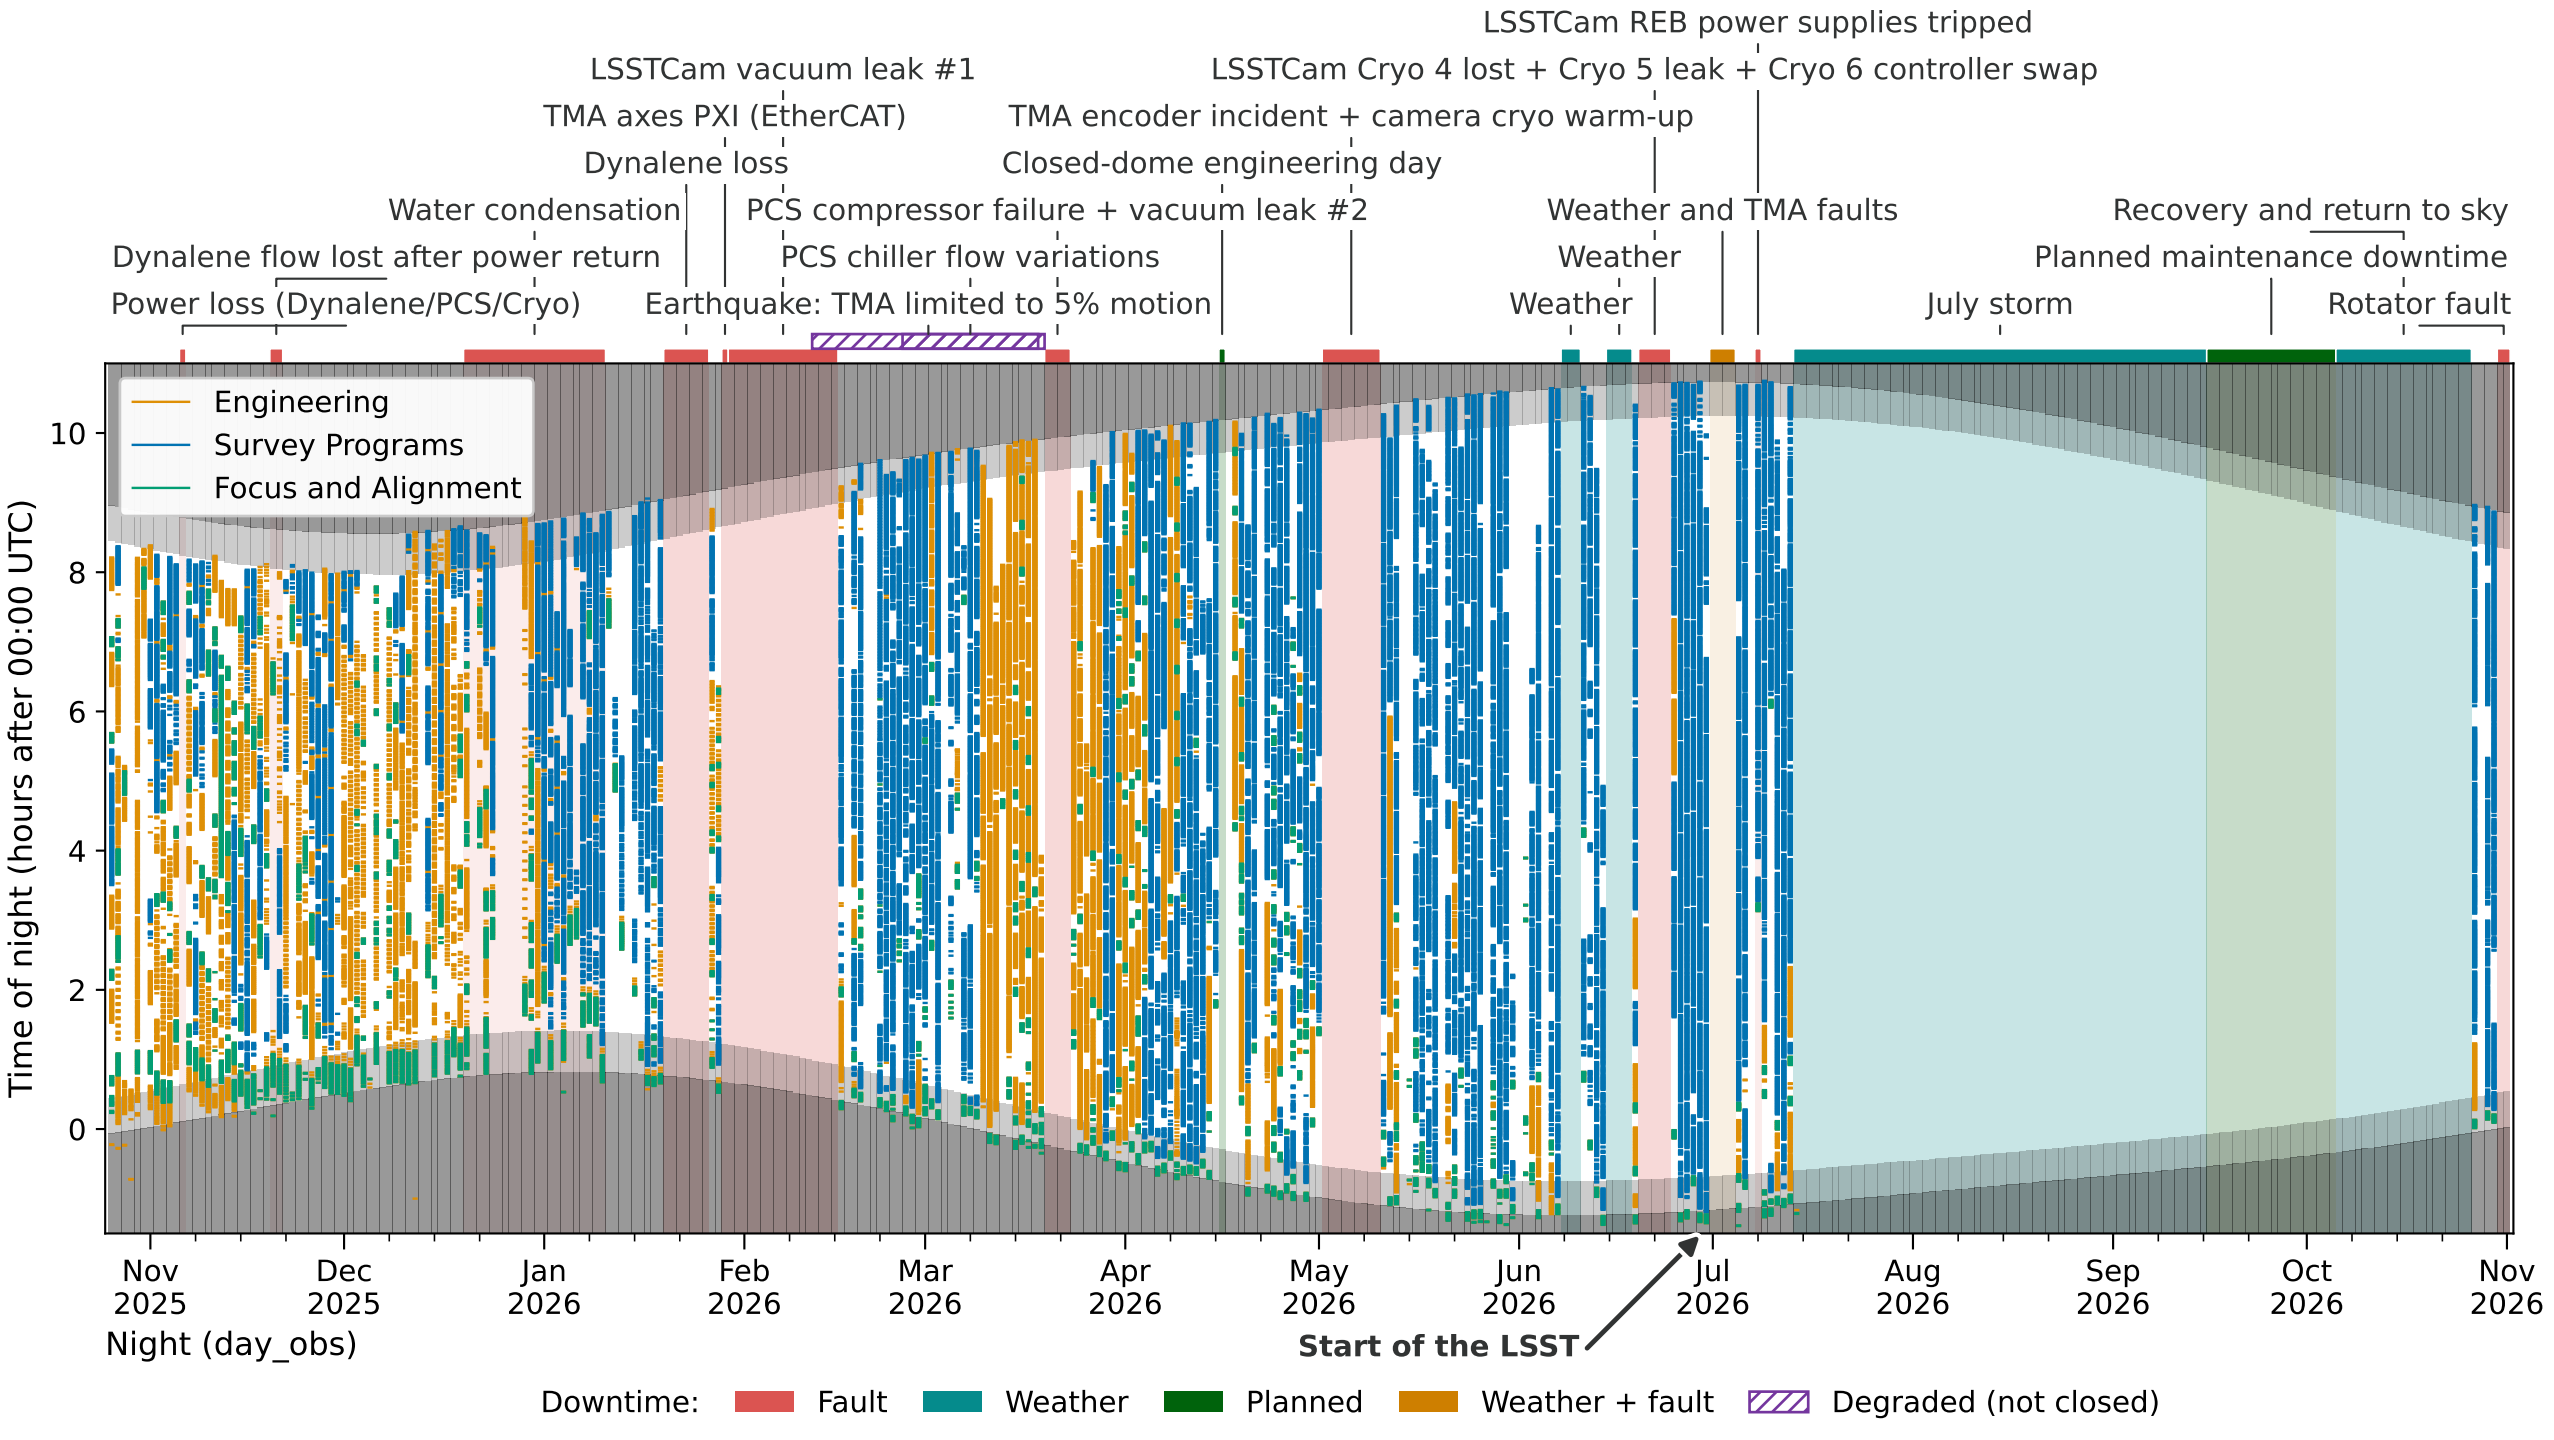

LSSTCam REB power supplies tripped
LSSTCam vacuum leak #1
LSSTCam Cryo 4 lost + Cryo 5 leak + Cryo 6 controller swap
TMA axes PXI (EtherCAT)
TMA encoder incident + camera cryo warm-up
Dynalene loss
Closed-dome engineering day
Water condensation
PCS compressor failure + vacuum leak #2
Weather and TMA faults
Recovery and return to sky
Dynalene flow lost after power return
PCS chiller flow variations
Weather
Planned maintenance downtime
Power loss (Dynalene/PCS/Cryo)
Earthquake: TMA limited to 5% motion
Weather
July storm
Rotator fault
Engineering
Survey Programs
Focus and Alignment
Time of night (hours after 00:00 UTC)
0
2
4
6
8
10
Nov 2025
Dec 2025
Jan 2026
Feb 2026
Mar 2026
Apr 2026
May 2026
Jun 2026
Jul 2026
Aug 2026
Sep 2026
Oct 2026
Nov 2026
Night (day_obs)
Start of the LSST
Downtime:
Fault
Weather
Planned
Weather + fault
Degraded (not closed)