

성수동1가 지식산업센터 신축공사

(수배전반)

2015. 05.


승인도(Rev.0)

NO.	FOR APPROVAL	DATE	DRAWN	CHECK	APPRO.	PROJECT	DRAWN	CHECK	APPRO	SCALE	NONE	FILE	DATE	DWG NO.	REV
		2015.05	LEE.H	LEE.H	YU.GW	성수동1가 지식산업센터 신축공사							2015.05		0
REVISION															




TITLE

TITLE

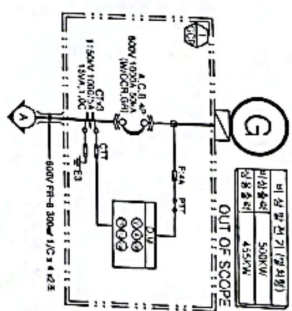


- | TC | MOB | 100NF | 225NF | 400NF |
|------------|--------|--------|--------|--------|
| 30 5000VA | 25kA이상 | 25kA이상 | 25kA이상 | 25kA이상 |
| 30 10000VA | 35kA이상 | 35kA이상 | 35kA이상 | 35kA이상 |

[illegible]

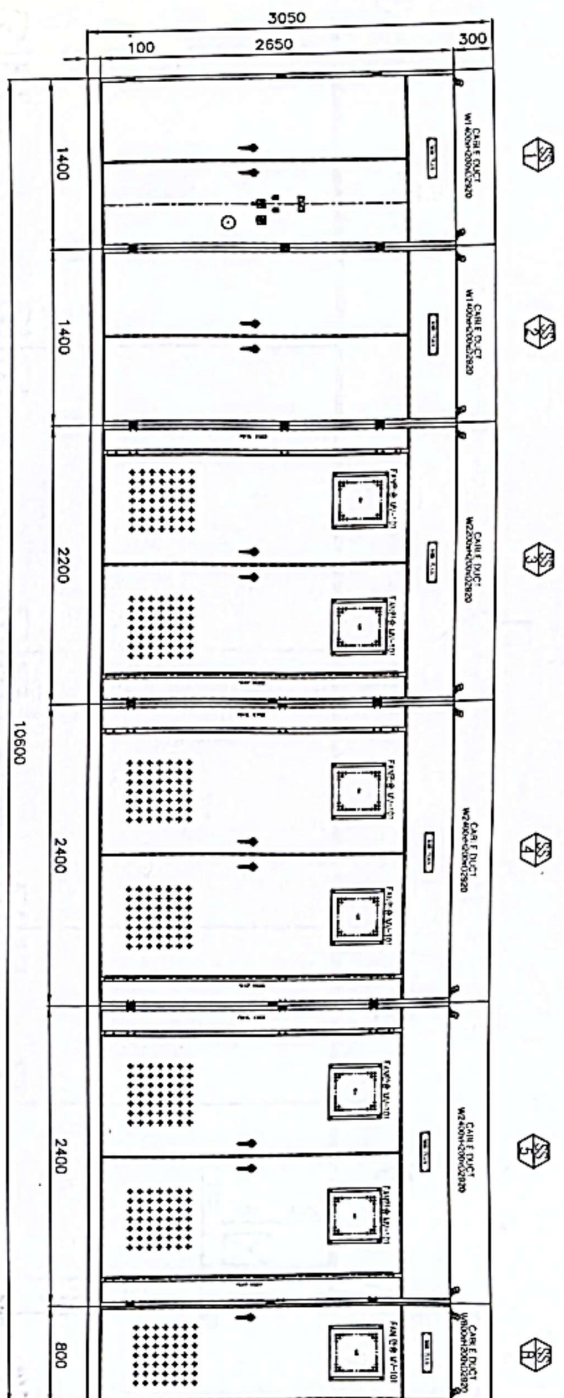

FRONT VIEW (특고측)

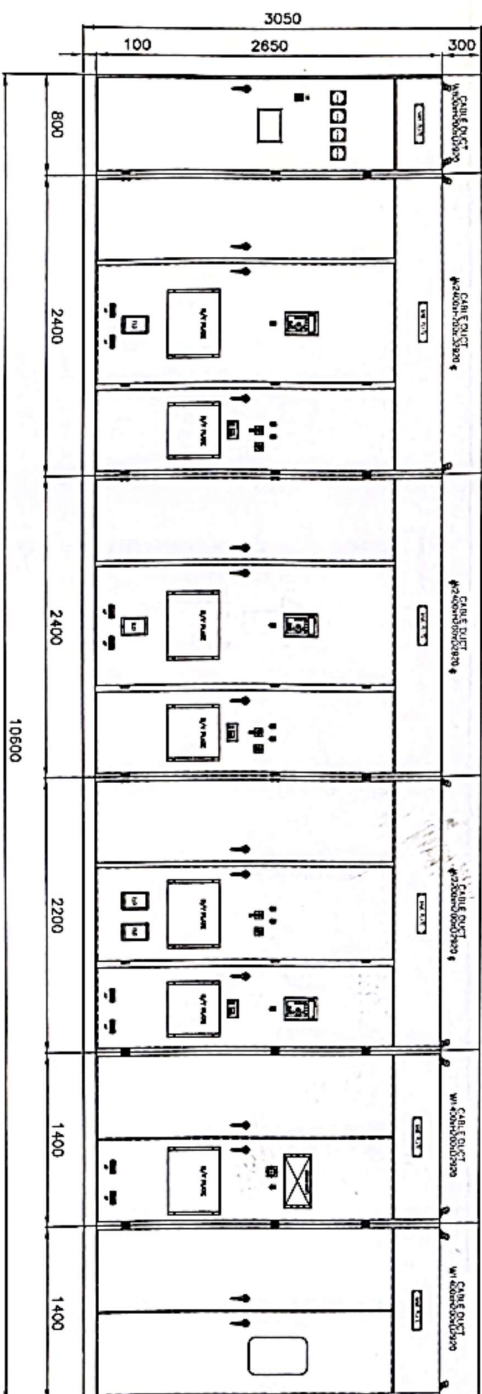


FRONT VIEW (지압측)

1. 구조 : 육각수직대면
2. 외판의 치질 치면
3. CHANNEL BASE : 51 x 100 x 50
4. FRONT DOOR : STEEL 3.2t
5. REAR DOOR : STEEL 3.2t
6. SIDE PLATE(IN) : STEEL 1.6t
7. SIDE PLATE(OUT) : STEEL 2.3t
8. OTHER PLATE : STEEL 1.6t
9. FRAME : STEEL 3.2t ANGLESS
10. PAINT COLOR : 녹+검32 (7비)인
11. CABLE IN/OUT : 불+검32 인출부
지압-인출 실패
12. TRAMPOLIN : 스프링 매트

Note

[illegible]

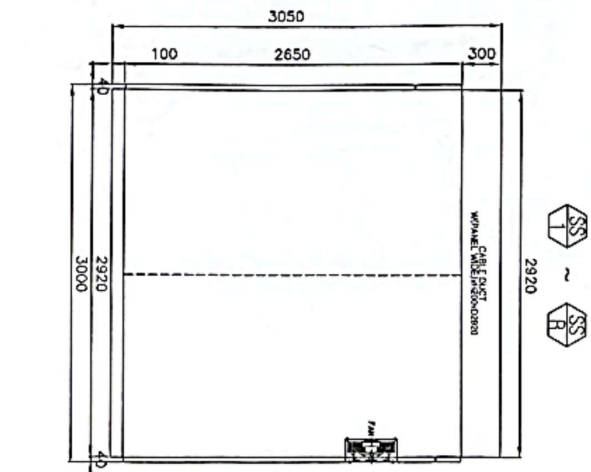


TOP VIEW

저압측

SIDE VIEW

1. 구조: 철근주철기
2. 외면의 마감처리
3. CHANNEL BASE: 50×100×60
4. FRONT DOOR: STEEL 3.2t
5. REAR DOOR: STEEL 3.2t
6. SIDE PLATE(1): STEEL 1.6t
7. SIDE PLATE(2): STEEL 2.3t
8. OTHER PLATE: STEEL 1.8t
9. FRAME: STEEL 3.2t ANGLELESS
10. PANEL COLOR: RAL-7032 (자른)
11. CABLE IN/OUT: 자른-일일 심부
12. 자른-일일 심부
13. 자른-일일 심부
14. 자른-일일 심부
15. 자른-일일 심부
16. 자른-일일 심부
17. 자른-일일 심부
18. 자른-일일 심부
19. 자른-일일 심부
20. 자른-일일 심부
21. 자른-일일 심부
22. 자른-일일 심부
23. 자른-일일 심부
24. 자른-일일 심부
25. 자른-일일 심부
26. 자른-일일 심부
27. 자른-일일 심부
28. 자른-일일 심부
29. 자른-일일 심부
30. 자른-일일 심부
31. 자른-일일 심부
32. 자른-일일 심부
33. 자른-일일 심부
34. 자른-일일 심부
35. 자른-일일 심부
36. 자른-일일 심부
37. 자른-일일 심부
38. 자른-일일 심부
39. 자른-일일 심부
40. 자른-일일 심부
41. 자른-일일 심부
42. 자른-일일 심부
43. 자른-일일 심부
44. 자른-일일 심부
45. 자른-일일 심부
46. 자른-일일 심부
47. 자른-일일 심부
48. 자른-일일 심부
49. 자른-일일 심부
50. 자른-일일 심부
51. 자른-일일 심부
52. 자른-일일 심부
53. 자른-일일 심부
54. 자른-일일 심부
55. 자른-일일 심부
56. 자른-일일 심부
57. 자른-일일 심부
58. 자른-일일 심부
59. 자른-일일 심부
60. 자른-일일 심부
61. 자른-일일 심부
62. 자른-일일 심부
63. 자른-일일 심부
64. 자른-일일 심부
65. 자른-일일 심부
66. 자른-일일 심부
67. 자른-일일 심부
68. 자른-일일 심부
69. 자른-일일 심부
70. 자른-일일 심부
71. 자른-일일 심부
72. 자른-일일 심부
73. 자른-일일 심부
74. 자른-일일 심부
75. 자른-일일 심부
76. 자른-일일 심부
77. 자른-일일 심부
78. 자른-일일 심부
79. 자른-일일 심부
80. 자른-일일 심부
81. 자른-일일 심부
82. 자른-일일 심부
83. 자른-일일 심부
84. 자른-일일 심부
85. 자른-일일 심부
86. 자른-일일 심부
87. 자른-일일 심부
88. 자른-일일 심부
89. 자른-일일 심부
90. 자른-일일 심부
91. 자른-일일 심부
92. 자른-일일 심부
93. 자른-일일 심부
94. 자른-일일 심부
95. 자른-일일 심부
96. 자른-일일 심부
97. 자른-일일 심부
98. 자른-일일 심부
99. 자른-일일 심부
100. 자른-일일 심부

[illegible]

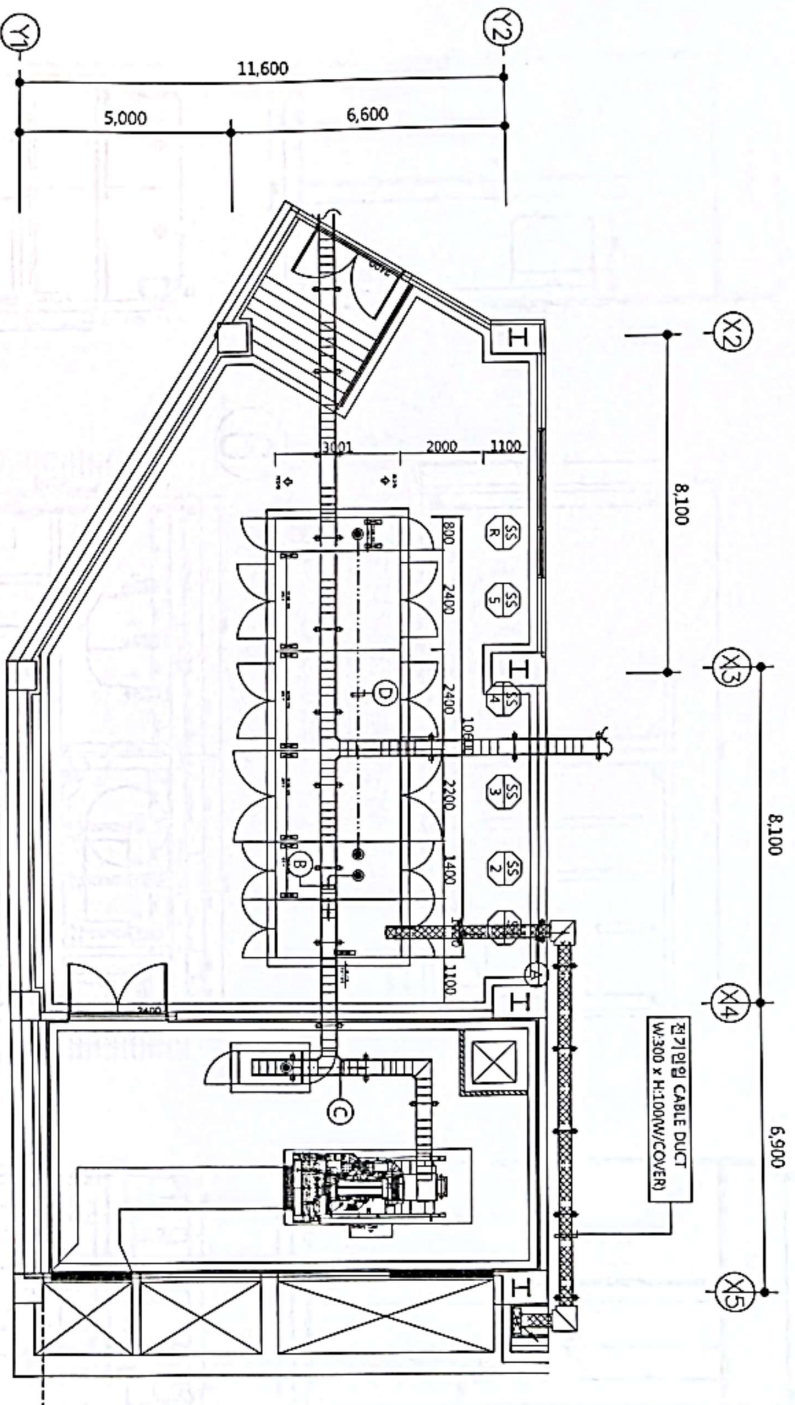

NO.	구 간	CABLE LIST
FROM	TO	
① 한국전력	SS-1	22.9kV FR-CHCOW 60mm ² - 1C x 3 x 230
② SS-3	LV-G	600V FR-8 300mm ² L/C x 4 x 230
③ LV-G	GENERATOR	600V FR-8 300mm ² L/C x 4 x 230
④ SS-3	SS-R	600V F-CV 25mm ² -3C

전기실 평면도




NO.	FOR APPROVAL	DATE	DRAWN	CHECK	APPRO
1	2015.05	LEE E.H	LEE E.H	YU G.W	
2	REVISION				

PROJECT.	성수동1가 지식산업센터 신축공사
DATE	2015.05.08
SCALE	NONE
FILE	
DATE	2015.05
DWG NO	KM15022-SH-003


TITLE	1st OUT DIAGRAM FOR SWITCHGEAR PANEL (전기실 평면도)
-------	--




1st OUT DIAGRAM FOR SWITCHGEAR PANEL (전기실 평면도)

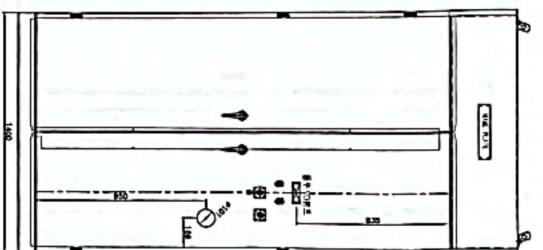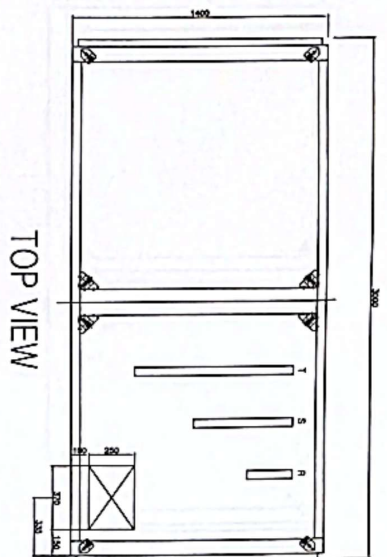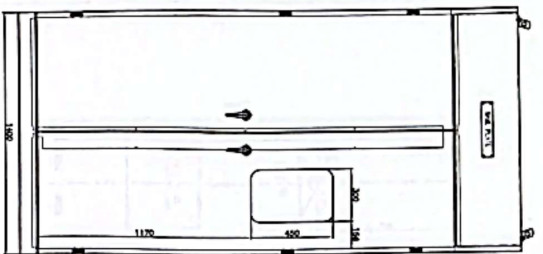


6

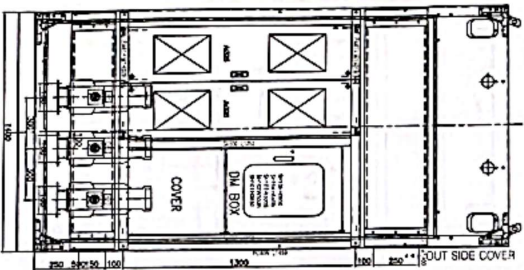

FRONT VIEW

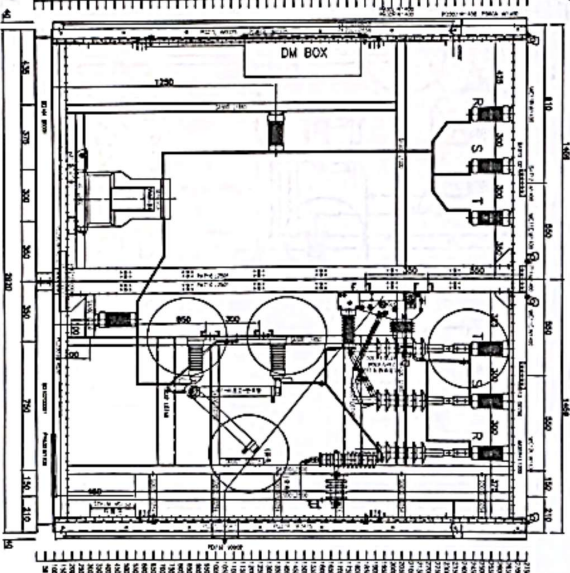

SIDE VIEW

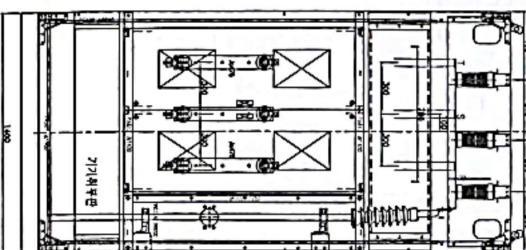

REAR VIEW

NO.	FOR APPROVAL	DATE	2015.05	LEECH	LEECH	YU.G.W	APPRO.
6	REVISION	DATE		DRAWN	CHECK		

PROJECT. 성수동1가 지식산업센터 신축공사





DRAWN	CHECK	APPRO.
DATE	DATE	DATE
2015.05.20	2015.05.20	

SCALE NONE RULE DATE 2015.05


PWG NO. KM15022-SH-004 0

TITLE LAY OUT DIAGRAM FOR SS-1 PANEL




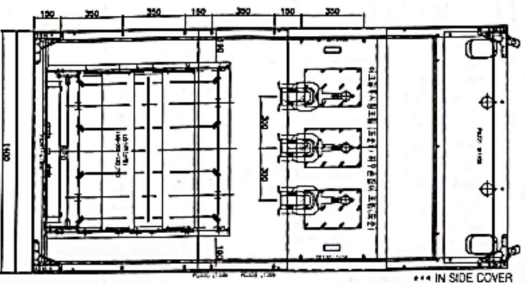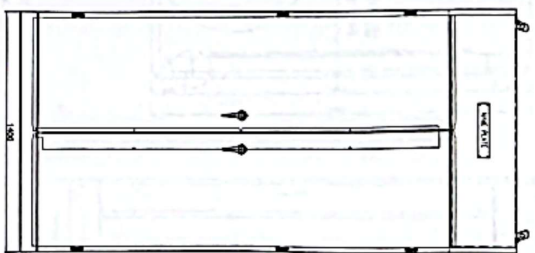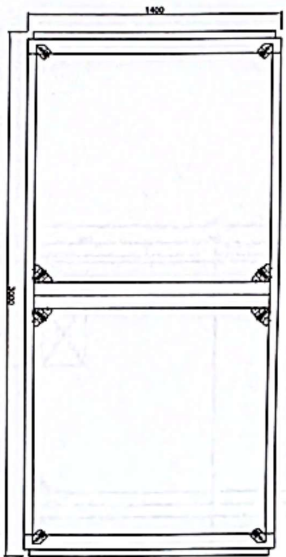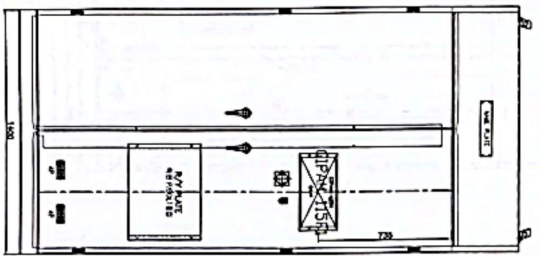

FRONT VIEW

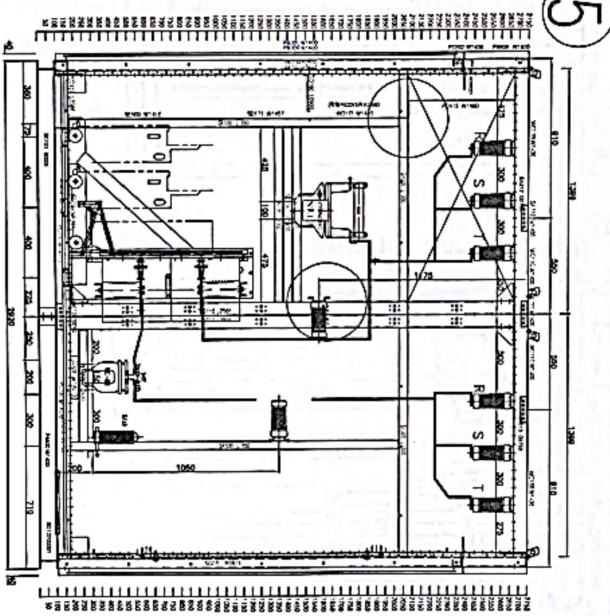

SIDE VIEW



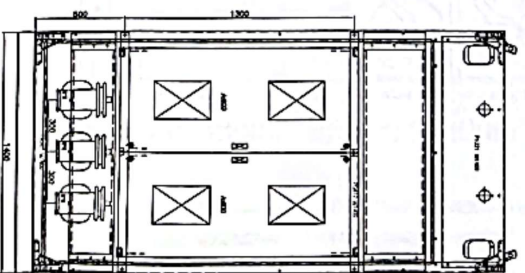


REAR VIEW



NO.		FOR APPROVAL		DATE		DRAWN		CHECK		APPRO.		PROJECT		DRAWN		CHECK		APPRO.		TITLE	
				2015.05		LEE.E.H		LEE.E.H		YU.G.W		성수동1가 지식산업센터 신축공사								LAY OUT DIAGRAM FOR SS-2 PANEL	
REVISION																					




DATE 2015.05
SCALE NONE
FILE
DATE 2015.05
JWG NO. KMI5022-SH-005.0

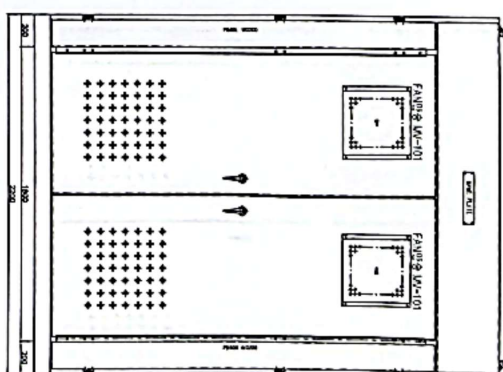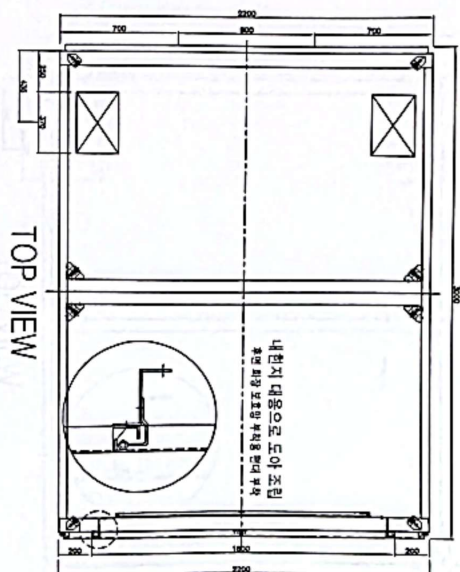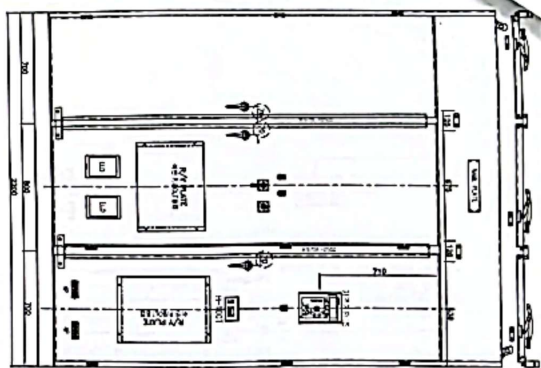


4

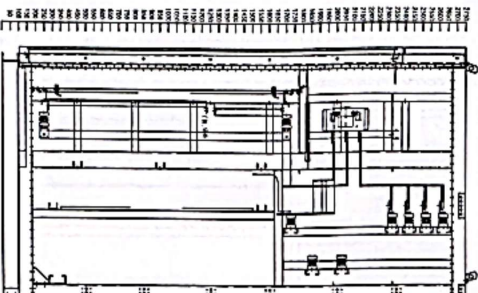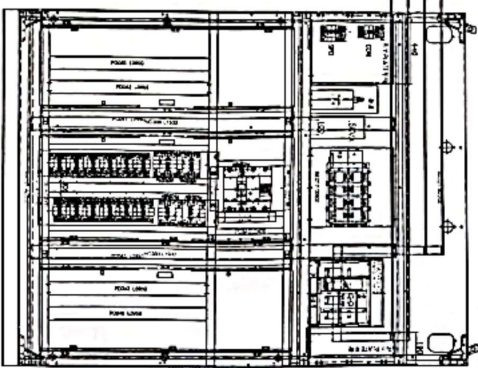


ATS SIDE VIEW

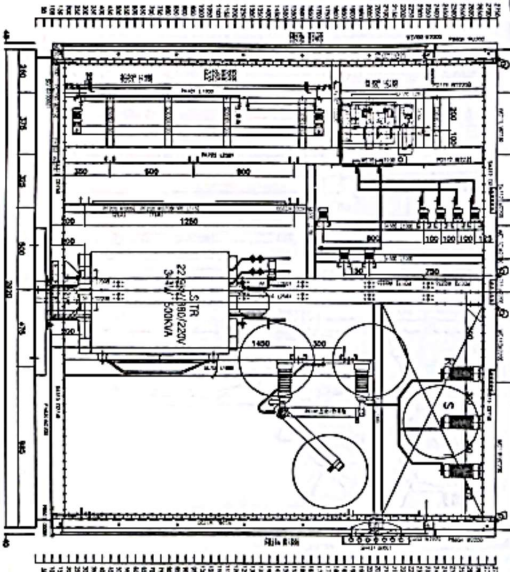


SIDE VIEW

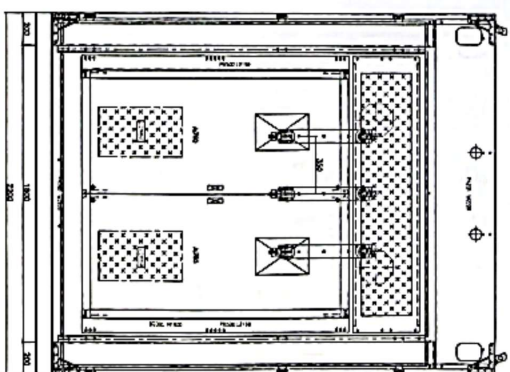

REAR VIEW

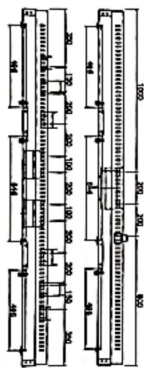










ATS SIDE VIEW

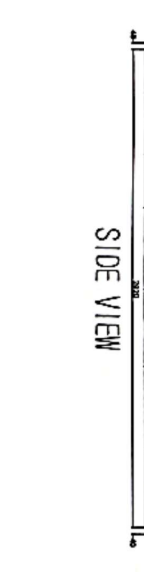

REAR VIEW









PROJECT.		DRAWN.		CHECK.		APPRO.		TITLE.	
성수동1가 지식산업센터 신축공사								LAY OUT DIAGRAM FOR SS-3 PANEL	
FOR APPROVAL		DATE.		DATE.		DATE.		DATE.	
2015.05		LEE E.H		LEE E.H		YU G.W		2015.05	
REVISION		DRAWN.		CHECK.		APPRO.		DWG NO. KAI-S022-SH-006	
NO.		DATE.		DATE.		DATE.		REV.	
6		5		4		3		2	
1		2		3		4		5	



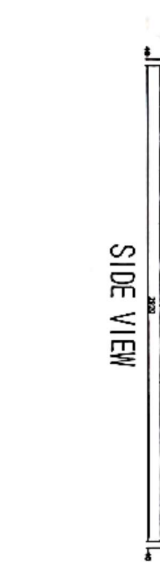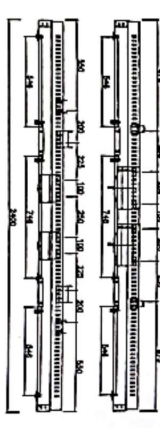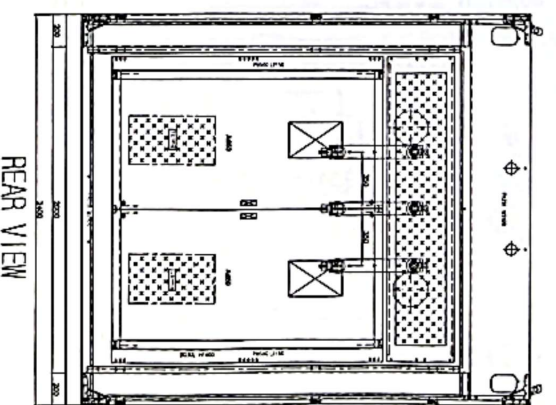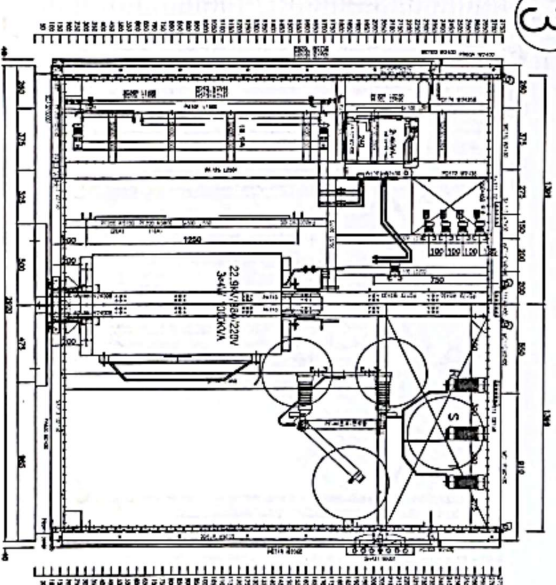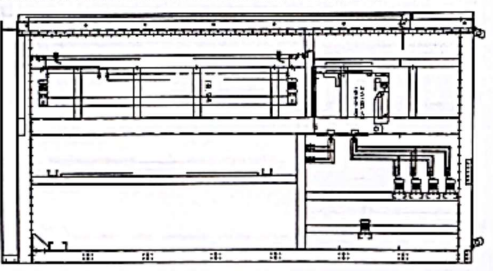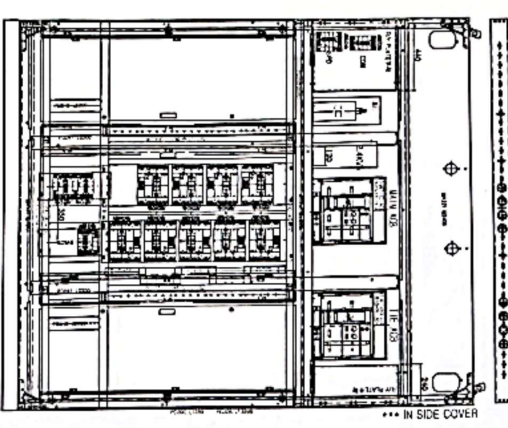
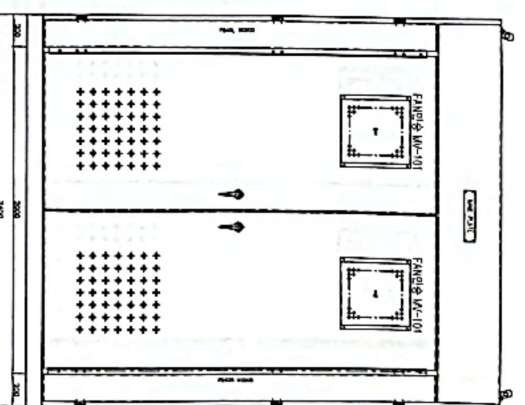
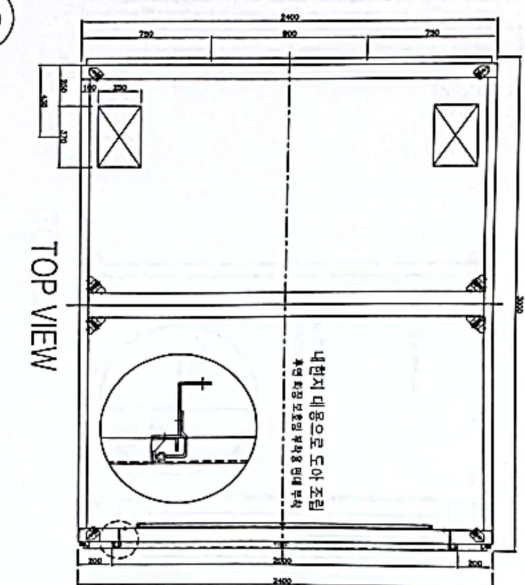
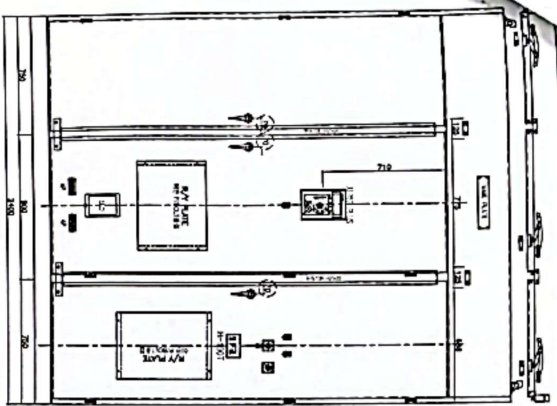


PROJECT.		DRAWN.		CHECK.		APPRO.		DATE		SCALE		FILE		DATE		DWG NO.		REV	
성수동1가 지식산업센터 신축공사																			
FOR APPROVAL		LEECH		LEECH		YU.G.W		2015.05		NONE				2015.05		KMS1022-SH-007		0	
REVISION		DATE		DRAWN		CHECK		APPRO.											


KWANG MYUNG ENT
 LAY OUT DIAGRAM FOR
 SS-4 PANEL

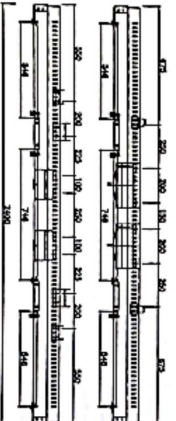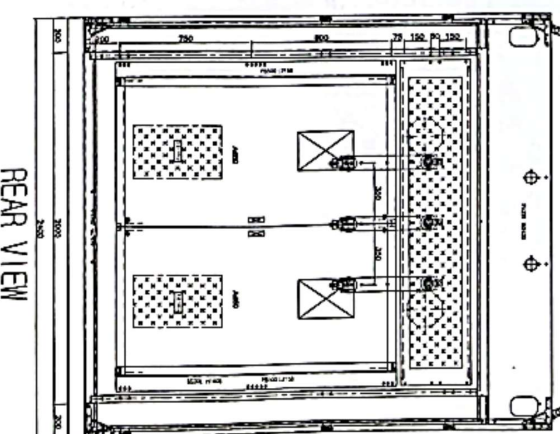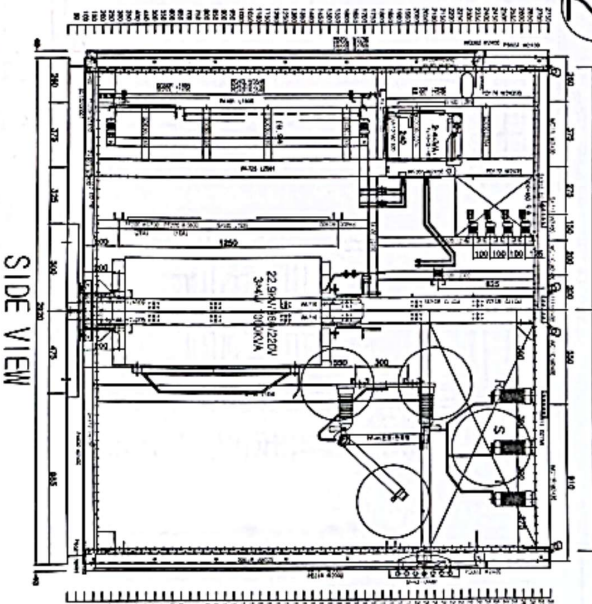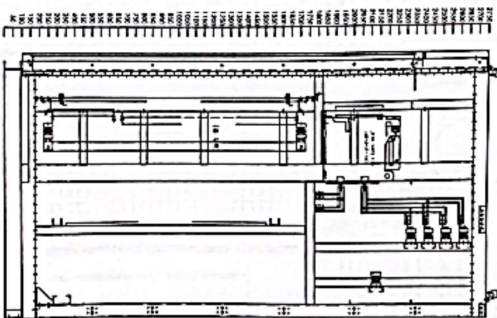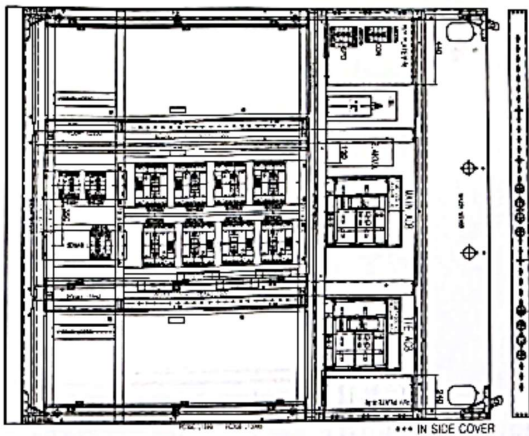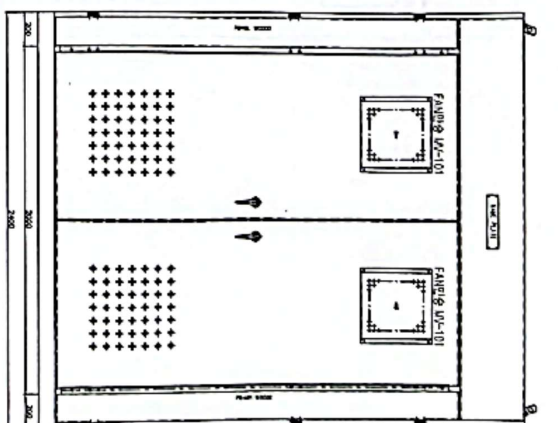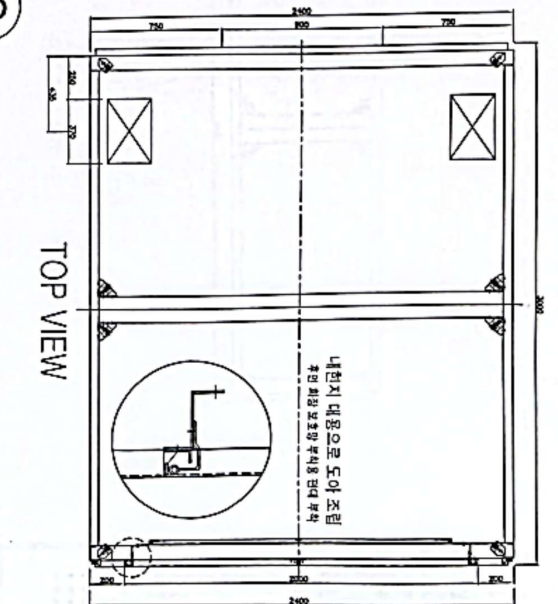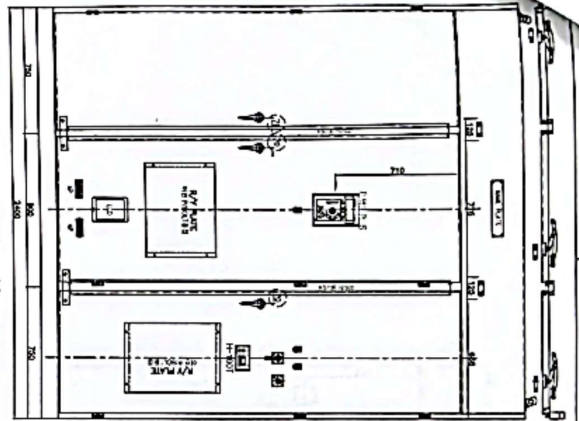


△						PROJECT. 성수동1가 지식산업센터 신축공사						
△												
△	FOR APPROVAL											
△		2015.05	LEE.H	LEE.H	Y.U.G.W							
NO.	R E V I S I O N.	DATE.	DRAWN.	CHECK.	APPRO.							
							DRAWN.	CHECK.	APPRO.			
							DATE.	DATE.	DATE.	SCALE.		
							2015.05	2015.05	2015.05	NONE	FILE.	DATE.
							2015.05	2015.05	2015.05			
							 KWANGMYUNG E.N.T Engineering Kwangmyung Engineering Co., Ltd. Exotic New Technology Co., Ltd.			TITLE LAY OUT DIAGRAM FOR SS-5 PANEL		
							DWG NO.	KM15022-SH-008	REV.			

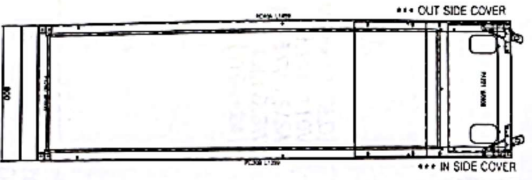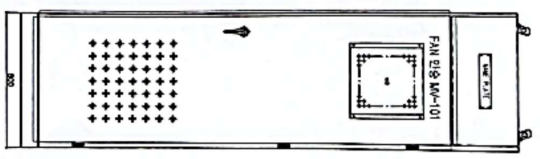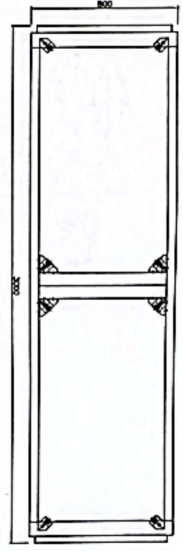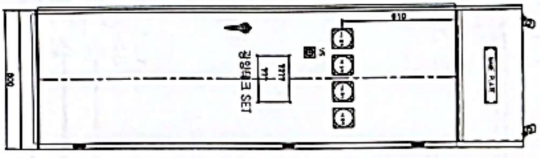

FRONT VIEW

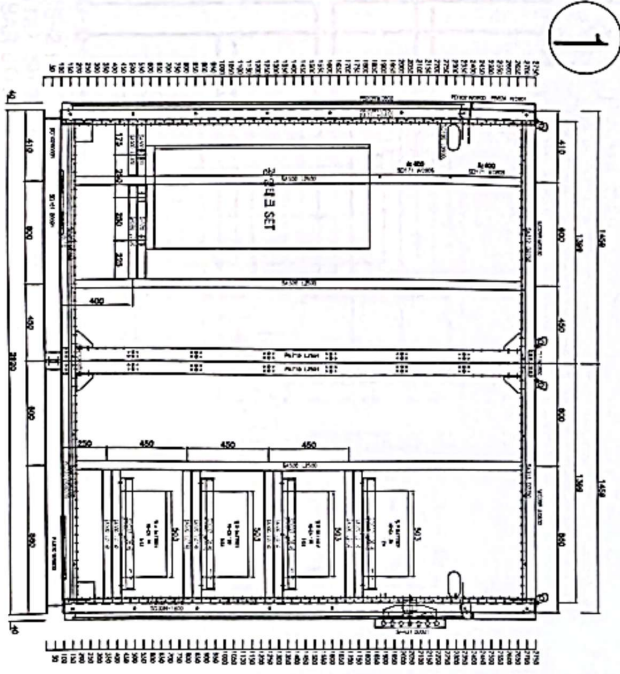

SIDE VIEW

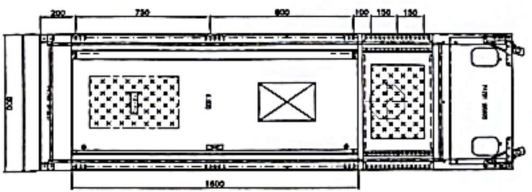


REAR VIEW

1

NO.	FOR APPROVAL	DATE	DRAWN	CHECK	APPRO	PROJECT	DRAWN	CHECK	APPRO	DATE	DATE	DATE	SCALE	FILE	DATE	TITLE
1	2015.05	LEE.E.H	LEE.E.H	YIL.C.W	성수동1가 지식산업센터 신축공사					2015.05.20	2015.05	2015.05	NONE			LAY OUT DIAGRAM FOR SS-R PANEL
2																
3																
4																
5																
6																



KRWANG MYUNG ENT.
ENGINEERING CO., LTD.
DWG NO. KMT5022-SHLD09

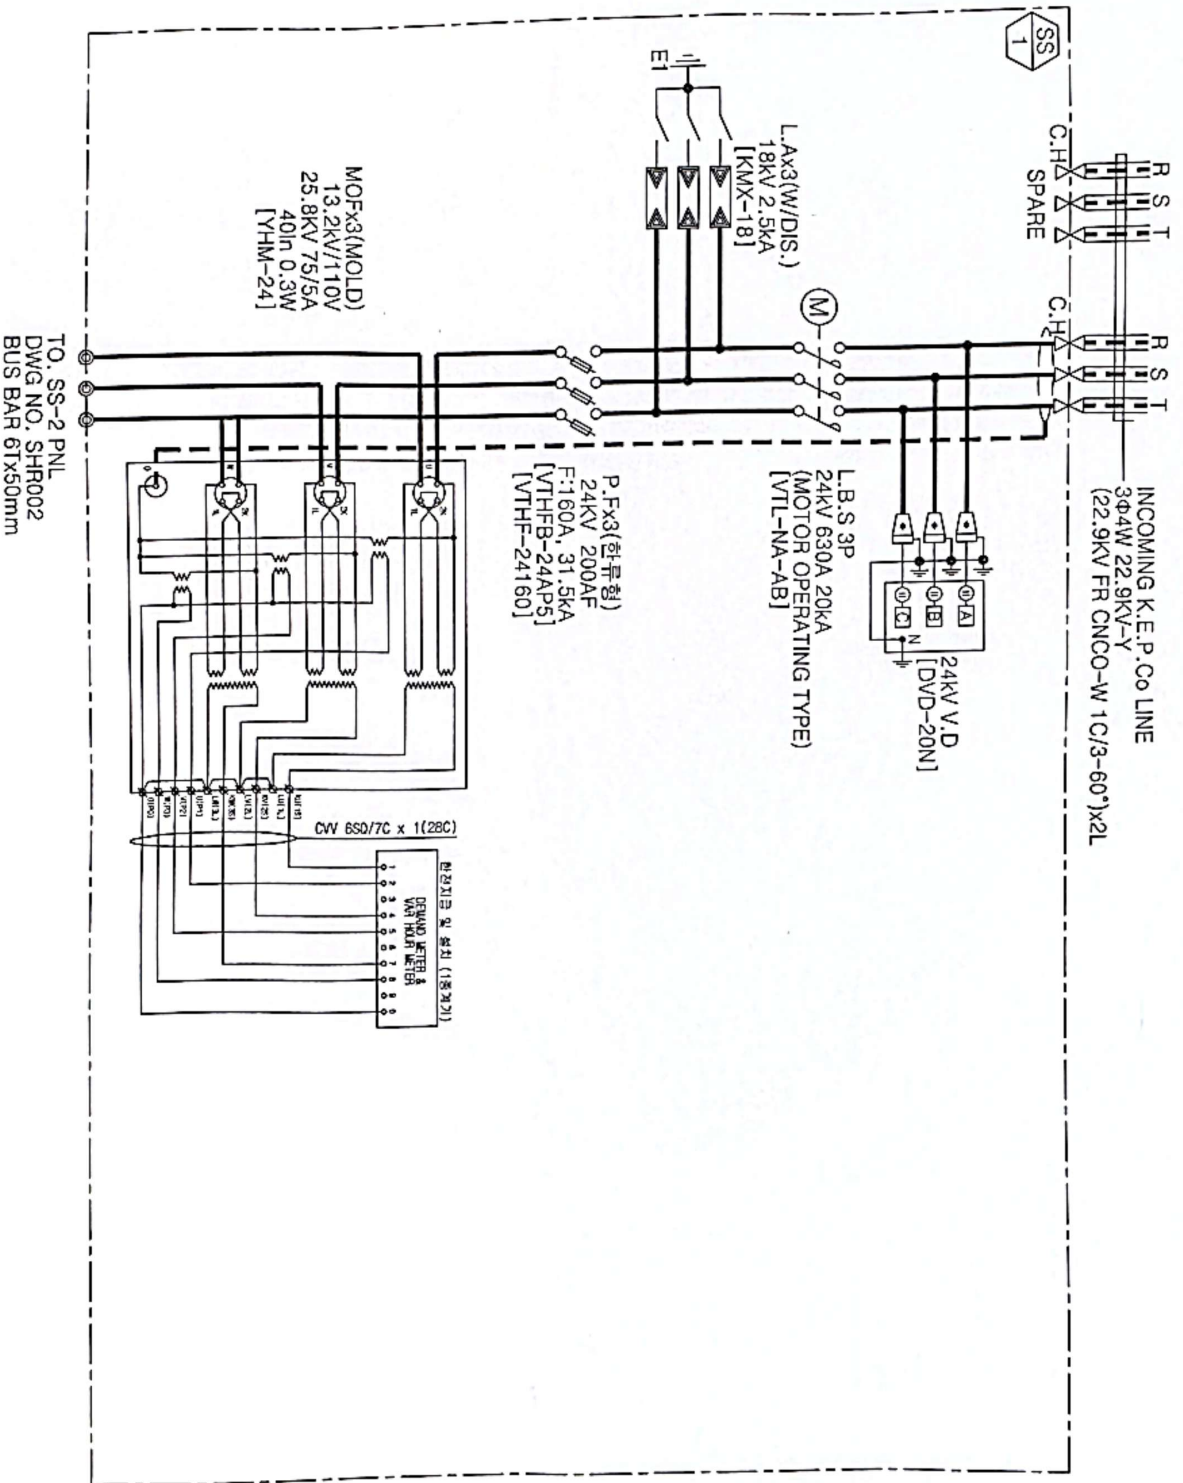


REVISION		DATE		DRAWN		CHECK		APPRO		DATE		SCALE		FILE		DATE		DWG NO.		TITLE	
NO.	FOR APPROVAL	DATE	2015.05	LEE E.H	LEE E.H	YUL G.W	APPRO.	PROJECT.	성수동1가 지식산업센터 신축공사	DRAWN	CHECK	APPRO	DATE	2015.05.20	SCALE	NONE	FILE	DATE	2015.05	DWG NO.	KIM 5022-SHR001.0
1																					
2																					
3																					
4																					
5																					
6																					



THREE LINE DIAGRAM OF
SS-1 PANEL

FROM, HV-5 PNL
DWG NO. SHR002
BUS BAR 6Tx50mm

P.TX3(MOLD)
22.9kV/√3/190V/√3
200VA,1.0C(F:1A)
[NE-1F]



Fx3
500V 4A
P10 P11 P12
P20 P21 P22
P30 P31 P32
P41 P42

V.C.B(52M)
24kV 3P 630A
12.5kA 520MVA
[LVB-20E-13D/061A2B]
[VCL-20E-13D/06]

CTX3
25.8kV 75/5A
12.5kA 40VA
[WE-8R]

S.Ax3
18kV 5kA
[KMSA-18]



CTT
(4W)
C10 C11
C20 C21
C30 C31
C40 C41



RS-485
통신단자


TO, SS-3 PNL
DWG NO. SHR003
BUS BAR 6Tx50mm

NO.	FOR APPROVAL	DATE	2015.05	LEE.EH	LEE.EH	YU.G.W	PROJECT	성수동1가 지식산업센터 신축공사	DRAWN	CHECK	APPRO	DATE	DATE	DATE	SCALE	TITLE	DATE	DWG NO	REV
1																			
2																			
3																			
4																			
5																			
6																			



THREE LINE DIAGRAM OF
SS - 2 PANEL

FROM. SS-2 PNL
DWG NO. SHR002
BUS BAR 6T x 50mm

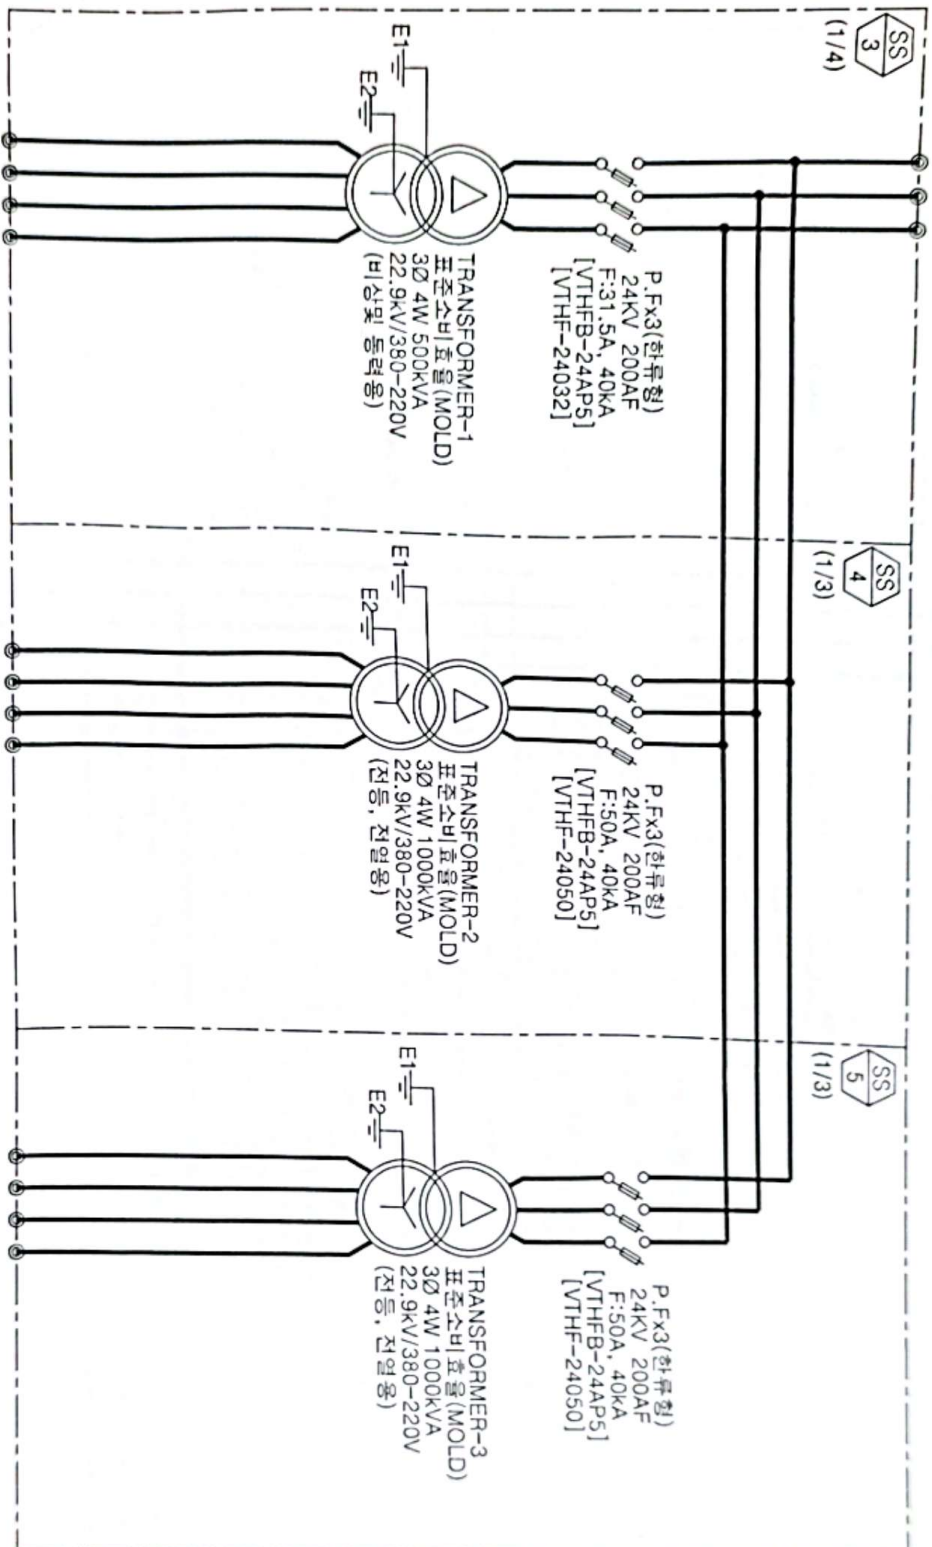

TO. SS-3 PNL ACB 1st
DWG NO. SHR003
BUS BAR 8T x 50mm

TO. SS-4 PNL ACB 1st
DWG NO. SHR007
BUS BAR 8T x 50mm x 2LINE

TO. SS-5 PNL ACB 1st
DWG NO. SHR009
BUS BAR 8T x 50mm x 2LINE

NO.	REVISION	DATE	DRAWN	CHECK	APPRO.
1					
2					
3					
4					
5					
6					


PROJECT.
성수동1가 지식산업센터 신축공사

DRAWN	CHECK	APPRO.

DATE	DATE	DATE	SCALE	FILE	DATE	DWG NO.
2013.03.01	2013.03.01	2013.03.01	NONE		2013.05	KMI15022-SHR003

TITLE
THREE LINE DIAGRAM OF
SS-3, 4, 5 PANEL (TR)

FROM. SS-3 PNL (TR 2nd)
DWG NO. SHR003

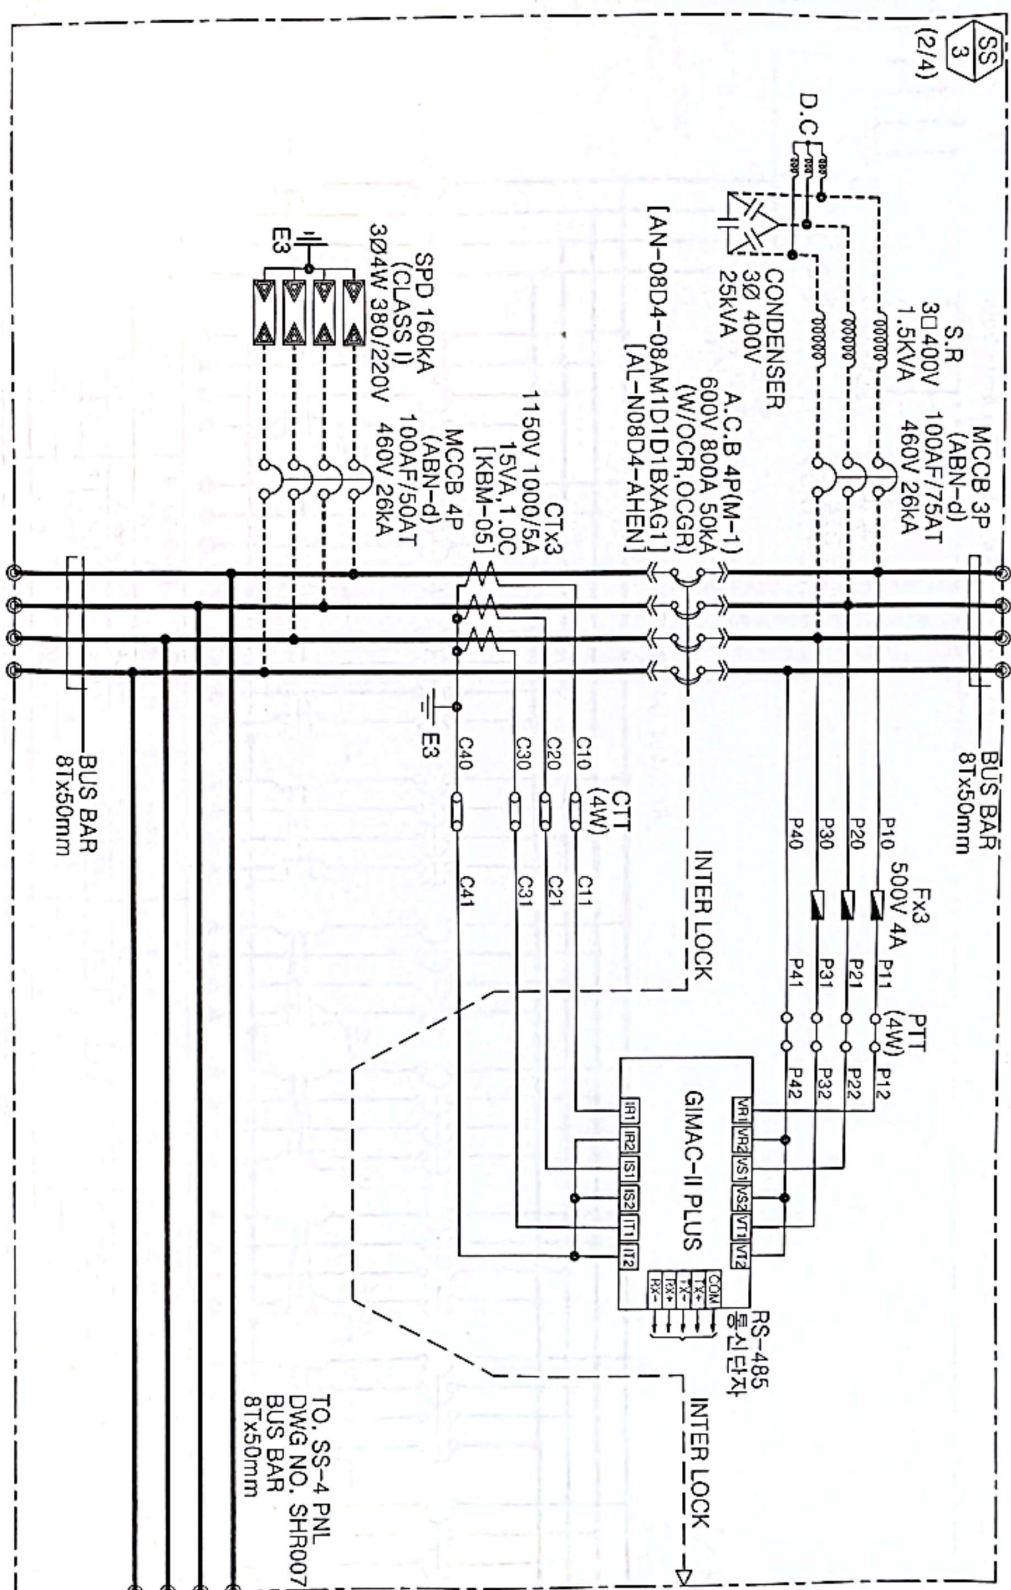

TO. SS-3 PNL ATS 한진측
DWG NO. SHR005
BUS BAR 8Tx50mm

[illegible]


FROM. LV-G PNL
DWG NO. SHG001
CABLE
600V FR-8 300*1/C x4 x2L



TITLE. THREE LINE DIAGRAM OF
SS - 3 PANEL
(ATS & MCCB)

SS
3
(4/4)

FROM: SS-1 PNL(1/2)
DWG NO. SHR005
BUS BAR
81x50mm

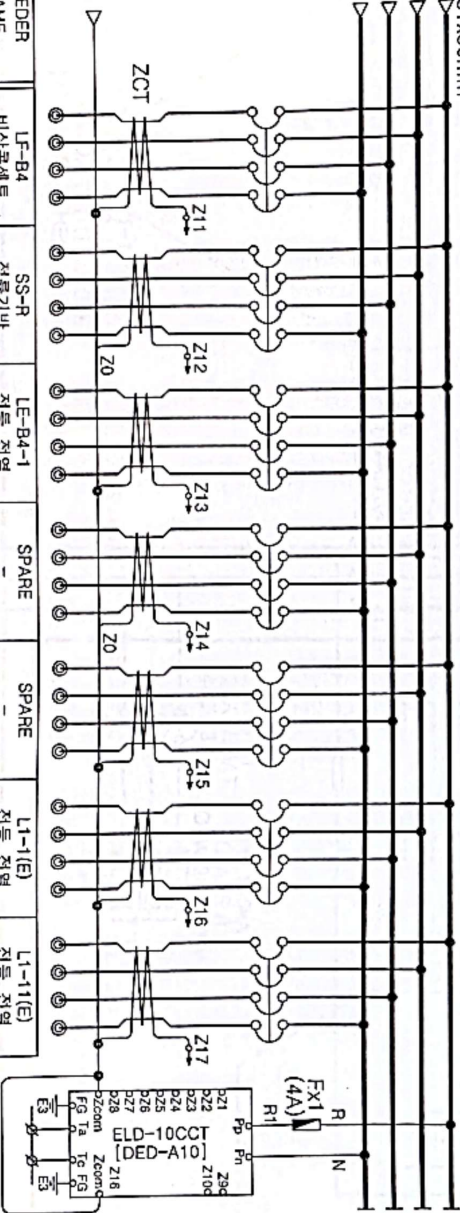

FEEDER NAME		UF-B4 비상콘센트	SS-R 정류기반	LE-B4-1 전등, 전열	SPARE	SPARE	L1-1(E) 전등, 전열	L1-11(E) 전등, 전열
TYPE	ABN-d	ABN-d	ABN-d	ABN-d	ABN-d	ABN-d	ABN-d	ABN-d
MCCB P/A/F/AT	4 100 50	4 100 50	4 100 30	4 100 30	4 100 30	4 100 20	4 100 20	4 100 20
V/A	460V 26kA	460V 26kA	460V 26kA	460V 26kA	460V 26kA	460V 26kA	460V 26kA	460V 26kA
ZCT(200mA/100mV)	DZR-30	DZR-30	DZR-30	DZR-30	DZR-30	DZR-30	DZR-30	DZR-30
CABLE&BUS BAR	KIV 16sq	KIV 16sq	KIV 6sq	KIV 6sq	KIV 6sq	KIV 6sq	KIV 6sq	KIV 6sq
POWER T.B	4P 60A	4P 60A	4P 30A	4P 30A	4P 30A	4P 30A	4P 30A	4P 30A

NO.	FOR APPROVAL	DATE	DESIGN	CHECK	APPRO.	PROJECT	DATE	CHECK	APPRO.	SCALE	FILE	DATE	TITLE
		2015.05	LEECH	LEECH	YUCW	성수동1가 지식산업센터 신축공사	2015.052015.05			NONE		2015.05	THREE LINE DIAGRAM OF SS-3 PANEL (MCCB)
	REVISION												




DWG NO. SHR003



△						PROJECT. 성수동1가 지식산업센터 신축공사	DRAWN	CHECK	APPRO	 KWANG MYOUNG ENT Exact line Technology Co., Ltd	TITLE THREE LINE DIAGRAM OF SS - 4 PANEL (ACB)
△											
△	FOR APPROVAL	2015.03	LEECH	LEECH	YUGW						
△											
NO.	R E V I S I O N .	DATE	DRAWN	CHECK	APPRO.						
		DATE 2015.08.12	DATE	SCALE	NONE	FILE	DATE 2015.09	DWG NO. KM15022-SHFC07	(REV) 0		

FROM SS-4 PNL ACB 2nd
DWG NO. SHR007
BUS BAR 8T x 50mm x 2LINE

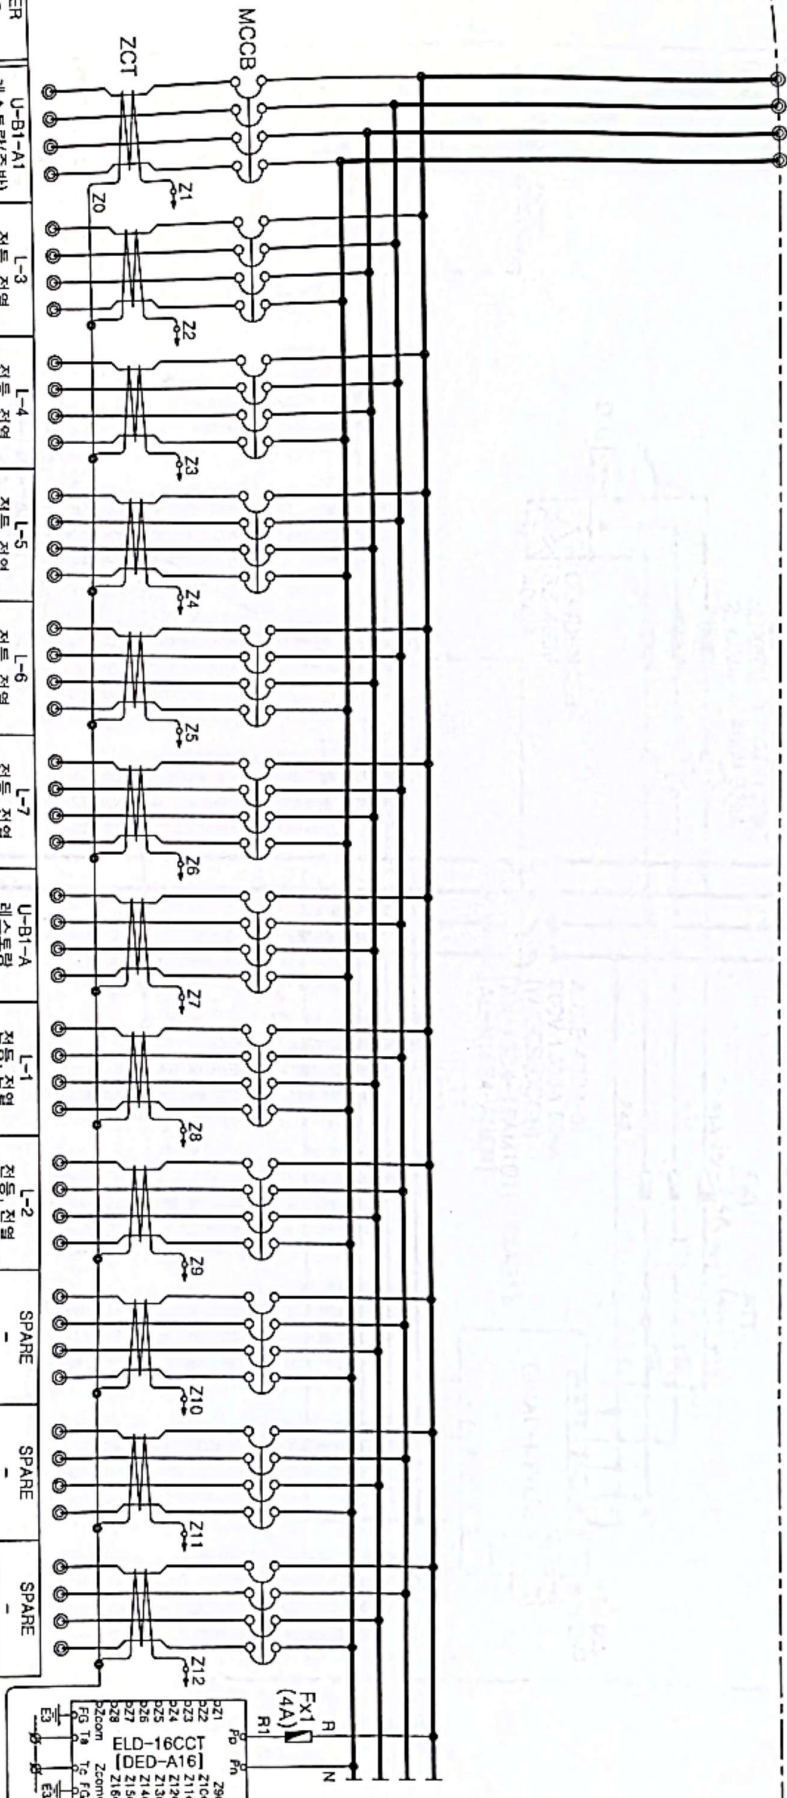

FEEDER NAME	TYPE	L-3		L-4		L-5		L-6		L-7		L-1		L-2		SPARE		SPARE		SPARE	
		ABN-C	전동, 전열	ABN-C	전동, 전열	ABN-C	전동, 전열	ABN-C	전동, 전열	ABN-C	전동, 전열	ABN-C	전동, 전열	ABN-C	전동, 전열	ABS-C	전동, 전열	ABS-C	전동, 전열	ABS-C	전동, 전열
MCCB	P/A/F/AT	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 125 100	4 125 100	4 125 100	4 125 100	4 125 100	4 125 100
	V/A	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	DZR-50	DZR-50	DZR-50	DZR-50	DZR-50	DZR-50
ZCT(200mA/100mV)		DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	KIV 35sq	KIV 35sq	KIV 35sq	KIV 35sq	KIV 35sq	KIV 35sq
CABLE & BUS BAR		BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	4P 100A	4P 100A	4P 100A	4P 100A	4P 100A	4P 100A
POWER T.B		BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	BUS 6T x 30mm	4P 100A	4P 100A	4P 100A	4P 100A	4P 100A	4P 100A

NO.		FOR APPROVAL		DATE		DRAWN		CHECK		APPRO		DATE		SCALE		NONE		FILE		DATE		DWG NO		KMI15022-SHR008	
		R E V I S I O N																							
PROJECT.																									
성수동1가 지식산업센터 신축공사																									
KWANG MYUNG E&T Electrical Engineering & Technology Co., Ltd. TITLE: THREE LINE DIAGRAM OF SS-4 PANEL (MCCB)																									


DWG NO. SHR003




성수동이 **지식산업센터** 신축공사

FROM, SS-4 PNL ACB 2nd
DWG NO. SHR009
BUS BAR 81x50mm x 2LINE

SS
5
(3/3)

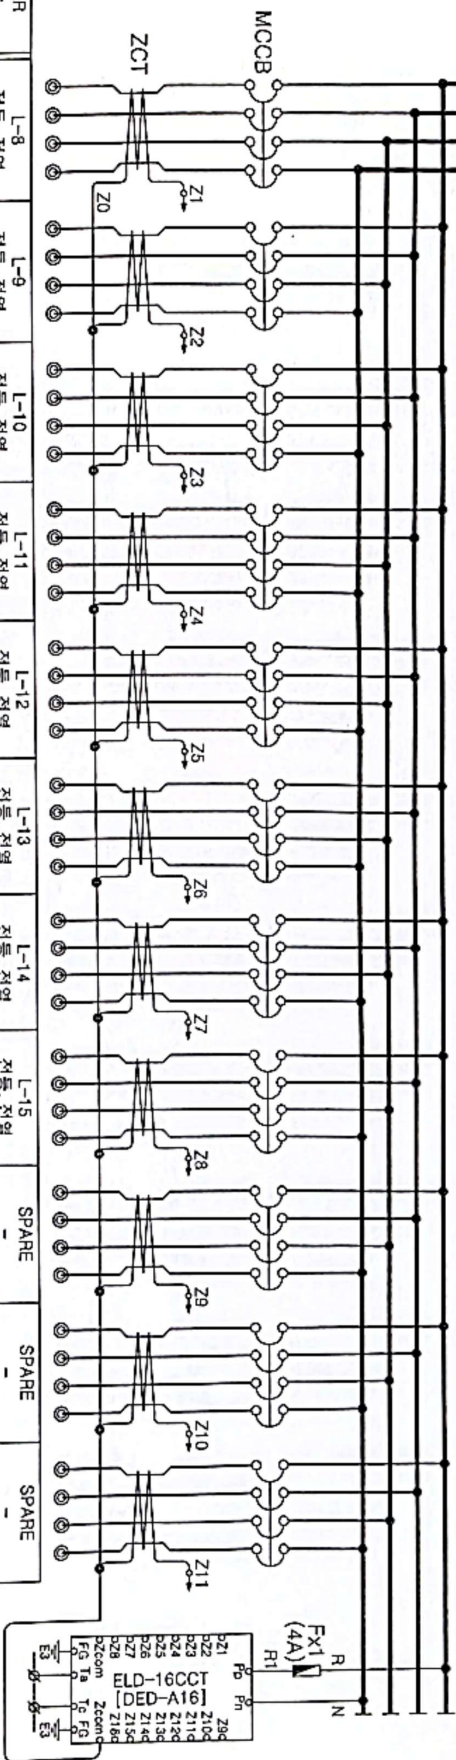

FEEDER NAME	L-8		L-9		L-10		L-11		L-12		L-13		L-14		L-15		SPARE		SPARE		SPARE	
	전동, 전열		전동, 전열		전동, 전열		전동, 전열		전동, 전열		전동, 전열		전동, 전열		전동, 전열		-		-		-	
TYPE	ABN-C		ABN-C		ABN-C		ABN-C		ABN-C		ABN-C		ABN-C		ABN-C		ABN-C		ABN-C		ABN-C	
MCCB	P/AE/AT	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 350	4 400 300	4 125 100	4 125 100	4 125 100	4 125 100	4 125 100	4 125 100	
CABLE&BUS BAR	V/A	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	460V 37KA	
	ZCT(200mA/100mV)	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	DZS-160	
POWER T.B		BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	
		BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	BUS 6Tx30mm	



PROJECT.		DRAWN.		CHECK.		APPRO.	
성수동1가 지식산업센터 신축공사							
FOR APPROVAL		DATE.		DATE.		DATE.	
REVISION.		DATE.		DATE.		DATE.	
		LEE E.H		LEE E.H		YUL G.W	
		DATE.		CHECK.		APPRO.	
		2015.05					
		DATE.		DATE.		DATE.	
		2015.05		2015.05		2015.05	
		SCALE.		SCALE.		SCALE.	
		NONE		NONE		NONE	
		FILE.		FILE.		FILE.	
		DATE.		DATE.		DATE.	
		2015.05		2015.05		2015.05	
		DWG NO.		DWG NO.		DWG NO.	
		KM15022-SH-F010		KM15022-SH-F010		KM15022-SH-F010	
		REV.		REV.		REV.	
		0		0		0	

THREE LINE DIAGRAM OF
SS PANEL
(MCCB)


⑤

 $2\frac{1}{2} \text{ hr}$ [illegible]




성수동1가 지식산업센터 신축공사

DRAWN		CHECK		APPRO	
DATE		DATE		SCALE	
2015.02.15.05				NONE	
				FILE	
				DATE	
				2015.05	
 KWANG MYUNG ENT Electronic Music Technology Co., Ltd.					
TITLE SEQUENCE DIAGRAM FOR SS-1 PULL-BS CONT.					
DWG NO.		KMT-5022-SH0001		REV	
				0	




	FOR APPROVAL	2015.05	LEE H	LEE H	YU G W				
NO.	R E V I S I O N .	DATE	DRAWN.	CHECK.	APPRO.				
PROJECT.						성수동1가 지식산업센터 신축공사			
		DRAWN.	CHECK.	APPRO					
KWANG MYUNG ENT Enters New Technology Co., Ltd.						TITLE SEQUENCE DIAGRAM FOR SS-2 PUL VOB CONT.			
		DATE. 2015.05.20/15.05	DATE.	DATE.	SCALE.	NONE	FILE	DATE. 2015.05	REV. DWG NO.(KAI)S022-SHQ002 0



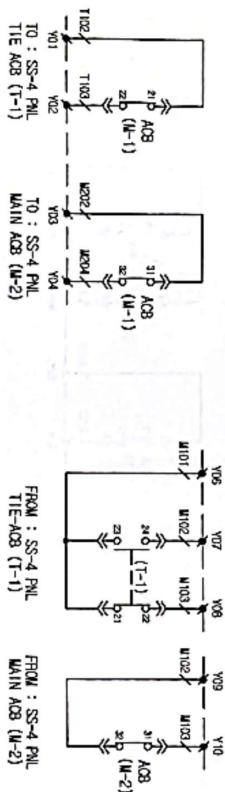


KWANG MYUNG ENT
Electric Heat Technology Co., Ltd.

SEQUENCE DIAGRAM FOR
SS-3 PNL ACB CONT.


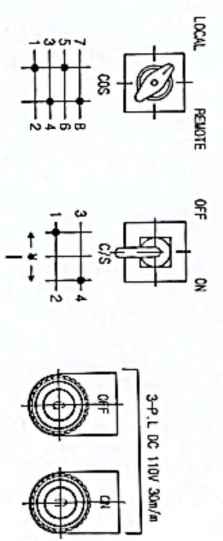


ACB 4P 800A	
13-14	O
23-24	O
33-34	O
43-44	O
53-54	O
11-12	O
21-22	O
31-32	O
41-42	O
51-52	O

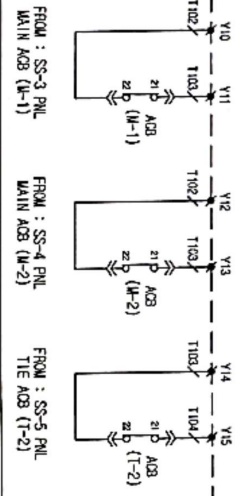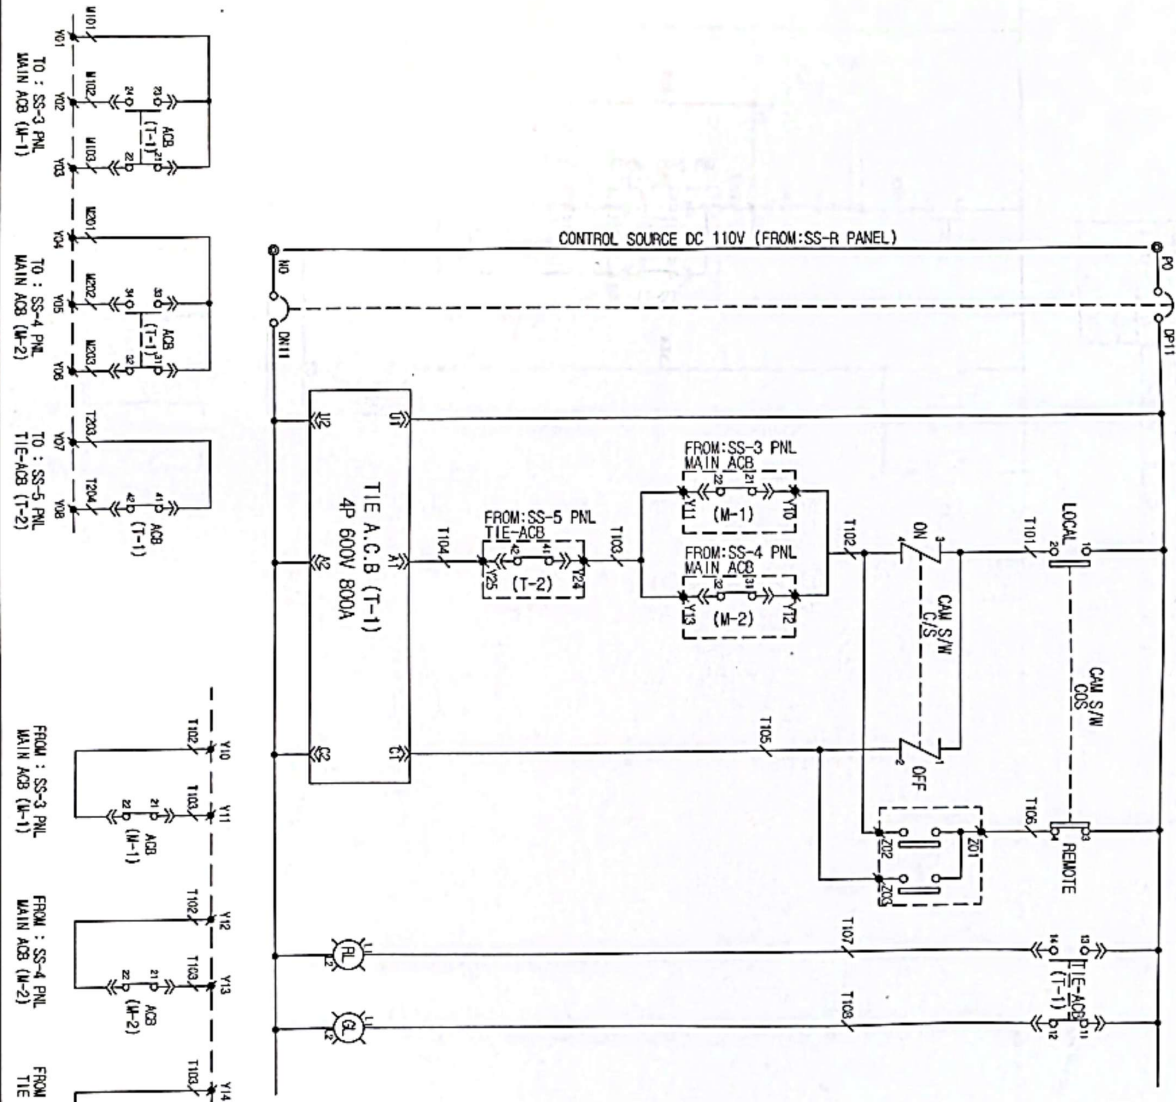

PROJECT.		DRAWN		CHECK		APPRO	
성수동1가 지식산업센터 신축공사							
FOR APPROVAL		DATE		DATE		DATE	
2015.05		LEE.E.H		LEE.E.H		YU.G.W	
REVISION		DATE		DATE		DATE	
		DRAWN		CHECK		APPRO	
TITLE		SCALE		FILE		DATE	
SEQUENCE DIAGRAM FOR SS-4 PNL TIE ACB CONT.		NONE				2015.05	
DWG NO. KMI 5022-SH-0004						REV. 0	

[illegible]



LOCAL REMO



COS

7 5 3 1 8 6 4 2

3-P.L DC 110V 30mA/m




성수

정수동이가 지식산업센터 신축공사




KWANG MYUNG ENT
Electro Wave Technology Co., Ltd.

SEQUENCE DIAGRAM FOR
SS-5 PNL TIE ACB CONT.





ACB 4P 1600A				51X				51GX			
13-14	O	→	a-b	O	→	a-b	O	→	a-b	O	→
23-24			a 13-14	O		a 13-14	O		a 13-14	O	
33-34			b 21-22	O		b 21-22	O		b 21-22	O	
43-44			a 33-34	O		a 33-34	O		a 33-34	O	
53-54			b 43-44	O		b 43-44	O		b 43-44	O	
11-12	O		MR-40(3a/b)	DC110V		MR-40(3a/b)	DC110V		MR-40(3a/b)	DC110V	
21-22	O		MR-40(3a/b)	DC110V		MR-40(3a/b)	DC110V		MR-40(3a/b)	DC110V	
31-32	O		MR-40(3a/b)	DC110V		MR-40(3a/b)	DC110V		MR-40(3a/b)	DC110V	
41-42											
51-52											

UCB 2P
(UCB-201)
51X/51GX
DC120V 3W4

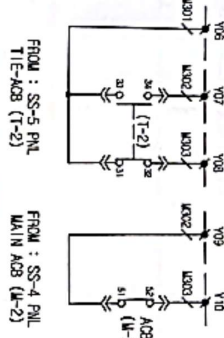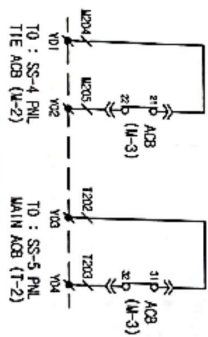
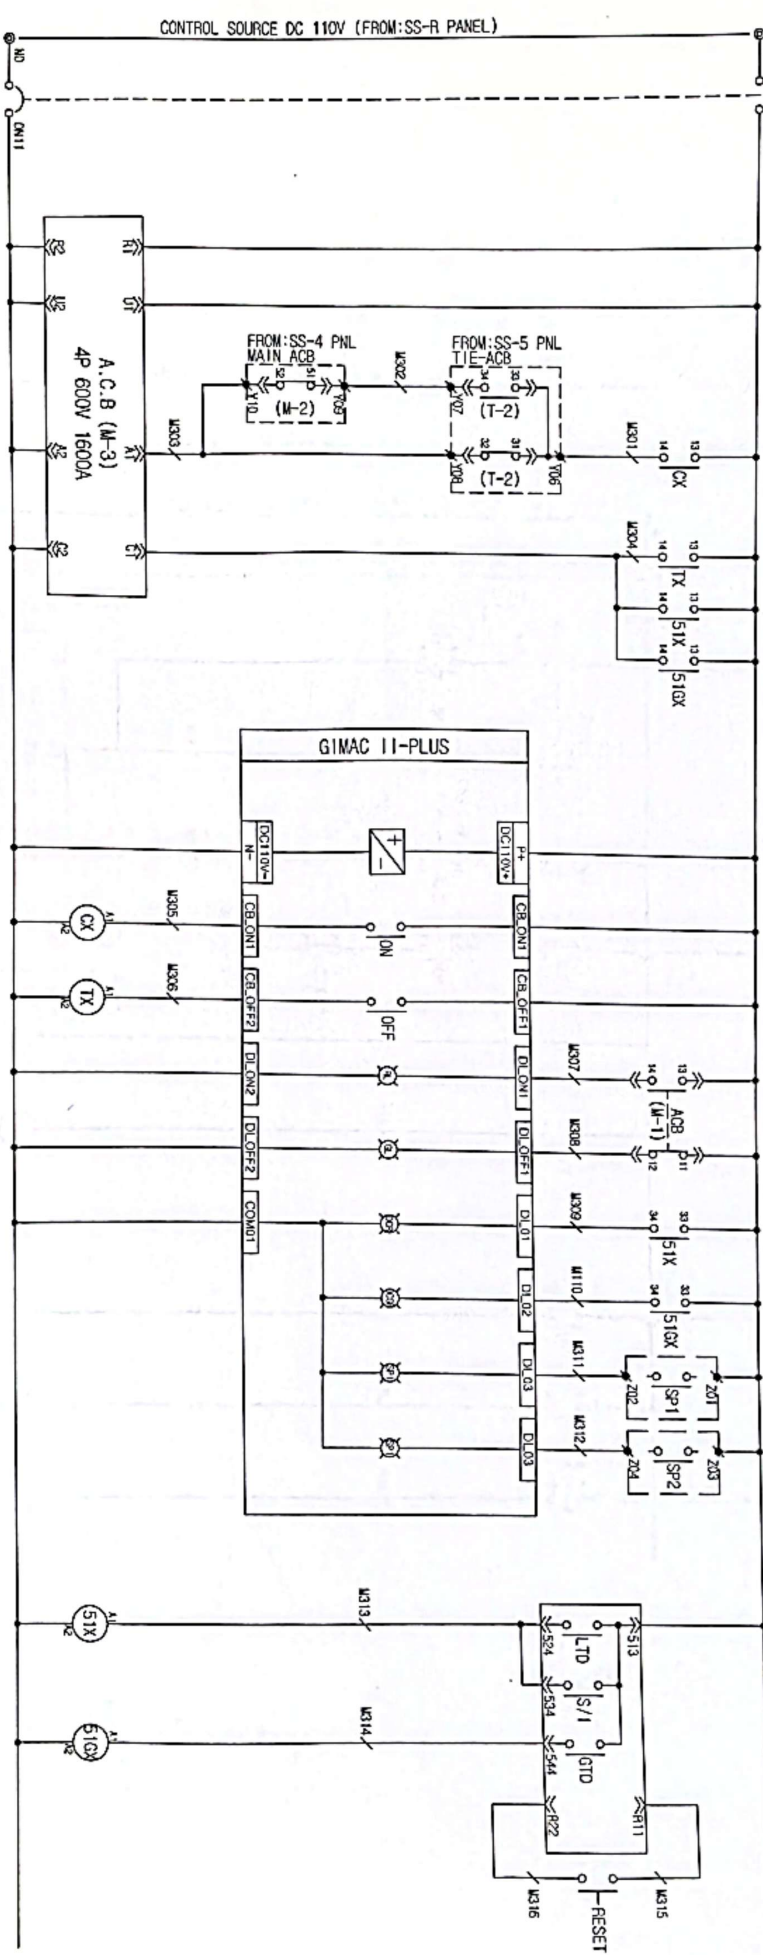


PROJECT.		DRAWN.		CHECK.		APPRO.		TITLE.	
성수동1가 지식산업센터 신축공사								SEQUENCE DIAGRAM FOR SS-3 PNL ACB CONT.	
FOR APPROVAL		DATE.		DATE.		DATE.		DATE.	
REVISION		DATE.		DATE.		DATE.		DATE.	
DRAWN.		CHECK.		APPRO.		SCALE.		FILE.	
DATE.		DATE.		DATE.		DATE.		DATE.	
2015.06		2015.06		2015.06		2015.06		2015.06	
LEE.E.H		LEE.E.H		YU.G.W		NONE		NONE	
DATE.		DATE.		DATE.		DATE.		DATE.	
2015.06		2015.06		2015.06		2015.06		2015.06	
DATE.		DATE.		DATE.		DATE.		DATE.	
2015.06		2015.06		2015.06		2015.06		2015.06	
DATE.		DATE.		DATE.		DATE.		DATE.	
2015.06		2015.06		2015.06		2015.06		2015.06	

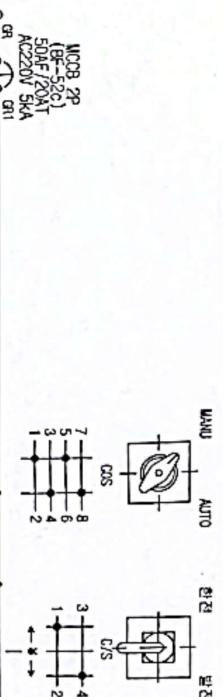

27X	27T	84X	84T
a-b	a-b	a-b	a-b
13-14	13-14	13-14	13-14
21-22	21-22	21-22	21-22
31-32	31-32	31-32	31-32
43-44	43-44	43-44	43-44

27X	27T	84X	84T
a-b	a-b	a-b	a-b
13-14	13-14	13-14	13-14
21-22	21-22	21-22	21-22
31-32	31-32	31-32	31-32
43-44	43-44	43-44	43-44



PROJECT.		성수동1가 지식산업센터 신축공사	
NO.	FOR APPROVAL	DATE	2015.05
REVISION	DATE	DRAWN	LEE.EH
		CHECK	LEE.EH
		APPRO.	YUS.W

DRAWN	CHECK	APPRO
DATE	DATE	DATE
2015.05.02	2015.05.05	2015.05.05

SCALE	NONE	FILE
DATE	2015.05	DWG NO
		KM15022-SHQ008

SEQUENCE DIAGRAM FOR
SS-3 PNL, ATS CONT.