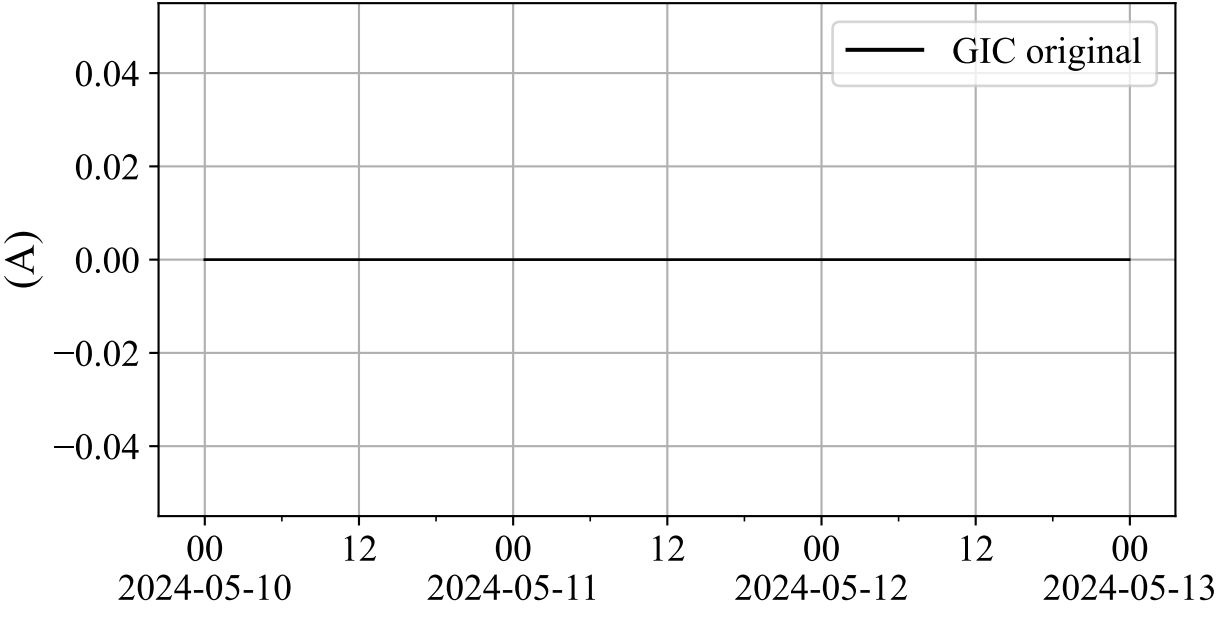Manual Error: stays at zero
Automated Error: All GIC values are positive;
All GIC values are negative;
Low signal: all GIC values within +/- 4 A;
Cadence is >= 60 seconds (294.0 seconds);
Data is constant for at least 5 minutes starting at time 2024-05-10 15:01:36