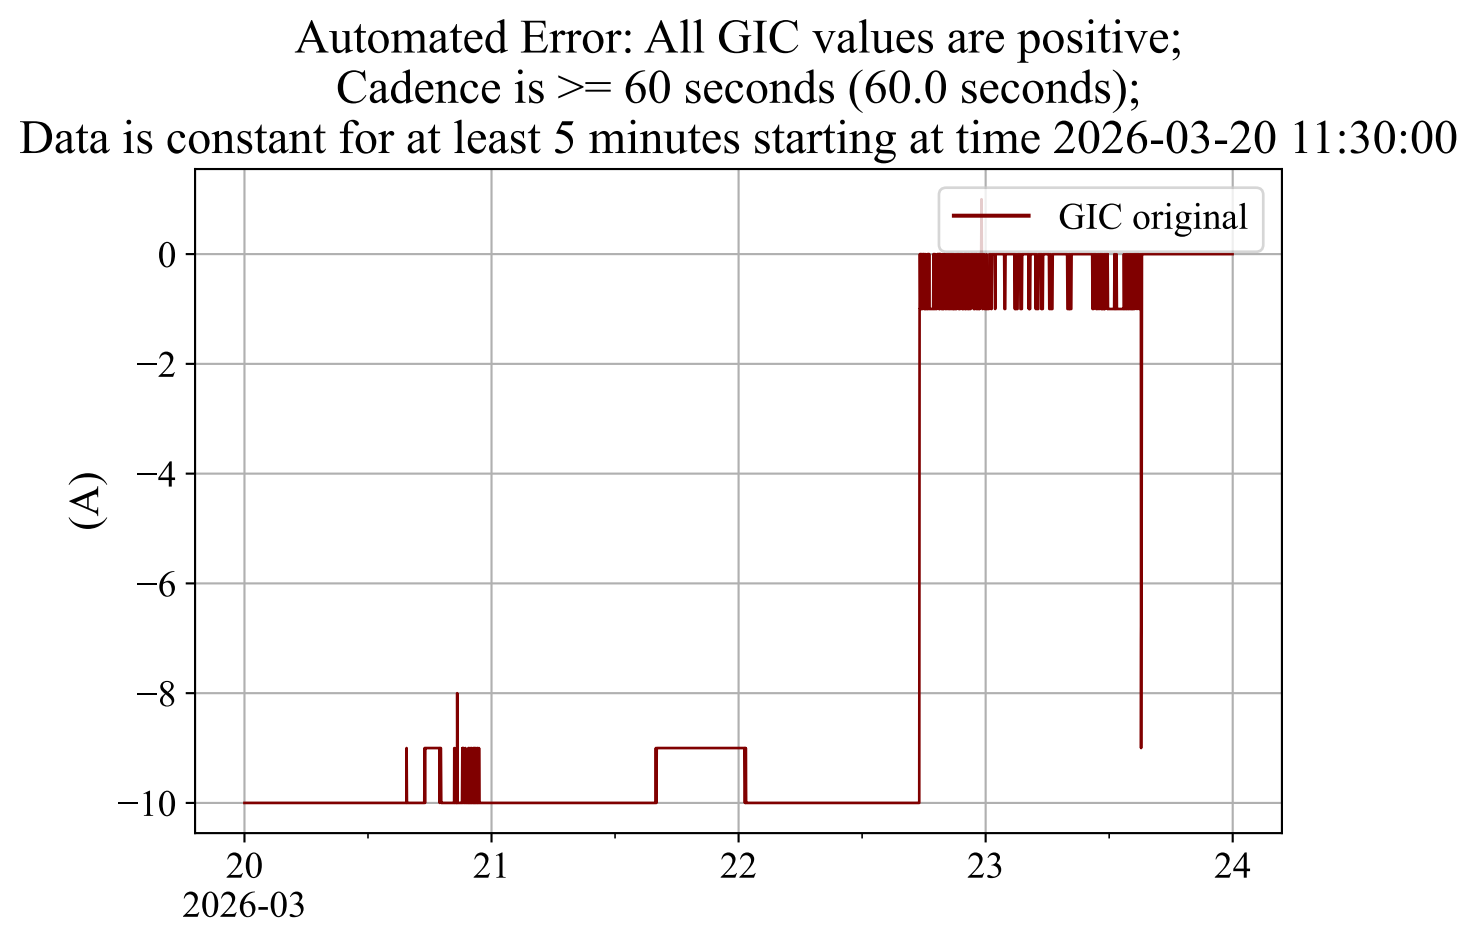
Automated Error: All GIC values are positive;
Cadence is >= 60 seconds (60.0 seconds);
Data is constant for at least 5 minutes starting at time 2026-03-20 11:30:00
GIC original
0
−2
−4
−6
−8
−10
(A)
20
2026-03
21
22
23
24