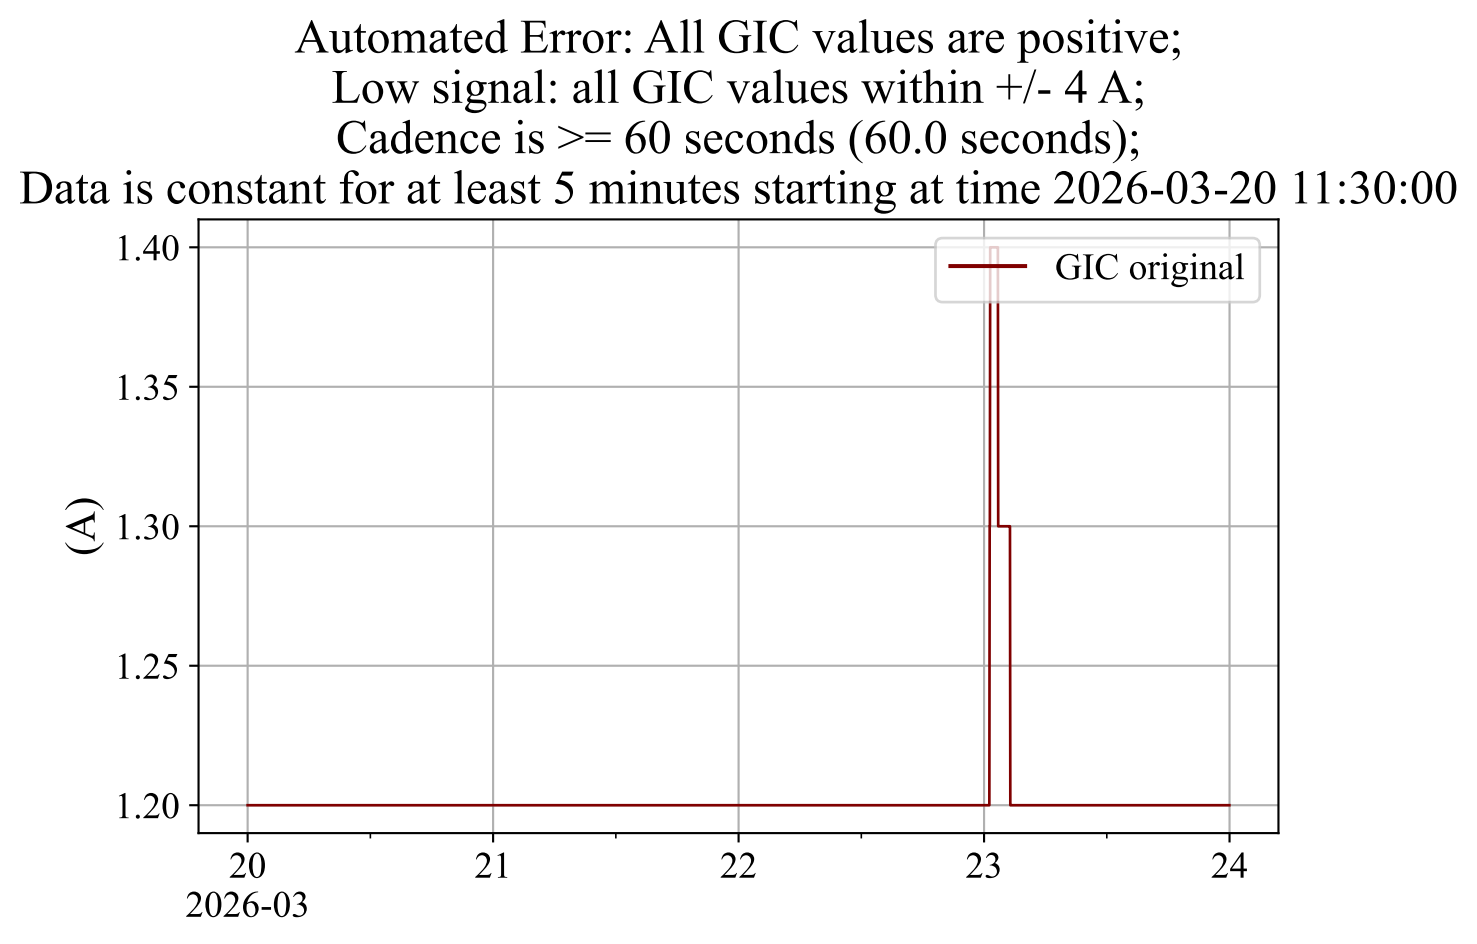
Automated Error: All GIC values are positive;
Low signal: all GIC values within +/- 4 A;
Cadence is >= 60 seconds (60.0 seconds);
Data is constant for at least 5 minutes starting at time 2026-03-20 11:30:00
GIC original
(A)
1.40
1.35
1.30
1.25
1.20
20
2026-03
21
22
23
24