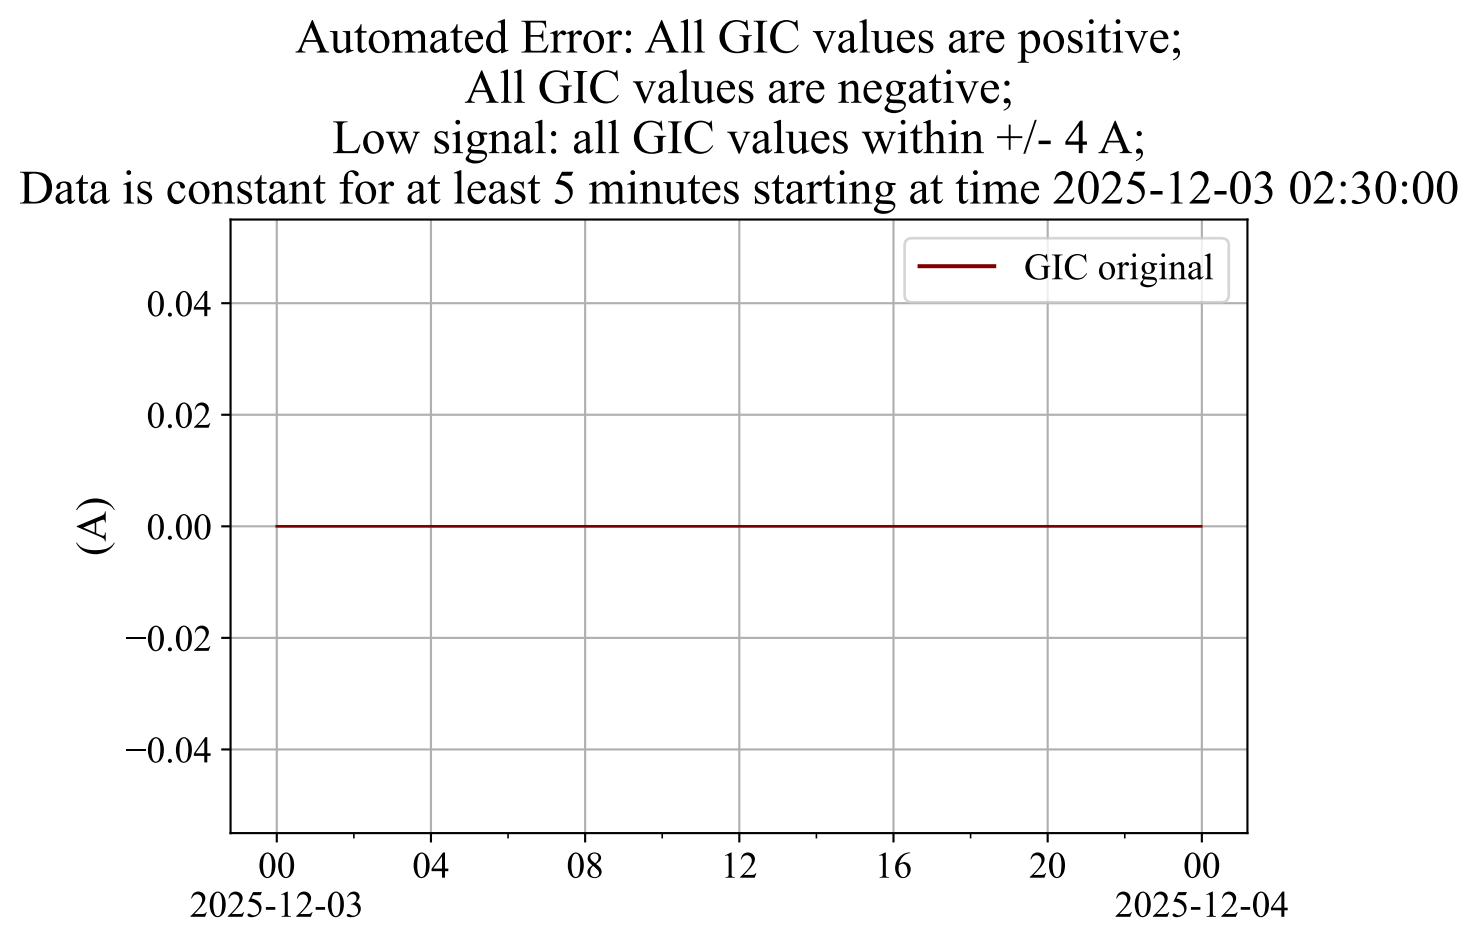
Automated Error: All GIC values are positive;
All GIC values are negative;
Low signal: all GIC values within +/- 4 A;
Data is constant for at least 5 minutes starting at time 2025-12-03 02:30:00
GIC original
0.04
0.02
0.00
−0.02
−0.04
(A)
00
04
08
12
16
20
00
2025-12-03
2025-12-04