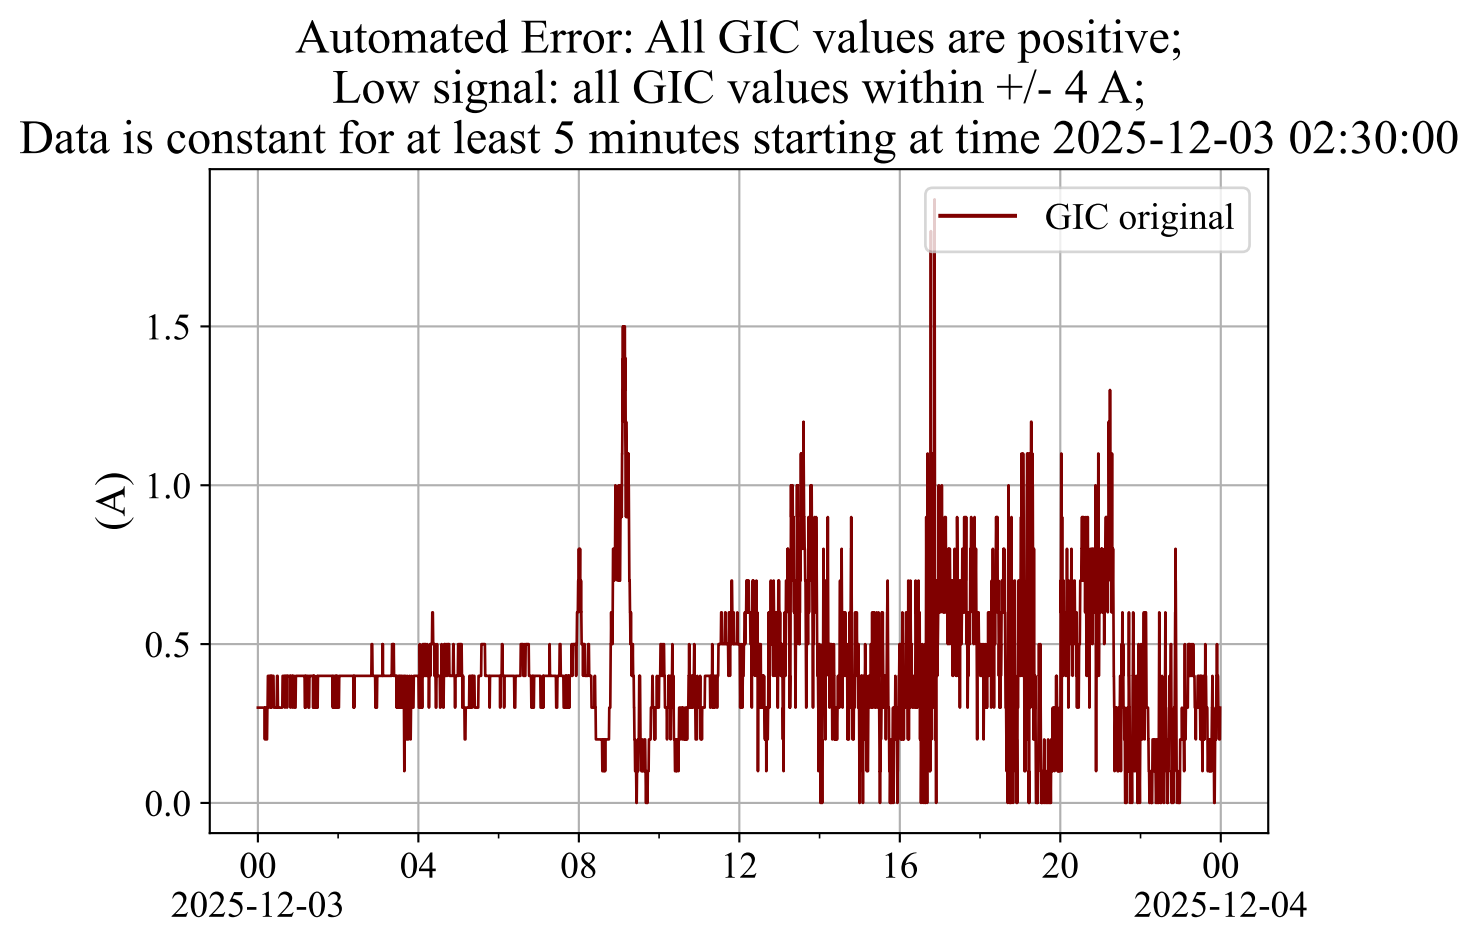
Automated Error: All GIC values are positive;
Low signal: all GIC values within +/- 4 A;
Data is constant for at least 5 minutes starting at time 2025-12-03 02:30:00
GIC original
(A)
1.5
1.0
0.5
0.0
00
2025-12-03
04
08
12
16
20
00
2025-12-04