


Sensor B1, T = 20 C - L(ann_125C_25h) / L(before_annealing)

ratio

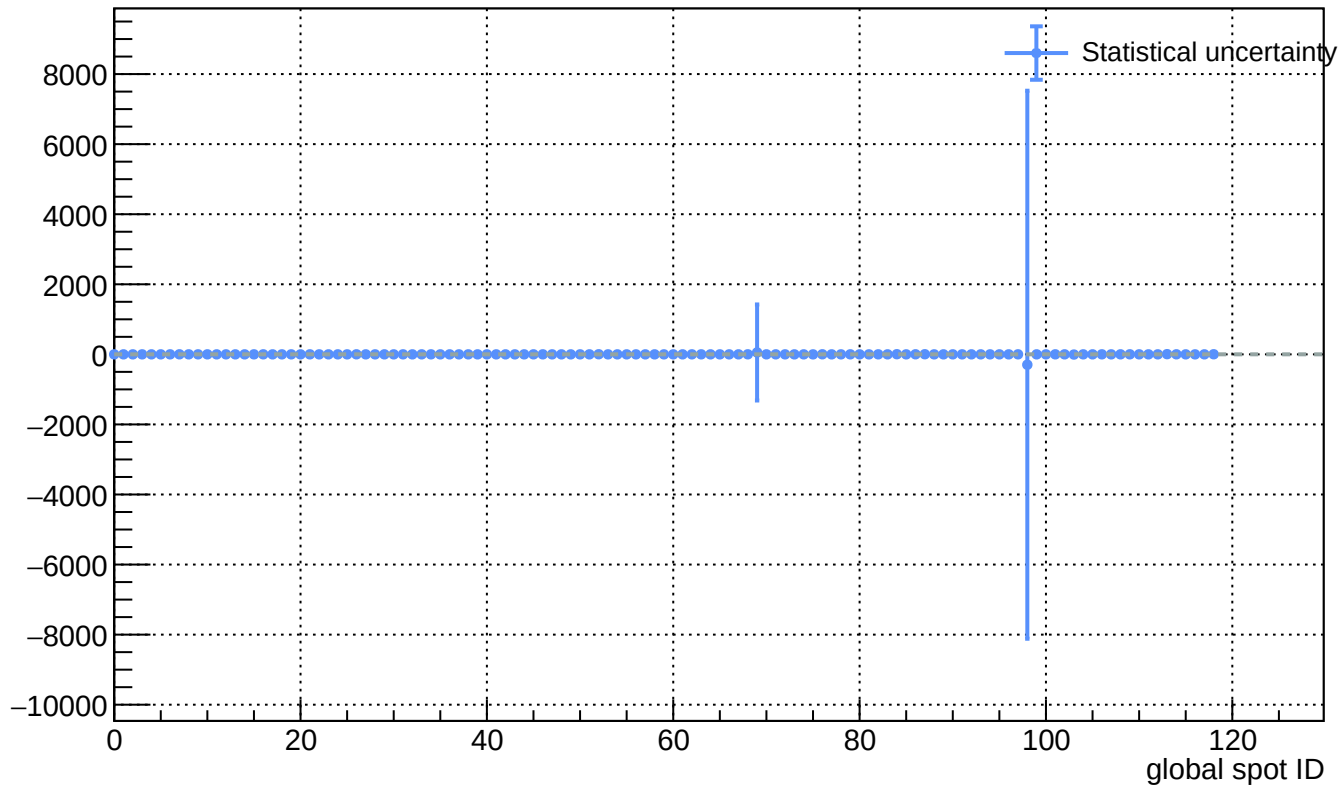

Statistical uncertainty