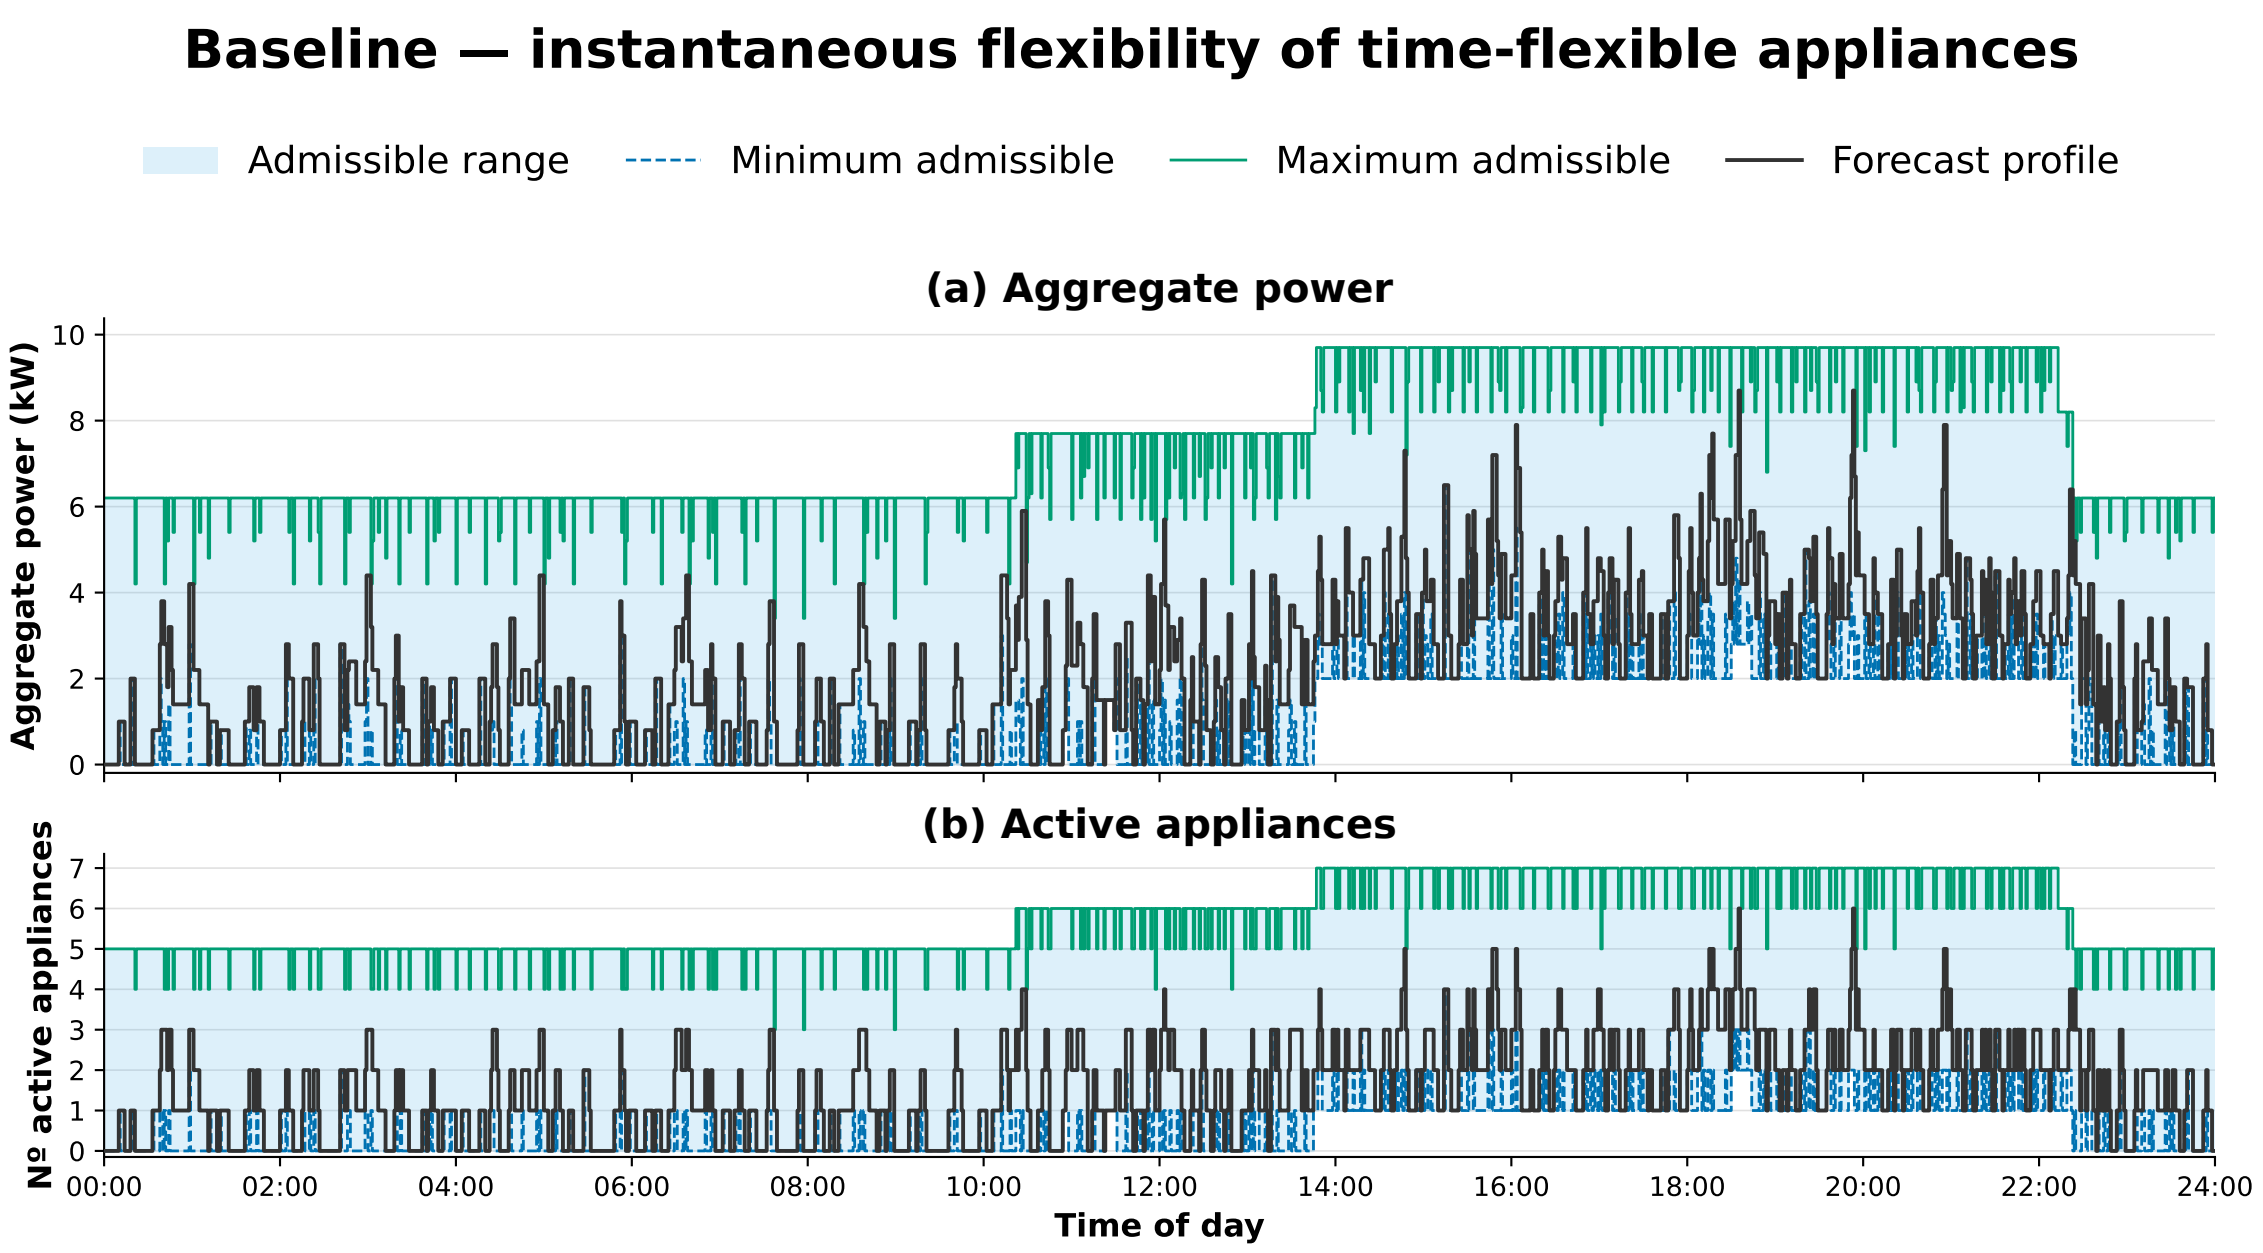

Baseline — instantaneous flexibility of time-flexible appliances
Admissible range
Minimum admissible
Maximum admissible
Forecast profile
(a) Aggregate power
Aggregate power (kW)
0
2
4
6
8
10
(b) Active appliances
Nº active appliances
0
1
2
3
4
5
6
7
00:00
02:00
04:00
06:00
08:00
10:00
12:00
14:00
16:00
18:00
20:00
22:00
24:00
Time of day