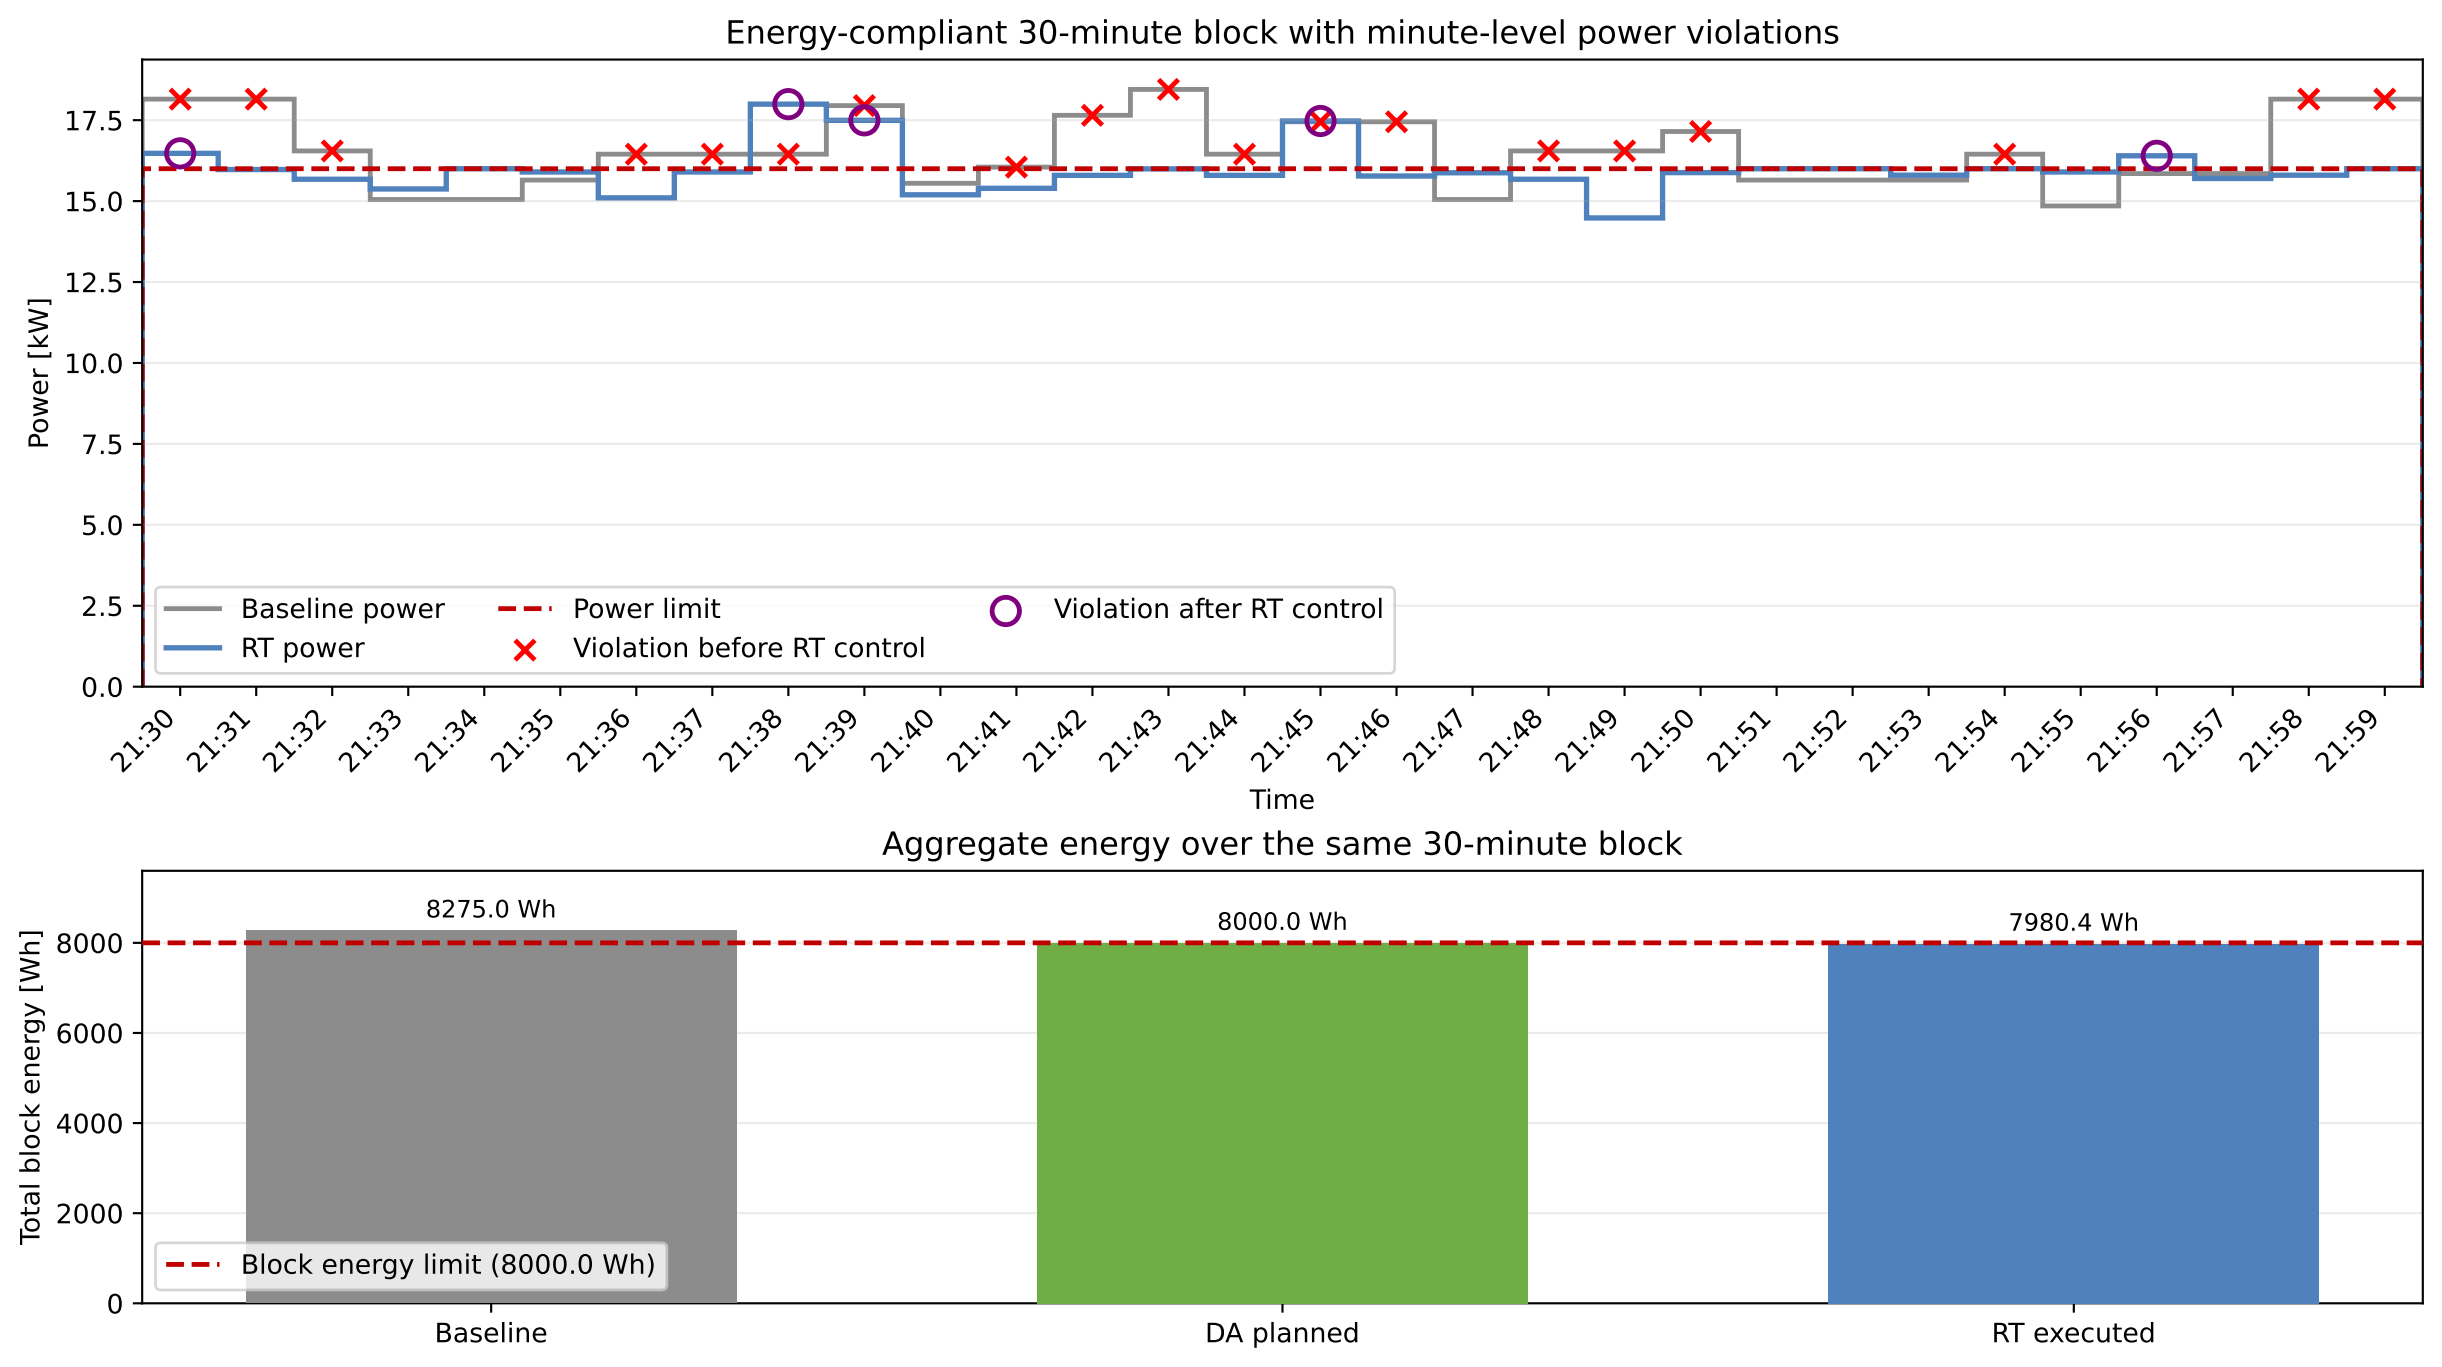
Energy-compliant 30-minute block with minute-level power violations
Power [kW]
Time
Baseline power
RT power
Power limit
Violation before RT control
Violation after RT control
Aggregate energy over the same 30-minute block
Total block energy [Wh]
8275.0 Wh
8000.0 Wh
7980.4 Wh
Block energy limit (8000.0 Wh)
Baseline
DA planned
RT executed