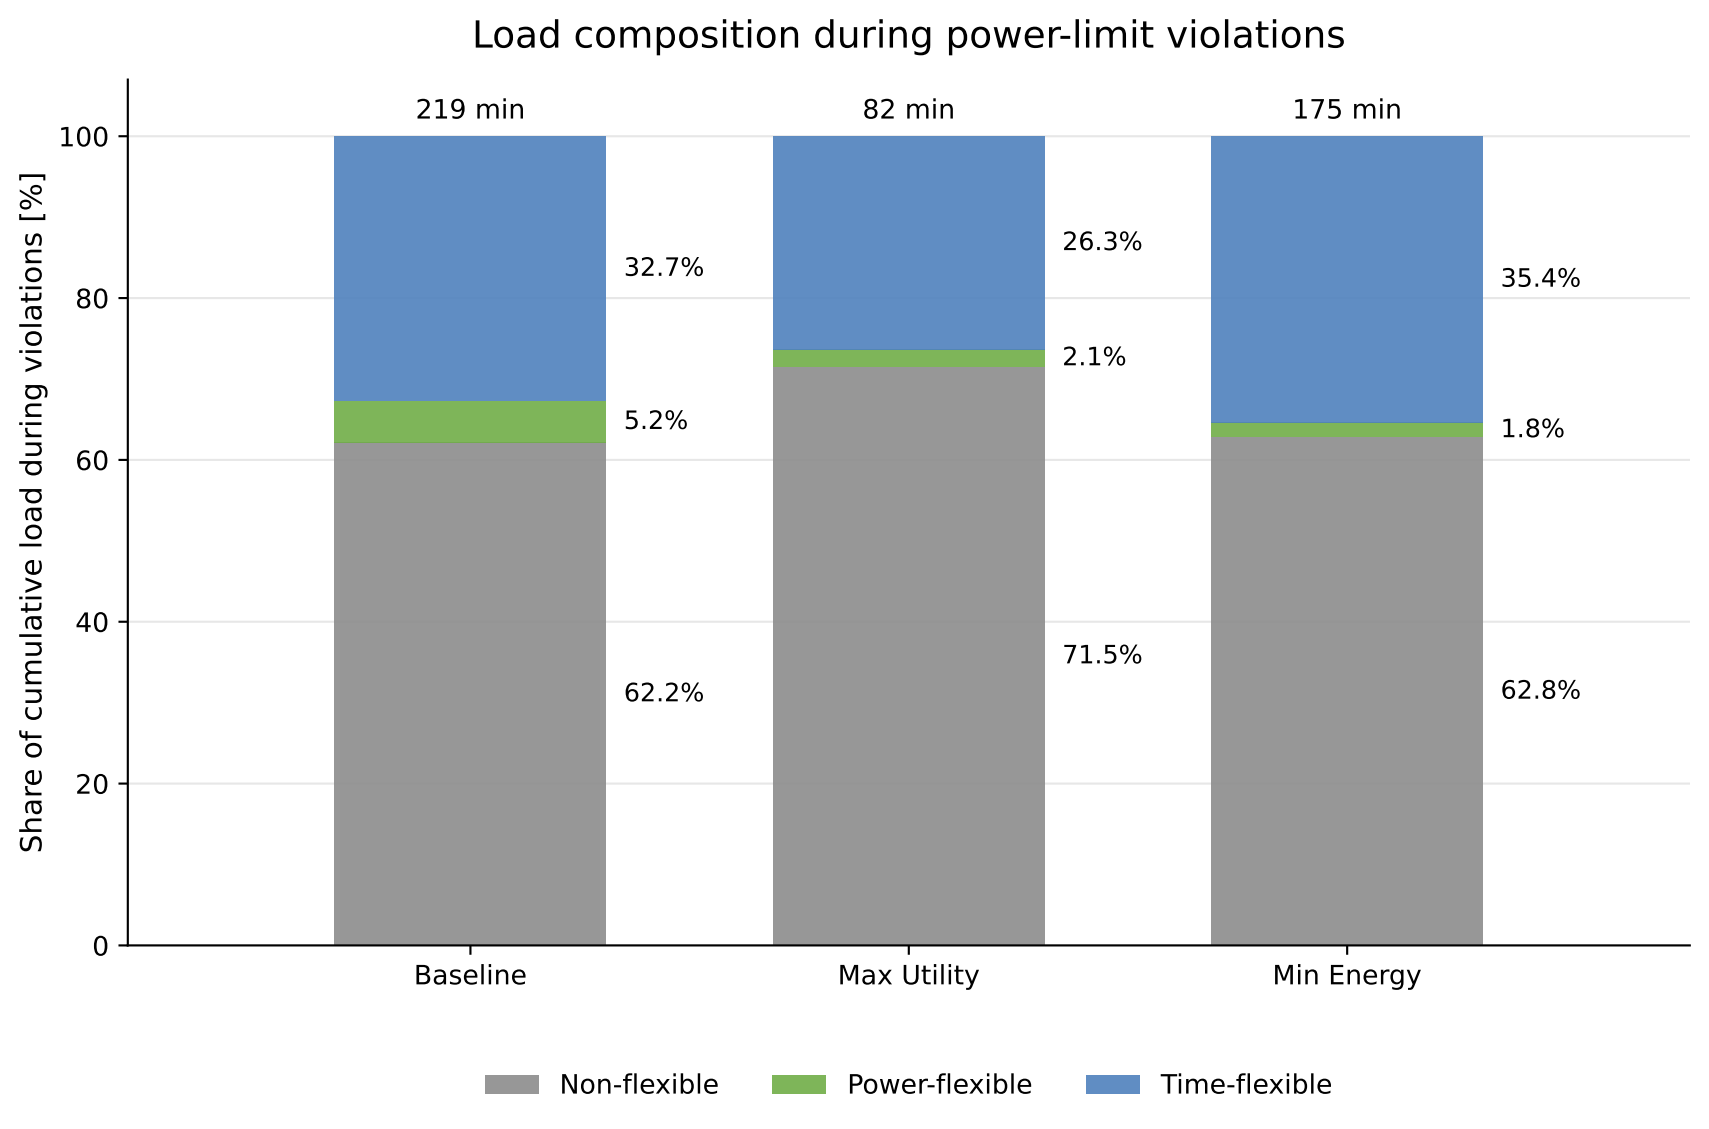
Load composition during power-limit violations
219 min
82 min
175 min
Share of cumulative load during violations [%]
100
80
60
40
20
0
32.7%
5.2%
62.2%
26.3%
2.1%
71.5%
35.4%
1.8%
62.8%
Baseline
Max Utility
Min Energy
Non-flexible
Power-flexible
Time-flexible