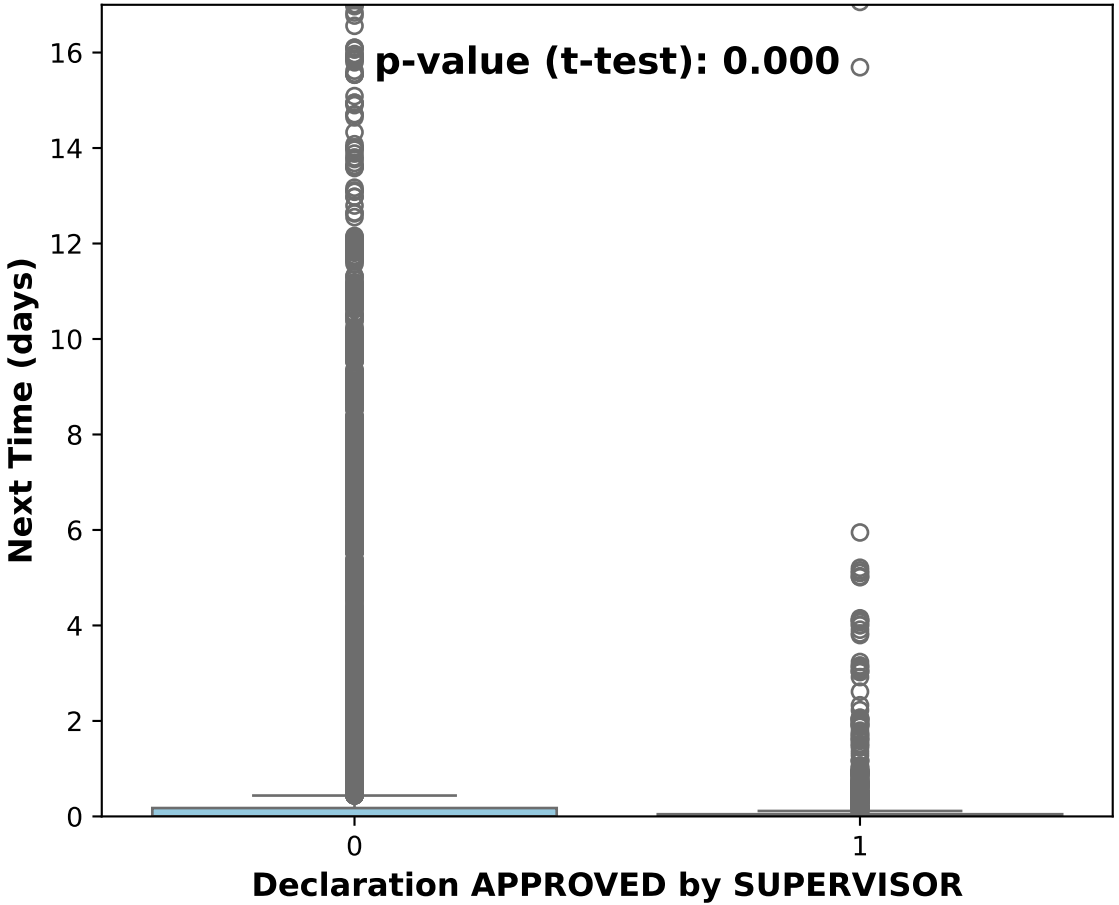
p-value (t-test): 0.000
Next Time (days)
0
2
4
6
8
10
12
14
16
0
1
Declaration APPROVED by SUPERVISOR

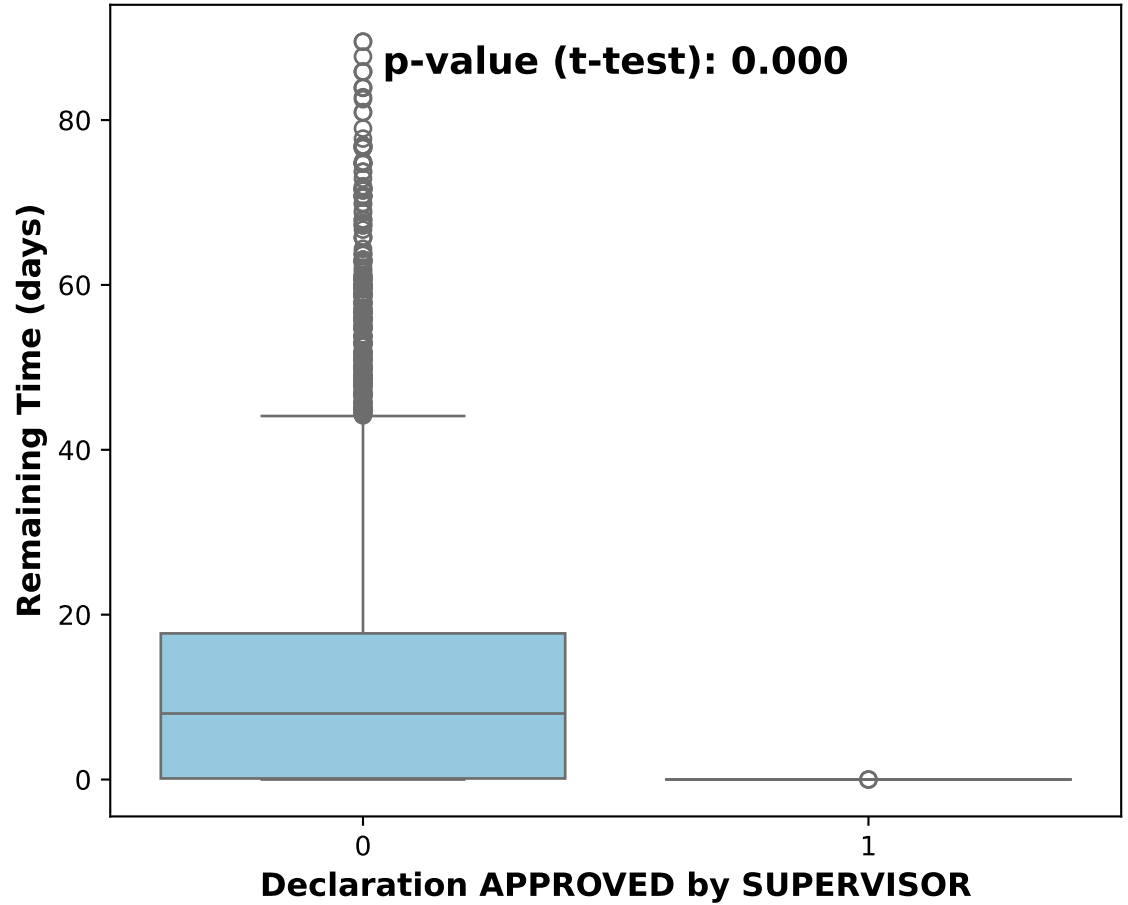
p-value (t-test): 0.000
Remaining Time (days)
0
20
40
60
80
0
1
Declaration APPROVED by SUPERVISOR