Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations
8095 Kalamath St. Denver, CO 80221
DAO No.: 2025-033
Construction Documents Submittal
September 25, 2026



VIEW FROM THE EAST

DRAWING INDEX

GENERAL

Cover	Cover Sheet
G0.0	Standard Symbols, Abbreviations & General Notes
G0.1	Building Code Data

ARCHITECTURE

AD1.0	Main Level Demolition Plan Area 'A'
AD1.1	Main Level Demolition Plan Area 'B'
AD2.0	Demo Exterior Elevation
A1.0	Main Level Plan Area 'A'
A1.1	Main Level Plan Area 'B'
A2.0	Exterior Elevation
A2.1	Exterior Elevation
A4.0	Wall Sections
A6.0	Interior Elevations
A6.1	Interior Elevations
A6.2	Interior Details/Door Schedule/Door & Window Details

PLUMBING

P0.0	Plumbing Cover Sheet - General Notes, Schedules & Legend
PD1.0	Main Level Demolition Plumbing Plan Area 'A'
P1.0	Main Level Plumbing Plan Area 'A'

ELECTRICAL

E0.1	Electrical Legends & Notes
E0.2	Electrical Schedules & One Line Diagram
ED1.3	Main Level Power Demo Plan - Area A
ED1.4	Main Level Fire Alarm Demo Plan - Area A
ED1.5	Basement & Main Level Electrical Demo Plan - Area B
ED1.6	Main Level Technology Demo Plan - Area A
E1.3	Main Level Power Plan - Area A
E1.5	Basement & Main Level Electrical Plan - Area B
E1.6	Main Level Technology Plan - Area A
E3.1	Electrical Details & Panel Schedules

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

OWNER:
WESTMINSTER PUBLIC SCHOOLS
7002 RALEIGH STREET
WESTMINSTER, CO 80030
CONTACT: DON CIANCIO
PHONE #: 720.542.5100

ARCHITECT:
DAO ARCHITECTURE
7230 MEADE STREET
WESTMINSTER, CO 80030
CONTACT: DAN ORECCHIO
PHONE #: 720.273.0431

MECHANICAL AND PLUMBING ENGINEERS:
THE BALLARD GROUP, INC.
2525 S WADSWORTH BLVD. SUITE 200
LAKEWOOD, CO 80227
CONTACT: ERIC BAALMAN; NATE RUST
PHONE: 303.988.4514

ELECTRICAL AND TECHNOLOGY ENGINEERS:
CATOR RUMA & ASSOCIATES, CO.
896 TABOR STREET
LAKEWOOD, CO 80401
CONTACT: KEVIN MILLER
PHONE: 303.232.6200

Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations
8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

CONSTRUCTION DOCUMENTS

Cover

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:37:59 PM

MATERIALS SYMBOLS

EARTHWORKS

EARTH NON-COMPACTED

EARTH COMPACT/FILL

GRAVEL/POROUS FILL

CONCRETE

CONCRETE

PRECAST CONCRETE

SAND/MORTAR/PLASTER

METAL

ALUMINUM

BRASS/BRONZE

STEEL

MASONRY

CONCRETE BLOCK

COMMON/FACE BLOCK

FIRE BRICK

STRUCTURAL FACING TILE

STONE

BLUESTONE/SLATE/ SOAPSTONE/FLAGGING

LIMESTONE

RUBBLE

WOOD

FINISH

ROUGH

SHIM

PLYWOOD

GLASS

GLASS

STRUCTURAL

GLASS BLOCK

INSULATION

BATT/LOOSE FILL

RIGID

SPRAY/FOAM

FINISHES

ACOUSTICAL TILE

CARPET AND PAD

CERAMIC TILE

GYPSUM WALLBOARD

TECTUM

PARTITION INDICATIONS

CAST-IN-PLACE CONCRETE

CONCRETE MASONRY

METAL STUD

WOOD STUD

ELEVATION INDICATIONS

BRICK

CERAMIC/ PORCELAIN TILE

CONCRETE/ PLASTER/GPDW

CONCRETE MASONRY UNIT

SHEET METAL

SHINGLES/SIDING

REFERENCE SYMBOLS

1 / A1.0 — SHEET ON WHICH IT IS FOUND; SIM — DETAIL OR SECTION NUMBER

No. / Sht. — SECTION REFERENCE

No. / Sht. — DETAIL REFERENCE

No. / Sht. — WALL SECTION REFERENCE

No. / Sht. — No. / Sht. — BUILDING SECTION REFERENCE

Sht. — No. — ELEVATION REFERENCE

ROOM NAME 101 — ROOM IDENTIFIER

1t — WINDOW/OPENING IDENTIFIER

1A101 — DOOR/OPENING IDENTIFIER

1 — EXISTING GRID LINE

Level 100'-0" — ELEVATION REFERENCE

1i — WALL TYPE REFERENCE

MATCH LINE

DEMOLITION INDICATOR

1 — REVISION INDICATOR

GENERAL NOTES

1. THE GENERAL CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS SHOWN ON PLANS PRIOR TO COMMENCEMENT OF THE WORK. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO COORDINATE INSTALLATION OF NEW WORK WITHIN THESE EXISTING CONDITIONS. ANY DEVIATIONS IN EXISTING CONDITIONS OR DIMENSIONS INDICATED SHALL BE COORDINATED WITH THE ARCHITECT AND OWNER IN ORDER TO MODIFY PLANS ACCORDINGLY.
2. ALL DISCIPLINES SHALL BE RESPONSIBLE FOR THEIR SCOPE OF WORK. THIS WORK IS TO BE SCHEDULED AND COMPLETED WITH THE GENERAL CONTRACTORS FULL KNOWLEDGE.
3. ALL HOT WORK ACTIVITIES (I.E. USING HEAT GUNS, SOLDERING, BRAZING, WELDING, GRINDING, METAL CUTTING, ETC.) OR OTHER ACTIVITIES INVOLVING FLAMES OR SPARKS SHALL BE PRECEDED BY OBTAINING AN APPROVED HOT WORK PERMIT. (IF HOT WORK REQUIRED)
4. THE PROJECT STAGING AREA / CONSTRUCTION ACTIVITIES SHALL NOT CAUSE THE OBSTRUCTION OF PATHS OF EGRESS INSIDE THE BUILDING, BLOCK EXIT DISCHARGE FROM THE BUILDING, OR IMPEDE EMERGENCY VEHICLE ACCESS TO THE BUILDING. CORRIDORS MAY NOT BE USED AS STAGING AREAS OR AS AREAS FOR DEBRIS COLLECTION.
5. ALL NECESSARY MEASURES SHALL BE TAKEN TO PREVENT THE NUISANCE ACTUATION OF ANY NEARBY SMOKE OR DUCT DETECTORS BY CONSTRUCTION ACTIVITIES THAT CREATE DUST OR FUMES INSIDE THE BUILDING.
6. THE CONTRACTOR SHALL NOT HANDLE OR DISABLE ANY FIRE SYSTEMS DEVICES. ONLY BUILDING FIRE SYSTEMS PERSONNEL MAY HANDLE OR DISABLE EXISTING FIRE SYSTEMS. ANY OUTAGES REQUIRED FOR THE EXISTING FIRE SYSTEMS SHALL BE PERFORMED ACCORDING TO WPS PROCEDURES.
7. THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR THE DETECTION OR REMOVAL OF ANY HAZARDOUS MATERIALS, INCLUDING, BUT NOT LIMITED TO, ASBESTOS IN ANY FORM. PARTIES RESPONSIBLE FOR DEMOLITION SHALL NOTIFY THE OWNER IMMEDIATELY OF ANY SUSPECTED MATERIALS.

PROJECT DESCRIPTION

ARCHITECTURALLY, THIS PROJECT ENTAILS THE REPLACEMENT OF EXISTING CASEWORK AND EXTERIOR WINDOWS, STAINING THE EXTERIOR EXISTING BRICK AND PAINTING EXTERIOR COMPONENTS.


THE PLUMBING SCOPE ENTAILS THE REPLACEMENT OF EXISTING CLASSROOM SINKS, FAUCETS AND BUBBLERS.

THE ELECTRICAL SCOPE ENTAILS THE REMOVAL OF EXISTING PLUG/MOLD/WIREMOLD AND REPLACEMENT WITH SURFACE MOUNTED CONDUIT AND JUNCTION BOXES, THE INSTALLATION OF POWER AND DATA NEW CLASSROOM MONITORS, REMOVAL AND REINSTALLATION OF SECURITY MOTION SENSORS WHERE THEY ARE MOUNTED ON TEACHERS CABINETS, VOICE LIFT POWER AND INTERCOM SYSTEM UPGRADES

STANDARD ABBREVIATIONS

A/E	ARCHITECT/ENGINEER	CONN	CONNECTION	GALV	GALVANIZED	MO	MASONRY OPENING	SLA	SLATE
AB	ANCHOR BOLT	CONSTR	CONSTRUCTION	GB	GRAB BAR	MOD	MODULE	SLP	SLOPE
ABBR	ABBREVIATE	CONT	CONTINUOUS	GDRL	GUARD RAIL	MTD	MOUNTED	SLS	SUB-FLOOR LEVELING SYSTEM
ABV	ABOVE	CONTR	CONTRACTOR	GENL	GENERAL	MTG	MEETING	SLV	SLEEVE
AC	AIR CONDITIONING	COORD	COORDINATE	GENL CONTR	GENERAL CONTRACTOR	MTL	METAL	SM	SHEET METAL
ACID RES	ACID RESISTANT	CORR	CORRIDOR	GFI	GROUND FAULT INTERRUPTER	MTR	MORTAR	SMLS	SEAMLESS
ACOUS	ACOUSTICAL	COV PL	COVER PLATE	GL	GLASS	MULL	MULLION	SP	SPACING
ACOUS INSUL	ACOUSTICAL INSULATION	CPRS	COMPRESSIBLE	GL BLK	GLASS BLOCK	MULT	MULTIPLE	SPCL	SPECIAL
ACOUS PNL	ACOUSTICAL PANEL	CPT	CARPET	GLU LAM	GLUE LAMINATED	MVBL	MOVABLE	SPEC	SPECIFICATION
ACOUS PLAS	ACOUSTICAL PLASTER	CRCMF	CIRCUMFERENCE	GLZ	GLAZING	N	NORTH	SPKLR	SPRINKLER
ACOUS TILE	ACOUSTICAL TILE	CRS	COLD ROLLED STEEL	GLZ CMU	GLAZED CONCRETE MASONRY UNIT	N/A	NOT APPLICABLE	SPKR	SPEAKER
ACT	ACTUAL	CSG	CASING	GND	GROUND	NEG	NEGATIVE	SPRT	SUPPORT
AD	AREA DRAIN	CSK	COUNTERSUNK	GPDW	GYPSUM DRY WALL	NF	NEAR FACE	SQFT	SQUARE FOOT
ADC	AUTOMATIC DOOR CLOSER	CSMT	CASEMENT	GR BM	GRADE BEAM	NIC	NOT IN CONTRACT	SQ	SQUARE
ADDL	ADDITIONAL	CSWK	CASEWORK	GR	GRADE	NO	NUMBER	SQIN	SQUARE INCH
ADDM	ADDENDUM	CT	CERAMIC TILE	GRTG	GRATING	NOM	NOMINAL	SQYD	SQUARE YARD
ADJ	ADJUSTABLE	C TV	CABLE TELEVISION	GUT	GUTTER	NS	NEAR SIDE	SSK	SERVICE SINK
ADJC	ADJACENT	CUB	CUBICLE	GYP	GYPSUM	NTS	NOT TO SCALE	SS	STAINLESS STEEL
AF	ACCESS FLOOR	CUR	CURRENT	GYP PLAS	GYPSUM PLASTER	O/O	OUT TO OUT	SSM	SOLID SURFACING MATERIAL
AFF	ABOVE FINISHED FLOOR	CW	COLD WATER	H	HIGH	OA	OVERALL	ST	STAIN
AFG	ABOVE FINISHED GRADE	DBL GLZ	DOUBLE GLAZING	H&CW	HOT & COLD WATER	OC	ON CENTER	ST	STREET
AFS	ABOVE FINISHED SLAB	DEPT	DEPARTMENT	HB	HOSE BIBB	OD	OUTSIDE DIAMETER	STAG	STAGGERED
AGGR	AGGREGATE	DET	DETAIL	HC	HOLLOW CORE	OD	OVERFLOW DRAIN	STC	SOUND TRANSMISSION CLASS
AHR	ANCHOR	DF	DRINKING FOUNTAIN	HC	HANDICAP	OF	OUTSIDE FACE	STD	STANDARD
AHU	AIR HANDLING UNIT	DF	DRAPERY FABRIC	HCMU	HOLLOW CONCRETE MASONRY UNIT	OFCI	OWNER FURNISHED CONTRACTOR INSTALL	STIR	STIRRUP
ALD	ALUMINUM DOOR	DFR	DOOR FRAME	HD	HEAVY DUTY	OFF	OFFICE	STL JST	STEEL JOIST
ALM	ALARM	DH	DOUBLE HUNG	HDJT	HEAD JOINT	OFOI	OWNER FURNISHED OWNER INSTALLED	STL PL	STEEL PLATE
ALT	ALTERNATE	DIA	DIAMETER	HDBD	HARDBOARD	OH	OVERHEAD	STL	STEEL
ALUM	ALUMINUM	DIM	DIMENSION	HDR	HEADER	OHD	OVERHEAD DOOR	STN	STONE
AMB	AMBIENT	DIST	DISTANCE	HDWD	HARDWOOD	OPER	OPERABLE	STOR	STORAGE
AMPL	AMPLIFIER	DIV	DIVIDER	HGT	HEIGHT	OPNG	OPENING	STRUCT	STRUCTURAL
AMT	AMOUNT	DIW	DEIONIZED WATER	HLB	HORIZONTAL LOUVER BLINDS	OPP	OPPOSITE	STRUCT STL	STRUCTURAL STEEL
ANN	ANNUNCIATOR	DJ	DOUBLE JOIST	HM	HOLLOW METAL	OPT	OPTIONAL	SUPPL	SUPPLEMENT
ANOD	ANODIZED	DL	DRAPERY LINER	HMD	HOLLOW METAL DOOR	ORIG	ORIGINAL	SURF	SURFACE
ANT	ANTENNA	DMPF	DAMPPROOFING	HMF	HOLLOW METAL FRAME	OVHD	OVERHEAD	SUSP	SUSPENDED
AP	ACCESS PANEL	DN	DOWN	HNDRL	HAND RAIL	OXY	OXYGEN	SUSP CLG	SUSPENDED CEILING
APPX	APPENDIX	DO	DITTO	HO	HOLD-OPEN	OZ	OUNCE	SVB	SHEET VINYL BASE
ARCH	ARCHITECT(URAL)	DR	DOOR	HORIZ	HORIZONTAL	PC	PRECAST	SVF	SHEET VINYL FLOOR
ASB	ASBESTOS	DR CLSR	DOOR CLOSURE	HR	HOUR	PAR	PARALLEL	SYM	SYMBOL
ASC	ABOVE SUSPENDED CEILING	DS	DOWNSPOUT	HS	HIGH STRENGTH	PARG	PARGING	SYMM	SYMMETRICAL
ASPH	ASPHALT	DST	DOOR STOP	HSB	HIGH STRENGTH BOLT	PB	PANIC BAR	SYST	SYSTEM
ASYM	ASYMMETRICAL	DT	DRAIN TILE	HTG	HEATING	PBD	PARTICLE BOARD	T&B	TOP & BOTTOM
AV	AUDIO VISUAL	DUPL	DUPLICATE	HVAC	HEATING, VENTILATION, AIR CONDITIONING	PC	PORTLAND CEMENT	T&G	TONGUE & GROOVE
AVE	AVENUE	DVTL	DOVETAIL	HW	HOT WATER	PCPLAS	PORTLAND CEMENT PLASTER	T	TABLE
AWC	ACOUSTICAL WALL COVERING	DW	DISHWASHER	HYD	HYDRANT	PED	PEDESTAL	TB	TACKBOARD
AWP	ACOUSTICAL WALL PANEL	DWG	DRAWING	ID	INSIDE DIAMETER	PERF	PERFORATED	TB-xx	TEST BORING-xx (E.G. TB-1)
B&B	BALLED AND BURLAPPED	DWL	DOWEL	IF	INSIDE FACE	PERIM	PERIMETER	TC	TOP OF CURB
BAF	BAFFLE	DWR	DRAWER	INCAND	INCANDESCENT	PERM	PERMANENT	TD	TRENCH DRAIN
BAL	BALANCE	DWTR	DUMBWAITER	INL	INLET	PERP	PERPENDICULAR	TE	TRANSITION EDGE
BB	BULLETIN BOARD	E	EAST	INSTL	INSTALLATION	PF	PANEL FABRIC	TECH	TECHNICAL
BC	BOTTOM OF CURB	EA	EACH	INSUL	INSULATION	PFP	PRE-FINISHED PANELS	TEMP	TEMPORARY
BD	BOARD	EF	EACH FACE	INTR	INTERIOR	PGBD	PEGBOARD	TER	TERRAZZO
BEV	BEVEL	EJ	EXPANSION JOINT	INV	INVERT	PH	PHASE	THK	THICK
BF	BOTH FACES	EL	ELEVATION	INV EL	INVERT ELEVATION	PL	PLASTIC LAMINATE	THRES	THRESHOLD
BFF	BELOW FINISH FLOOR	ELEC	ELECTRICAL	JAN	JANITOR	PLAM	PLASTIC LAMINATE	THRU	THROUGH
BFP	BACKFLOW PREVENTER	ELEV	ELEVATOR	JC	JANITOR'S CLOSET	PLAS	PLASTER	TKBD	TACKBOARD
BITUM	BITUMINOUS	EMER	EMERGENCY	JST	JOIST	PLAT	PLATFORM	TLT	TOILET
BJT	BED JOINT	EMER SHR	EMERGENCY SHOWER	JT	JOINT	PLBG	PLUMBING	TMPD	TEMPERED
BL	BASE LINE	ENAM	ENAMEL	KB	KNEE BRACE	PLYWD	PLYWOOD	TMPD GL	TEMPERED GLASS
BLDG	BUILDING	ENCL	ENCLOSURE	KO	KNOCKOUT	POL	POLISHED	TNL	TUNNEL
BLK	BLOCK	ENGR	ENGINEER	KOP	KNOCKOUT PANEL	POLY	POLYSTYRENE	TO	TOP OF
BLKG	BLOCKING	ENTR	ENTRANCE	KPL	KICK PLATE	POLYISO	POLYISOCYANURATE	TOF	TOP OF FLANGE
BLKHD	BULKHEAD	EO	ELECTRICAL OUTLET	KWY	KEYWAY	POS	POSITIVE	TOFF	TOP OF FINISH FLOOR
BLST	BALLAST	EP	ELECTRICAL PANEL	L	LEFT	PR	PAIR	TOJ	TOP OF JOIST
BM	BEAM	EPS	EXPANDED POLYSTYRENE	LAB	LABORATORY	PREFAB	PREFABRICATED	TOL	TOLERANCE
BO	BOTTOM OF	EPX	EPOXY FLOOR	LAT	LAY-IN ACOUSTICAL TILE	PRELIM	PRELIMINARY	TOS	TOP OF STEEL
BOC	BACK OF CURB	EQL SP	EQUALLY SPACED	LAV	LAVATORY	PRKG	PARKING	TOT	TOTAL
BOW	BOTTOM OF WALL	EQ	EQUAL	LB	POUND	PROJ	PROJECT	TOW	TOP OF WALL
BP	BASE PLATE	EQUIP	EQUIPMENT	LBR	LUMBER	PS	PROJECTION SCREEN	TRNBKL	TURNBUCKLE
BRCG	BRACING	EQUIV	EQUIVALENT	LCMU	LIGHTWEIGHT CONCRETE MASONRY UNIT	PT	PAINT	TS	TUBE STEEL
BRDG JST	BRIDGING JOIST	ERECT	ERECTION	LD BRG	LOAD BEARING	PT	PORCELAIN TILE	TV	TELEVISION
BRG	BEARING	ESCAL	ESCALATOR	LDG	LANDING	PTN	PARTITION	TYP	TYPICAL
BRG PL	BEARING PLATE	ESMT	EASEMENT	LF	LINEAR FOOT	PVC	POLYVINYL CHLORIDE	UF	UPHOLSTERY FABRIC
BRK	BRICK	EST	ESTIMATE	LG	LENGTH	PVG	PAVING	UFD	UNDER FLOOR DUCT
BRKT	BRACKET	EW	EACH WAY	LH	LEFT HAND	PVMT	PAVEMENT	UG	UNDERGROUND
BRS	BRASS	EXC	EXCAVATE	LHR	LEFT HAND REVERSE	PWR	POWER	UL	UNDERWRITERS LABORATORY
BRZ	BRONZE	EXG	EXISTING	LIN	LINOLEUM	QT	QUARRY TILE	ULT	ULTIMATE
BS	BOTH SIDES	EXH HD	EXHAUST HOOD	LIQ	LIQUID	QTY	QUANTITY	UNEX	UNEXCAVATED
BSMT	BASEMENT	EXH FN	EXHAUST FAN	LKR	LOCKER	QUAL	QUALITY	UNFIN	UNFINISHED
BTM	BOTTOM	EXP	EXPANSION	LKR RM	LOCKER ROOM	R	RISER	UNO	UNLESS NOTED OTHERWISE
BUR	BUILT-UP ROOF	EXSP	EXPOSED	LL	LIVE LOAD	RAD	RADIUS	UPS	UNINTERRUPTIBLE POWER SUPPLY
BW	BOTH WAYS	EXST	EXISTING	LNTL	LINTEL	RB	RUBBER BASE	UR	URINAL
BOW	BOTTOM OF WALL	EXST GR	EXISTING GRADE	LOC	LOCATION	RBR	RUBBER	UTIL	UTILITY
C/C	CENTER TO CENTER	EXT	EXTERIOR	LONG	LONGITUDINAL	RC	REINFORCED CONCRETE	V	VOLT
C&G	CURB AND GUTTER	EXTN	EXTENSION	LRG	LARGE	RCP	REINFORCED CONCRETE PIPE	VAC	VACUUM
CAB	CABINET	EIFS	EXTERIOR INSULATION & FINISH SYSTEM	LS	LUMP SUM	RD	ROOF DRAIN	VAV	VARIABLE AIR VOLUME
CARP	CARPET	F BRK	FIRE BRICK	LT	LIGHT	REC	RECESSED	VB	VAPOR BARRIER
CAV	CAVITY	F/F	FACE TO FACE	LT WT	LIGHTWEIGHT	RECD	RECEIVED	VB	VINYL BASE
CB	CATCH BASIN	FBD	FIBERBOARD	LTG	LIGHTING	RECPT	RECEPTACLE	VCT	VINYL COMPOSITION TILE
CCTV	CLOSED CIRCUIT TELEVISION	FC	FIRE COATED	LVL	LEVEL	RECT	RECTANGULAR	VDB	VISUAL DISPLAY BOARD
CEM	CEMENT	FD	FLOOR DRAIN	LVR	LOUVER	REF	REFERENCE	VERT	VERTICAL
CEM PLAS	CEMENT PLASTER	FDN	FOUNDATION	LW PLAS	LIGHTWEIGHT PLASTER	REINF	REINFORCEMENT	VEST	VESTIBULE
CER	CERAMIC	FEC	FIRE EXTINGUISHER CABINET	LWC	LIGHTWEIGHT CONCRETE	REM	REMOVABLE	VIB	VIBRATION
CER TILE	CERAMIC TILE	FF	FACTORY FINISH	M	METER	REQD	REQUIRED	VNR	VENEER
C FLG	COUNTER FLASHING	FFE	FINISH FLOOR ELEVATION	MAINT	MAINTENANCE	RESIL	RESILIENT	VOL	VOLUME
CH BD	CHALKBOARD	FGL	FIBERGLASS	MARB	MARBLE	RFM	RECESSED FLOOR MAT	VR	VAPOR RETARDER
CG	CORNER GUARD	FIN GR	FINISH GRADE	MAS	MASONRY	RFG	ROOFING	VT	VINYL TILE
CHAN	CHANNEL	FIN FL	FINISH FLOOR	MATL	MATERIAL	RH	RIGHT HAND	VWC	VINYL WALL COVERING
CHFR	CHAMFER	FIN	FINISH	MAX	MAXIMUM	RHR	RIGHT HAND REVERSE	W	WITH
CHK	CHECK	FL	FLOWLINE	MB	MARKERBOARD	RND	ROUND	WW	WALL TO WALL
CI	CAST IRON	FLDG	FOLDING	MBR	MEMBER	RO	ROUGH OPENING	WO	WITHOUT
CIP	CAST IN PLACE	FLG	FLANGE	MC	METAL CLAD	RST	RUBBER STAIR TREAD	W	WEST
CIR	CIRCLE	FLR	FLOOR	MDF	MEDIUM DENSITY FIBERBOARD	RT	RUBBER TILE	WC	WATER CLOSET
CJ	CONTROL JOINT	FLR SK	FLOOR SINK	MDO	MEDIUM DENSITY OVERLOAD	RV	ROOF VENT	WC	WALL COVERING
CL	CENTER LINE	FLR PL	FLOOR PLATE	ME	MATCH EXISTING	RVS	REVERSE	WCPT	WALL CARPET
CLG	CEILING	FLR FIN	FLOOR FINISH	ME	MISCELLANEOUS EQUIPMENT	S	SOUTH	WD	WOOD
CLG DIFF	CEILING DIFFUSER	FLT GL	FLOAT GLASS	MECH	MECHANICAL	S	SEATING	WDD	WOOD DOOR
CLG HT	CEILING HEIGHT	FLOUR	FLUORESCENT	MED	MEDIUM	SALV	SALVAGE	WDW	WINDOW
CLL	CONTRACT LIMIT LINE	FOC	FACE OF CONCRETE	MEMB	MEMBRANE	SB	SPLASH BLOCK	WF	WOOD FLOORING
CLOS	CLOSET	FOM	FACE OF MASONRY	MEZZ	MEZZANINE	SC	SOLID CORE	WF	WIDE FLANGE
CLR	CLEAR	FOS	FACE OF STUD	MFG	MANUFACTURING	SCH	SCHEDULE	WGL	WIRE GLASS
CLSR	CLOSURE	FPL	FIREPLACE	MFR	MANUFACTURER	SCMU	SOLID CONCRETE MASONRY UNIT	WH	WALL HUNG
CMPST	COMPOSITE	FPRF	FIREPROOFING	MH	MANHOLE	SCRN	SCREEN	WHSE	WAREHOUSE
CMU	CONCRETE MASONRY UNIT	FRM	FRAME	MIL	MILLIMETER	SD	STORM DRAIN	WL	WIND LOAD
CNR	CORNER	FRNT	FRONT	MIN	MINIMUM	SECT	SECTION	WLD	WELDED
CNTR	COUNTER	FS	FULL SIZE	MIR	MIRROR	SF	SYSTEMS FURNITURE	WR	WATER RESISTANT
CO	CLEANOUT	FSP	FIRE STANDPIPE	MISC	MISCELLANEOUS	SGL	SINGLE	WS	WEATHERSTRIPPING
COL	COLUMN	FSTNR	FASTENER	MK	MARK	SHR	SHOWER	WSCT	WAINSCOT
COMM	COMMERCIAL	FTG	FOOTING	MKRBD	MARKERBOARD	SHTHG	SHEATHING	WT	WEIGHT
COMPL	COMPLETE	FURR	FURRING	ML	MATCH LINE	SHVL	SHELVES	WTR	WATER
CONC	CONCRETE	FUT	FUTURE	MLC	METAL LABORATORY CASEWORK	SIM	SIMILAR	WTRPRF	WATERPROOFING
CONC FL	CONCRETE FLOOR	FXTR	FIXTURE	MLDG	MOLDING	SJ	SLIP JOINT	WWM	WELDED WIRE MESH
CONF	CONFERENCE	GA	GYPSUM ASSOCIATION	MLWK	MILLWORK	SK	SINK	X SECT	CROSS SECTION

VICINITY MAP

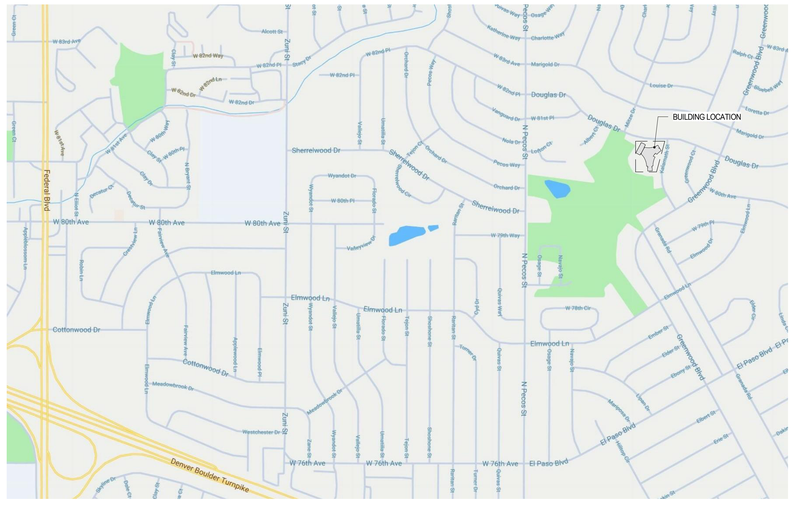

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

Standard Symbols, Abbreviations & General Notes

G0.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:25:58 PM

APPLICABLE BUILDING CODES

All new work shall comply with the requirements of the codes and standards adopted by the State of Colorado.
The primary Applicable Codes and Standards are:

The 2021 International Code Series:
- The 2021 International Existing Building Code (IEBC)
- The 2021 International Building Code (IBC)
- The 2021 International Fire Code (IFC)
- The 2021 International Mechanical Code (IMC)
- The 2021 International Energy Conservation Code (IECC)

The 2024 Colorado Plumbing Code (CPC)
The 2024 Colorado Fuel Gas Code (CFGC)
The 2023 National Electrical Code
The 2017 ICC A117.1, Accessible and Usable Buildings and Facilities
The 2023 Colorado Model Electric Ready and Solar Ready Code

CODE REVIEW

This project entails an office remodel at Sherrelwood Elementary School in Westminster, CO.
This building is an existing E Occupancy and will remain an E Occupancy.

In general, the Architectural scope entails the replacement of existing casework and exterior windows, staining the exterior brick and painting exterior components, the replacement of an existing metal panel partition wall with a new framed wall and door, a new accordion door, and the replacement of markerboards. The plumbing scope entails the replacement of classroom sinks, faucets and bubblers. The electrical scope entails the removal of existing plugmold/wiremold and replacement with surface mounted conduit and junction boxes, the installation of new classroom monitors, removal and reinstallation of security motion sensors where they are mounted on teachers cabinets, voice lift power and intercom system upgrades.

The project will follow the Prescriptive compliance method, per section 301.1.1 of the 2021 IEBC. The project is considered an Alteration per section 403 of the 2021 IEBC. As such, any alterations shall comply with the requirements fof the 2021 International Building Code, and the existing building shall be no less conforming to the provisions of the IBC than the existing building was prior to the alteration.
Per section 410.7 the alteration affects an area containing a primary function, and the route to the primary function area shall be accessible. The accessible route to the primary function area shall include toilet facilities and drinking fountains serving the area of primary function. See the Life Safety Plan for the accessible route.

Chapter 3 - Use Occupancy Classification
305 - Educational: Group E - Educational Group E occupancy includes, among others, the use of a building or structure, or a portion thereof, by six or more persons at any one time for educational purposes through the 12th grade.

Chapter 4 - Special Detailed Requirements Based on Use and Occupancy
Not Applicable to new work.

Chapter 5 - General Building Heights and Areas
Existing building height and area are to remain as-is and are not being modified by this project.

Chapter 6 - Types of Construction
602 - Construction Classification
602.3 - Type IIIB - The existing building is assumed to be type IIIB, as the exterior walls are of noncombustible materials, and the interior building elements are of any material permitted by the IBC.

Chapter 7 - Fire and Smoke Protection Features
705 - Accessibility
705.2 - Alterations affecting an area containing a primary function - Where an alteration affects the accessibility to a, or contains an area of, primary function, the route to the primary function shall be accessible. The accessible route to the primary function area shall include toilet facilities and drinking fountains serving the area of primary function.

708 - Fire Partitions
708.1 General - Corridor walls as required by section 1020.1 shall be fire partitions.
708.4 Continuity - Fire partitions hall extend from the top of the foundation or floor/ceiling assembly below to the underside of the floor or roof sheathing, slab, or deck above, and shall be securely attached thereto.
708.6 Openings. - Openings in a fire partition shall be protected in accordance with Section 716
Table 716.5 - Doors in corridor walls which are required to be 1-hour fire resistance rated fire partitions shall be 20 minute rated.
Table 716.6 - Windows in corridor walls which are required to be 1-hour fire resistance rated fire partitions shall be 45 minute rated.
708.7 Penetrations - Penetrations of fire partitions shall comply with Section 714.
722 - Calculated Fire Resistance - Existing masonry wall construction at existing corridor wall locations is of sufficient thickness to meet a 1-hour fire resistance rating, per 2015 IBC Table 721.1.(2).

Chapter 8 - Interior Finishes
803 - Wall and Ceiling Finishes
803.1 - Interior wall and ceiling finish materials shall be classified for fire performance and smoke development in accordance with section 803.1.1
803.9 - Interior finish requirements based on group - Per Table 803.9
E Occupancy (non-sprinklered) - Exit enclosures and exit passageways - Class A;
Corridors - Class B;
Rooms and Enclosed Spaces - Class C

Chapter 9 - Fire Protection Systems
Fire alarm and detection systems are existing-to-remain
906 - Portable Fire Extinguishers
906.1 Where required - Portable fire extinguishers shall be installed in E Occupancies
906.3 Size and Distribution - Educational occupancies are considered a light hazard occupancy. Per table 906.3(1), the minimum rating for a single extinguisher shall be 2-A, the maximum floor area per unit A shall be 3,000 square feet, the maximum area per extinguisher shall be 11,250 square feet, and the maximum travel distance shall be 75 feet.

Chapter 10 - Means of Egress
1001.2 Minimum Requirements - It shall be unlawful to alter a building or structure in a manner that will reduce the number of exits or the capacity of the means of egress to less that required by this code.
1003.2 Ceiling height - The means of egress shall have a ceiling height of not less than 7'-6".
1004 - Occupant Load
1004.1 Design Occupant Load - In determining means of egress requirements, the number of occupants for whom means of egress facilities shall be provided shall be determined in accordance with this section. Refer to the Occupant Load table on this sheet
1005 - Means of Egress Sizing
1005.3.2 Other egress components - The capacity, in inches, or means of egress components other than stairways shall be calculated by multiplying the occupant load served by each component by a means of egress capacity factor of .2 inch per occupant.
1005.5 Distribution of egress capacity - Where more than one exit, or access to more than one exit, is required, the means of egress shall be configured such that the loss of any one exit, or access to one exit, shall not reduce the available capacity to less than 50 percent of the required capacity.
1006 - Number of Exits and Exit Access Doorways
1006.2 Egress from Spaces - Rooms, areas, or spaces, shall be provided with the number of exits or access to exits in accordance with this section.
1006.2.1 Egress based on occupant load and common path of egress travel (CPET) distance - Two exits or exit access doorways from any space where the design occupant load or the common path of egress travel distance exceeds the values listed in table 1006.2.1
E Occupancy - Greater than 49 occupants, or more than 75' CPET distance.
1007 - Exit and Exit Access Doorway Configuration
1007.1.1 Two exits or exit access doorways - Where two exits or exit access doorways are required from any portion of the exit access, the exit doors or exit access doorways shall be placed a distance apart equal to no less than one-half of the length of the maximum overall diagonal dimension of the building or area to be served measured in a straight line between exit doors or exit access doorways.
1009 - Accessible Means of Egress
1009.1 Accessible means of egress required - Exception 1: Accessible means of egress are not required to be provided in existing buildings.
1010 - Doors, Gates and Turnstiles
1010.1.1 Size of Doors - The minimum width of each door opening shall be sufficient for the occupant load thereof and shall provide a clear width of 32 inches.
1010.1.2 Door Swing - Doors shall swing in the direction of egress travel where serving a room or area containing an occupant load of 50 or more persons.
1013 - Exit Signs
1013.1 Where Required - Exits and exit access doors shall be marked by an approved exit sign readily visible from any direction of egress travel.
1017 - Exit Access Travel Distance
1017.2 Limitations - Exit Access Travel Distance shall not exceed the values given in table 1017.2
Table 1017.2 - E Occupancy (non-sprinklered) - 200'
1020 - Corridors
Corridors shall be fire-resistance rated in accordance with table 1020.1. The corridor walls required to be fire-resistance rated shall comply with section 708 for fire partitions.
Table 1020.1 - E occupancy, greater than 30 occupants served by corridor, non-sprinklered -1 hour.

Chapter 11 - Accessibility
1103 - Scoping Requirements
1103.1 Where required - Sites, buildings, structures, facilities, elements and spaces, temporary or permanent shall be accessible to individuals with disabilities.
1104 - Accessible Route
1104.1 Site arrival points. At least one accessible route within the site shall be provided from public transportation stops, accessible parking, accessible passenger loading zones, and public streets or sidewalks to the accessible building entrance served.
1104.2 Within a site. At least one accessible route shall connect accessible buildings, accessible facilities, accessible elements and accessible spaces that are on the same site.
1104.3 Connected spaces. When a building or portion of a building is required to be accessible, at least one accessible route shall be provided to each portion of the building, to accessible building entrances connection accessible pedestrian walkways and to the public way

Chapter 13 - Energy Efficiency
The only exterior work that is occurring which affects the envelope is the like for like replacement of new doors in existing frames. The envelope will be made no less conforming than it was prior to the project.

Chapter 29 - Plumbing Systems
The existing plumbing fixture count has not been altered as a result of this project, and the occupant load has not been increased from existing conditions, as such, the fixture count remains the same.

Occupant Load Table

Number	Name	Occupancy Classification	Area	Area Function	SF Per Occupant	Occupant Load	Required Exiting Width
Classroom Wing							
1	Classroom	(IBC) E	0 SF	IBC_Educational: Classroom area	20 SF	0	0
1A	Office	(IBC) B	422 SF	IBC_Business areas	100 SF	5	0.9
1B	Office	(IBC) B	174 SF	IBC_Business areas	100 SF	2	0.4
2	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
3	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
4	Classroom	(IBC) E	610 SF	IBC_Educational: Classroom area	20 SF	31	6.2
5	Classroom	(IBC) E	617 SF	IBC_Educational: Classroom area	20 SF	31	6.3
6	Classroom	(IBC) E	607 SF	IBC_Educational: Classroom area	20 SF	31	6.2
7	Classroom	(IBC) E	609 SF	IBC_Educational: Classroom area	20 SF	31	6.2
8	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
9	Classroom	(IBC) E	606 SF	IBC_Educational: Classroom area	20 SF	31	6.2
10	Classroom	(IBC) E	604 SF	IBC_Educational: Classroom area	20 SF	31	6.1
11	Classroom	(IBC) E	607 SF	IBC_Educational: Classroom area	20 SF	31	6.2
12	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
13	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
14	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
15	Classroom	(IBC) E	609 SF	IBC_Educational: Classroom area	20 SF	31	6.2
16	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
17	Classroom	(IBC) E	608 SF	IBC_Educational: Classroom area	20 SF	31	6.2
18	Storage	(IBC) S-1	129 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.2
19	Storage	(IBC) S-1	132 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.2
23	Restroom	(none)	124 SF	(none)		0	0
24	Restroom	(none)	149 SF	(none)		0	0
25	Restroom	(none)	24 SF	(none)		0	0
26	Restroom	(none)	24 SF	(none)		0	0
27	Library	(IBC) E	1355 SF	IBC_Library: Reading rooms	50 SF	28	5.5
27a	Office	(IBC) B	68 SF	IBC_Business areas	100 SF	1	0.2
27b	Work Room	(IBC) E	75 SF	IBC_Business areas	100 SF	1	0.2
28	Work Room	(IBC) B	333 SF	IBC_Business areas	100 SF	4	0.8
29	Storage	(IBC) S-1	149 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.2
30	Restroom	(none)	156 SF	(none)		0	0
30a	Storage	(IBC) E	85 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.2
31	Restroom	(none)	171 SF	(none)		0	0
31a	Storage	(IBC) E	66 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.1
32	Storage	(IBC) B	140 SF	IBC_Kitchens, commercial	200 SF	1	0.2
32a	Storage	(IBC) B	68 SF	IBC_Kitchens, commercial	200 SF	1	0.2
33	Custodial	(none)	59 SF	(none)		0	0
34	Kitchen	(IBC) B	361 SF	IBC_Kitchens, commercial	200 SF	2	0.5
35	Serving Counter	(IBC) E	144 SF	IBC_Kitchens, commercial	200 SF	1	0.2
37	Vestibule	(none)	58 SF	(none)		0	0
38	Vestibule	(none)	59 SF	(none)		0	0
41	Storage	(IBC) S-1	292 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.3
42	Office	(IBC) B	158 SF	IBC_Business areas	100 SF	2	0.4
43	Music Room	(IBC) E	960 SF	IBC_Educational: Classroom area	20 SF	48	9.7
100	Vestibule	(none)	129 SF	(none)		0	0
101a	Corridor	(none)	2421 SF	(none)		0	0
101b	Corridor	(none)	933 SF	(none)		0	0
101c	Corridor	(none)	950 SF	(none)		0	0
101d	Corridor	(none)	772 SF	(none)		0	0
101e	Corridor	(none)	343 SF	(none)		0	0
102	Reception	(IBC) B	403 SF	IBC_Business areas	100 SF	5	0.9
103	Infirmary	(IBC) B	87 SF	IBC_Business areas	100 SF	1	0.3
104	Work Area	(IBC) B	91 SF	IBC_Business areas	100 SF	1	0.3
105	Flex	(IBC) B	186 SF	IBC_Business areas	100 SF	2	0.5
106	Storage	(IBC) S-1	0 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	0	0
107	Secretary	(IBC) B	127 SF	IBC_Business areas	100 SF	2	0.4
109	Work Room	(IBC) B	466 SF	IBC_Business areas	100 SF	5	1
110	MDF	(none)	75 SF	IBC_Accessory storage areas, mechanical equipment room	300 SF	1	0.1
111	Office	(IBC) B	150 SF	IBC_Business areas	100 SF	2	0.4
112	Lounge	(IBC) B	220 SF	IBC_Business areas	100 SF	3	0.5
A	Classroom	(IBC) E	732 SF	IBC_Educational: Classroom area	20 SF	37	7.4
B	Classroom	(IBC) E	731 SF	IBC_Educational: Classroom area	20 SF	37	7.4
Classroom Wing: 62			24485 SF			693	138.6
Gymnasium							
40	Gymnasium	(IBC) A-3	3192 SF	IBC_Assembly: without fixed seats - Concentrated (chairs only - not fixed)	7 SF	456	91.3
Gymnasium: 1			3192 SF			456	91.3
Grand total: 63			27677 SF			1150	229.9

NOTE:
THE GYMNASIUM IS SHOWN SPLIT OUT FROM THE REST OF THE SCHOOL, FOR COMPARISON OF THE OCCUPANT LOAD OF THE AFTER HOURS ASSEMBLY SPACES AND THE EDUCATIONAL SPACES. THE OCCUPANT LOAD FOR THE BUILDING IS BASED ON THE COMBINED TOTAL.

EGRESS TRAVEL DISTANCES	
PATH NAME	DISTANCE
1A	63' - 0"

LIFE SAFETY SYMBOLS

- FEC — FIRE EXTINGUISHER CABINET (EXISTING)
- FEC — FIRE EXTINGUISHER CABINET
- 1 HOUR FIRE PARTITION (EXISTING)
- XX — PATH OF EGRESS TRAVEL (FOR CUMULATIVE DISTANCES REFER TO SCHEDULE)
- EXIT DISCHARGE
- P: XX" / R: XX" — WIDTH PROVIDED / WIDTH REQUIRED
- ACCESSIBLE TRAVEL ROUTE



Life Safety Plan
SCALE: 1/16" = 1'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations
8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026


Building Code Data

G0.1

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:01 PM

DEMOLITION KEY NOTES

1. REMOVE EXISTING WINDOW SYSTEM IN ITS ENTIRETY. WHERE PRESENT, EXISTING STEEL COLUMNS TO REMAIN. PATCH AND PREPARE SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
2. REMOVE EXISTING CASEWORK. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
3. REMOVE EXISTING SINK IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION. SEE PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
4. REMOVE EXISTING SECURITY GATE IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES ARE REQUIRED FOR NEW CONSTRUCTION
5. REMOVE EXISTING INTERIOR SLOPED GYP WALL IN ALL ITS ENTIRETY. EXISTING EXTERIOR BRICK WALL BEHIND IS TO REMAIN. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
6. REMOVE EXISTING ACCORDION DOOR IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION.
7. REMOVE EXISTING MARKERBOARD AND TACKBOARD IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION.
8. REMOVE EXISTING PANEL WALL SYSTEM AND ASSOCIATED DOORS IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION.
9. REMOVE EXISTING BRICK WING WALL IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION

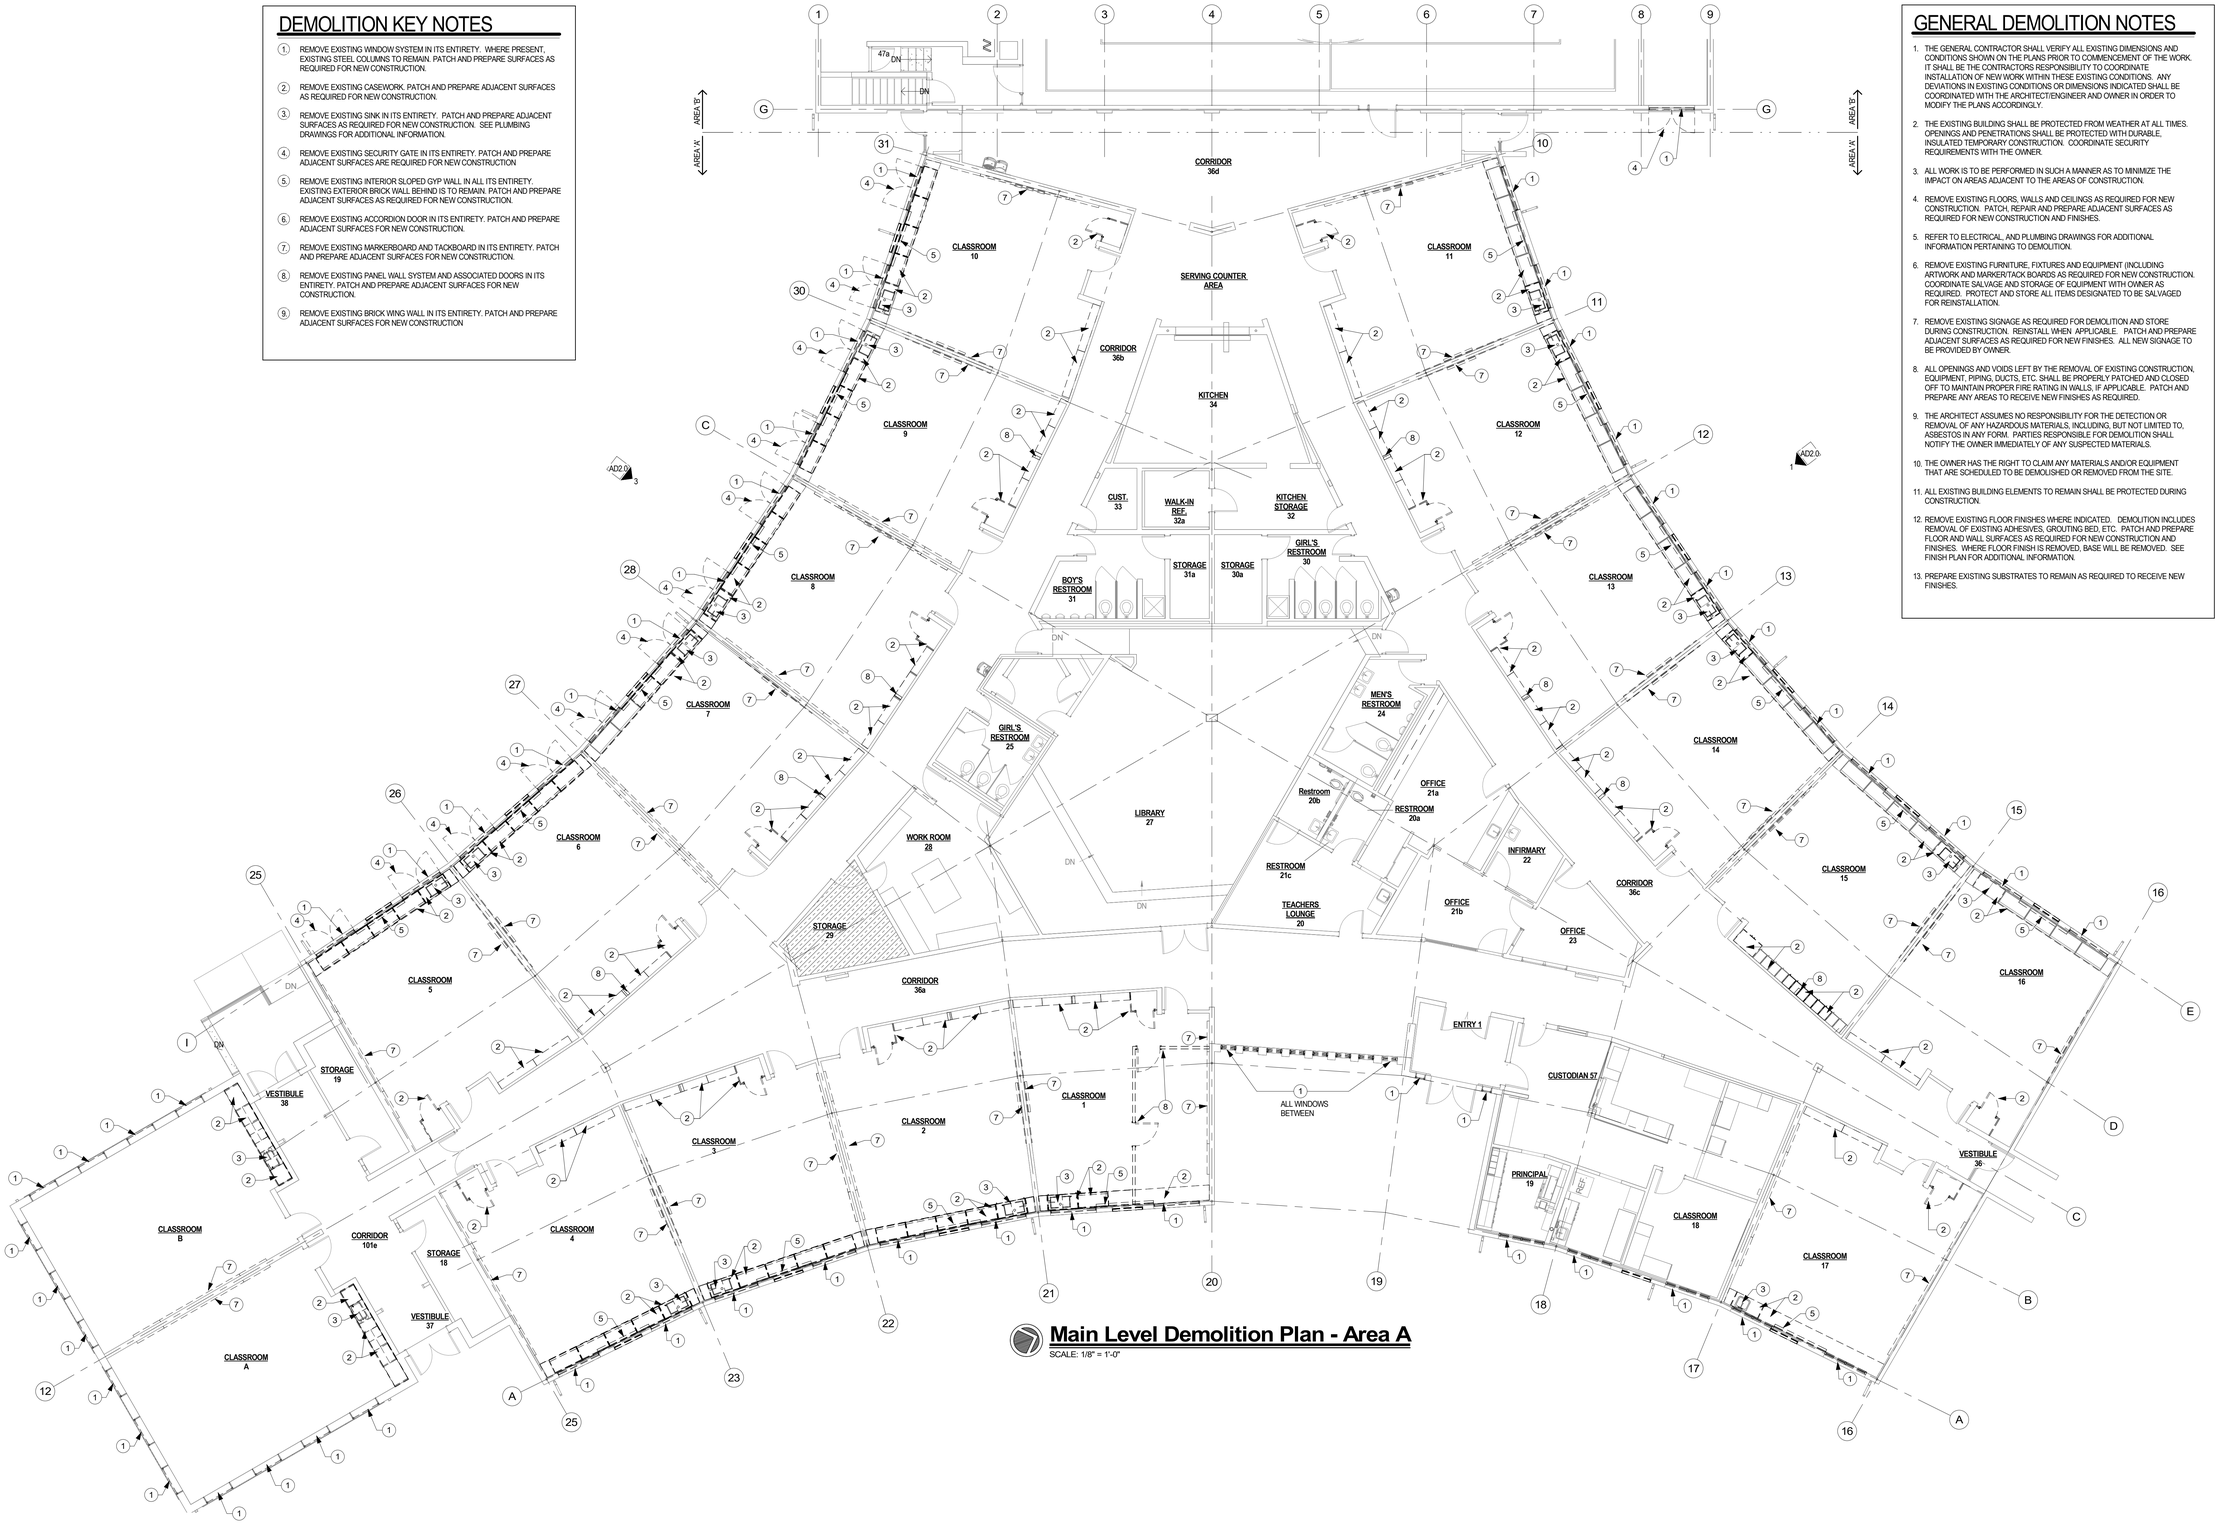


Main Level Demolition Plan - Area A

SCALE: 1/8" = 1'-0"

GENERAL DEMOLITION NOTES

1. THE GENERAL CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS SHOWN ON THE PLANS PRIOR TO COMMENCEMENT OF THE WORK. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO COORDINATE INSTALLATION OF NEW WORK WITHIN THESE EXISTING CONDITIONS. ANY DEVIATIONS IN EXISTING CONDITIONS OR DIMENSIONS INDICATED SHALL BE COORDINATED WITH THE ARCHITECT/ENGINEER AND OWNER IN ORDER TO MODIFY THE PLANS ACCORDINGLY.
2. THE EXISTING BUILDING SHALL BE PROTECTED FROM WEATHER AT ALL TIMES. OPENINGS AND PENETRATIONS SHALL BE PROTECTED WITH DURABLE, INSULATED TEMPORARY CONSTRUCTION. COORDINATE SECURITY REQUIREMENTS WITH THE OWNER.
3. ALL WORK IS TO BE PERFORMED IN SUCH A MANNER AS TO MINIMIZE THE IMPACT ON AREAS ADJACENT TO THE AREAS OF CONSTRUCTION.
4. REMOVE EXISTING FLOORS, WALLS AND CEILINGS AS REQUIRED FOR NEW CONSTRUCTION. PATCH, REPAIR AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION AND FINISHES.
5. REFER TO ELECTRICAL, AND PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION PERTAINING TO DEMOLITION.
6. REMOVE EXISTING FURNITURE, FIXTURES AND EQUIPMENT (INCLUDING ARTWORK AND MARKER/TACK BOARDS AS REQUIRED FOR NEW CONSTRUCTION. COORDINATE SALVAGE AND STORAGE OF EQUIPMENT WITH OWNER AS REQUIRED. PROTECT AND STORE ALL ITEMS DESIGNATED TO BE SALVAGED FOR REINSTALLATION.
7. REMOVE EXISTING SIGNAGE AS REQUIRED FOR DEMOLITION AND STORE DURING CONSTRUCTION. REINSTALL WHEN APPLICABLE. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW FINISHES. ALL NEW SIGNAGE TO BE PROVIDED BY OWNER.
8. ALL OPENINGS AND VOIDS LEFT BY THE REMOVAL OF EXISTING CONSTRUCTION, EQUIPMENT, PIPING, DUCTS, ETC. SHALL BE PROPERLY PATCHED AND CLOSED OFF TO MAINTAIN PROPER FIRE RATING IN WALLS, IF APPLICABLE. PATCH AND PREPARE ANY AREAS TO RECEIVE NEW FINISHES AS REQUIRED.
9. THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR THE DETECTION OR REMOVAL OF ANY HAZARDOUS MATERIALS, INCLUDING, BUT NOT LIMITED TO, ASBESTOS IN ANY FORM. PARTIES RESPONSIBLE FOR DEMOLITION SHALL NOTIFY THE OWNER IMMEDIATELY OF ANY SUSPECTED MATERIALS.
10. THE OWNER HAS THE RIGHT TO CLAIM ANY MATERIALS AND/OR EQUIPMENT THAT ARE SCHEDULED TO BE DEMOLISHED OR REMOVED FROM THE SITE.
11. ALL EXISTING BUILDING ELEMENTS TO REMAIN SHALL BE PROTECTED DURING CONSTRUCTION.
12. REMOVE EXISTING FLOOR FINISHES WHERE INDICATED. DEMOLITION INCLUDES REMOVAL OF EXISTING ADHESIVES, GROUTING BED, ETC. PATCH AND PREPARE FLOOR AND WALL SURFACES AS REQUIRED FOR NEW CONSTRUCTION AND FINISHES. WHERE FLOOR FINISH IS REMOVED, BASE WILL BE REMOVED. SEE FINISH PLAN FOR ADDITIONAL INFORMATION.
13. PREPARE EXISTING SUBSTRATES TO REMAIN AS REQUIRED TO RECEIVE NEW FINISHES.

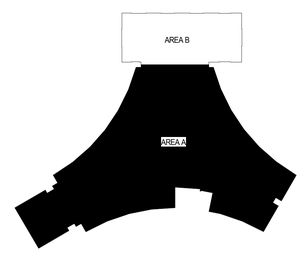

Key Plan 'A'

SCALE: 1" = 60'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026

Main Level Demolition Plan
Area 'A'


AD1.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:03 PM

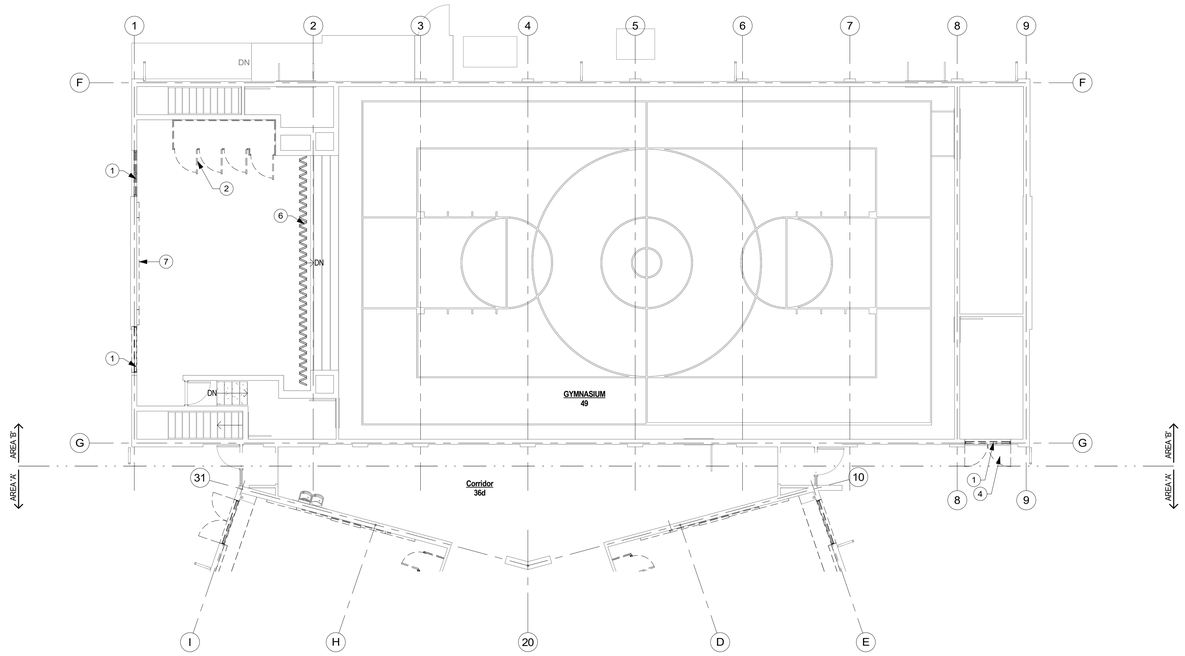

Main Level Demolition Plan - Area B

SCALE: 1/8" = 1'-0"

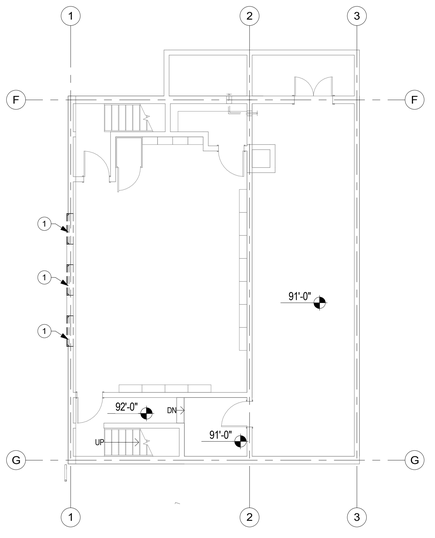

Basement Demo Plan


SCALE: 1/8" = 1'-0"

GENERAL DEMOLITION NOTES

1. THE GENERAL CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS SHOWN ON THE PLANS PRIOR TO COMMENCEMENT OF THE WORK. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO COORDINATE INSTALLATION OF NEW WORK WITHIN THESE EXISTING CONDITIONS. ANY DEVIATIONS IN EXISTING CONDITIONS OR DIMENSIONS INDICATED SHALL BE COORDINATED WITH THE ARCHITECT/ENGINEER AND OWNER IN ORDER TO MODIFY THE PLANS ACCORDINGLY.
2. THE EXISTING BUILDING SHALL BE PROTECTED FROM WEATHER AT ALL TIMES. OPENINGS AND PENETRATIONS SHALL BE PROTECTED WITH DURABLE, INSULATED TEMPORARY CONSTRUCTION. COORDINATE SECURITY REQUIREMENTS WITH THE OWNER.
3. ALL WORK IS TO BE PERFORMED IN SUCH A MANNER AS TO MINIMIZE THE IMPACT ON AREAS ADJACENT TO THE AREAS OF CONSTRUCTION.
4. REMOVE EXISTING FLOORS, WALLS AND CEILINGS AS REQUIRED FOR NEW CONSTRUCTION. PATCH, REPAIR AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION AND FINISHES.
5. REFER TO ELECTRICAL, AND PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION PERTAINING TO DEMOLITION.
6. REMOVE EXISTING FURNITURE, FIXTURES AND EQUIPMENT (INCLUDING ARTWORK AND MARKER/TACK BOARDS AS REQUIRED FOR NEW CONSTRUCTION. COORDINATE SALVAGE AND STORAGE OF EQUIPMENT WITH OWNER AS REQUIRED. PROTECT AND STORE ALL ITEMS DESIGNATED TO BE SALVAGED FOR REINSTALLATION.
7. REMOVE EXISTING SIGNAGE AS REQUIRED FOR DEMOLITION AND STORE DURING CONSTRUCTION. REINSTALL WHEN APPLICABLE. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW FINISHES. ALL NEW SIGNAGE TO BE PROVIDED BY OWNER.
8. ALL OPENINGS AND VOIDS LEFT BY THE REMOVAL OF EXISTING CONSTRUCTION, EQUIPMENT, PIPING, DUCTS, ETC. SHALL BE PROPERLY PATCHED AND CLOSED OFF TO MAINTAIN PROPER FIRE RATING IN WALLS, IF APPLICABLE. PATCH AND PREPARE ANY AREAS TO RECEIVE NEW FINISHES AS REQUIRED.
9. THE ARCHITECT ASSUMES NO RESPONSIBILITY FOR THE DETECTION OR REMOVAL OF ANY HAZARDOUS MATERIALS, INCLUDING, BUT NOT LIMITED TO, ASBESTOS IN ANY FORM. PARTIES RESPONSIBLE FOR DEMOLITION SHALL NOTIFY THE OWNER IMMEDIATELY OF ANY SUSPECTED MATERIALS.
10. THE OWNER HAS THE RIGHT TO CLAIM ANY MATERIALS AND/OR EQUIPMENT THAT ARE SCHEDULED TO BE DEMOLISHED OR REMOVED FROM THE SITE.
11. ALL EXISTING BUILDING ELEMENTS TO REMAIN SHALL BE PROTECTED DURING CONSTRUCTION.
12. REMOVE EXISTING FLOOR FINISHES WHERE INDICATED. DEMOLITION INCLUDES REMOVAL OF EXISTING ADHESIVES, GROUTING BED, ETC. PATCH AND PREPARE FLOOR AND WALL SURFACES AS REQUIRED FOR NEW CONSTRUCTION AND FINISHES. WHERE FLOOR FINISH IS REMOVED, BASE WILL BE REMOVED. SEE FINISH PLAN FOR ADDITIONAL INFORMATION.
13. PREPARE EXISTING SUBSTRATES TO REMAIN AS REQUIRED TO RECEIVE NEW FINISHES.

DEMOLITION KEY NOTES

1. REMOVE EXISTING WINDOW SYSTEM IN ITS ENTIRETY. WHERE PRESENT, EXISTING STEEL COLUMNS TO REMAIN. PATCH AND PREPARE SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
2. REMOVE EXISTING CASEWORK. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
3. REMOVE EXISTING SINK IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION. SEE PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION.
4. REMOVE EXISTING SECURITY GATE IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES ARE REQUIRED FOR NEW CONSTRUCTION
5. REMOVE EXISTING INTERIOR SLOPED GYP WALL IN ALL ITS ENTIRETY. EXISTING EXTERIOR BRICK WALL BEHIND IS TO REMAIN. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
6. REMOVE EXISTING ACCORDION DOOR IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION.
7. REMOVE EXISTING MARKERBOARD AND TACKBOARD IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION.
8. REMOVE EXISTING PANEL WALL SYSTEM AND ASSOCIATED DOORS IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION.
9. REMOVE EXISTING BRICK WING WALL IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES FOR NEW CONSTRUCTION



Key Plan 'B'

SCALE: 1" = 60'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026


Main Level Demolition Plan
Area 'B'

AD1.1


Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:04 PM

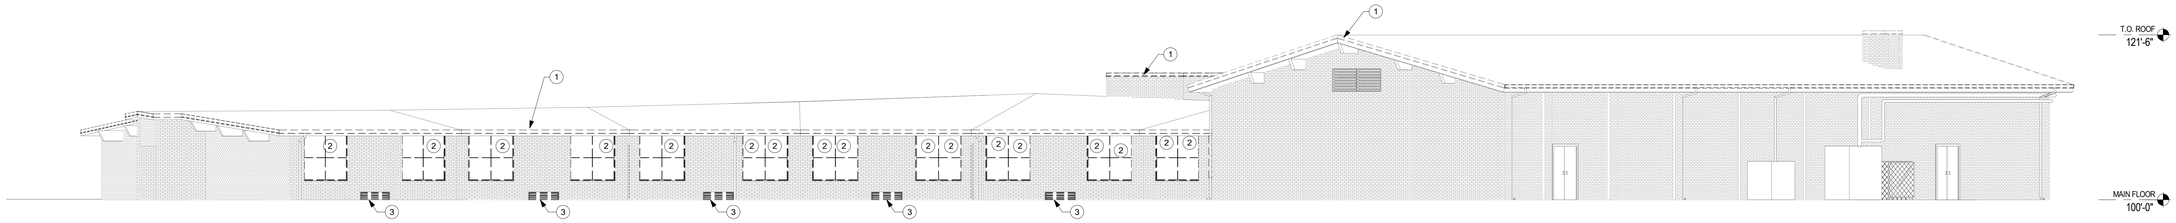

1 Overall North Demo Elevation
SCALE: 1/8" = 1'-0"

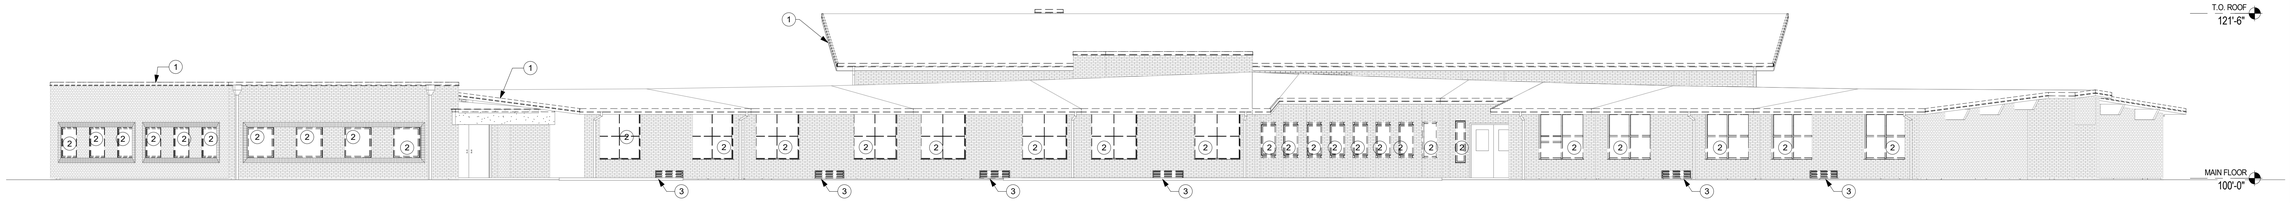

2 Overall East Demo Elevation
SCALE: 1/8" = 1'-0"

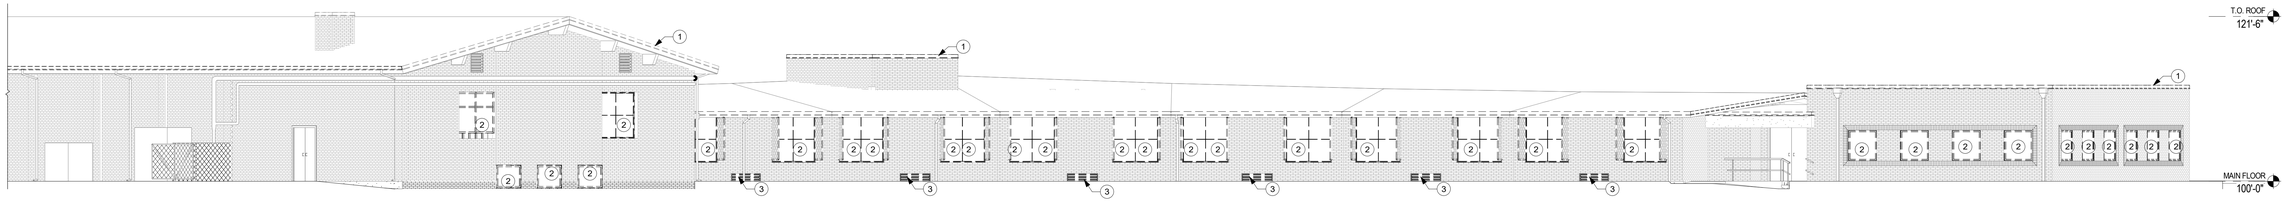

3 Overall West Demo Elevation
SCALE: 1/8" = 1'-0"

DEMO ELEVATION KEY NOTES

1. REMOVE EXISTING PARAPET CAP IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
2. REMOVE EXISTING WINDOW SYSTEM IN ITS ENTIRETY. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION.
3. REMOVE EXISTING LOUVER. PATCH AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION

GENERAL ELEV. DEMO. NOTES

1. THE GENERAL CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS SHOWN ON THE PLANS PRIOR TO COMMENCEMENT OF THE WORK. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO COORDINATE INSTALLATION OF NEW WORK WITHIN THESE EXISTING CONDITIONS. ANY DEVIATION IN EXISTING CONDITIONS OR DIMENSIONS INDICATED SHALL BE COORDINATED WITH THE ARCHITECT/ENGINEER AND OWNER IN ORDER TO MODIFY THE PLANS ACCORDINGLY.
2. THE EXISTING BUILDING SHALL BE PROTECTED FROM WEATHER AT ALL TIMES. OPENINGS AND PENETRATIONS SHALL BE PROTECTED WITH DURABLE, INSULATED TEMPORARY CONSTRUCTION. COORDINATE SECURITY REQUIREMENTS WITH THE OWNER.
3. ALL WORK IS TO BE PERFORMED IN SUCH A MANNER AS TO MINIMIZE THE IMPACT ON AREAS ADJACENT TO THE AREAS OF CONSTRUCTION.
4. REMOVE EXISTING FLOORS, WALLS AND CEILINGS AS REQUIRED FOR NEW CONSTRUCTION. PATCH, REPAIR AND PREPARE ADJACENT SURFACES AS REQUIRED FOR NEW CONSTRUCTION AND FINISHES.
5. REFER TO ELECTRICAL AND PLUMBING DRAWINGS FOR ADDITIONAL INFORMATION PERTAINING TO DEMOLITION.
6. THE OWNER HAS THE RIGHT TO CLAIM ANY MATERIALS AND/OR EQUIPMENT THAT ARE SCHEDULED TO BE DEMOLISHED OR REMOVED FROM THE SITE.
7. PREPARE EXISTING SUBSTRATES TO REMAIN AS REQUIRED TO RECEIVE NEW FINISHES.
8. REPAIR DAMAGED AND WEATHERED BRICK AND MORTAR AS REQUIRED TO RECEIVE NEW FINISHES.

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

Demo Exterior Elevation

AD2.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:06 PM

Main Level Plan - Area A

SCALE: 1/8" = 1'-0"

GENERAL PLAN NOTES

1. DRAWINGS & SPECIFICATIONS ARE COMPLIMENTARY COMPONENTS OF THE CONTRACT DOCUMENTS. REVIEW ALL DRAWINGS AND SPECIFICATIONS FOR THE COMPLETE SCOPE OF WORK. NOTIFY ARCHITECT IMMEDIATELY FOR CLARIFICATION IF INCONSISTENCIES, CONTRADICTIONS OR OMISSIONS ARE DISCOVERED.
2. DO NOT SCALE DRAWINGS. IF DIMENSIONAL INFORMATION IS REQUIRED & NOT FOUND, NOTIFY ARCHITECT IMMEDIATELY FOR CLARIFICATION.
3. ALL DIMENSIONS ARE TO COLUMN CENTERLINES OR FACE OF FINISHED WALLS OR SURFACES UNLESS NOTED OTHERWISE.
4. REFER TO DEMOLITION DRAWINGS FOR WORK REQUIRED IN ADVANCE OF CONSTRUCTION AND COORDINATE ACCORDINGLY.
5. ALL NEW DOOR FRAMES ARE TO BE INSTALLED 4" AWAY FROM ADJACENT PERPENDICULAR WALLS UNLESS NOTED OTHERWISE.
6. REFER TO STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING AND SPECIALTY CASEWORK VENDOR DRAWINGS FOR ADDITIONAL INFORMATION.
7. ALL SIGNAGE, FURNITURE, FIXTURES, AND EQUIPMENT TO PROVIDED BY OWNER, UNLESS SHOWN OTHERWISE.

KEY NOTES

1. 2-BASIN ADA DEPTH SINK. RE: PLUMBING
2. NEW PLAM CASEWORK WITH SOLID SURFACE COUNTERTOP.
3. NEW BUBBLER INSTALLED ON COUNTERTOP OVER SINK BASIN, RE: PLUMBING
4. NEW TV MONITOR, EQUIPMENT NUMBER 01
5. NEW MARKER BOARD, EQUIPMENT NUMBER 02
6. PROVIDE NEW OPERABLE PARTITION
   BASIS OF DESIGN: MODERNFOLD ACCORDION SM 8, COLOR ARCTIC 13


EQUIPMENT SCHEDULE

ITEM NO.	ITEM DESCRIPTION (MANUFACTURER & MODEL)	QUANTITY	FURNISHED/INSTALLED BY
01	TV - 85"	19	OWNER/CONTRACTOR
02	4' X 7' MARKER BOARD, CLARIDGE SERIES 4	40	CONTRACTOR/CONTRACTOR

WALL PARTITION TYPES

B3S 5/8" TYPE 'X' GPDW, 3-5/8" 20 GAUGE METAL STUDS AT 16" O.C. WITH SOUND BATT INSULATION BETWEEN STUDS, 5/8" TYPE 'X' GPDW. FROM FINISHED FLOOR TO STRUCTURE ABOVE.

NOTES:
1) PROVIDE BACKING IN WALLS FOR ALL NEW EQUIPMENT AND SHELVING AS REQUIRED.
2) SOUND CAULK WHERE WALLS WITH THE 'S' SUFFIX MEET THE ROOF DECK AND AT ANY LOCATIONS WITH ALUMINUM MULLION CLOSURES.



Key Plan 'A'

SCALE: 1" = 60'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026

Main Level Plan Area 'A'


A1.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2025).rvt
9/25/2026 12:26:10 PM

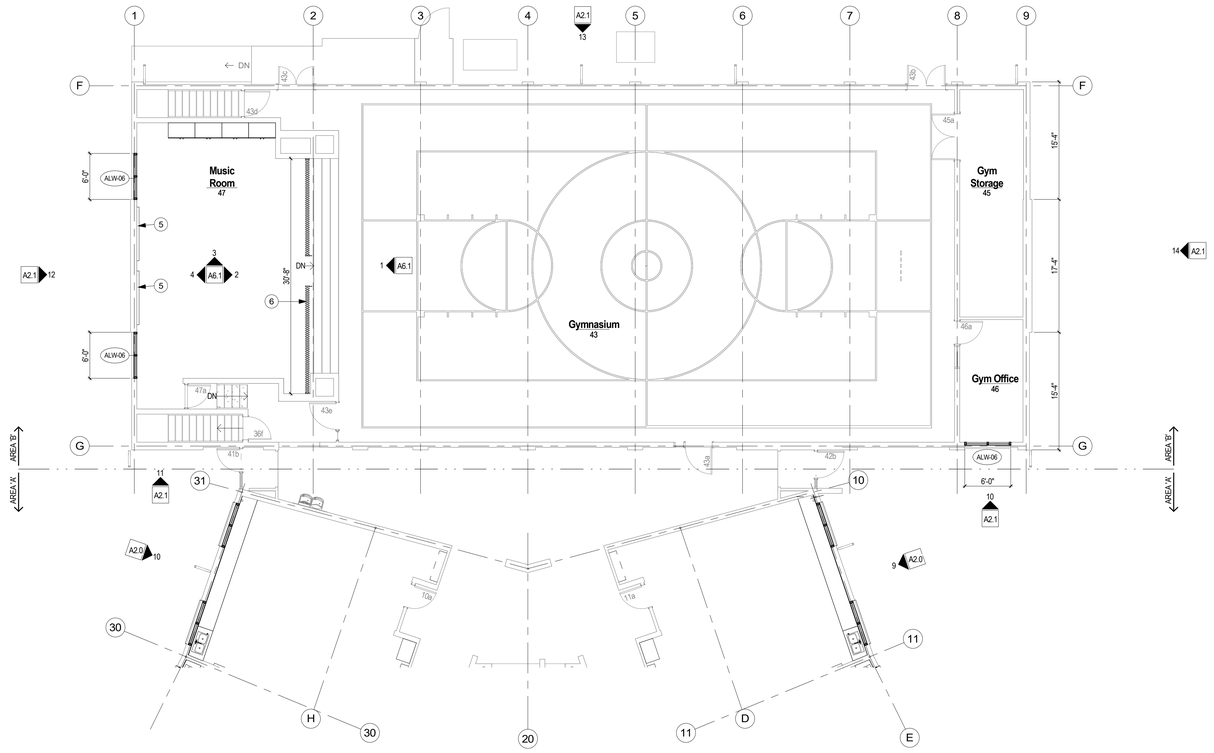


1 Main Level Plan - Area B

SCALE: 1/8" = 1'-0"

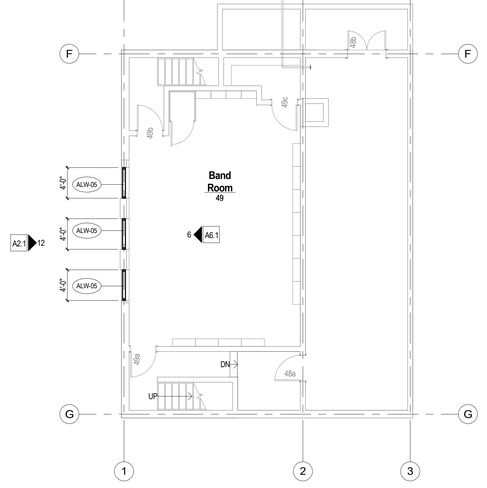

2 Basement Plan

SCALE: 1/8" = 1'-0"

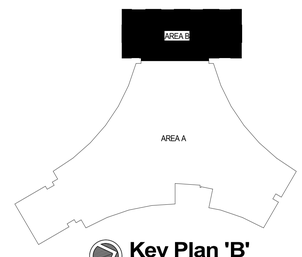

Key Plan 'B'

SCALE: 1" = 60'-0"

GENERAL PLAN NOTES

1. DRAWINGS & SPECIFICATIONS ARE COMPLIMENTARY COMPONENTS OF THE CONTRACT DOCUMENTS, REVIEW ALL DRAWINGS AND SPECIFICATIONS FOR THE COMPLETE SCOPE OF WORK. NOTIFY ARCHITECT IMMEDIATELY FOR CLARIFICATION IF INCONSISTENCIES, CONTRADICTIONS OR OMISSIONS ARE DISCOVERED.
2. DO NOT SCALE DRAWINGS, IF DIMENSIONAL INFORMATION IS REQUIRED & NOT FOUND, NOTIFY ARCHITECT IMMEDIATELY FOR CLARIFICATION.
3. ALL DIMENSIONS ARE TO COLUMN CENTERLINES OR FACE OF FINISHED WALLS OR SURFACES UNLESS NOTED OTHERWISE.
4. REFER TO DEMOLITION DRAWINGS FOR WORK REQUIRED IN ADVANCE OF CONSTRUCTION AND COORDINATE ACCORDINGLY.
5. ALL NEW DOOR FRAMES ARE TO BE INSTALLED 4" AWAY FROM ADJACENT PERPENDICULAR WALLS UNLESS NOTED OTHERWISE.
6. REFER TO STRUCTURAL, MECHANICAL, ELECTRICAL, PLUMBING AND SPECIALTY CASEWORK VENDOR DRAWINGS FOR ADDITIONAL INFORMATION.
7. ALL SIGNAGE, FURNITURE, FIXTURES, AND EQUIPMENT TO PROVIDED BY OWNER, UNLESS SHOWN OTHERWISE.

KEY NOTES

1. 2-BASIN ADA DEPTH SINK. RE: PLUMBING
2. NEW PLAM CASEWORK WITH SOLID SURFACE COUNTERTOP.
3. NEW BUBBLER INSTALLED ON COUNTERTOP OVER SINK BASIN, RE: PLUMBING
4. NEW TV MONITOR, EQUIPMENT NUMBER 01
5. NEW MARKER BOARD, EQUIPMENT NUMBER 02
6. PROVIDE NEW OPERABLE PARTITION
   BASIS OF DESIGN: MODERNFOLD ACCORDION SM 8, COLOR ARCTIC 13

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026

Main Level Plan Area 'B'


A1.1

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:11 PM

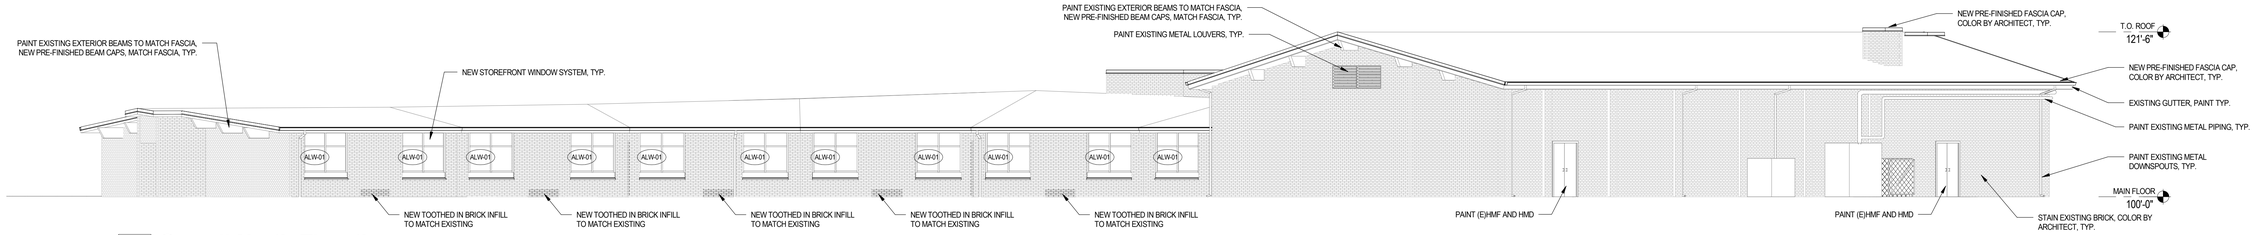


1 Overall North Elevation

SCALE: 1/8" = 1'-0"

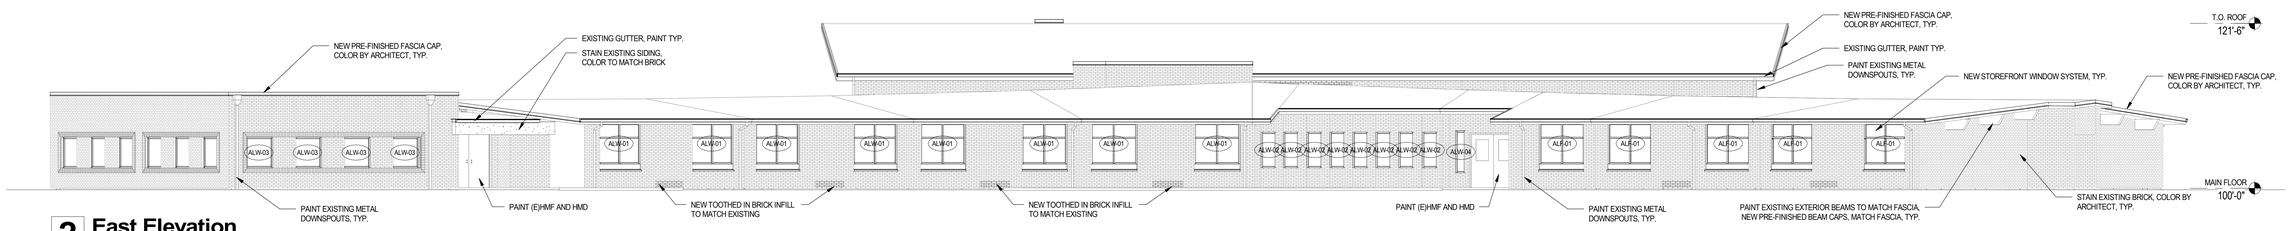


2 East Elevation

SCALE: 1/8" = 1'-0"

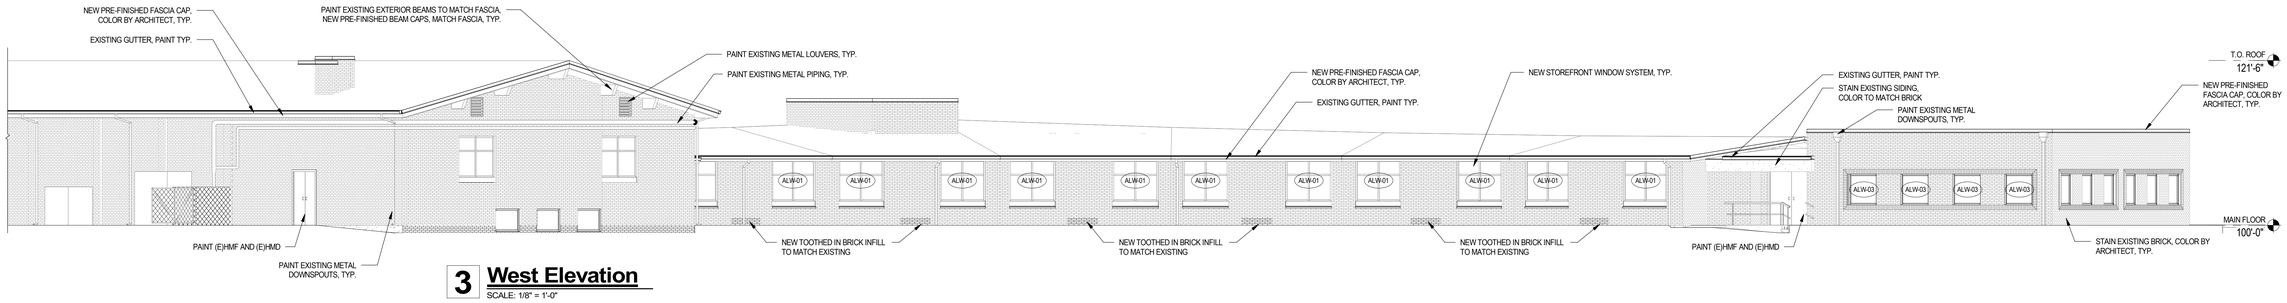


3 West Elevation

SCALE: 1/8" = 1'-0"

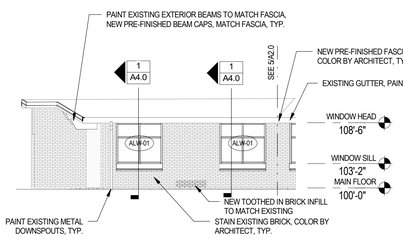


4 North Elevation 1

SCALE: 1/8" = 1'-0"




5 North Elevation 2

SCALE: 1/8" = 1'-0"




6 North Elevation 3

SCALE: 1/8" = 1'-0"




7 North Elevation 4

SCALE: 1/8" = 1'-0"




8 North Elevation 5

SCALE: 1/8" = 1'-0"

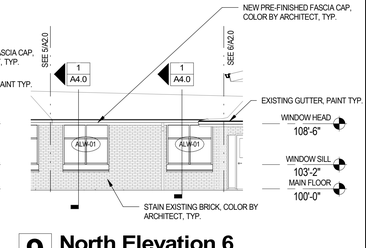


9 North Elevation 6

SCALE: 1/8" = 1'-0"

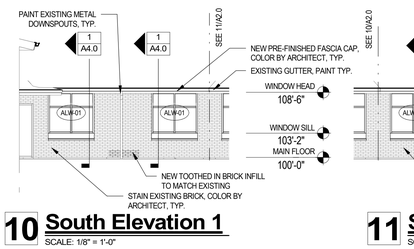


10 South Elevation 1

SCALE: 1/8" = 1'-0"




11 South Elevation 2

SCALE: 1/8" = 1'-0"




12 South Elevation 3

SCALE: 1/8" = 1'-0"




13 South Elevation 4

SCALE: 1/8" = 1'-0"




14 South Elevation 5

SCALE: 1/8" = 1'-0"

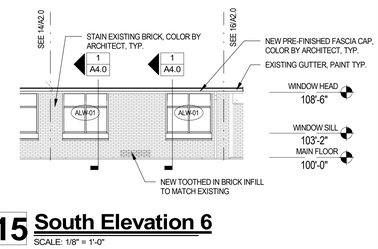


15 South Elevation 6

SCALE: 1/8" = 1'-0"

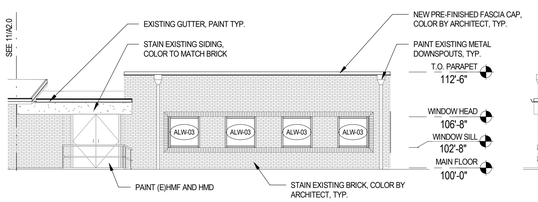

16 South Elevation 7

SCALE: 1/8" = 1'-0"

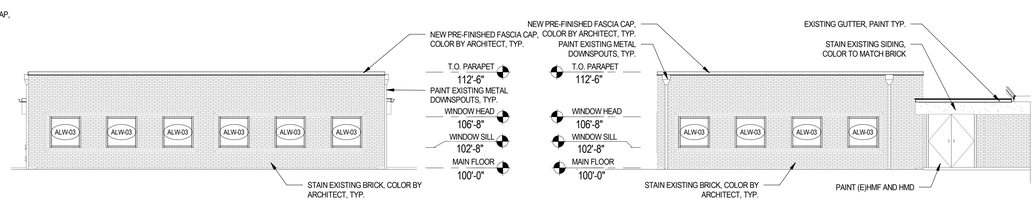

17 Southeast Elevation 1

SCALE: 1/8" = 1'-0"

18 East Elevation 1

SCALE: 1/8" = 1'-0"

BASIS OF DESIGN LEGEND

EXISTING BRICK

ALL BRICK TO BE STAINED, BASIS OF DESIGN: BRICK IMAGING, COLOR SELECTED BY ARCHITECT

NEW PRE-FINISHED PARAPET CAPS AND FLASHING, BASIS OF DESIGN: SHERWIN-WILLIAMS GENESIS. COLOR: COPPER PENNY

BRICK REPAIR SCOPE GENERAL NOTES:

1. CONTRACTOR TO FIELD VERIFY EXTENTS OF ALL CRACKED AND/OR DAMAGED BRICK. CONFIRM WITH OWNER FOR DIRECTION ON REPAIR AND REPLACEMENT
2. CONTRACTOR TO PROVIDE NOT-TO-EXCEED PRICING FOR BRICK RE-POINTING AND REPAIR IN AREAS INDICATED ON THE DRAWINGS, ESTIMATED AT 1,800 SF. CONTRACTOR TO PROVIDE UNIT PRICING FOR ADDITIONAL AREAS OF REPAIR, AND/OR TO CREDIT AREAS INDICATED THAT ARE FOUND TO NOT NEED REPAIR.

NOTE

ALL SIGNAGE AND EQUIPMENT TO BE REMOVED AS NEEDED FOR STAINING OF BRICK. RE-INSTALL AS REQUIRED

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
Revision Schedule		

Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026

Exterior Elevation


A2.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:16 PM

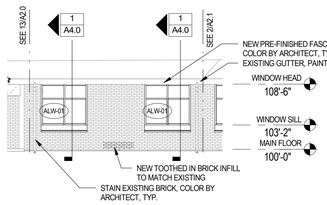


1 East Elevation 2

SCALE: 1/8" = 1'-0"

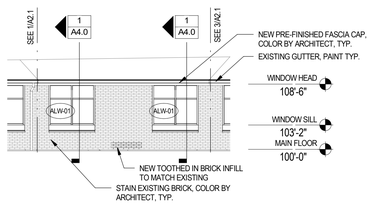


2 East Elevation 3

SCALE: 1/8" = 1'-0"

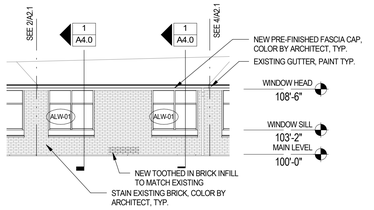


3 East Elevation 4

SCALE: 1/8" = 1'-0"

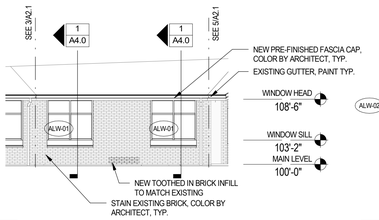


4 East Elevation 5

SCALE: 1/8" = 1'-0"

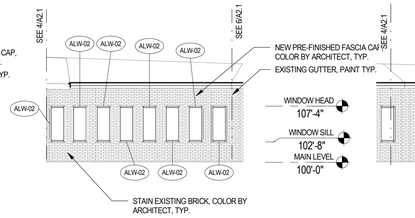


5 East Elevation 6

SCALE: 1/8" = 1'-0"




6 East Elevation 7

SCALE: 1/8" = 1'-0"




7 East Elevation 8

SCALE: 1/8" = 1'-0"

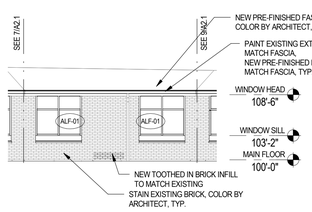


8 East Elevation 9

SCALE: 1/8" = 1'-0"

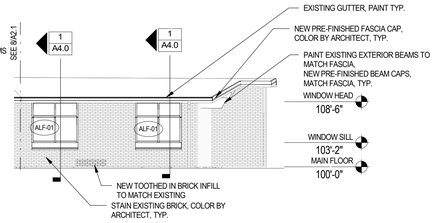


9 East Elevation 10

SCALE: 1/8" = 1'-0"

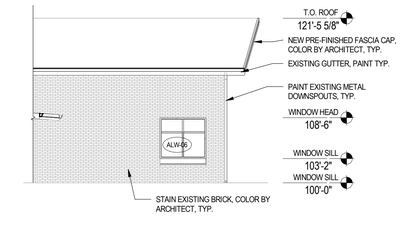


10 East Elevation - Gym North

SCALE: 1/8" = 1'-0"

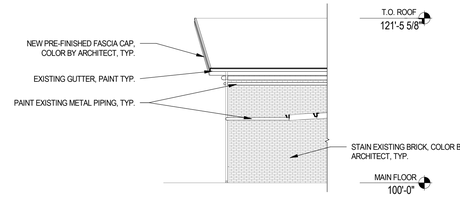


11 East Elevation - Gym South

SCALE: 1/8" = 1'-0"

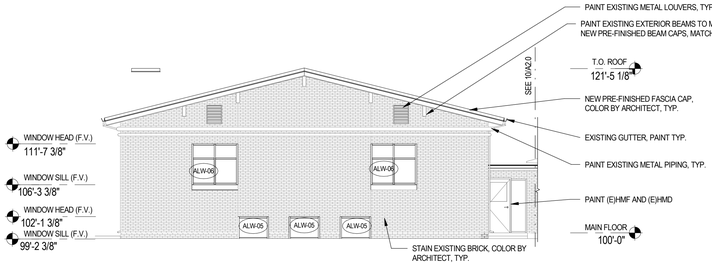


12 South Elevation - Gym

SCALE: 1/8" = 1'-0"

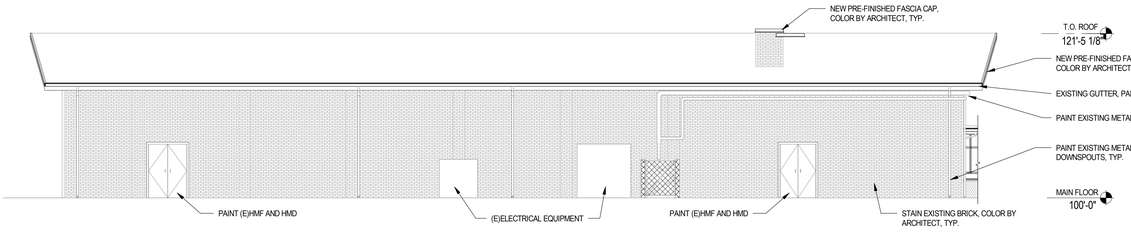


13 West Elevation - Gym

SCALE: 1/8" = 1'-0"

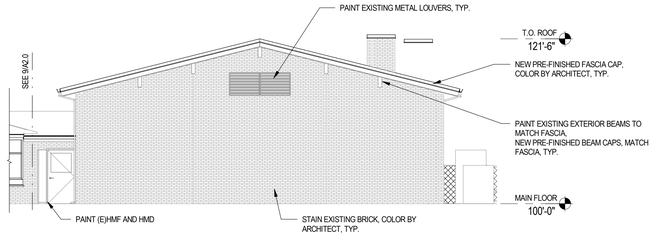

14 North Elevation - Gym

SCALE: 1/8" = 1'-0"

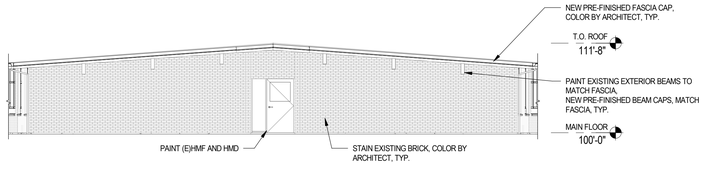

15 Northeast Exterior Elevation

SCALE: 1/8" = 1'-0"

NOTE

ALL SIGNAGE AND EQUIPMENT TO BE REMOVED AS NEEDED FOR STAINING OF BRICK. RE-INSTALL AS REQUIRED

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
Revision Schedule		

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026

Exterior Elevation

A2.1

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:19 PM

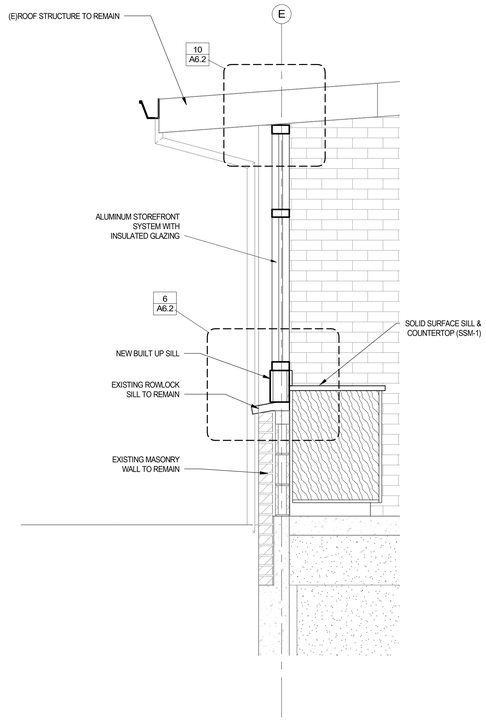

1 **TYP Classroom Wall Section**
SCALE: 3/4" = 1'-0"

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
Revision Schedule		

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026


Wall Sections

A4.0


Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:19 PM

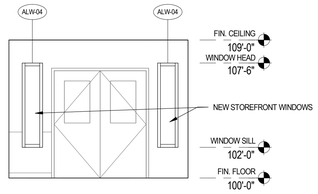


1 Vestibule (100) East
SCALE: 1/4" = 1'-0"




2 Work Area (100b) East
SCALE: 1/4" = 1'-0"




3 Infirmary (100c) East
SCALE: 1/4" = 1'-0"

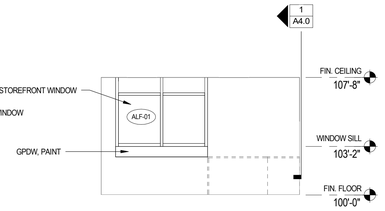


4 Flex (100d) East
SCALE: 1/4" = 1'-0"

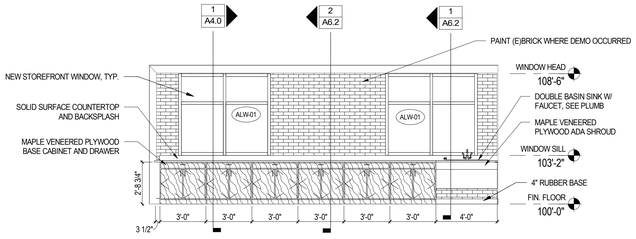


5 Typical Classroom Elevation 1
SCALE: 1/4" = 1'-0"

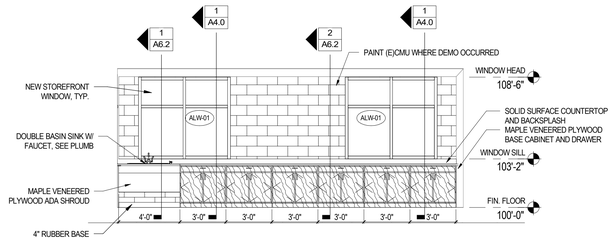


6 Typical Classroom Elevation 2
SCALE: 1/4" = 1'-0"

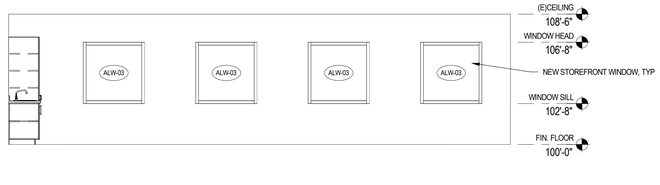


7 Classroom A - Northeast Elevation
SCALE: 1/4" = 1'-0"

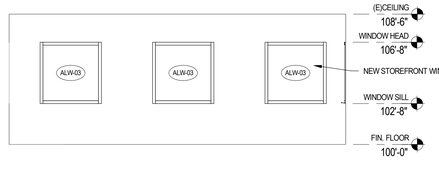


8 Classroom A - Southwest Elevation
SCALE: 1/4" = 1'-0"

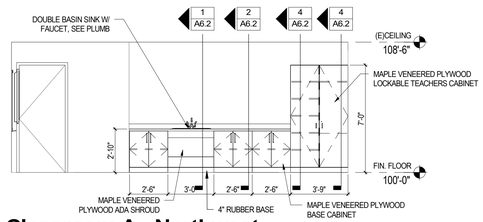


9 Classroom A - Northwest
SCALE: 1/4" = 1'-0"

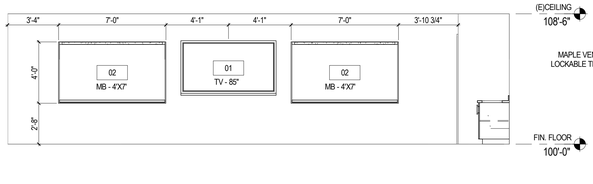

10 Classroom A - SouthWest
SCALE: 1/4" = 1'-0"

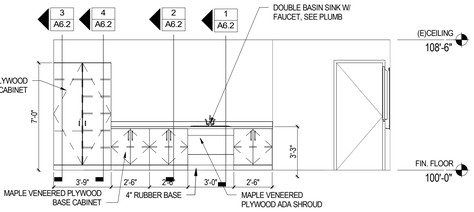

13 Classroom B - Northwest
SCALE: 1/4" = 1'-0"

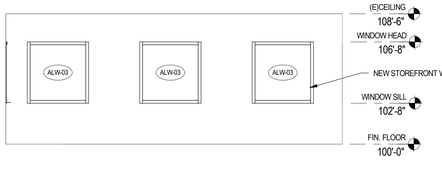

11 Classroom B - Southeast Elevation
SCALE: 1/4" = 1'-0"

EQUIPMENT SCHEDULE			
ITEM NO.	ITEM DESCRIPTION (MANUFACTURER & MODEL)	QUANTITY	FURNISHED/INSTALLED BY
01	TV - 85"	19	OWNER/CONTRACTOR
02	4' X 7' MARKER BOARD, CLARIDGE SERIES 4	40	CONTRACTOR/CONTRACTOR


FINISH LEGEND

WALL BASE


RUBBER BASE
RB-1 ROPPE 4" COVE BASE

WALLS


PAINT/EPOXY PAINT
PT-1 - FIELD PAINT BENJAMIN MOORE OLYMPIC MOUNTAINS #971

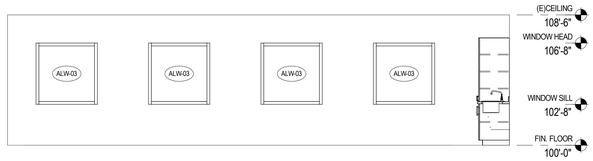


12 Classroom B - Southwest Elevation
SCALE: 1/4" = 1'-0"

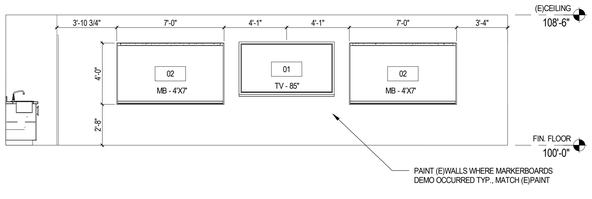


14 Classroom B - Northeast
SCALE: 1/4" = 1'-0"

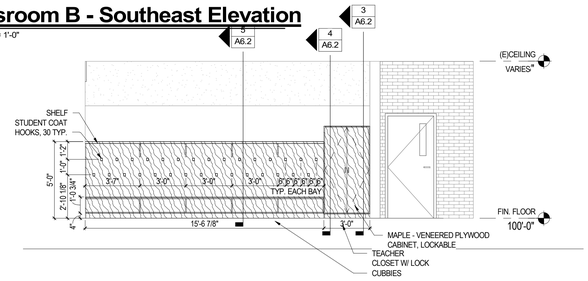


15 TYP Classroom RH Teacher Cabinet
SCALE: 1/4" = 1'-0"

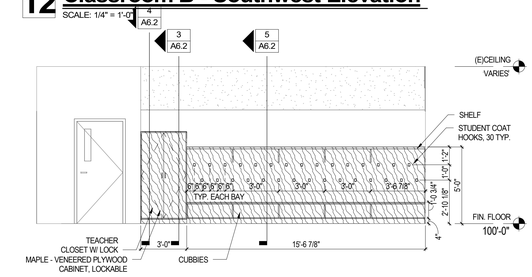


16 TYP Classroom LH Teacher Cabinet
SCALE: 1/4" = 1'-0"

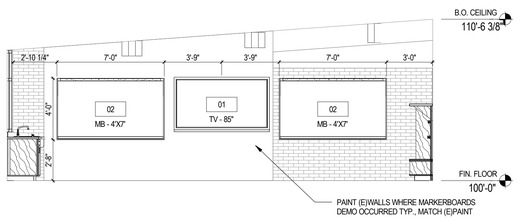


17 TYP Classroom Teaching Wall
SCALE: 1/4" = 1'-0"

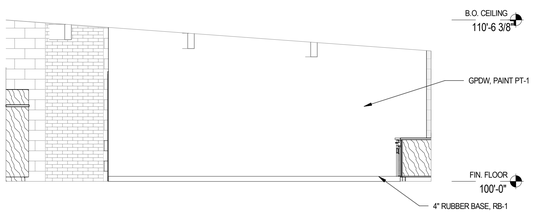


18 Classroom 1 - North
SCALE: 1/4" = 1'-0"

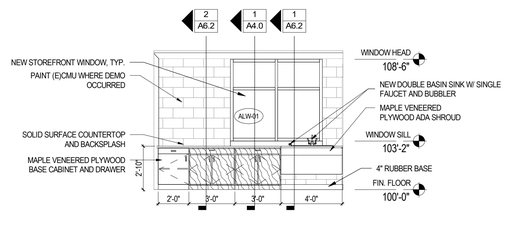


19 Classroom 1 - East
SCALE: 1/4" = 1'-0"

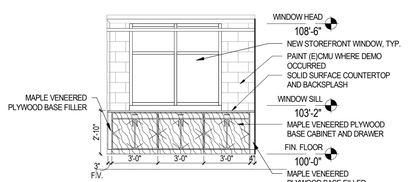


20 Office 1a - East
SCALE: 1/4" = 1'-0"

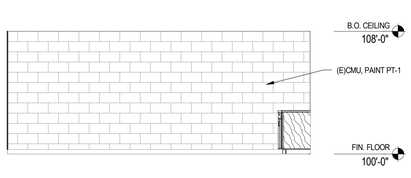


21 Office 1a - North
SCALE: 1/4" = 1'-0"

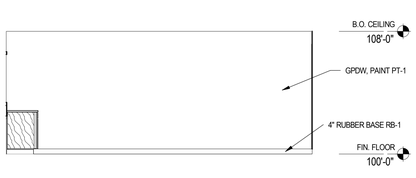

22 Office 1a - South
SCALE: 1/4" = 1'-0"

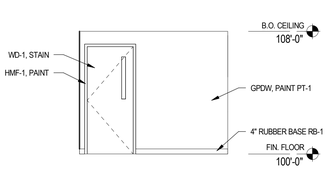

23 Office 1a - West
SCALE: 1/4" = 1'-0"

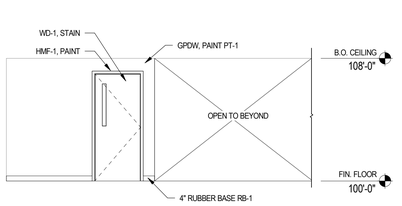

24 Classroom 1 - South
SCALE: 1/4" = 1'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations
8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026


Interior Elevations

A6.0


Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:23 PM

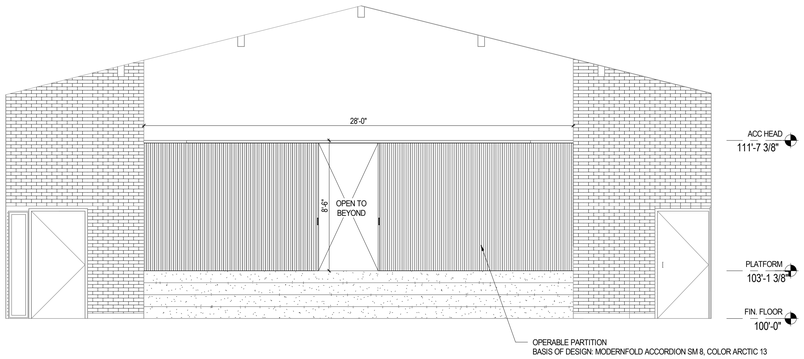


1 Gymnasium 43 - East
SCALE: 1/4" = 1'-0"

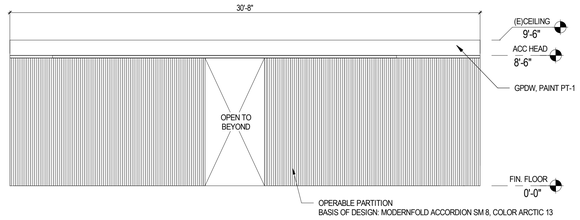


2 Music Room 48 - North
SCALE: 1/4" = 1'-0"

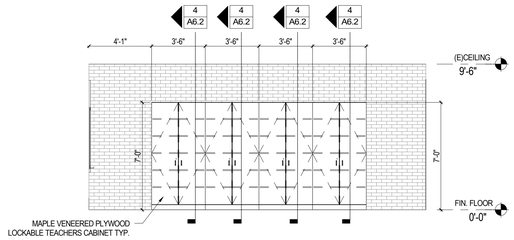


3 Music Room 48 - West
SCALE: 1/4" = 1'-0"

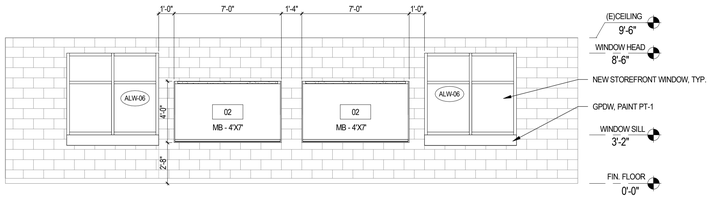


4 Music Room 48 - South
SCALE: 1/4" = 1'-0"

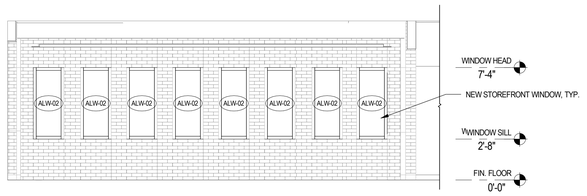


5 Corridor 36a - East
SCALE: 1/4" = 1'-0"

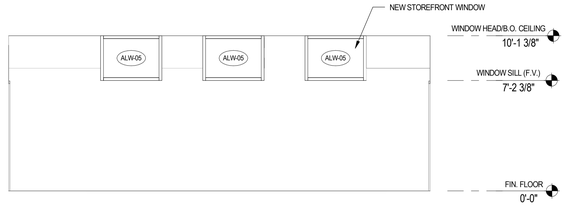

6 Band Room 49 - South
SCALE: 1/4" = 1'-0"

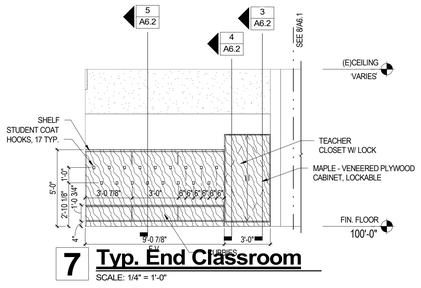

7 Typ. End Classroom
SCALE: 1/4" = 1'-0"



8 Typ. End Classroom
SCALE: 1/4" = 1'-0"

EQUIPMENT SCHEDULE			
ITEM NO.	ITEM DESCRIPTION (MANUFACTURER & MODEL)	QUANTITY	FURNISHED/INSTALLED BY
01	TV - 85"	19	OWNER/CONTRACTOR
02	4' X 7' MARKER BOARD, CLARIDGE SERIES 4	40	CONTRACTOR/CONTRACTOR

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood
Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

Interior Elevations

A6.1

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:24 PM


CASEWORK GENERAL NOTES

1. ALL CASEWORK SHALL BE CONSTRUCTED TO MEET THE FOLLOWING AWI CONSTRUCTION GRADES:
   WOOD VENEERED PLYWOOD CASEWORK
   -GRADE = CUSTOM
   -SOLID SURFACE COUNTERTOPS AND BACKSPLASH
2. TYPICAL MATERIALS:
   -HEAVY DUTY DRAWER SLIDES
   -FIVE KNUCKLE HINGES
   -WIRE PULLS
   -METAL SHELF CLIPS ON RECESSED K.V. STANDARDS


3. SEE SHEET A9.0 FOR FINISHES.

4. RECESS ALL KV STANDARDS PER DETAIL 1 ON SHEET A6.1 (THIS SHEET).


5. PROVIDE CASEWORK LOCKS ON ALL DOORS AND DRAWERS IN THE INFIRMARY CASEWORK, AND ALL BOTTOM DRAWERS OF THE RECEPTION DESK CASEWORK.




1 Casework Section
SCALE: 1/2" = 1'-0"

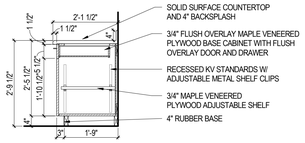


2 Casework Section
SCALE: 1/2" = 1'-0"

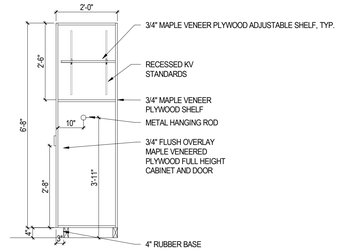


3 Teachers Cabinet - Wardrobe
SCALE: 1/2" = 1'-0"

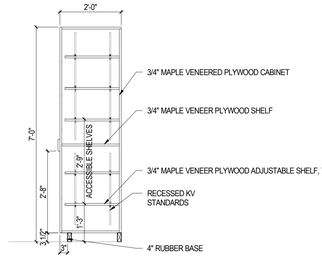


4 Teachers Cabinet
SCALE: 1/2" = 1'-0"




5 Classroom Shelf
SCALE: 1/2" = 1'-0"

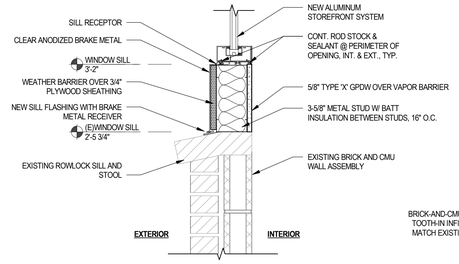


6 Window Will Detail
SCALE: 1 1/2" = 1'-0"

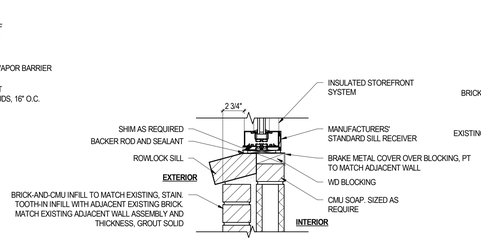


7 Window Will Detail
SCALE: 1 1/2" = 1'-0"

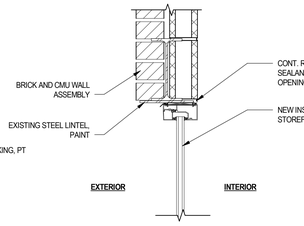


8 Window Head Detail
SCALE: 1 1/2" = 1'-0"

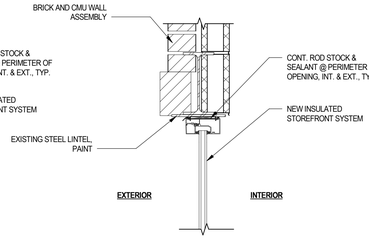


9 Window Head Detail
SCALE: 1 1/2" = 1'-0"

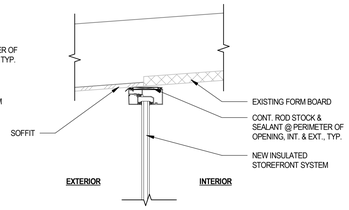


10 Window Head Detail
SCALE: 1 1/2" = 1'-0"

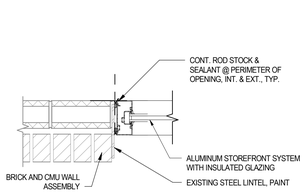


11 Window Head Detail
SCALE: 1 1/2" = 1'-0"




12 HMF-1 Frame Head Detail
SCALE: 3" = 1'-0"




13 HMF-1 Frame Jamb Detail
SCALE: 3" = 1'-0"

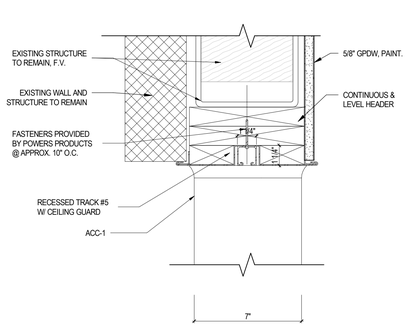


14 ACC - 1 FRAME HEAD DETAIL
SCALE: 3" = 1'-0"

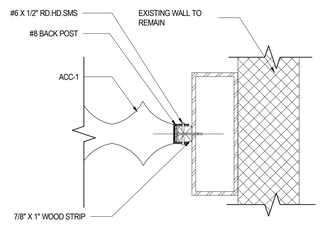


15 ACC - 1 FRAME JAMB DETAIL
SCALE: 3" = 1'-0"

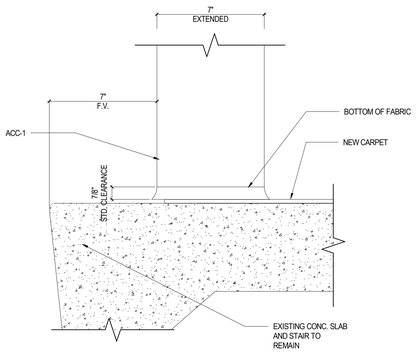


16 ACC - 1 FRAME SILL DETAIL
SCALE: 3" = 1'-0"



WD-1/ HMD-1
FLUSH WOOD DOOR W/ LITE / HM DOOR W/ LITE



HMF-1
HM FRAME

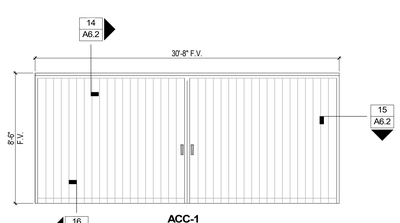


ACC-1
ACCORDION DOOR
BASIS OF DESIGN: MODERNFOLD ACCORDION SM 8, COLOR ARCTIC 13


Door and Frame Types

DOOR AND FRAME SCHEDULE									
IDENTIFICATION			DOOR						
			DIMENSIONS						
DOOR NO.	ROOM NO.	ROOM NAME	W1	H	TYPE	FRAME TYPE	DOOR/FRAME FIRE RATING	HARDWARE	REMARKS
1aa	1a	Office	3' - 0"	7' - 0"	WD-1	HMF-1	NA	01	Narrow Lite


DOOR NOTES:
1. NEW WOOD DOORS TO BE PAINT GRADE SOLID CORE DOORS, PAINT.
2. GENERAL CONTRACTOR TO VERIFY EXISTING DOORS AND/OR FRAMES AND COORDINATE REQUIRED PREPARATION.
3. DO NOT PAINT ANY NEW OR EXISTING PRE-FINISHED DOOR MULLIONS.
4. DOOR LITE KITS TO BE ANEMOSTAT LO-PRO.
5. PREPARE EXISTING DOORS WHICH ARE TO RECEIVE NEW PAINT AS REQUIRED FOR NEW FINISH.
6. PROVIDE SAFETY GLAZING OR FIRE-PROTECTION RATED GLAZING IN LOCATIONS REQUIRED BY CURRENT LOCAL CODE. NOTIFY ARCHITECT WITH QUESTIONS.




17 ALW-01
SCALE: 1/4" = 1'-0"




18 ALW-02
SCALE: 1/4" = 1'-0"




19 ALW-03
SCALE: 1/4" = 1'-0"



20 ALW-04
SCALE: 1/4" = 1'-0"



21 ALW-05
SCALE: 1/4" = 1'-0"



22 ALW-06
SCALE: 1/4" = 1'-0"

BASIS OF DESIGN: KAWNEER 451 UT

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects
Sherrelwood Renovations
8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

Interior Details/Door Schedule/Door & Window Details

A6.2

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/WPS - Sherrelwood Elementary (Revit 2026).rvt
9/25/2026 12:26:25 PM

PLUMBING FIXTURE SCHEDULE

PLAN CODE	DESCRIPTION	MANUF.	MODEL	COLOR FINISH	FITTINGS	MANUF.	MODEL	COLOR FINISH	REMARKS
S-1	SINK (ACCESSIBLE) (1.5 GPM)	ELKAY	DRKAD252265L	STAINLESS STEEL	FAUCET BUBBLER	CHICAGO ELKAY	895-GN8AE3ABCP LK1141A	CHROME CHROME	NOTES: 1,2,3,5
S-2	SINK (ACCESSIBLE) (1.5 GPM)	ELKAY	DRKAD252265R	STAINLESS STEEL	FAUCET BUBBLER	CHICAGO ELKAY	895-GN8AE3ABCP LK1141A	CHROME CHROME	NOTES: 1,2,3,4
S-3	SINK (ACCESSIBLE) (1.5 GPM)	ELKAY	LRAD2918-6"	STAINLESS STEEL	FAUCET	CHICAGO	895-GN8AE3ABCP	CHROME	NOTES: 1,2,3

NOTES:
1. 17 GA. P-TRAP, ANGLE SUPPLIES WITH 1/4 TURN L.K. STOPS.
2. GRID STRAINER, INSULATION KIT ON SUPPLIES AND DRAIN.
3. 1.5 GPM FLOW RESTRICTOR.
4. BUBBLER TO BE ON RIGHT SIDE OF SINK, FAUCET CENTERED ON SINK.
5. BUBBLER TO BE ON LEFT SIDE OF SINK, FAUCET CENTERED ON SINK.

PLUMBING FIXTURE CONNECTION SCHEDULE

PLAN CODE	FIXTURE	PIPE SIZE (INCHES, MINIMUM)							REMARKS
		WASTE			COLD WATER		HOT WATER		
		TRAP & ARM	VERT. DRAIN	VENT (MIN.)	SUPPLY (MIN.)	CONNECTION (ACTUAL)	SUPPLY (MIN.)	CONNECTION (ACTUAL)	
S	SINK	1-1/2"	2"	1-1/2"	1/2"	1/2"	1/2"	1/2"	

GENERAL LEGEND

ABBV.	SYMBOL	DESCRIPTION
G.C.		GENERAL CONTRACTOR
P.C.		PLUMBING CONTRACTOR
A.F.F.		ABOVE FINISHED FLOOR
B.F.F.		BELOW FINISHED FLOOR
(N)		NEW
(E)		EXISTING
		EXISTING (DEMOLITION OR REMOVED)
		POINT OF CONNECTION - NEW TO EXISTING
		PIPE CAP
		BALL VALVE
		PIPE ELBOW DOWN
		PIPE ELBOW UP
		TEE OFF BOTTOM OF PIPE
		TEE OFF TOP OF PIPE
	X XXX	X = SECTION/DETAIL NUMBER XXX = SHEET NUMBER WHERE SECTION/DETAIL IS DRAWN

PLUMBING LEGEND

ABBV.	SYMBOL	DESCRIPTION
WC		WATER CLOSET
UR		URINAL
L		LAVATORY
S		SINK
EWC		ELECTRIC WATER COOLER
DF		DRINKING FOUNTAIN
PP		PLUMBING CIRC. PUMP
PET		PLUMBING EXPANSION TANK
GWH		GAS WATER HEATER
GPM		GALLON PER MINUTE
CW		DOMESTIC COLD WATER
HW		DOMESTIC HOT WATER
HWC		DOMESTIC HOT WATER CIRCULATING
W		SANITARY WASTE BELOW FLOOR
V		SANITARY VENT
WCO	OR	WALL CLEANOUT

SHEET INDEX

SHEET NUMBER	PLUMBING & FIRE PROTECTION SHEET TITLE	SHEET SCALE
P0.0	Plumbing Cover Sheet - General Notes, Schedules & Legend	None
P1.0	Main Level Plumbing Plan Area 'A'	1/8" = 1'-0"
PD1.0	Main Level Demolition Plumbing Plan Area 'A'	1/8" = 1'-0"

PLUMBING DEMOLITION GENERAL NOTES

1. COORDINATE DEMOLITION REQUIREMENTS WITH THE GENERAL CONTRACTOR.
2. COORDINATE EXTENT OF DEMOLITION WITH THE NEW CONSTRUCTION AS SHOWN IN THESE DOCUMENTS.
3. EXISTING PLUMBING PIPING, EQUIPMENT ETC IS SHOWN LIGHT.
4. ALL PLUMBING ITEMS INDICATED TO BE DEMOLISHED SHALL BE INSPECTED FOR SALVAGE BY THE OWNER. ALL NON-SALVAGEABLE ITEMS SHALL THEN BE IMMEDIATELY REMOVED FROM THE SITE BY THE PLUMBING CONTRACTOR.
5. ALL UNUSED HANGERS AND SUPPORTS SHALL BE REMOVED.
6. THE REMOVAL OR INSTALLATION OF FIXTURES, PIPES AND EQUIPMENT MAY REQUIRE THE REMOVAL OF EXISTING WALLS AND CEILINGS. THE PLUMBING CONTRACTOR AND GENERAL CONTRACTOR SHALL COORDINATE AND BE RESPONSIBLE FOR REPAIRING AND PAINTING THESE WALLS AND/OR CEILINGS SO THEY MATCH THE EXISTING WHERE NOT REPLACED UNDER THE ARCHITECTURAL DOCUMENTS. THE CONTRACTOR SHALL REVIEW THE PLUMBING DRAWINGS TO IDENTIFY THESE LOCATIONS PRIOR TO BID PRICING.
7. THE GENERAL CONTRACTOR SHALL PATCH AND SEAL UNUSED ROOF PENETRATIONS AT DEMOLISHED PLUMBING TO MATCH EXISTING CONDITIONS.
8. THE GENERAL CONTRACTOR SHALL MAKE REPAIRS TO ALL EXISTING BUILDING COMPONENTS THAT HAVE BEEN AFFECTED BY THE DEMOLITION OF PLUMBING SYSTEMS.

PLUMBING GENERAL NOTES

1. FIELD VERIFY EXACT LOCATION OF ALL CONNECTIONS PRIOR TO CONSTRUCTION.
2. ROUGH-IN AND FINAL CONNECT ALL FIXTURES, EQUIPMENT, ETC.
3. CONTRACTOR SHALL INSPECT SITE TO THOROUGHLY FAMILIARIZE HIMSELF WITH THE AREA OF WORK. ANY DISCREPANCES BETWEEN THESE DOCUMENTS AND ACTUAL CONDITIONS SHALL BE REPORTED TO THE ARCHITECT/ENGINEER FOR RESOLUTION PRIOR TO BID PRICING. NO EXTRAS WILL BE ALLOWED DUE TO LACK OF KNOWLEDGE OF EXISTING CONDITIONS.
4. COMPLY WITH ALL BUILDING AND HEALTH DEPARTMENT REGULATIONS FOR PLUMBING INSTALLATION. VERIFY ALL REQUIREMENTS PRIOR TO SUBMITTING BID OR COMMENCING WORK.
5. CONTRACTOR SHALL INSTALL PIPING IN ADHERENCE TO 2021 COLORADO PLUMBING CODE, 2021 COLORADO FUEL GAS CODE, 2021 COLORADO ENERGY CODE, AND LOCAL HEALTH CODES. TABLE C404.5.1, FROM THE IECC, IS INCLUDED ON THIS SHEET BELOW FOR EASE OF REFERENCE.
6. PROVIDE BALL VALVES ON ALL BRANCH LINES FOR BUILDING ISOLATION WHETHER SHOWN OR NOT.
7. REFERENCE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF ALL FIRE RATED WALLS. ALL PIPE PENETRATIONS THROUGH FIRE RATED WALLS SHALL BE SEALED IN ACCORDANCE WITH THE BUILDING CODE.
8. OFFSET ALL PIPING AS REQUIRED TO AVOID STRUCTURAL MEMBERS, CANTS, FLASHING, MECHANICAL, OR ELECTRICAL EQUIPMENT.
9. PROTECT ALL EXISTING EQUIPMENT INDICATED AS REMAINING IN PLACE OR BEING RELOCATED. REPLACE DAMAGED EQUIPMENT IMMEDIATELY WITH EXACT DUPLICATE AT NO ADDITIONAL COST TO THE OWNER.
10. PLUMBING CONTRACTOR SHALL BE RESPONSIBLE FOR PROPERLY LOCATING AND PROTECTING ALL EXISTING PIPING AND UTILITIES FOR THE DURATION OF THE WORK. ANY DAMAGE CAUSED TO EXISTING PIPING OR UTILITIES SHALL BE REPAIRED IMMEDIATELY AT NO ADDITIONAL COST TO THE OWNER.
11. SUBMIT TO THE ARCHITECT/ENGINEER ELECTRONIC PDF FILES OF MECHANICAL SUBMITTALS FOR REVIEW OF ALL MAJOR EQUIPMENT AS LISTED ON DRAWING EQUIPMENT SCHEDULES, AS WELL AS PRODUCTS SHOWN IN SPECIFICATIONS. ENGINEER ASSUMED NO RESPONSIBILITY FOR EQUIPMENT OR INSTALLATION COORDINATION THAT HAS NOT BEEN SUBMITTED FOR REVIEW.
12. CONTRACTOR SHALL WARRANTY WORK, EQUIPMENT, FIXTURES, MATERIALS, AND PROPER OPERATION FOR A PERIOD OF ONE YEAR FROM THE DATE OF ACCEPTANCE OF BUILDING BY OWNER. THIS GUARANTEE SHALL NOT INCLUDE NORMAL MAINTENANCE REQUIRED BY THE OWNER AS DESCRIBED IN THE OPERATION AND MAINTENANCE MANUALS.
13. PROVIDE TWO SETS OF OPERATION AND MAINTENANCE (O&M) MANUALS FOR OWNER AT COMPLETION OF PROJECT TO THE ARCHITECT/ENGINEER FOR REVIEW. MANUALS TO INCLUDE INSTALLATION INSTRUCTIONS, REPLACEMENT PART LISTS, AND MAINTENANCE INFORMATION ON ALL MECHANICAL EQUIPMENT, FIXTURES, ETC. SUBMITTED.
14. CONTRACTOR SHALL MAINTAIN A COMPLETE AND ACCURATE SET OF RECORD DRAWINGS SHOWING ACTUAL INSTALLED LOCATIONS OF WORK. SUBMIT THESE DRAWINGS AS PART OF THE OPERATION AND MAINTENANCE MANUALS AT COMPLETION OF PROJECT.
15. NEW WATER PIPING SHALL DISINFECTED AS OUTLINED IN THE CURRENT ADOPTED PLUMBING CODE.

SPECIFICATION (PLUMBING)

PIPING:
A. WASTE, VENT, AND STORM PIPING ABOVE FINISHED FLOOR SHALL BE SERVICE WEIGHT CAST-IRON WITH NO-HUB FITTINGS.

B. WASTE, VENT, AND STORM PIPING BELOW FINISHED FLOOR/GRADE SHALL BE SCHEDULE 40 PVC "SOLID CORE" WITH SOLVENT WELDED FITTINGS.

C. WATER PIPING SHALL BE TYPE "L" COPPER, SOLDERED FITTINGS WITH LEAD FREE SOLDER AND FLUX.

INSULATION:
A. COLD WATER, HOT WATER AND HOT WATER RECIRCULATION INSULATION SHALL BE 1" THICK FIBERGLASS TYPE WITH ALL SERVICE JACKET WITH SELF SEAL LAP (ASJ-SSL).

B. PROVIDE PVC FITTING COVERS FOR ALL OF THE ABOVE MENTIONED SYSTEMS.

EQUIPMENT:
A. WALL CLEANOUT (WCO): CAST IRON BODY ADAPTABLE TO PIPE W/ CAST BRONZE OR CAST BRASS CLEANOUT PLUG. STAINLESS STEEL COVER INCLUDING SCREWS. JOSAM OR EQUAL.

VALVES:
A. BALL VALVES SHALL BE NSF 61 RATED AND EQUAL TO APOLLO #77CLF-100/200.

MISCELLANEOUS:
A. SAN-TEES, STOPS, SUPPLIES TO MATCH EXISTING.

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

The Ballard Group, Inc.
Mechanical Consulting Engineers
2525 S. Wadsworth Blvd, Suite 200
Lakewood, CO 80227
(303) 988-4514

Westminster Public Schools

Sherrelwood ES Secure Vestibule Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.:2019-010

September 25th, 2026

Plumbing Cover Sheet - General Notes, Schedules & Legend

P0.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/25094 Sherrelwood2026 Bond Projects-PLBG-R26.rvt
9/24/2026 4:08:04 PM

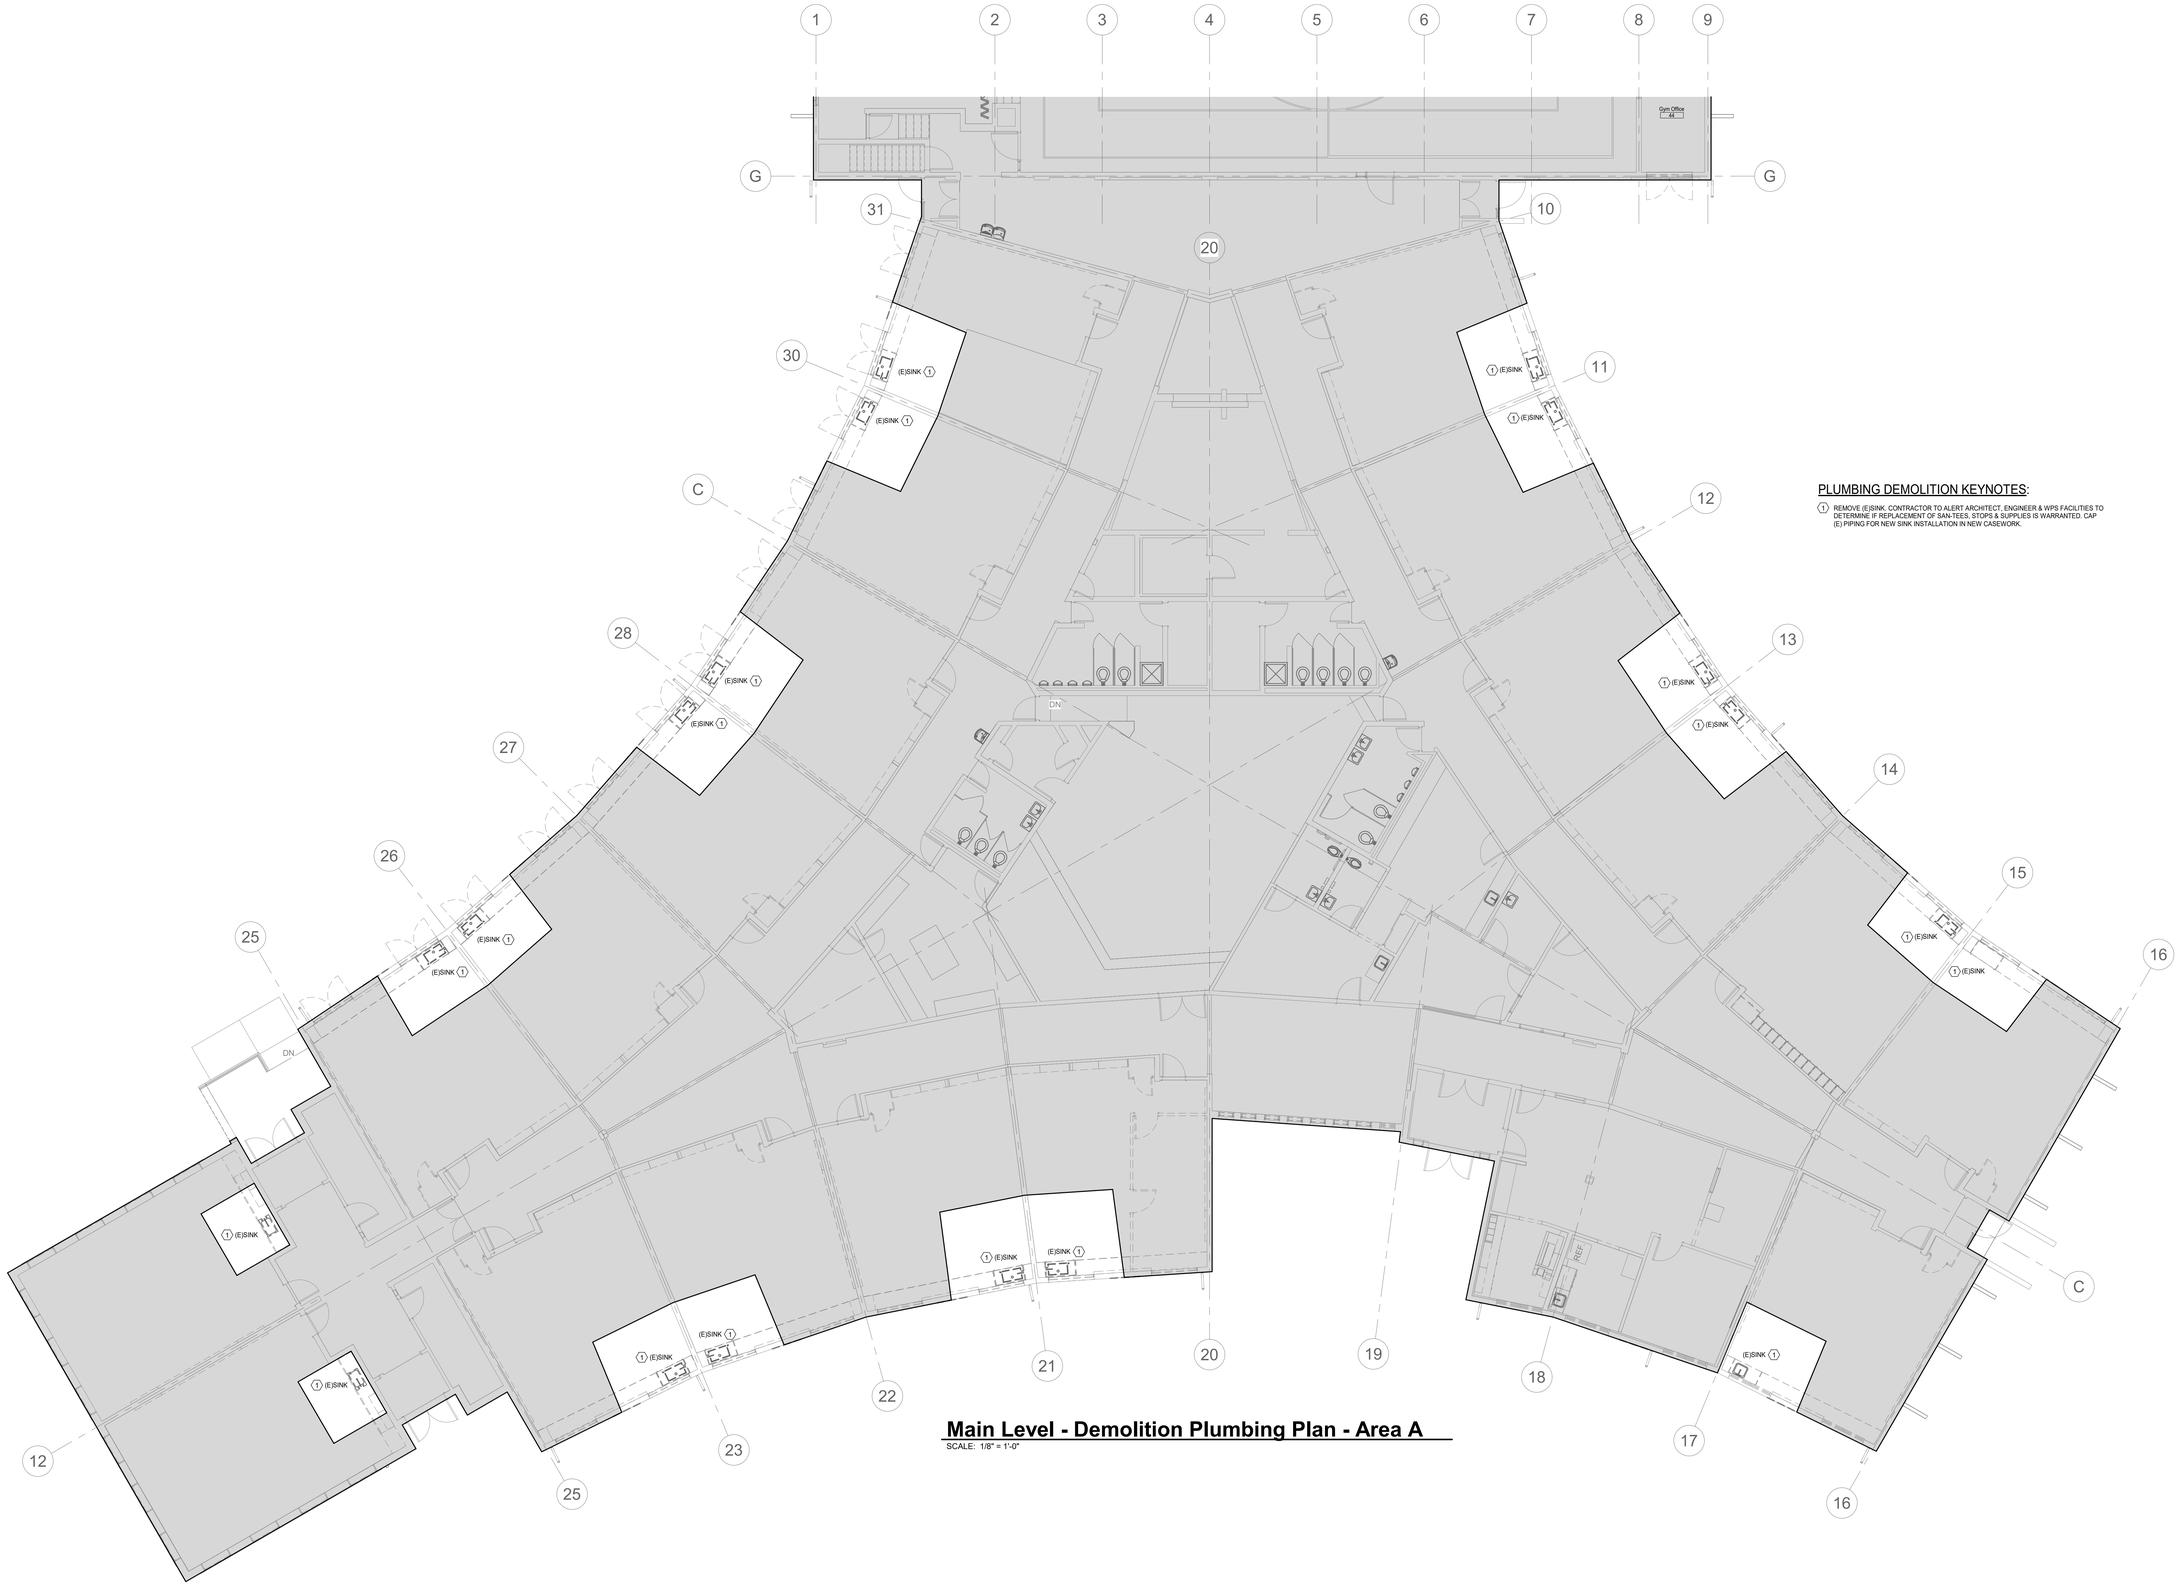

Main Level - Demolition Plumbing Plan - Area A

SCALE: 1/8" = 1'-0"

PLUMBING DEMOLITION KEYNOTES:

1. REMOVE (E)SINK. CONTRACTOR TO ALERT ARCHITECT, ENGINEER & WPS FACILITIES TO DETERMINE IF REPLACEMENT OF SAN-TEES, STOPS & SUPPLIES IS WARRANTED. CAP (E) PIPING FOR NEW SINK INSTALLATION IN NEW CASEWORK.

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

The Ballard Group, Inc.
Mechanical Consulting Engineers
2525 S. Wadsworth Blvd, Suite 200
Lakewood, CO 80227
(303) 988-4514

Westminster Public Schools

Sherrelwood ES Secure Vestibule Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.:2019-010

September 25th, 2026

Main Level Demolition Plumbing Plan Area 'A'

PD1.0

Autodesk Docs://WPS 2026 Bond Projects - Sherrelwood Renovations/25094 Sherrelwood2026 Bond Projects-PLBG-R26.rvt
9/24/2026 4:08:11 PM

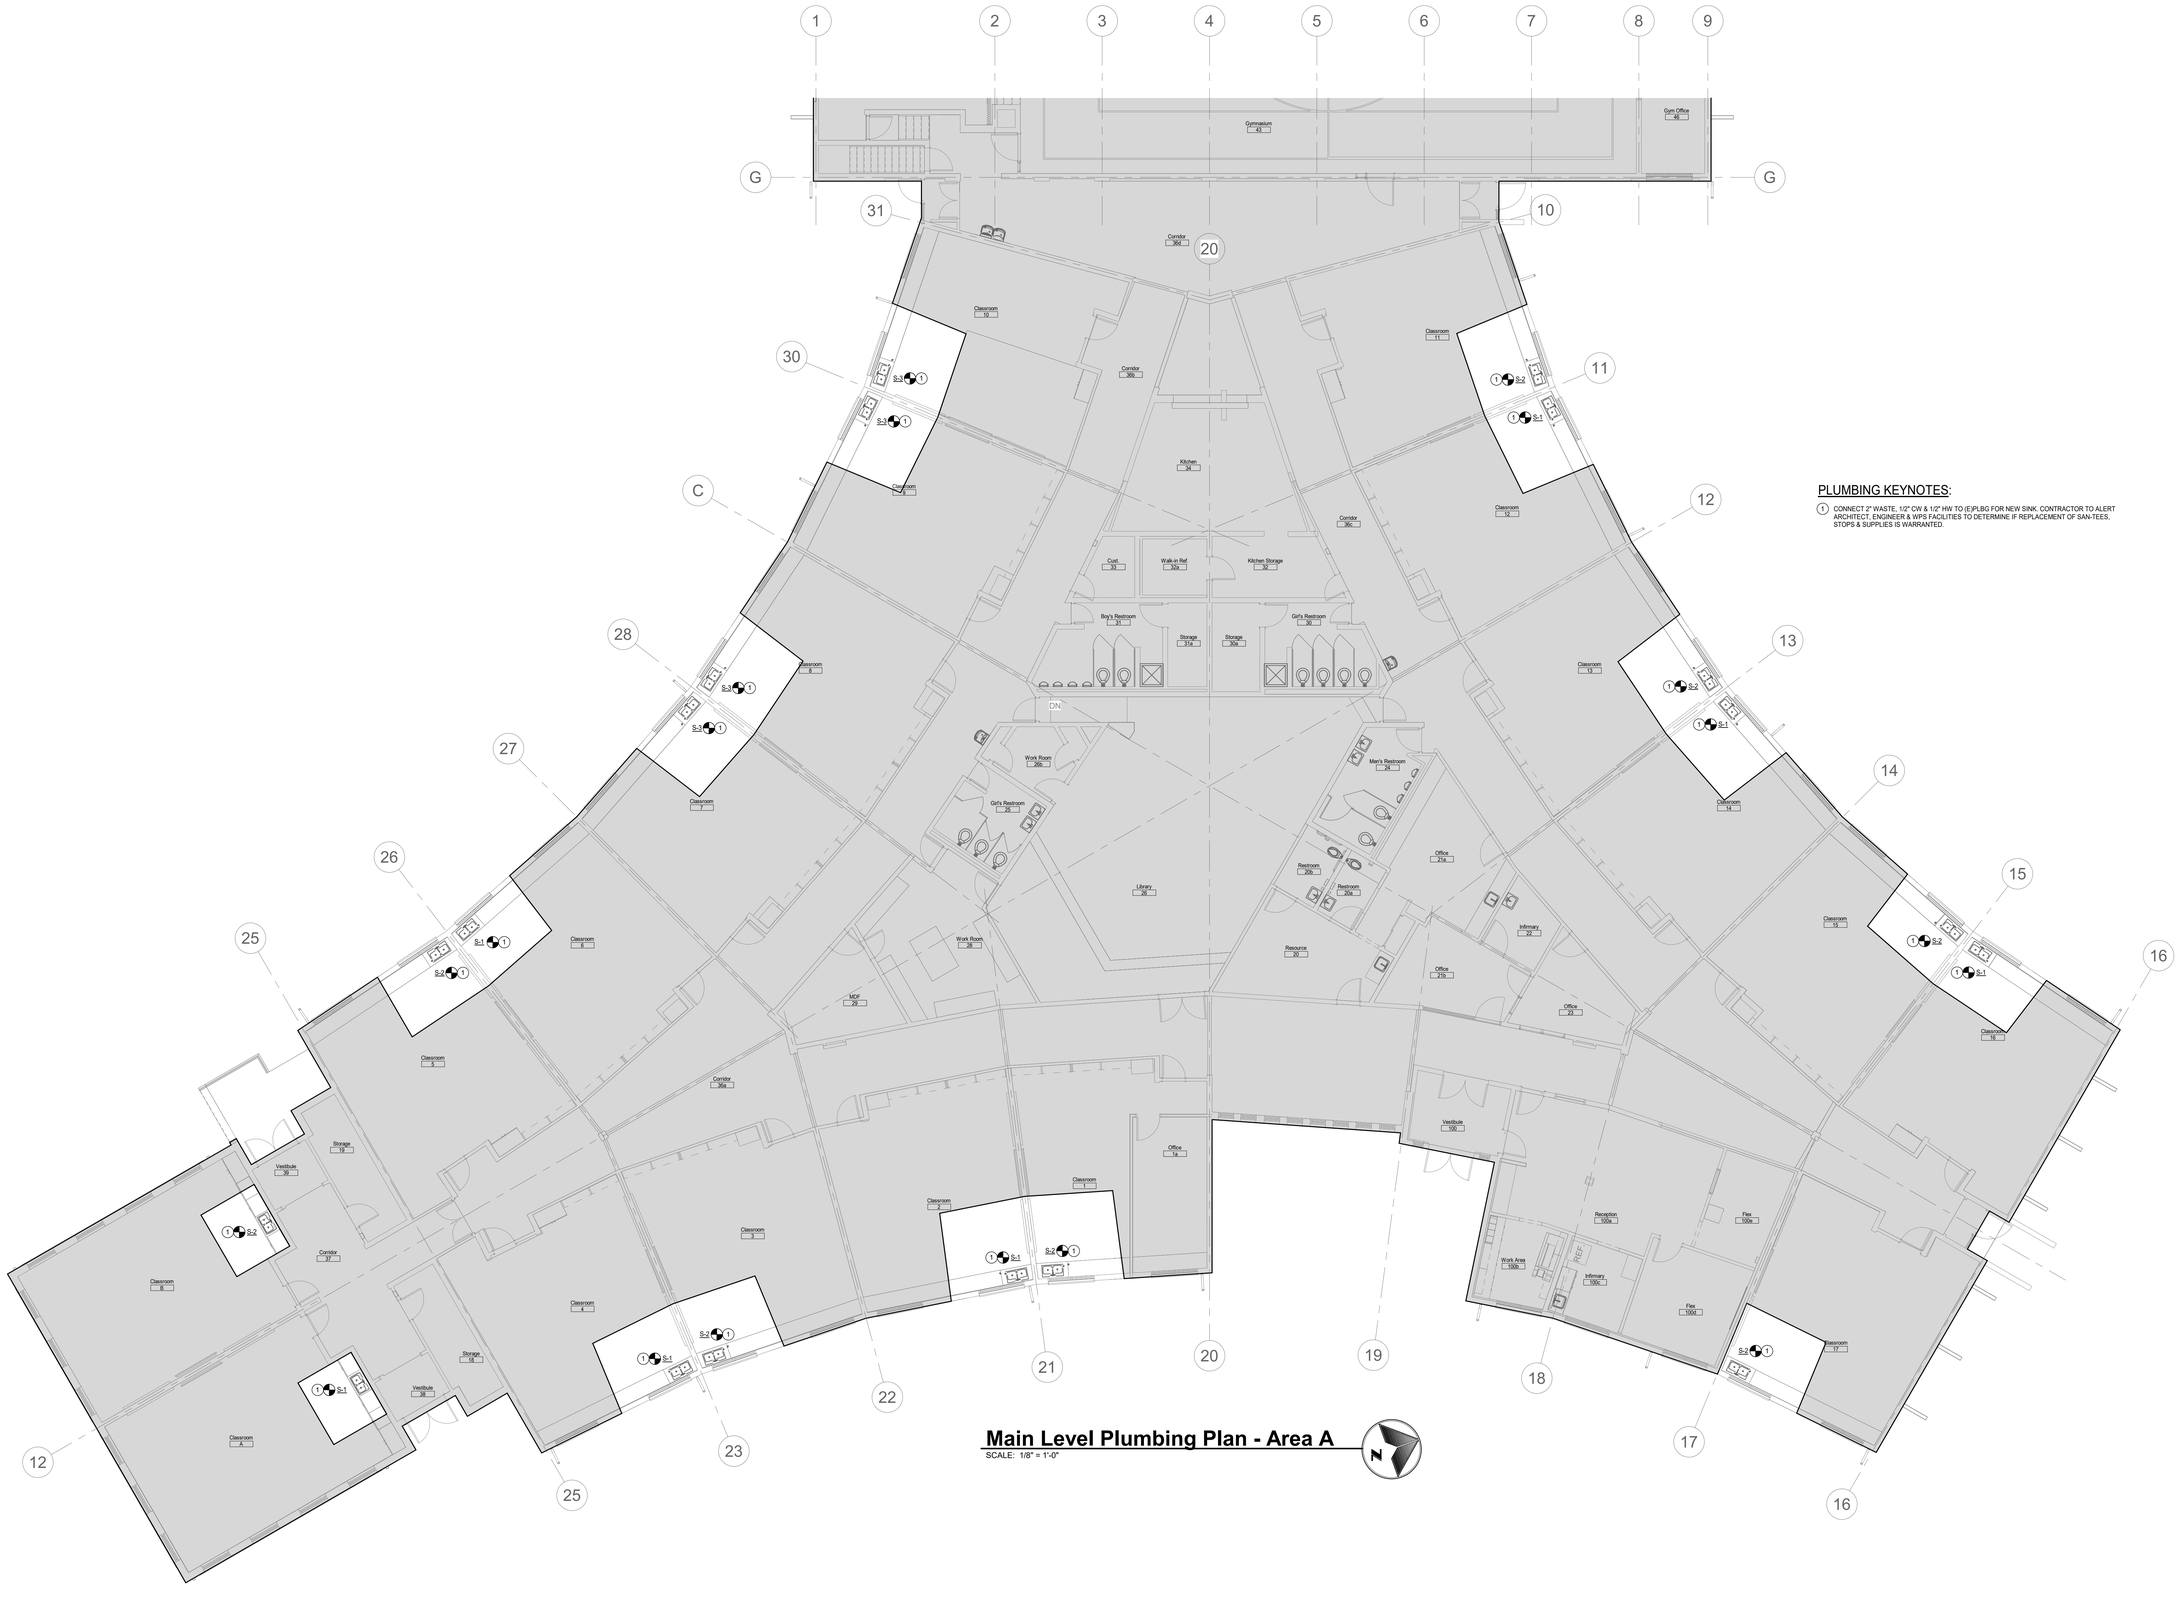

PLUMBING KEYNOTES:

1. CONNECT 2" WASTE, 1/2" CW & 1/2" HW TO (E)PLBG FOR NEW SINK. CONTRACTOR TO ALERT ARCHITECT, ENGINEER & WPS FACILITIES TO DETERMINE IF REPLACEMENT OF SAN-TEES, STOPS & SUPPLIES IS WARRANTED.

Main Level Plumbing Plan - Area A

SCALE: 1/8" = 1'-0"

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

The Ballard Group, Inc.
Mechanical Consulting Engineers
2525 S. Wadsworth Blvd, Suite 200
Lakewood, CO 80227
(303) 988-4514

Westminster Public Schools

Sherrelwood ES Secure Vestibule Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.:2019-010

September 25th, 2026

Main Level Plumbing Plan Area 'A'

P1.0

Autodesk Docs://WPS 2025 Bond Projects - Sherrelwood Renovations/25094 Sherrelwood2026 Bond Projects-PLBG-R26.rvt
9/24/2025 4:08:19 PM

POWER LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SINGLE RECEPTACLE	PM	PLUG MOLD (MULTI-OUTLET ASSEMBLY)
	DUPLEX RECEPTACLE	WM	WIREMOLD (SURFACE RACEWAY)
	DOUBLE DUPLEX RECEPTACLE		CONDUIT CONCEALED
	DUPLEX RECEPTACLE, HALF SWITCHED		CONDUIT EXPOSED
CLG	DUPLEX RECEPTACLE, CEILING MOUNTED		CONDUIT, UNDERGROUND OR CONCEALED IN FLOOR AS ALLOWED PER SPECIFICATIONS
	DUPLEX RECEPTACLE, FLOOR MOUNTED		CONDUIT TURNING DOWN
	DOUBLE DUPLEX RECEPTACLE, FLOOR MOUNTED		CONDUIT TURNING UP
	SPECIAL RECEPTACLE		CONDUIT CAPPED
	SPECIAL RECEPTACLE, FLOOR MOUNTED	A-1,3,5	BRANCH CIRCUIT HOME RUN, NUMBER OF ARROWS INDICATES NUMBER OF CIRCUITS, SUBSCRIPTS INDICATE PANEL & CIRCUITS
	JUNCTION BOX, FLOOR OR CEILING MOUNTED		GROUND BAR
	JUNCTION BOX, WALL MOUNTED		MAIN SWITCHBOARD/DISTRIBUTION CENTER
M	MOTOR	T	TRANSFORMER
	DISCONNECT SWITCH (NON-FUSED)	CT	CURRENT TRANSFORMER
	DISCONNECT SWITCH (FUSED)	T	THERMOSTAT
	VARIABLE SPEED DRIVE WITH DISCONNECT	GANN	GENERATOR ANNUNCIATOR PANEL
M	UTILITY METER	A-1	SHADING INDICATES EMERGENCY SYSTEM TEXT INDICATES PANEL AND CIRCUIT DESIGNATION
	ELECTRICAL PANELBOARD, CONTROL PANEL, OR OTHER CABINET AS NOTED		

LIGHTING LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
A	SHADING INDICATES EM SYSTEM, LOWER CASE SUBSCRIPT INDICATES SWITCHING, UPPER CASE SUBSCRIPT INDICATES LUMINAIRE TYPE (TYP)		DECORATIVE ADJUSTABLE ACCENT DOWNLIGHT
	SURFACE OR PENDANT MOUNTED LUMINAIRE		SQUARE DOWNLIGHT
	LENSED TROFFER		SQUARE WALL WASH DOWNLIGHT
	DIRECT/INDIRECT TROFFER		SQUARE ADJUSTABLE ACCENT DOWNLIGHT
	PATIENT OVERBED LIGHT		SQUARE DOWNLIGHT
	DIRECT/INDIRECT DISTRIBUTION, SUSPENDED LINEAR PENDANT		SQUARE WALL WASH DOWNLIGHT
	INDIRECT DISTRIBUTION, SUSPENDED LINEAR PENDANT		SQUARE ADJUSTABLE ACCENT DOWNLIGHT
	DIRECT DISTRIBUTION, SUSPENDED LINEAR PENDANT		DECORATIVE PENDANT
	DIRECT/INDIRECT DISTRIBUTION, WALL MOUNT LINEAR		PENDANT
	INDIRECT DISTRIBUTION, WALL MOUNT LINEAR		RECESS MOUNTED WALL LUMINAIRE
	DIRECT DISTRIBUTION, WALL MOUNT LINEAR		WALL PACK OR EXTERIOR NON-DECORATIVE WALL SIGNAGE
	DECORATIVE LINEAR WALLMOUNT		DECORATIVE SCONCE
	STRIP LINEAR WALLMOUNT		DECORATIVE POLE
	SURFACE OR PENDANT MOUNTED STRIP OR INDUSTRIAL LUMINAIRE		POLE
	THEATRICAL PIPE OR TRACK LIGHTING		BOLLARD
	TRACK HEAD	PC	PORCELAIN KEYLESS LAMPHOLDER, BRYANT #5228 W/ 100W A19, I.F. LAMP. "PC" INDICATES PULLCHAIN
	SURFACE DOWNLIGHT		EMERGENCY LIGHTING UNIT
	DOWNLIGHT		EXTERIOR STAKE MOUNTED
	WALL WASH DOWNLIGHT		DOCK LIGHT
	ADJUSTABLE ACCENT DOWNLIGHT		DARKROOM SAFE LIGHT (TWO COMPARTMENT SHOWN)
	DECORATIVE DOWNLIGHT		UNDERCABINET LIGHT
	DECORATIVE WALL WASH DOWNLIGHT		EXIT LIGHT, ARROWS AS INDICATED, FACES INDICATED BY SHADING

CONTROLS LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
S_A	SINGLE POLE SWITCH (SUBSCRIPT DENOTES SWITCHING)	S_{VS}	VARIABLE SPEED/SPEED CONTROLLER SWITCH
S_2	TWO POLE SWITCH	S_{EP}	EXPLOSION PROOF SWITCH
S_3	THREE-WAY SWITCH	S_{TO}	THERMAL OVERLOAD SWITCH
S_4	FOUR-WAY SWITCH	S_{MC}	MOMENTARY CONTACT SWITCH
S_K	KEY OPERATED SWITCH	S	COMBINATION SWITCH AND DUPLEX RECEPTACLE
S_M	MANUAL SWITCH, HORSEPOWER RATE	P	PHOTOCELL
S_D	DIMMER SWITCH		PUSH BUTTON
S_{PI}	SWITCH WITH PILOT LIGHT (PILOT LIGHT IS 'ON' WHEN SWITCH IS 'ON')	TC	TIME CLOCK
S_P	SWITCH WITH PILOT LIGHT LOCATOR (CONTINUOUSLY LIGHTED HANDLE)		OCCUPANCY SENSOR - WALL MOUNTED IR=INFRARED, US=ULTRASONIC, DT=DUAL TECHNOLOGY
S_{LV}	LOW VOLTAGE SWITCH		

TECHNOLOGY LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION		SYMBOL	DESCRIPTION	
	WALL FIELD		# XXX	CEILING MOUNTED OUTLET (# = QTY OF CABLES; XXX= SEE BELOW)	
	TELECOM GROUND BAR			AV = AUDIO VISUAL	SEC = SECURITY
	WIRE BASKET TRAY			WAP=WIRELESS ACCESS POINT	PRJ = PROJECTOR
	CABLE TRAY				
	J-HOOK PATHWAY		■ T XXX	DATA POWER POLE (XXX = SEE BELOW)	
#	FLOOR SPACE BOX DATA OUTLET(# = QTY OF CABLES)			SEC = SECURITY	SR = SURFACE RACEWAY
#	POKE-THRU (# = QTY OF CABLES)		ZZ	TELEVISION COAXIAL CABLE (ZZ = ELEVATION)	
# XXX ZZ	DATA OUTLET (# = QTY OF CABLES; XXX = SEE BELOW ZZ = ELEVATION)			CEILING MOUNTED TELEVISION COAXIAL OUTLET	
	D = MEDICAL/SUPPLY DISPENSER RED = RED PHONE		J	FLOOR JBOX	
	EEG = EEG NETWORK	T = TRANSLATION PHONE	H XXX	POKE THRU; (XXX = SEE BELOW)	
	EP = EMERGENCY PHONE	TC = TIME CLOCK		FF = FURNITURE FEED	AV = AUDIO VISUAL
	F = FACP	W = WALL PHONE	J XXX ZZ	WALL MOUNTED JBOX (XXX = SEE BELOW; ZZ = ELEVATION)	
	POS = POINT OF SALE	AV = AUDIO VISUAL		CLG = CEILING	AV = AUDIO VISUAL
	RAD = RADIOLOGY NETWORK	PRT = PRINTER	PB YY	PULLBOX (YY = SIZE)	
	SR = SURFACE RUNWAY	MFP = MULTI FUNCTIONS PRINTER	C XXX	CLOCK OUTLET (XXX = SEE BELOW)	
	BAS = BUILDING AUTOMATION SYSTEM	WP = WEATHER PROOF		DS = DOUBLE SIDED	DIGITAL (PROVIDE 1 CAT 6 CONNECTION)
	SCH = SCHEDULER	SEC = SECURITY		A = ANALOG	
	CP = CONTROL PANEL	CLK = CLOCK	XXX	COMBINATION CLOCK/SPEAKER OUTLET (XXX = SEE BELOW)	
				A = ANALOG	D = DIGITAL
			C	CEILING MOUNTED CLOCK	
			DAS	DISTRIBUTED ANTENNA SYSTEM	
			WAP	WIRELESS ACCESS POINT ENCLOSURE	
				EQUIPMENT RACK	
				WIRE MANAGER	
				CABINET	

AUDIO VISUAL LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	
S ##	CEILING MOUNTED SPEAKER (## = TYPE #)	T XXX	FLOOR POKE THRU (XXX = SEE BELOW)	
S	WALL MOUNTED SPEAKER		CTRL = CONTROL UNIT	I/O = INPUT/OUTPUT PLATE
DIS (XX)	DISPLAY (XX = SIZE OF SCREEN * = ELEVATION)	SSS	SOUND SHOWER SPEAKER	
SCH *	SCHEDULER ; (* = ELEVATION)	PS ZZ	PARTITION SENSOR (ZZ = ELEVATION)	
CTRL *	CONTROL UNIT ; (* = ELEVATION)	ZZ	TELEVISION COAXIAL CABLE (ZZ = ELEVATION)	
I/O *	INPUT/OUTPUT PLATE ; (* = ELEVATION)		CEILING MOUNTED TELEVISION COAXIAL OUTLET	
M *	MICROPHONE OUTLET ; (* = ELEVATION)	VC	VOLUME CONTROL	
P	PROJECTOR	HDMI	HIGH DEFINITION MULTIMEDIA INTERFACE	
VL	VOICELIFT SYSTEM UNIT	##	CEILING MOUNTED MICROPHONE (## = TYPE #)	

REFERENCE SYMBOLS LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
X	KEY NOTE REFERENCE	T	KITCHEN/OWNER/MEDICAL EQUIPMENT REFERENCE
LPA-#	TYPICAL CIRCUIT NUMBER	E	EXISTING TO REMAIN
TG#	TYPICAL LUMINAIRE TYPE	E	EXISTING TO BE REMOVED
RM FLR	TYPICAL ROOM REFERENCE (TOP = RM #, BOTTOM = FLR)	E	EXISTING TO BE RELOCATED
MK	MECHANICAL EQUIPMENT REFERENCE	E	EXISTING TO REMAIN - REPLACE DEVICE
LCT	LIGHTING CONTROL / EQUIPMENT REFERENCE	E	EXISTING TO BE REMOVED AND REPLACED

ABBREVIATIONS LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
A	AMPERES	MCP	MOTOR CIRCUIT PROTECTOR
AC	ABOVE COUNTER, MOUNT HORIZONTALLY TO CENTERLINE OF DEVICE, +6" ABOVE COUNTER OR BACK SPLASH	MEC	SEE MECHANICAL EQUIPMENT SCHEDULE
AFF	ABOVE FINISHED FLOOR	MIN	MINIMUM
AFG	ABOVE FINISHED GRADE	MLO	MAIN LUGS ONLY
ANN	ANNUNCIATOR	MTS	MANUAL TRANSFER SWITCH
ARF	ABOVE RAISED FLOOR	NC	NORMALLY CLOSED
ASSD	AIR SAMPLING SMOKE DETECTION	NIC	NOT IN CONTRACT
ATS	AUTOMATIC TRANSFER SWITCH	NL	NIGHT LIGHT
BFG	BELOW FINISHED GRADE	NO	NORMALLY OPEN
C	CONDUIT	NTS	NOT TO SCALE
CATV	CABLE TELEVISION	OC	ON CENTER
CB	CIRCUIT BREAKER	OFCI	OWNER FURNISHED, CONTRACTOR INSTALLED
CCTV	CLOSED CIRCUIT TELEVISION	OFOI	OWNER FURNISHED, OWNER INSTALLED
(E)	EXISTING	OSWF	ON SITE WORK FORCE
EM	EMERGENCY	PB	PULL BOX
EMDC	EMERGENCY MAIN DISTRIBUTION CENTER	SB	STAND-BY
EP	EXPLOSION PROOF	SDC	SUB-DISTRIBUTION CENTER
EPO	EMERGENCY POWER OFF	TP	TAMPER PROOF
EVO	EMERGENCY VENTILATION ON/OFF	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSER
EWC	ELECTRIC WATER COOLER	TYP	TYPICAL
FA	FIRE ALARM	UF	UNDER FLOOR
G	GROUND	UG	UNDER GROUND
GCP	GENERATOR CONTROL PANEL	UON	UNLESS OTHERWISE NOTED
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	UPS	UNINTERRUPTIBLE POWER SUPPLY
HOA	HAND OFF AUTOMATIC	V	VOLTS
IG	ISOLATED GROUND	VFD	VARIABLE FREQUENCY DRIVE
MAX	MAXIMUM	W/	WITH
MCB	MAIN CIRCUIT BREAKER	W/O	WITHOUT
MCC	MOTOR CONTROL CENTER	WP	WEATHER PROOF
MDC	MAIN DISTRIBUTION CENTER	XFMR	TRANSFORMER

FIRE ALARM SYSTEM LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
FACP	FIRE ALARM CONTROL PANEL	M	MANUAL PULL STATION
FAPS	FIRE ALARM (NAC) POWER SUPPLY	IMM	ADDRESSABLE INPUT MODULE
FSA	FIRE ALARM SYSTEM ANNUNCIATOR PANEL (GRAPHIC/LED)	OCM	ADDRESSABLE OUTPUT MODULE
FAA	REMOTE ANNUNCIATOR PANEL	H15cd	AUDIO/VISUAL DEVICE (H#=HORN/STROBE COMBINATION S=SPEAKER/STROBE COMBINATION, C=CHIME/STROBE COMBINATION)
GZM	GRAPHIC ZONE MAP	H	AUDIBLE DEVICE (H=HORN, S=SPEAKER, C=CHIME)
RACP	RESCUE ASSISTANCE SYSTEM HEAD END UNIT	15cd	FIRE ALARM STROBE (cd= CANDELA RATING 15, 30, 75, 110)
FSC	FIRE FIGHTER SMOKE CONTROL PANEL	J	EMERGENCY TELEPHONE STATION (J=JACK, H=HANDSET)
FAD	FIRE ALARM DIRECTORY ANNUNCIATOR	RA	RESCUE ASSISTANCE TELEPHONE STATION)
P	SMOKE DETECTOR (P=PHOTOELECTRIC, SB=WITH SOUNDER BASE, BR=BEAM RECEIVER, BT=BEAM TRANSMITTER)		MAGNETIC DOOR HOLD
F	THERMAL DETECTOR F=FIXED TEMPERATURE, R=FIXED TEMPERATURE & RATE OF RISE (TEMP. RATING)		TAMPER SWITCH
UV	FLAME DETECTOR (UV=ULTRAVIOLET, IR=INFRARED)		FLOW DETECTOR SWITCH
	DUCT SMOKE DETECTOR S=SUPPLY, R=RETURN		PRESSURE SWITCH
RTS	DUCT DETECTOR REMOTE INDICATOR ALARM AND TEST	FSD	FIRE/SMOKE DAMPER
	REMOTE INDICATOR LIGHT	CO	CARBON MONOXIDE ALARM/DETECTOR

ONE-LINE DIAGRAM LEGEND
(Not all symbols listed below are used on these drawings)

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	DISCONNECT SWITCH	A	PANELBOARD "A"
	DISCONNECT SWITCH, FUSED	EM	EM=ENERGY METER, PM=POWER METER, CM=CIRCUIT MONITOR
	CIRCUIT BREAKER	VS	VOLTMETER TEST SWITCH
	FUSE	AS	AMMETER TEST SWITCH
	GROUND	V	VOLTMETER
##	STEP DOWN TRANSFORMER, ## INDICATES KVA	A	AMMETER
KVA ##	K-RATED STEP DOWN TRANSFORMER ## INDICATES KVA, # INDICATES K RATING	XXX	SEE FEEDER/MEC/TRANSFORMER SCHEDULES FOR FEEDER SIZE
	CURRENT TRANSFORMER	G	ENGINE GENERATOR
	POTENTIAL TRANSFORMER		CONTACTOR/RELAY/CAPACITOR (AS NOTED)
OR	SERVICE ENTRANCE TRANSFORMER		TRANSFER SWITCH - ATS=AUTOMATIC; MTS=MANUAL
	METER	GFI	GROUND FAULT INTERRUPTER
	EQUIPMENT ENCLOSURE	SPD	SURGE PROTECTIVE DEVICE
	SERVICE WEATHERHEAD	ST	SHUNT TRIP
ISCA	SHORT CIRCUIT CURRENT AVAILABLE		TERMINATIONS LB=LOAD BREAK, NLB=NO LOAD BREAK
A	KIRK KEY INTERLOCK, SUBSCRIPT INDICATES INTERLOCKED GROUP		DRAW-OUT DEVICE
A	ELECTRICAL INTERLOCK, SUBSCRIPT INDICATES INTERLOCKED GROUP		PLUG-IN DEVICE
	MECHANICAL INTERLOCK	EO	ELECTRICALLY OPERATED

LIGHTING PLAN NOTES:

1. REFER TO ARCHITECTURAL ELEVATIONS AND REFLECTED CEILING PLANS FOR EXACT MOUNTING LOCATIONS OF DEVICES AND LUMINAIRES.
2. PROVIDE A DEDICATED NEUTRAL CONDUCTOR FOR EACH 120V CIRCUIT.
3. CIRCUITS MAY BE COMBINED INTO HOMERUNS OF UP TO SIX (6) CURRENT CARRYING CONDUCTORS, INCLUDING NEUTRALS, UNLESS OTHERWISE INDICATED. WHERE CIRCUITS ARE COMBINED WITHIN A SINGLE CONDUIT, PROVIDE STRIPING FOR FULL LENGTH OF NEUTRAL CONDUCTOR INSULATION TO MATCH THE COLOR CODE OF THE ASSOCIATED PHASE CONDUCTOR. SEE SPECIFICATION FOR COLOR CODES.

POWER PLAN NOTES:

1. MAKE ALL FINAL ELECTRICAL CONNECTIONS TO EQUIPMENT REQUIRING ELECTRICAL CONNECTION. THIS SHALL INCLUDE BUT NOT BE LIMITED TO ALL MECHANICAL AND OTHER EQUIPMENT INCLUDED IN THIS PROJECT.
2. RECEPTACLES INDICATED TO BE MOUNTED ABOVE COUNTER ARE TO BE MOUNTED HORIZONTALLY 6" ABOVE COUNTER UNLESS OTHERWISE NOTED.
3. COORDINATE AND VERIFY EXACT MOUNTING LOCATIONS OF WALL AND FLOOR DEVICES WITH ARCHITECTURAL ELEVATIONS, AND ANY FURNITURE OR SPECIALTY EQUIPMENT SUPPLIER DRAWINGS PRIOR TO ROUGH-IN.
4. NO RECEPTACLES SHALL BE MOUNTED BELOW +18" AFF.
5. PROVIDE A DEDICATED NEUTRAL CONDUCTOR FOR EACH 120V CIRCUIT.
6. CIRCUITS MAY BE COMBINED INTO HOMERUNS OF UP TO SIX (6) CURRENT CARRYING CONDUCTORS, INCLUDING NEUTRALS, UNLESS OTHERWISE INDICATED. WHERE CIRCUITS ARE COMBINED WITHIN A SINGLE CONDUIT, PROVIDE STRIPING FOR FULL LENGTH OF NEUTRAL CONDUCTOR INSULATION TO MATCH THE COLOR CODE OF THE ASSOCIATED PHASE CONDUCTOR. SEE SPECIFICATION FOR COLOR CODES.
7. GFCI RECEPTACLES ARE NOT GENERALLY SHOWN ON DRAWINGS. ALL RECEPTACLE OUTLETS LOCATED IN TOILET ROOMS, OUTDOOR LOCATIONS, WITHIN 6 FEET OF A SINK, AT ELECTRIC WATER COOLERS, OR OTHER WET LOCATIONS SHALL BE PROVIDED WITH GFCI PROTECTION PER NEC ARTICLE 210 AND NEC SECTION 422.5. ADDITIONAL GFCI PROTECTION TO BE PROVIDED AS INDICATED. WHERE GFCI DEVICES ARE REQUIRED AND/OR SHOWN BUT ARE NOT ACCESSIBLE WHEN EQUIPMENT IS INSTALLED, PROVIDE BLANK FACE GFCI DEVICE AND COVERPLATE AHEAD OF INACCESSIBLE RECEPTACLES. MOUNT ADJACENT TO EQUIPMENT AT SWITCH HEIGHT UNLESS OTHERWISE SHOWN.
8. PROVIDE TAMPER PROOF RECEPTACLES IN WAITING AREAS, INFIRMARY, BATHROOMS, PLAYROOMS, ACTIVITY ROOMS, CLASSROOMS, CORRIDORS AND AREAS ACCESSIBLE TO CHILDREN PER NEC 406.12.

ONE-LINE DIAGRAM NOTES:

1. PANELBOARDS INDICATED ON ONE LINE DIAGRAMS DO NOT SHOW ALL BRANCH CIRCUITS. REFER TO PANELBOARD SCHEDULE(S).
2. EXISTING ONE-LINE DIAGRAM TAKEN FROM OWNER FURNISHED DRAWINGS. EXISTING INFORMATION SHOWN OTHER THAN LOCATIONS IMPACTED BY NEW WORK HAS NOT BEEN VERIFIED.

TECHNOLOGY PLAN NOTES:

1. PROVIDE J-HOOK TYPE CABLE SUPPORTS EVERY 4'-0" TO 5'-0" IN OPEN OR ACCESSIBLE CEILING SPACE AS REQUIRED TO SUPPORT CABLES IN ROUTE TO CABLE TRAY OR CONDUIT PATHWAY TO TELECOMMUNICATIONS ROOM. ROUTE CABLE SUPPORTS SUCH THAT CABLE VISIBILITY WILL BE MINIMIZED IN ANY OPEN CEILING AREAS.

ROUGH-IN AND PATHWAY NOTES:

1. PROVIDE 4-11/16" x 4-11/16" x 2-7/8" OUTLET BOX AND SINGLE GANG MUD RING FOR ALL TELE/DATA OUTLETS. ROUTE 1" CONDUIT FROM EACH OUTLET TO ABOVE ACCESSIBLE CEILING UNLESS OTHERWISE NOTED. PROVIDE INSULATED THROAT CONNECTOR ON CONDUIT END. KEEP ALL EXPOSED CONDUITS TIGHT TO STRUCTURE.
2. PROVIDE 4-11/16" x 4-11/16" x 2-7/8" OUTLET BOX AND TWO-GANG MUD RING FOR ALL AV DEVICE AND DISPLAY BACKBOX LOCATIONS UNLESS OTHERWISE NOTED. ROUTE 1-1/4" CONDUIT TO ABOVE ACCESSIBLE CEILING UNLESS OTHERWISE NOTED. PROVIDE INSULATED THROAT CONNECTOR ON CONDUIT END. KEEP ALL EXPOSED CONDUITS TIGHT TO STRUCTURE.
3. COORDINATE AND VERIFY EXACT MOUNTING LOCATIONS OF WALL, CEILING, AND FLOOR DEVICES WITH ARCHITECTURAL ELEVATIONS AND ANY FURNITURE OR SPECIALTY EQUIPMENT SUPPLIER DRAWINGS PRIOR TO ROUGH-IN.
4. CONDUIT DEDICATED FOR TECHNOLOGY SYSTEMS SHALL BE INSTALLED IN EMT UNLESS OTHERWISE NOTED. FLEX CONDUIT SHALL NOT BE USED WITHOUT PRIOR APPROVAL FROM THE ENGINEER OR OWNER.
5. CONDUIT DEDICATED FOR TECHNOLOGY SYSTEMS SHALL NOT EXCEED 100' OR CONTAIN MORE THAN 180 DEGREES OF TOTAL BENDS WITHOUT UTILIZING APPROPRIATELY SIZED PULL BOXES.
6. MINIMUM BEND RADII FOR 2" CONDUIT OR SMALLER SHALL BE 6 TIMES THE OUTSIDE DIAMETER OF THE CONDUIT. BEND RADII FOR CONDUIT LARGER THAN 2" SHALL BE 10 TIMES THE OUTSIDE DIAMETER OF THE CONDUIT. L-BENDS SHALL NOT BE USED.
7. ALL BACKBONE PATHWAYS SHALL BE EQUIPPED WITH A PULL CORD THAT HAS A MINIMUM TEST RATING OF 200lbs.
8. ALLOW FOR A MINIMUM OF 3" VERTICAL CLEAR SPACE ABOVE CONDUITS AND 12"VERTICAL CLEAR SPACE ABOVE CABLE TRAY.

GENERAL NOTES:

1. FOR REMODELING, WORK INCLUDED IS DENOTED IN BOLD. EXISTING CONDITIONS TO REMAIN ARE DENOTED LIGHTLY.
2. PROTECT STRUCTURE AND OWNER EQUIPMENT FROM DAMAGE. IMMEDIATELY REPLACE OR REPAIR, TO ORIGINAL CONDITION, DAMAGE CAUSED BY THE CONTRACTOR WHETHER EQUIPMENT APPEARS TO BE CURRENTLY IN USE OR NOT, UNLESS WRITTEN AUTHORIZATION FROM THE OWNER INDICATED OTHERWISE. PREPARE LISTING OF ALL EXISTING DAMAGED ITEMS AND SUBMIT TO OWNER PRIOR TO BEGINNING WORK.
3. INSTALL CONDUIT CONCEALED IN FINISHED AREAS UNLESS OTHERWISE NOTED. PAINT EXPOSED CONDUIT TO MATCH EXISTING FINISHES WITHIN THE SURROUNDING AREA.
4. FIRE SEAL ALL FIRE RATED WALL AND FLOOR PENETRATIONS. REFER TO ARCHITECTURAL DRAWINGS FOR FIRE RATED WALLS.
5. COORDINATE EXACT REQUIREMENTS AND LOCATIONS OF MECHANICAL EQUIPMENT WITH MECHANICAL DRAWINGS AND MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN AND ORDERING MATERIALS OR EQUIPMENT.
6. EXISTING INFORMATION SHOWN ON THE DRAWINGS HAS BEEN TAKEN FROM OWNER FURNISHED DRAWINGS AND/OR LIMITED FIELD OBSERVATIONS. CATOR, RUMA & ASSOCIATES IS NOT RESPONSIBLE FOR THE ACCURACY OF ANY INFORMATION OR THE ADEQUACY, SAFETY AND CONFORMANCE TO CURRENT PREVAILING CODES OF ANY WORK SHOWN AS EXISTING ON THESE DRAWINGS.
7. PROVIDE SEPARATE INSULATED GROUNDING CONDUCTOR IN ALL FEEDER, HOMERUN AND BRANCH CIRCUITS.

DEMOLITION NOTES:

1. UNLESS NOTED OTHERWISE, BOLD ITEMS INDICATE EQUIPMENT, DEVICES, ETC. TO BE REMOVED. SEE SPECIFICATION SECTION 260500 FOR REMODEL/DEMOLITION DETAILED REQUIREMENTS.
2. DEMOLITION DRAWINGS MAY NOT SHOW EVERY ITEM TO BE DEMOLISHED. CONTRACTOR SHALL VISIT SITE TO DETERMINE AND COORDINATE THE EXACT EXTENT OF DEMOLITION TO FACILITATE ALL WORK INDICATED BY THE CONTRACT DOCUMENTS PRIOR TO QUOTATION. NO EXTRAS WILL BE ALLOWED FOR WORK REQUIRED TO ACHIEVE THE END RESULT AS INDICATED BY THE CONTRACT DOCUMENTS. REWORK EXISTING TERMINATIONS, CONNECTIONS, CONDUIT, WIRING, ETC. TO ACCEPT NEW WORK. MAINTAIN CIRCUIT CONTINUITY TO EXISTING CIRCUITS AND DEVICES TO REMAIN OR REMODEL/DEMOLITION DETAILED REQUIREMENTS TO BE RELOCATED. PRIOR TO COMMENCEMENT OF ANY DEMO WORK, CONFIRM EXISTING CONDITIONS AND NOTIFY ENGINEER OF ANY DISCREPANCIES FOR RESOLUTION.
3. ALL ITEMS IDENTIFIED TO BE REMOVED SHALL BE REMOVED IN THEIR ENTIRETY INCLUDING ALL WIRING AND EXPOSED CONDUIT AND CONDUIT SUPPORTS BACK TO POINT OF ORIGIN OR NEXT DEVICE TO REMAIN. REMOVED ITEMS SHALL BE TURNED OVER TO THE OWNER, UNLESS NOTED OTHERWISE, AND STORED IN THE AREA DESIGNATED BY THE OWNER. REMOVE FROM SITE AND LEGALLY DISPOSE OF ALL ITEMS THE OWNER CHOOSES NOT TO ACCEPT.
4. WHERE EXISTING CONDUITS ARE SHOWN TO BE REMOVED AND HAVE BEEN ROUTED IN CONCRETE FLOOR SLABS, CONCRETE WALLS OR CONCRETE CEILINGS, THEY SHALL BE CUT BACK FLUSH WITH CONCRETE. FILL WITH GROUT TO ACHIEVE A SMOOTH AND EVEN FINISH FLUSH WITH CONCRETE SURFACE AFTER CONDUCTORS HAVE BEEN REMOVED.
5. REUSE EXISTING CONDUIT WHERE CURRENT NEC AND LOCAL CODE REQUIREMENTS ARE MAINTAINED. PROVIDE NEW CONDUIT AND WIRE FOR NEW INSTALLATIONS AND EXTENSION OF EXISTING INSTALLATIONS. REUSE EXISTING CONDUIT IN PLACE. DO NOT REINSTALL EXISTING CONDUIT. PROVIDE LABELING PER SPECIFICATIONS FOR REUSED CONDUIT.
6. RELOCATED EQUIPMENT AND DEVICES ARE TO BE CLEANED OF ALL FOREIGN MATERIAL. REPLACE EQUIPMENT OR DEVICES WHICH ARE DEFECTIVE OR DAMAGED DURING RELOCATION.
7. WHERE EXISTING DEVICES, SWITCHES, MOTOR CONNECTIONS, ETC. ARE TO BE REMOVED FROM WALLS WHICH ARE REMAINING, WALLS SHALL BE PATCHED TO MATCH ORIGINAL FINISH. BLANK COVERPLATES OVER EXISTING BOXES ARE NOT ACCEPTABLE, UNLESS NOTED OTHERWISE.

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

ELECTRICAL LEGENDS & NOTES

E0.1

P:\WPS\2026-0531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:41 AM

GENERAL EQUIPMENT SCHEDULE

COMMON NOTES:

A. PRIOR TO WORK, VERIFY ELECTRICAL REQUIREMENTS (VOLTAGE, AMPERAGE, RECOMMENDED OCPD, CONDUCTORS, AND DISCONNECT) FOR EACH PIECE OF EQUIPMENT.
B. PRIOR TO WORK, VERIFY EXACT LOCATION FOR EACH PIECE OF EQUIPMENT WITH ARCHITECT AND/OR OWNER.

SPECIFIC REMARKS:

							FEEDERS			PROTECTION			
KEY	ITEM	HP	FLA	LOAD	EQ LOAD (VA)	VOLTAGE	WIRE	GROUND	CONDUIT	BREAKER	DISCONNECT	FUSE	REMARKS
DOOR	OPERABLE PARTITION DOOR	0.5	0 A	0 VA	1176 VA	120 V/ 1ph	2#12	#12G	3/4"	20 A	S		

LIGHTING CONTROL MATRIX

COMMON NOTES:

A. NOT ALL SPACE NAMES ARE LISTED FOR EACH LIGHTING CONTROL TYPE. REFER TO PLANS FOR ALL SPACES TO BE CONTROLLED.
B. SPACES MAY CONTAIN MULTIPLE ZONES OF CONTROL. REFER TO PLANS FOR QUANTITY OF ZONES, SWITCHES, ETC.
C. PROVIDE THE QUANTITY OF SENSORS AS REQUIRED FOR FULL COVERAGE OF THE SPACE. DEVICES SHOWN ON PLAN ARE FOR DESIGN INTENT ONLY AND DO NOT NECESSARILY REFLECT THE EXACT QUANTITY REQUIRED FOR FULL COVERAGE.
D. WHERE A SINGLE SWITCH/DIMMER IS DENOTED WITH MULTIPLE SWITCH LEGS, DESIGN INTENT IS A SINGLE-GANG DEVICE WITH MULTIPLE-MODE CONTROL.
E. ALL NON-NETWORKED SPACES WITH SENSORS SHALL BE PROVIDED WITH MANUAL 'OFF' MEANS.
F. WHERE NETWORKED SPACES HAVE NO MANUAL 'OFF' MEANS WITHIN SPACE, PROVIDE LABELED MEANS OF SHUTOFF AT CONTROLLER LOCATION FOR NO MORE THAN 5,000 SQUARE FEET.
G. WHERE EMERGENCY LIGHTING IS CONTROLLED, PROVIDE FIRE ALARM CONNECTION(S) TO NETWORKED LIGHTING CONTROL SYSTEM AND/OR SELF-CONTAINED ALCR UNITS PER NFPA 101-7.8. EMERGENCY LIGHTING SHALL BE ILLUMINATED TO 100% OUTPUT UPON ACTIVATION OF FIRE ALARM SYSTEM.

SPECIFIC REMARKS:

KEY:

ON / OFF	M = MANUAL (SWITCH), A = AUTOMATIC (SENSOR), T = TIME SCHEDULE, P = EXTERIOR PHOTOCELL, #% = CONTROL TO #% LIGHT LEVEL
CONTROL	0-10V DIMMING, ELV DIMMING, STEP DIMMING, DMX CONTROL
OCC / VAC	DT = DUAL TECHNOLOGY, PIR = PASSIVE INFRARED, CLG = CEILING MOUNT, WALL = WALL CORNER MOUNT, SW = INTEGRAL TO WALL SWITCH
DAYLIGHT	CALIBRATE BOTTOM LIMIT OF DAYLIGHT SENSOR TO DENOTED FOOTCANDLE LEVEL AT HEIGHT LISTED
INTERFACE	AV = ALLOW OVERRIDE BY A/V SYSTEM, BAS = COMMUNICATE OCCUPIED/UNOCCUPIED STATE TO BAS, VAV = TIE SENSOR RELAY DIRECTLY TO VAV BOX IN ROOM
NETWORK	X = CONNECT ZONE TO CENTRAL LIGHTING CONTROL SYSTEM
EMERGENCY	X = PROVIDE AUTOMATIC LOAD CONTROL RELAYS (ALCR) FOR LUMINAIRES ON EMERGENCY CIRCUIT, PROVIDE TEST SWITCH IF NOT INTEGRAL TO RELAY

					OCCUPANCY / VACANCY SENSOR			DAYLIGHT SENSOR						
TYPE	SPACE	ON	OFF	CONTROL	TECH	MOUNT	DELAY (MIN.)	TARGET LEVEL (FC)	MEASURED HEIGHT (IN.)	RCPT CONTROL	INTERFACE	NETWORK	EMERGENCY	REMARKS
LC13	MUSIC ROOM TRACK	M	A	0-10V	DT	CLG	20			T				

LUMINAIRE SCHEDULE


COMMON NOTES:

A. CATALOG NUMBER REFERS TO FIRST NAME LISTED UNDER MANUFACTURER PER LUMINAIRE TYPE. REMAINING MANUFACTURERS LISTED ARE CONSIDERED TO BE EQUIVALENT PRODUCTS FOR THIS PROJECT AND SHALL MEET ALL CRITERIA LISTED INCLUDING THAT CALLED FOR BY THE SPECIFIC LUMINAIRE CATALOG NUMBER. CATALOG NUMBERS DO NOT NECESSARILY REPRESENT COMPLETE CATALOG NUMBERS. ALL ITEMS LISTED IN THE DESCRIPTION SHALL BE PROVIDED.
B. REFER TO LIGHTING SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
C. PROVIDE UNIT PRICING FOR ALL LUMINAIRES BY TYPE AND SUBMIT WITH BID FORM.
D. PROVIDE AN EMERGENCY BALLAST TEST SWITCH FOR RECESSED DOWNLIGHTS ON CEILING ADJACENT TO LUMINAIRE.
E. PROVIDE FLICKER FREE LED DRIVERS MEETING IEEE 1789.

SPECIFIC REMARKS:

1. PROVIDE ALL MOUNTING HARDWARE, LAMP HEADS, ACCESSORIES, ETC. FOR A COMPLETE AND OPERATIONAL TRACK LIGHTING SYSTEM.
2. PROVIDE (2) DGF 275 GLASS FILTERS, IN EVERY AVAILABLE COLOR, FOR EACH FIXTURE.

		LAMP		BALLAST/DRIVER								
TYPE	DESCRIPTION	COLOR	LUMENS	TYPE	DIM LEVEL	VOLTAGE	APPARENT LOAD	MANUFACTURER	CATALOG SERIES	FINISH	MOUNTING	REMARKS
TH1	3" ADJUSTABLE BEAM LED TRACK HEAD. VARIABLE BEAM SYSTEM, AHR620 BLACK ACCESSORY HOLDER	3500K	1157	PHASE	N/A	120 V	15 VA	JUNO	R620L	BLACK	TRACK	1,2
TK1	2-CIRCUIT ALUMINUM I BEAM TRACK	N/A	N/A	PHASE	N/A	120 V	0 VA	JUNO	T TRAC	BLACK	SURFACE	1

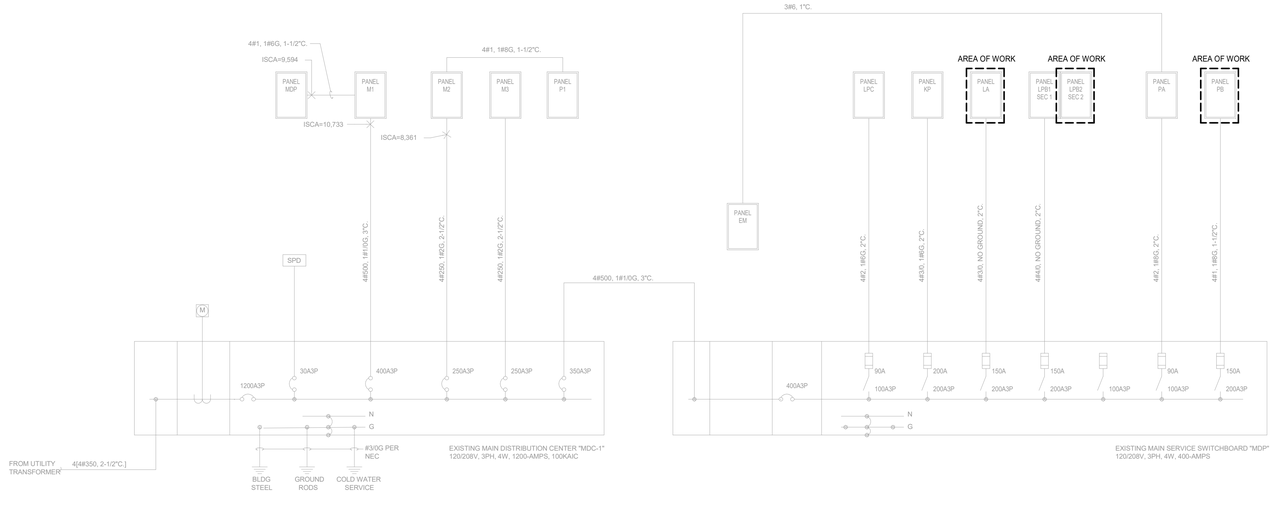

ELECTRICAL ONE-LINE DIAGRAM (SHOWN FOR REFERENCE ONLY)
SCALE: 1/8" = 1'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026


ELECTRICAL SCHEDULES & ONE LINE DIAGRAM

E0.2

P:\WPS\2026-0531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:41 AM

KEYNOTES

E4	REMOVE EXISTING LIGHTING CONTROL DEVICE AND ASSOCIATED CONTROL WIRING. REZONE EXISTING ZONE B LIGHTING TO NEW DIMMER SWITCH AT OFFICE ENTRY.

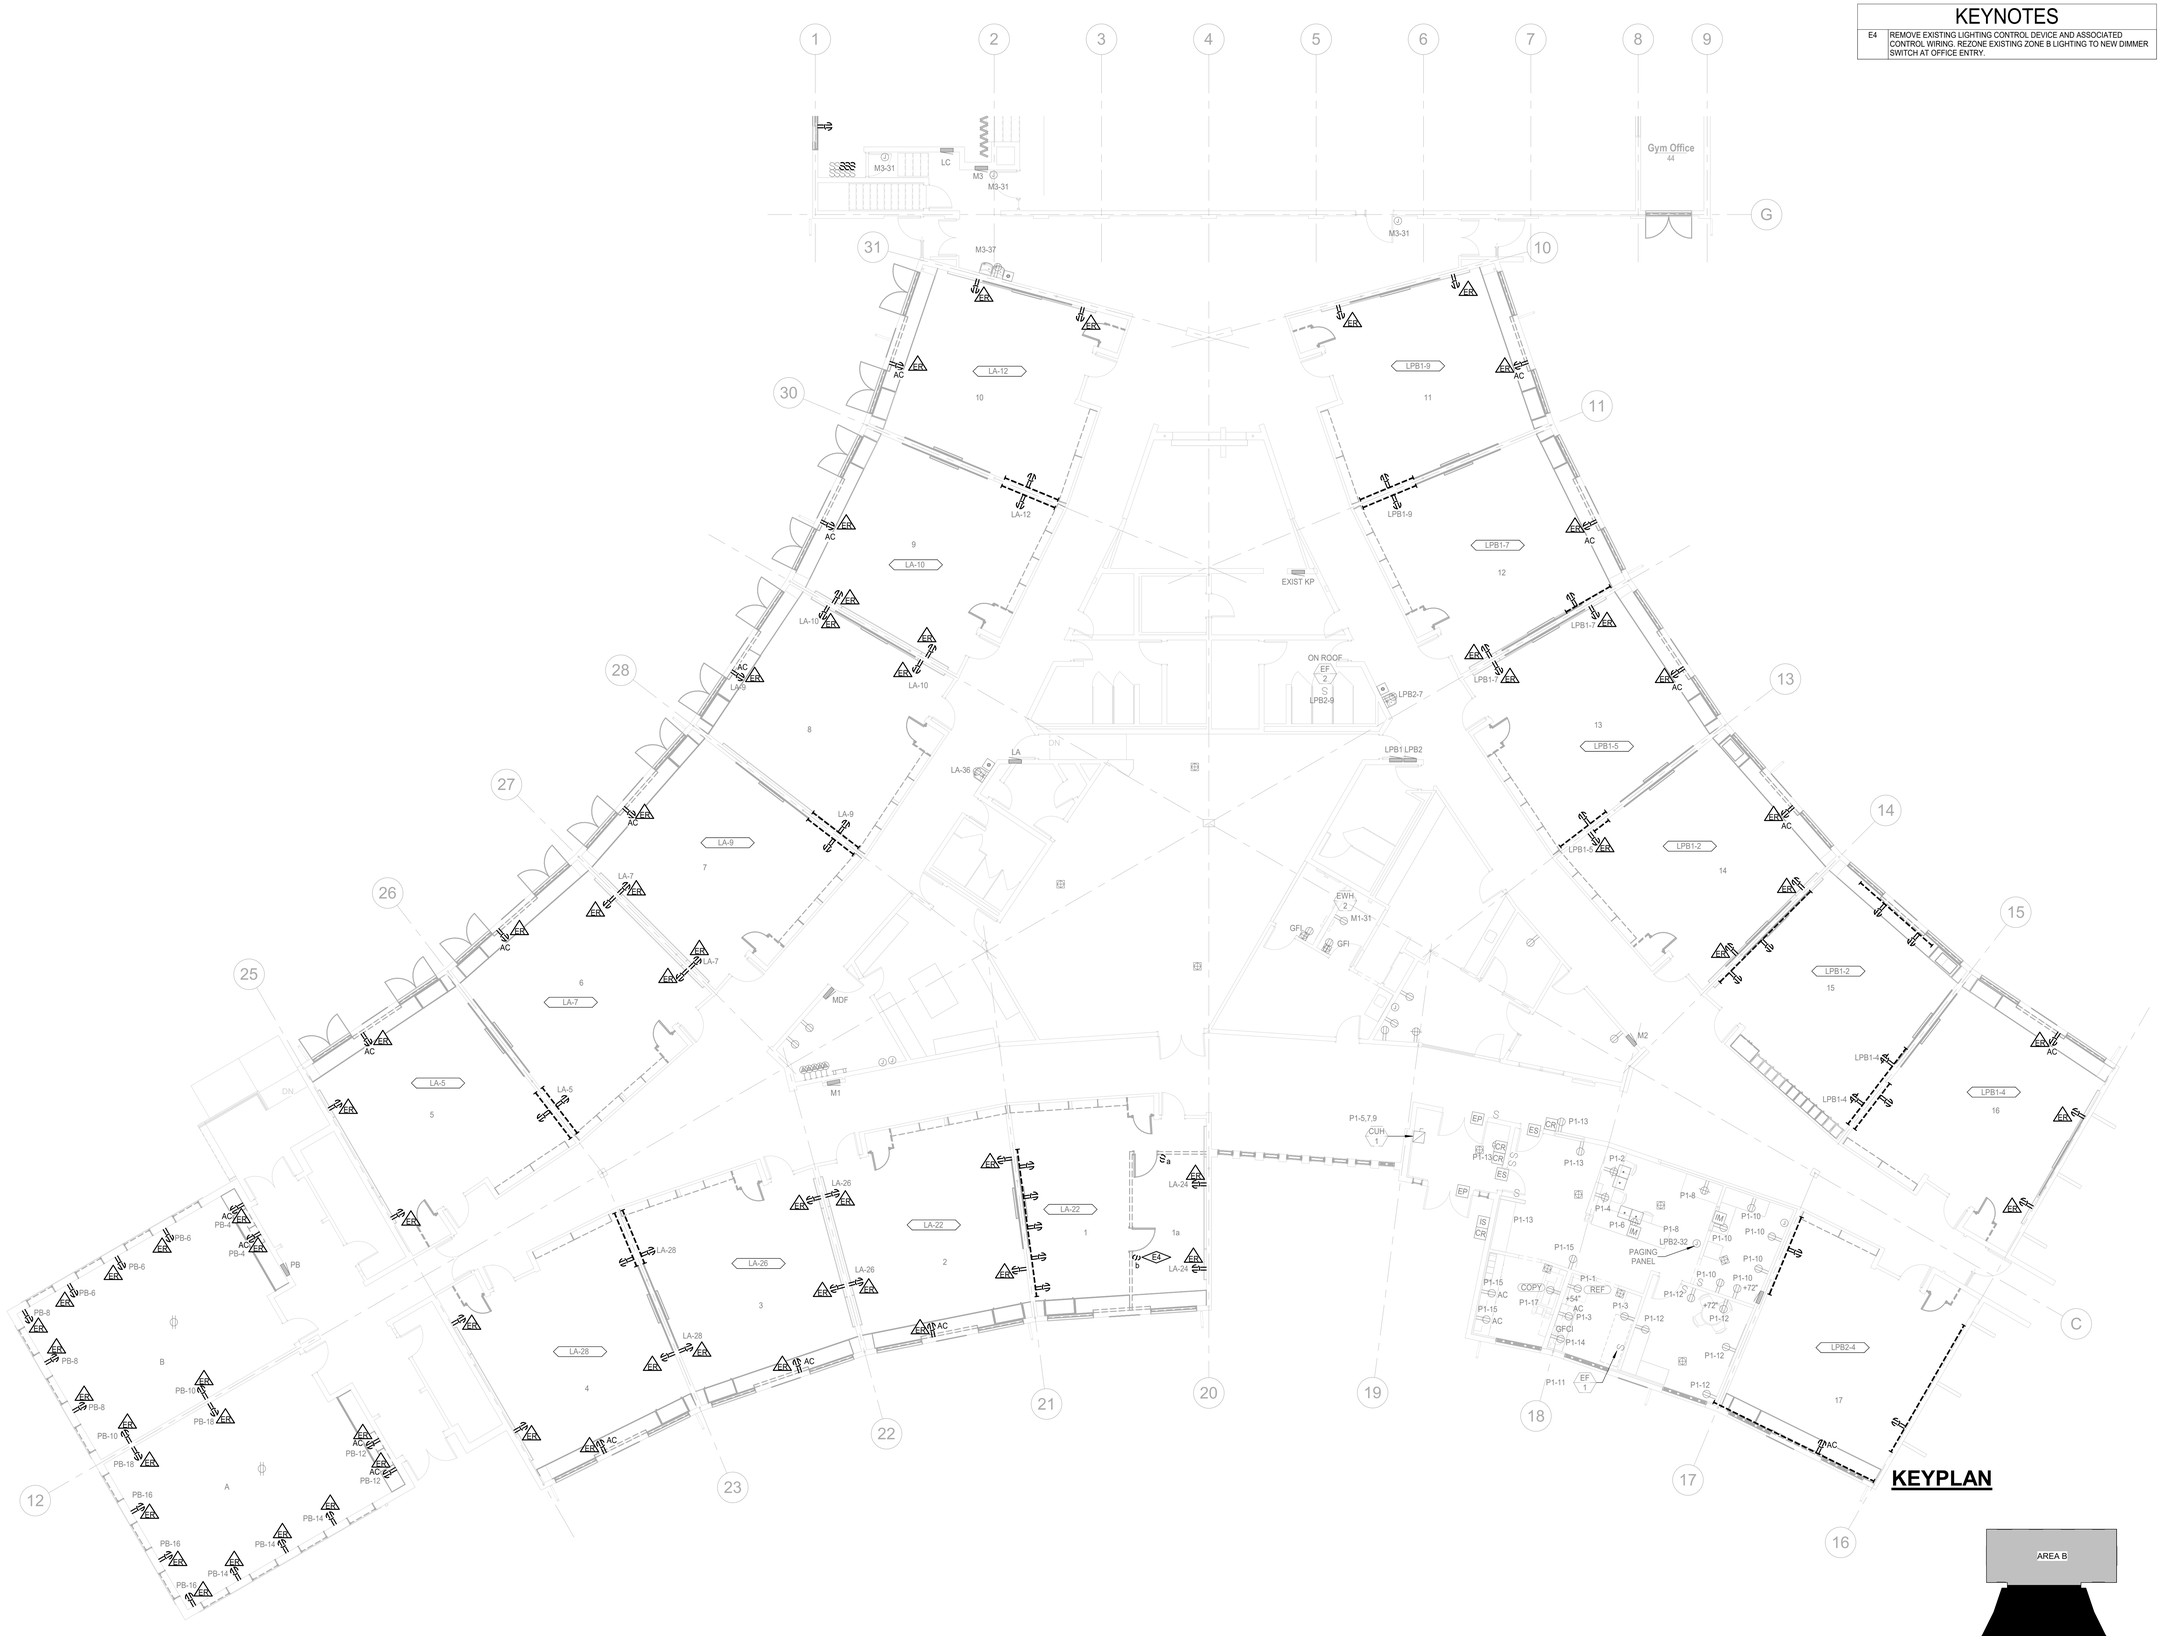

MAIN LEVEL POWER DEMO PLAN - AREA A

SCALE: 1/8" = 1'-0"

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

MAIN LEVEL POWER DEMO PLAN - AREA A

ED1.3

P:\WPS\2026-5531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:42 AM


KEYNOTES

E11	REMOVE EXISTING SMOKE DETECTORS WITHIN BEAM POCKETS. ROOM IS LESS THAN 900 SQ. FT., INDIVIDUAL BEAM POCKET DETECTION IS NOT REQUIRED PER NFPA 72. MAINTAIN EXISTING CENTER SMOKE DETECTOR AND CO DETECTOR.



MAIN LEVEL FIRE ALARM DEMO PLAN - AREA A
SCALE: 1/8" = 1'-0"

KEYPLAN

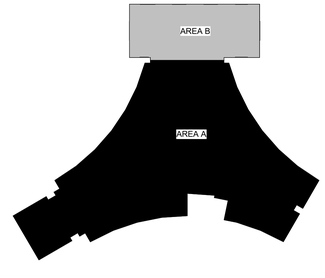

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033


September 25, 2026

MAIN LEVEL FIRE ALARM DEMO PLAN - AREA A

ED1.4

P:\WPS\2026-0531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:43 AM


KEYNOTES	
E6	DISCONNECT AND REMOVE EXISTING MOTORIZED STAGE ACCORDION DOOR ELECTRICAL CONNECTIONS. PRESERVE EXISTING BRANCH CIRCUIT FOR RECONNECTION TO NEW MOTORIZED DOOR. FIELD VERIFY EXISTING CIRCUIT AND PROVIDE CIRCUIT TRACING AS REQUIRED.

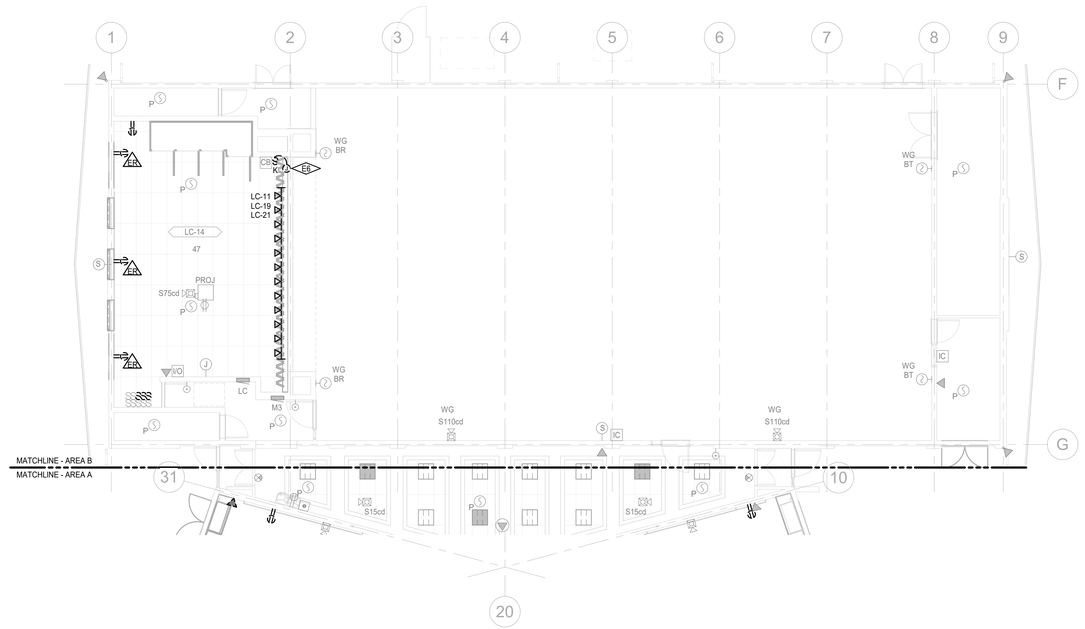

MAIN LEVEL ELECTRICAL DEMO PLAN - AREA B

SCALE: 1/8" = 1'-0"

KEYPLAN

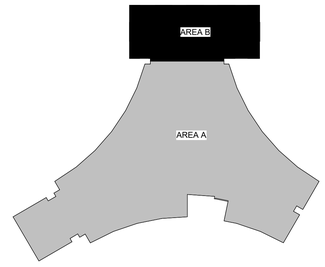

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033


September 25, 2026

BASEMENT & MAIN LEVEL ELECTRICAL DEMO PLAN - AREA B

ED1.5


P:\WPS\2026-0531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:43 AM

KEYNOTES

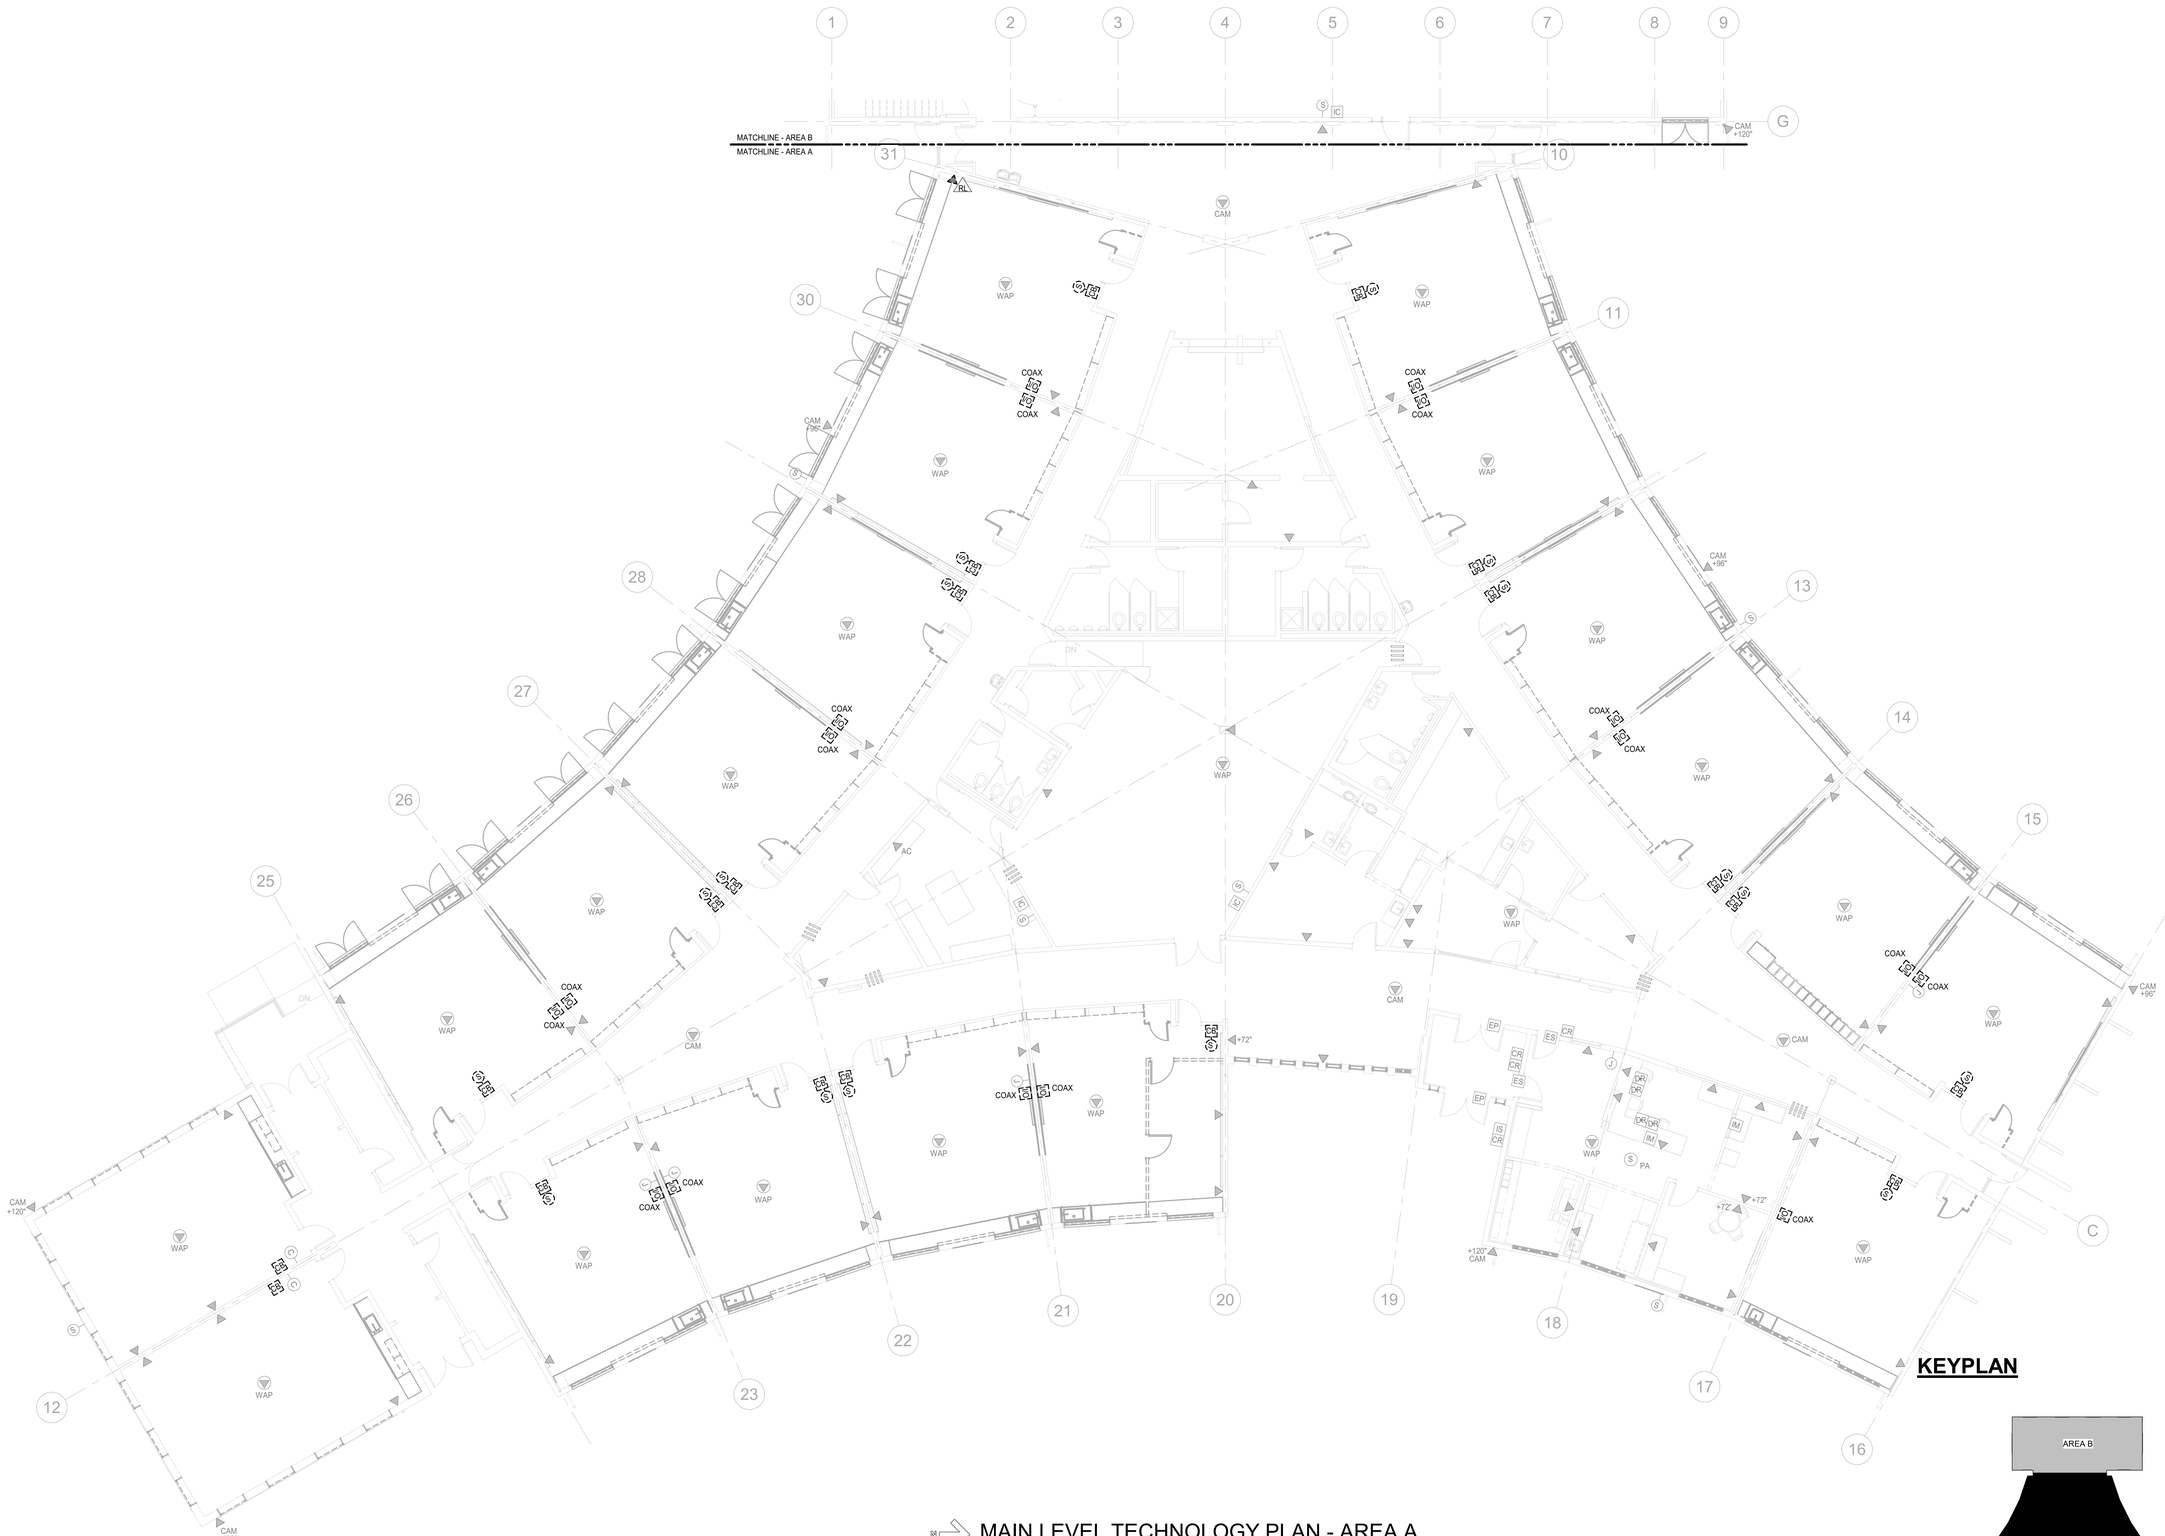

MAIN LEVEL TECHNOLOGY PLAN - AREA A
SCALE: 1/8" = 1'-0"

KEYPLAN

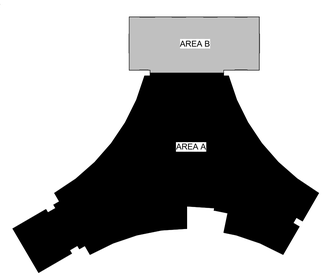

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026


MAIN LEVEL TECHNOLOGY DEMO PLAN - AREA A

ED1.6


P:\WPS\2026-1031 Sherrelwood Elementary_2026 Bond Project\Cad
9/24/2026 8:48:44 AM

KEYNOTES

E1	PROVIDE 120V DUPLEX RECEPTACLE MOUNTED TO BACK SIDE OF GLULAM BEAM FOR CONNECTION TO NEW VOICE LIFT SYSTEM. CONNECT TO UNSWITCHED LEG OF EXISTING CLASSROOM LIGHTING CIRCUIT.
E5	PROVIDE NEW DIMMER SWITCH. REZONE EXISTING LIGHTING WITHIN OFFICE 1A TO BE CONTROLLED FROM THIS LOCATION.
E9	PROVIDE NEW RELAY PANEL FOR AUTOMATIC PLUG LOAD CONTROL OF CONTROLLED RECEPTACLES IN CLASSROOMS. COORDINATE PROGRAMMING WITH OWNER.
E10	REUSE EXISTING CEILING RECEPTACLE CIRCUIT SERVING FORMER PROJECTOR. EXTEND CIRCUIT TO JUNCTION BOX ABOVE CEILING FOR HARDWIRED CONNECTION TO NEW VOICELIFT UNIT.

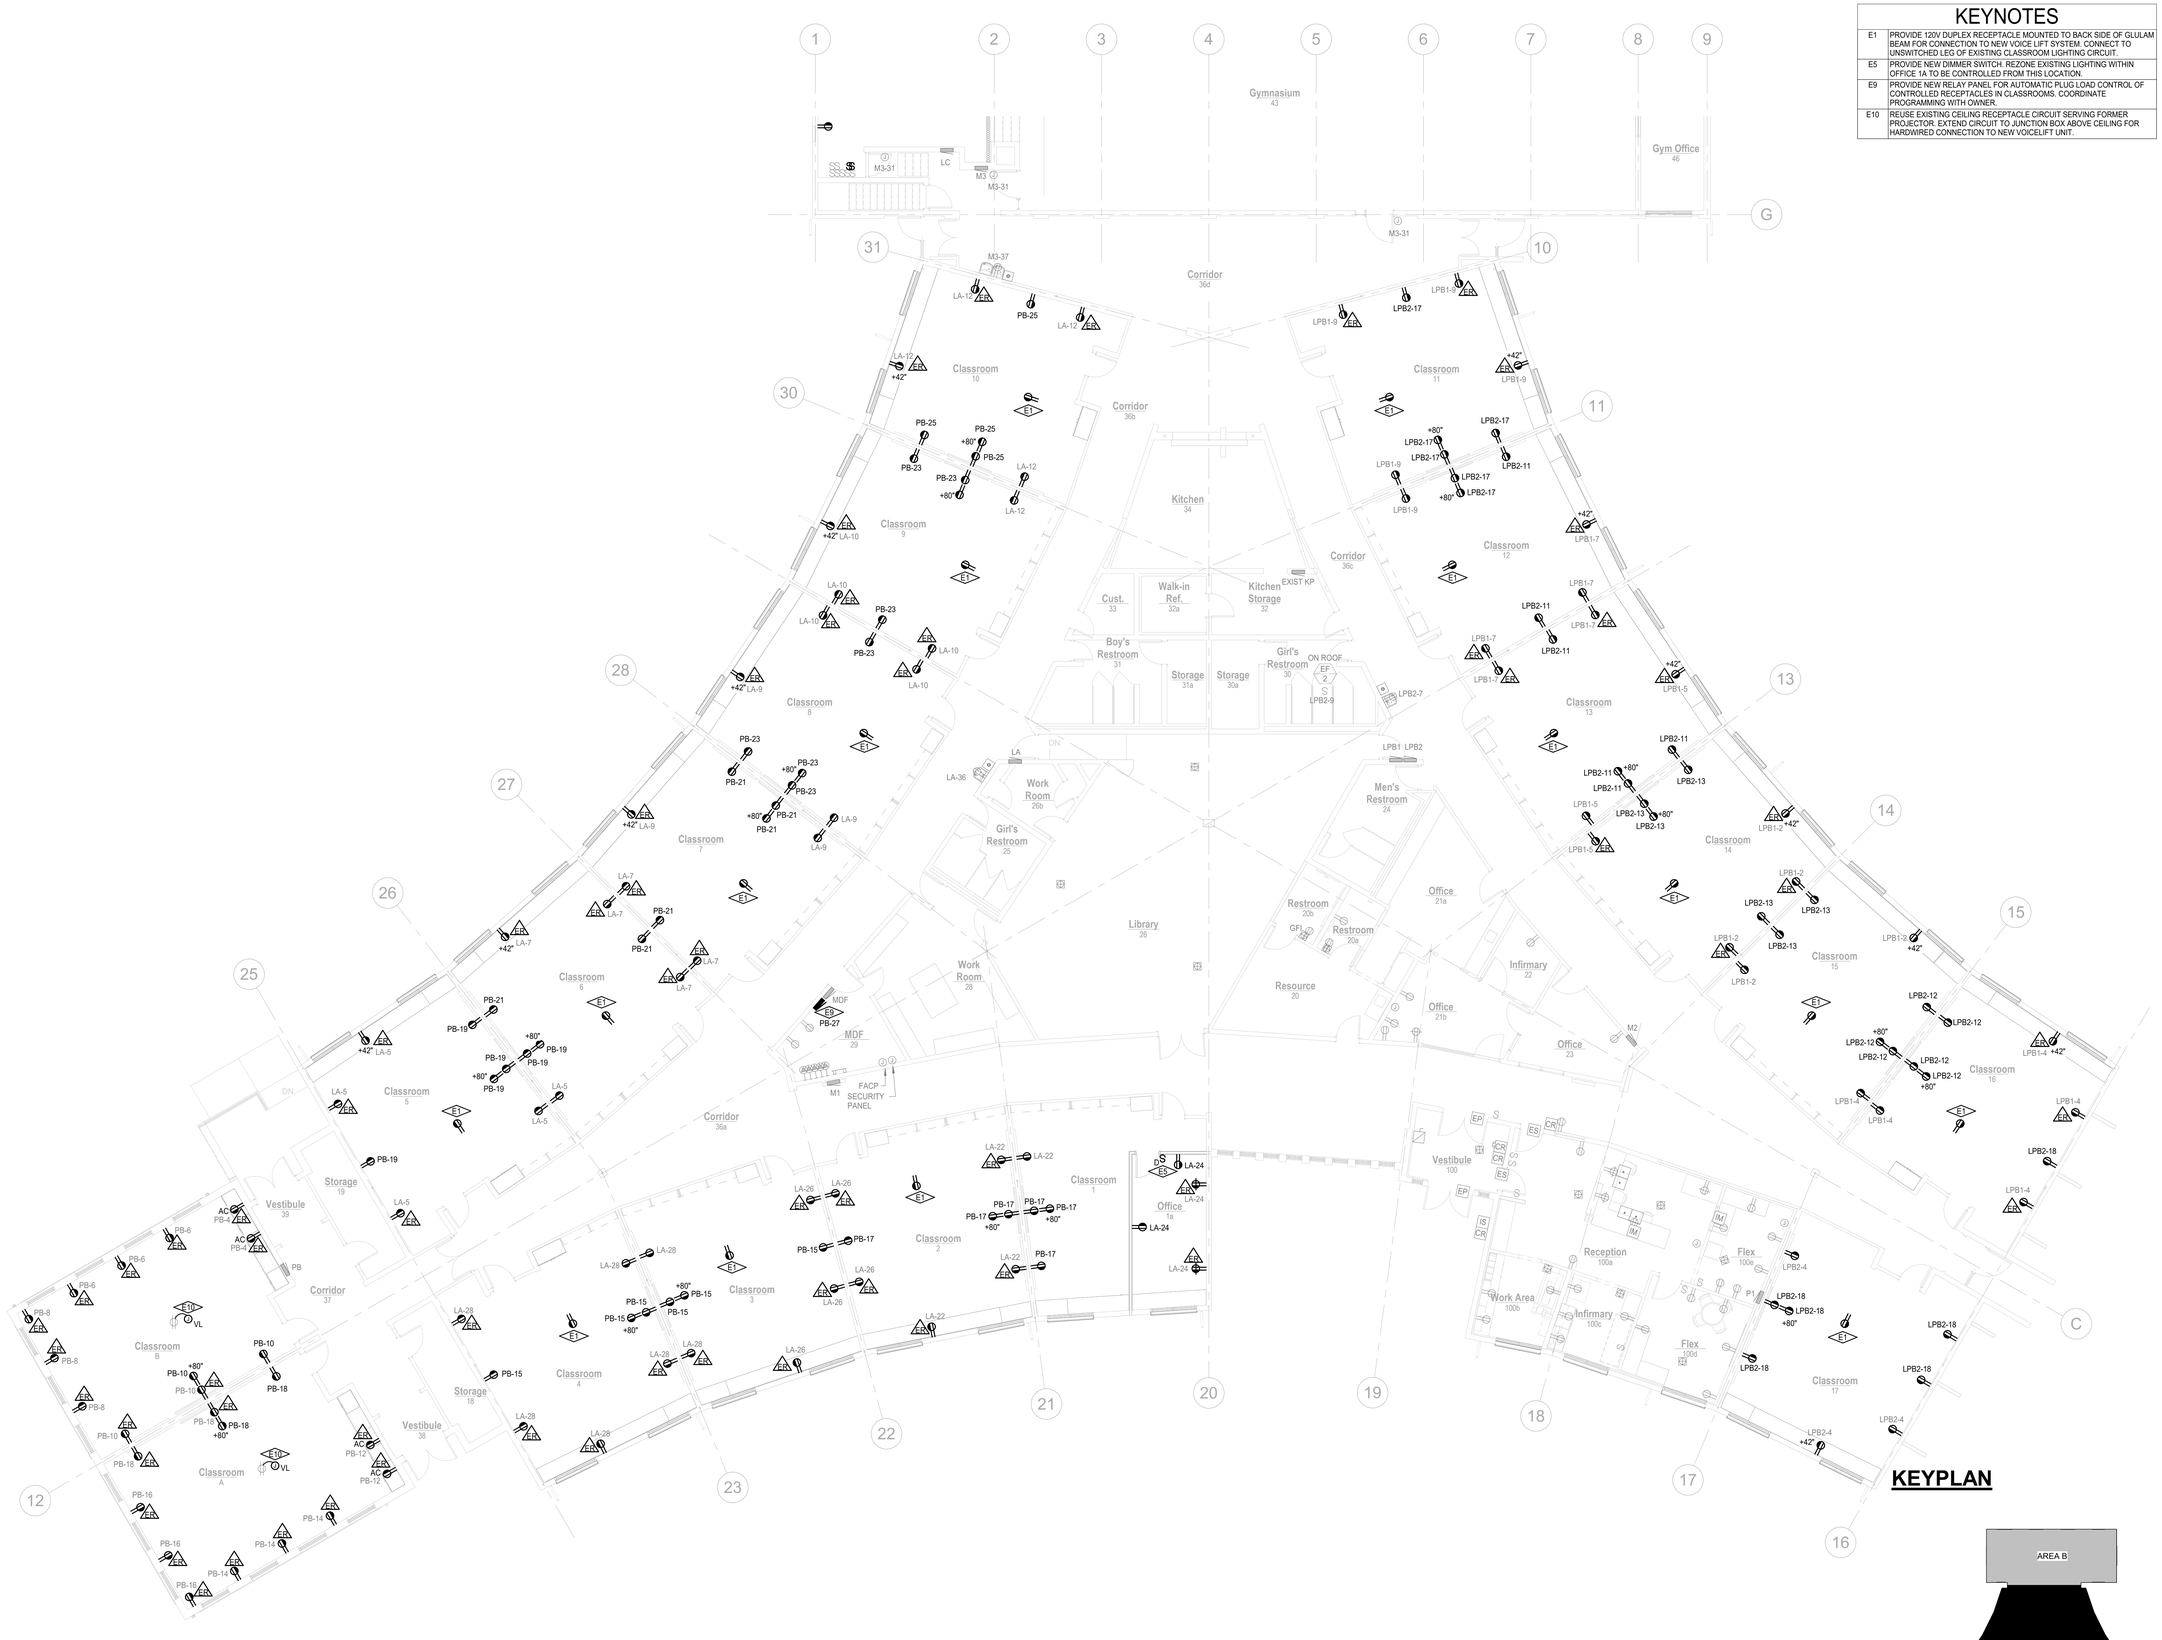

KEYPLAN

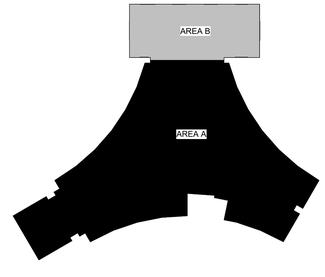

MAIN LEVEL POWER PLAN - AREA A

SCALE: 1/8" = 1'-0"

DAO ARCHITECTURE

7230 Meade St.
Westminster, CO 80030

Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026


MAIN LEVEL POWER PLAN - AREA A

E1.3


P:\WPS\2026-5531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:46 AM

KEYNOTES

E2	REUSE EXISTING CEILING RECEPTACLE CIRCUIT. EXTEND CIRCUIT TO JUNCTION BOX ABOVE CEILING FOR HARDWIRED CONNECTION TO NEW VOICELIFT UNIT.
E3	PROVIDE SURFACE-MOUNTED BOX AND SERIES I-500 WIREMOLD FOR CAMDEN CM-7000/7100 SERIES MOMENTARY SWITCH. MOUNT SWITCH WITH OPERABLE PART AT 48 INCHES MAXIMUM AFF FOR CONTROL OF EXISTING DOOR HOLD.
E7	PROVIDE POWER CONNECTION TO NEW MOTORIZED STAGE ACCORDION DOOR, 1/2 HP, 120V, 1-PHASE. REUSE EXISTING 20A BRANCH CIRCUIT PRESERVED DURING DEMOLITION. PROVIDE CONNECTION PER MANUFACTURER'S REQUIREMENTS.
E8	PROVIDE NEW KEYED CONTROL SWITCH AT EXISTING LOCATION, MOUNTED AT 48" AFF MAXIMUM TO OPERABLE PART. REUSE AND EXTEND EXISTING RACEWAY AS REQUIRED. PROVIDE NEW WIRING FROM SWITCH TO DOOR OPERATOR.

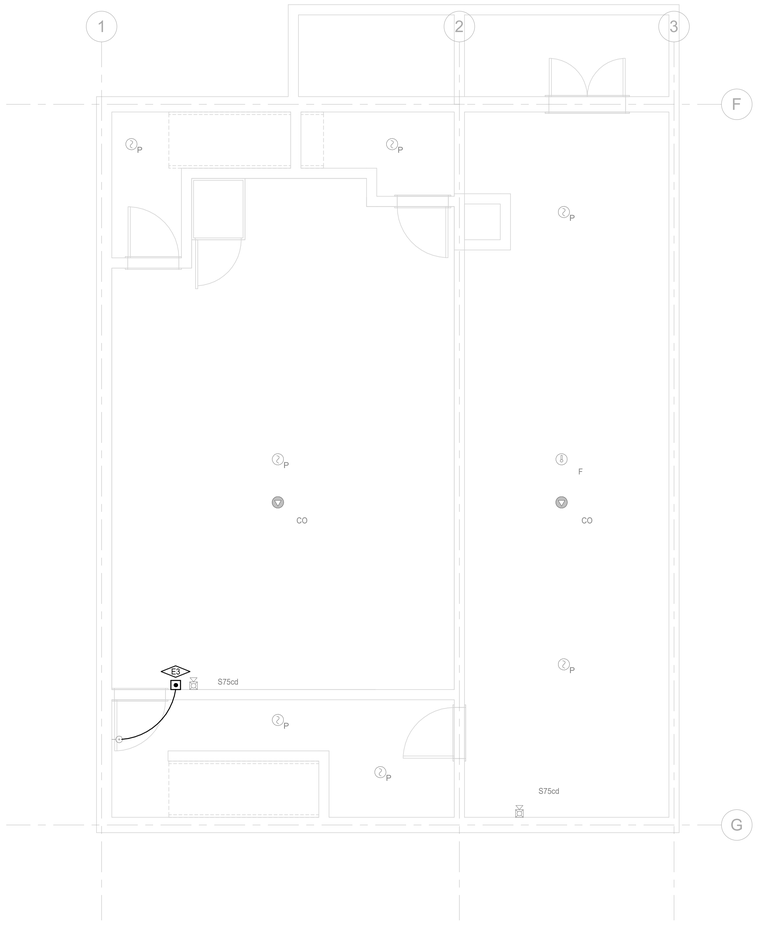


BASEMENT LEVEL FIRE ALARM PLAN
SCALE: 1/4" = 1'-0"

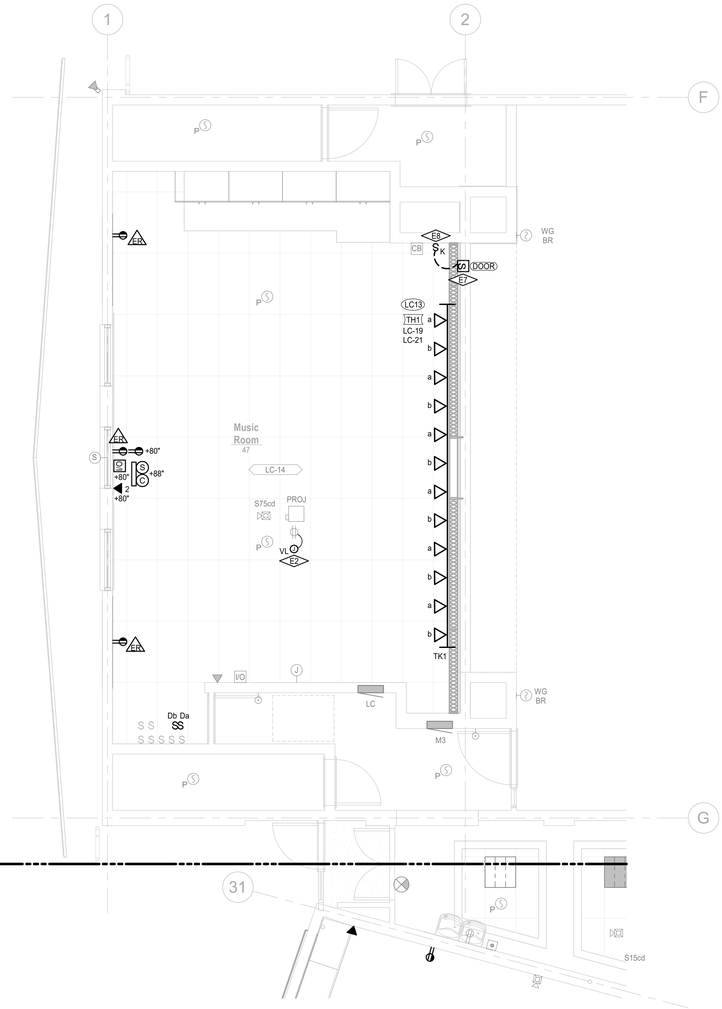

MAIN LEVEL ELECTRICAL PLAN - AREA B
SCALE: 1/4" = 1'-0"

KEYPLAN

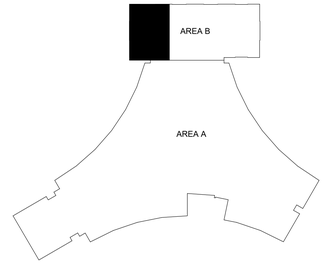

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
Revision Schedule		

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221

DAO No.: 2025-033

September 25, 2026

BASEMENT & MAIN LEVEL ELECTRICAL PLAN - AREA B


E1.5

P:\WPS\2026-0531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:46 AM

KEYNOTES



KEYPLAN

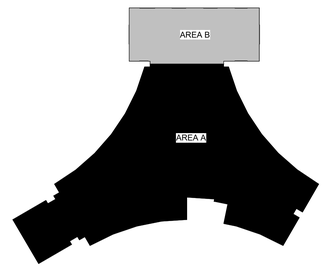

MAIN LEVEL TECHNOLOGY PLAN - AREA A
SCALE: 1/8" = 1'-0"

DAO ARCHITECTURE
7230 Meade St.
Westminster, CO 80030
Phone: 720.273.0431
Email: dan@daoarch.com
Web: www.daoarch.com

CATOR | RUMA & ASSOCIATES, CO.
896 Tabor Street, Lakewood, CO 80401
(303) 232-6200 ▪ www.catorruma.com

Rev. #	Description	Rev. Date
	Revision Schedule	

Westminster Public Schools

2026 Bond Projects - Sherrelwood Renovations

8095 Kalamath St.
Denver, CO 80221


DAO No.: 2025-033

September 25, 2026

MAIN LEVEL TECHNOLOGY PLAN - AREA A

E1.6

P:\WPS\2026-0531 Sherrelwood Elementary 2026 Bond Project\Cad
9/24/2026 8:48:47 AM

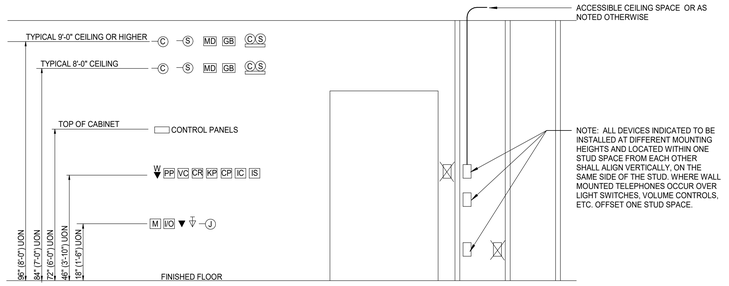


TYPICAL LOW VOLTAGE DEVICE MOUNTING HEIGHTS

NO SCALE

NOTES:

1. HEIGHTS SHOWN ARE TYPICAL TO CENTERLINE OF BOX UNLESS OTHERWISE NOTED.
2. WHERE EVER DEVICES ARE INDICATED TO BE ABOVE DOORS, DEVICE SHALL BE CENTERED BETWEEN TOP OF DOOR TRIM AND CEILING LINE.
3. MOUNTING HEIGHTS SHOWN ON ARCHITECTURAL ELEVATIONS SHALL GOVERN OVER THOSE SHOWN ABOVE. VERIFY MOUNTING HEIGHTS SHOWN ON ARCHITECTURAL ELEVATIONS. DEVICES AND COVER PLATES SHALL NOT COVER/OVERLAP EDGES OF WAINSCOTING, TILE OR OTHER SPECIALTY WALL FINISHES.
4. DEVICE MOUNTING HEIGHTS SHALL BE PER MOST CURRENT VERSION OF GOVERNING CODE AND STANDARDS NEC, IBC, NFPA, ADA, ETC. WHERE DISCREPANCIES BECOME EVIDENT, CONSULT THE ARCHITECT AND ENGINEER OF RECORD.
5. WHERE DEVICES ARE INSTALLED ABOVE COUNTER, THE DEVICES SHALL BE INSTALLED AT 46" MAXIMUM (COUNTERS/SHELVES 0-20 INCHES WIDE) AND 44" MAXIMUM (COUNTER/SHELVES 20-25 INCHES WIDE) ABOVE FINISHED FLOOR TO DEVICE CENTER.
6. LOW VOLTAGE DEVICES SHALL NOT BE INSTALLED BELOW 15" AFF PER ADA STANDARDS.

TTM-003

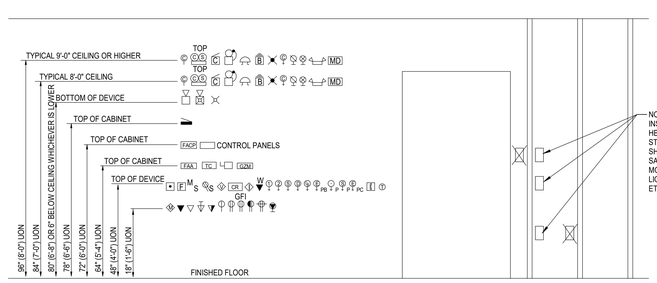


TYPICAL DEVICE MOUNTING HEIGHTS

NO SCALE

NOTES:

1. HEIGHTS SHOWN ARE TYPICAL TO CENTERLINE OF BOX UNLESS NOTED OTHERWISE.
2. WHERE EVER DEVICES ARE INDICATED TO BE ABOVE DOORS, DEVICE SHALL BE CENTERED BETWEEN TOP OF DOOR TRIM AND CEILING LINE.
3. MOUNTING HEIGHTS SHOWN ON ARCHITECTURAL ELEVATIONS SHALL GOVERN OVER THOSE SHOWN ABOVE.

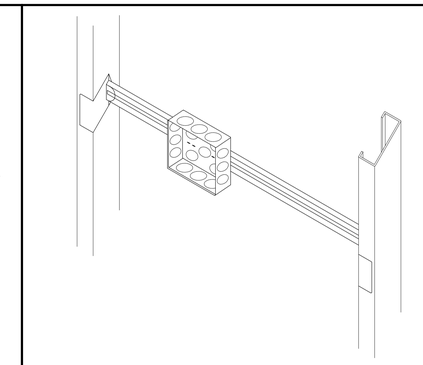

OUTLET BOX SUPPORT DETAIL

NO SCALE

EXISTING **SWITCHBOARD** **MDC-1**

1200 A MAIN CIRCUIT BREAKER
1200 A BUS
MFR : EATON
MTG. : SURFACE
VOLTAGE 120 / 208 V
PHASE 3 PH
WIRE 4 W
100,000 AMPERE SHORT CIRCUIT RATING (FULLY RATED)

Notes:
1. NEW LOAD ON EXISTING CIRCUIT BREAKER.
2. PROVIDE CIRCUIT BREAKER IN SPACE TO MATCH EXISTING.
3. REPLACE EXISTING CIRCUIT BREAKER WITH NEW CIRCUIT BREAKER.
6. PROVIDE 30mA GROUND FAULT CIRCUIT BREAKER.
7. PROVIDE GFCI CIRCUIT BREAKER.
8. PROVIDE SHUNT-TRIP CIRCUIT BREAKER.

DESCRIPTION OF SUB-LOAD OR PANEL	CONNECTED LOADS (IN VA) BY CATEGORY AND PHASE: LIGHTING PH A	LIGHTING PH B	LIGHTING PH C	RECEPTACLES PH A	RECEPTACLES PH B	RECEPTACLES PH C	MOTORS PH A	MOTORS PH B	MOTORS PH C	MOTORS LARGEST	OTHER PH A	OTHER PH B	OTHER PH C	GENERAL PH A	GENERAL PH B	GENERAL PH C	REMARKS
PANELBOARD M1																	
PANELBOARD M2																	
PANELBOARD M3																	
MAIN DISTRIBUTION BOARD MDP														44323	45576	46099	
SURGE SUPPRESSION (NO LOAD)																	
UTILITY PEAK DEMAND - RECORDED 10/2025 69.12kW AT 125%														28,800	28,800	28,800	

PHASE LOADING SUMMARY	PH A	PH B	PH C
LOAD TYPE (VA)			
LIGHTING	0	0	0
RECEPTACLES	0	0	0
MOTORS	0	0	0
OTHER	0	0	0
GENERAL	73,123	74,376	74,899
TOTAL	73,123	74,376	74,899
PHASE BALANCE	A-B	B-C	C-A
	2%	1%	2%

LOADING SUMMARY

LOAD TYPE	CONNECTED LOAD KVA	NEC CALCULATED DEMAND LOAD		POWER FACTOR	DEMAND LOAD KW
LIGHTING	0.0	KVA x 125% = 0.0	KVA	x 95% = 0.0	kW
RECEPTACLES					
FIRST 10 KVA	0.0	KVA x 100% = 0.0	KVA	x 100% = 0.0	kW
REMAINDER	0.0	KVA x 50% = 0.0	KVA	x 100% = 0.0	kW
MOTORS					
LARGEST	0.0	KVA x 125% = 0.0	KVA	x 90% = 0.0	kW
REMAINDER	0.0	KVA x 100% = 0.0	KVA	x 90% = 0.0	kW
OTHER	0.0	KVA x 125% = 0.0	KVA	x 100% = 0.0	kW
GENERAL	222.4	KVA x 100% = 222.4	KVA	x 100% = 222.4	kW
TOTAL	222.4	KVA	222.4	KVA	222.4 kW

CONNECTED PF= 100%
CONNECTED AMPACITY = 617.3
NEC DEMAND AMPACITY = 617.3

EXISTING **SWITCHBOARD** **MDP**

400 A MAIN CIRCUIT BREAKER
400 A BUS
MFR :
MTG. : SURFACE
VOLTAGE 120 / 208 V
PHASE 3 PH
WIRE 4 W
65000 AMPERE SHORT CIRCUIT RATING (FULLY RATED)

Notes:
1. NEW LOAD ON EXISTING CIRCUIT BREAKER.
2. PROVIDE CIRCUIT BREAKER IN SPACE TO MATCH EXISTING.
3. REPLACE EXISTING CIRCUIT BREAKER WITH NEW CIRCUIT BREAKER.
6. PROVIDE 30mA GROUND FAULT CIRCUIT BREAKER.
7. PROVIDE GFCI CIRCUIT BREAKER.
8. PROVIDE SHUNT-TRIP CIRCUIT BREAKER.

DESCRIPTION OF SUB-LOAD OR PANEL	CONNECTED LOADS (IN VA) BY CATEGORY AND PHASE: LIGHTING PH A	LIGHTING PH B	LIGHTING PH C	RECEPTACLES PH A	RECEPTACLES PH B	RECEPTACLES PH C	MOTORS PH A	MOTORS PH B	MOTORS PH C	MOTORS LARGEST	OTHER PH A	OTHER PH B	OTHER PH C	GENERAL PH A	GENERAL PH B	GENERAL PH C	REMARKS
PANELBOARD PB														7753	7886	7859	
PANELBOARD PA														7000	7000	7000	
PANELBOARD LPB														8160	8240	8160	
PANELBOARD LA														4410	5350	6080	
PANELBOARD KP														10000	10000	10000	
PANELBOARD LPC														7000	7000	7000	

PHASE LOADING SUMMARY	PH A	PH B	PH C
LOAD TYPE (VA)			
LIGHTING	0	0	0
RECEPTACLES	0	0	0
MOTORS	0	0	0
OTHER	0	0	0
GENERAL	44,323	45,576	46,099
TOTAL	44,323	45,576	46,099
PHASE BALANCE	A-B	B-C	C-A
	3%	1%	4%

LOADING SUMMARY

LOAD TYPE	CONNECTED LOAD KVA	NEC CALCULATED DEMAND LOAD		POWER FACTOR	DEMAND LOAD KW
LIGHTING	0.0	KVA x 125% = 0.0	KVA	x 95% = 0.0	kW
RECEPTACLES					
FIRST 10 KVA	0.0	KVA x 100% = 0.0	KVA	x 100% = 0.0	kW
REMAINDER	0.0	KVA x 50% = 0.0	KVA	x 100% = 0.0	kW
MOTORS					
LARGEST	0.0	KVA x 125% = 0.0	KVA	x 90% = 0.0	kW
REMAINDER	0.0	KVA x 100% = 0.0	KVA	x 90% = 0.0	kW
OTHER	0.0	KVA x 125% = 0.0	KVA	x 100% = 0.0	kW
GENERAL	136.0	KVA x 100% = 136.0	KVA	x 100% = 136.0	kW
TOTAL	136.0	KVA	136.0	KVA	136.0 kW

CONNECTED PF= 100%
CONNECTED AMPACITY = 377.5
NEC DEMAND AMPACITY = 377.5

EXISTING **PANEL** **PB**

225 A M.L.O.
225 A BUS
MFR :
MTG. : RECESSED
VOLTAGE 120 / 208 V
PHASE 3 PH
WIRE 4 W
10000 AMPERE SHORT CIRCUIT RATING (FULLY RATED)

Panel Notes:
1. NEW LOAD ON EXISTING CIRCUIT BREAKER.
2. PROVIDE CIRCUIT BREAKER IN SPACE TO MATCH EXISTING.
3. REPLACE EXISTING CIRCUIT BREAKER WITH NEW CIRCUIT BREAKER.
4. EXISTING LOAD ON NEW CIRCUIT BREAKER. LOAD IS ESTIMATED.
5. EXISTING LOAD REMOVED.

NOTE	DESCRIPTION	LTG	RECEPT	MOTORS	OTHER	GENERAL	TOTAL	BREAKER AMP / P	CCT	PH	CCT	BREAKER AMP / P	TOTAL	GENERAL	OTHER	MOTORS	RECEPT	LTG	DESCRIPTION	NOTE
	L-CLASSROOM	400					400	20 / 1	1	A	2	20 / 1	720						MISC RECPT.	
	L-CLASSROOM	400					400	20 / 1	3	B	4	20 / 1	360						R-CLASSROOM	
	L-CORRIDOR	133					133	20 / 1	5	C	6	20 / 1	540						R-CLASSROOM	
	L-STORAGE RMS	107					107	20 / 1	7	A	8	20 / 1	540						R-CLASSROOM	
	L-EXTERIOR	160					160	20 / 1	9	B	10	20 / 1	720						R-CLASSROOM	1
	EXH FAN #2 114 HP			800			800	20 / 1	11	C	12	20 / 1	360						R-CLASSROOM	
	HVAC CTRL PANEL					500	500	20 / 1	13	A	14	20 / 1	540						R-CLASSROOM	
1	**R-CLASS 3 & 4**		**1,080**				**1080**	20 / 1	15	B	16	20 / 1	540						R-CLASSROOM	
1	**R-CLASS 1 & 2**		**1,080**				**1080**	20 / 1	17	C	18	20 / 1	720						R-CLASSROOM	1
1	**R-CLASS 5 & 6**		**1,080**				**1080**	20 / 1	19	A	20	20 / 1	0						SPARE	
1	**R-CLASS 6 & 7**		**1,080**				**1080**	20 / 1	21	B	22	20 / 1	0						SPARE	
1	**R-CLASS 8 & 9**		**1,080**				**1080**	20 / 1	23	C	24	20 / 1	0						SPARE	
1	**R-CLASS 10**		**720**				**720**	20 / 1	25	A	26	20 /	1333		1,333				ELEC WALL HEATER	
1	**RELAY PANEL**					**500**	**500**	20 / 1	27	B	28	/	1333		1,333				--	
	SPARE						0	20 / 1	29	C	30	/ 3	1333		1,333				--	
	SPARE						0	20 / 1	31	A	32	20 /	1333		1,333				ELEC WALL HEATER	
	SPARE						0	20 / 1	33	B	34	/	1333		1,333				--	
	SPARE						0	20 / 1	35	C	36	/ 3	1333		1,333				--	
	SPARE						0	20 / 1	37	A	38	15 /	480			480			HVAC #1 1 HP	
	SPARE						0	20 / 1	39	B	40	/	480			480			--	
	SPARE						0	20 / 1	41	C	42	/ 3	480			480			--	

PHASE LOADING SUMMARY	PH A	PH B	PH C
LOAD TYPE (VA)			
LIGHTING	507.0	560.0	133.0
RECEPTACLES	3,600.0	3,780.0	3,780.0
MOTORS	480.0	480.0	1,280.0
OTHER	2,666.0	2,666.0	2,666.0
GENERAL	500.0	500.0	0.0
TOTAL (VA)	7,753.0	7,986.0	7,859.0
NEC CALCULATED			
PHASE AMPACITY	#REF!	#REF!	#REF!
	#REF!		
PHASE BALANCE	A-B	B-C	C-A
	3%	2%	1%

PANEL LOADING SUMMARY

LOAD TYPE	CONNECTED LOAD KVA	NEC CALCULATED DEMAND LOAD		POWER FACTOR	DEMAND LOAD KW
LIGHTING	1.2	KVA x 125% = 1.5	KVA	x 95% = 1.4	kW
RECEPTACLES					
FIRST 10 KVA	10.0	KVA x 100% = 10.0	KVA	x 100% = 10.0	kW
REMAINDER	1.2	KVA x 50% = 0.6	KVA	x 100% = 0.6	kW
MOTORS					
LARGEST	1.4	KVA x 125% = 1.8	KVA	x 90% = 1.6	kW
REMAINDER	0.8	KVA x 100% = 0.8	KVA	x 90% = 0.7	kW
OTHER	8.0	KVA x 125% = 10.0	KVA	x 100% = 10.0	kW
GENERAL	1.0	KVA x 100% = 1.0	KVA	x 100% = 1.0	kW
TOTAL	23.6	KVA	25.7	KVA	25.3 kW

PANEL CONNECTED PF= 99%
CONNECTED AMPACITY = 65.5
NEC DEMAND AMPACITY = 71.3

GENERAL NOTES:
' PROVIDE NEW UPDATED PANEL DIRECTORIES FOR PANELS THAT ARE INCLUDED IN THIS PROJECT.
' PROVIDE TYPED DESCRIPTIONS OF NEW CIRCUITS BEING INSTALLED. INDICATE NEW SPARES IN PENCIL.

EXISTING **PANEL** **LPB1**

225 A M.L.O.
225 A BUS
MFR : GE
MTG. : RECESSED
VOLTAGE 120 / 208 V
PHASE 3 PH
WIRE 4 W
10000 AMPERE SHORT CIRCUIT RATING (FULLY RATED)

Panel Notes:
1. NEW LOAD ON EXISTING CIRCUIT BREAKER.
2. PROVIDE CIRCUIT BREAKER IN SPACE TO MATCH EXISTING.
3. REPLACE EXISTING CIRCUIT BREAKER WITH NEW CIRCUIT BREAKER.
4. EXISTING LOAD ON NEW CIRCUIT BREAKER. LOAD IS ESTIMATED.
5. EXISTING LOAD REMOVED.

NOTE	DESCRIPTION	LTG	RECEPT	MOTORS	OTHER	GENERAL	TOTAL	BREAKER AMP / P	CCT	PH	CCT	BREAKER AMP / P	TOTAL	GENERAL	OTHER	MOTORS	RECEPT	LTG	DESCRIPTION	NOTE
	LTS ROOM 16	1,000					1000	20 / 1	1	A	2	20 / 1	1080				1,080		PLUGS ROOMS 14 & 15	
	LTS ROOM 16	1,000					1000	20 / 1	3	B	4	20 / 1	1080				1,080		PLUGS ROOMS 15 & 16	
	PLUGS RMS 13 & 14		1,080				1080	20 / 1	5	C	6	20 / 1	1000					1,000	LTS ROOM 14	
	PLUGS RMS 12 & 13		1,080				1080	20 / 1	7	A	8	20 / 1	1000					1,000	LTS ROOM 15	
	PLUGS RMS 11& 12		1,080				1080	20 / 1	9	B	10	20 / 1	1000					1,000	LTS ROOM 15	
	LTS ROOM 13	1,000					1000	20 / 1	11	C	12	20 / 1	1000					1,000	LTS ROOM 15	
	LTS ROOM 13	1,000					1000	20 / 1	13	A	14	20 / 1	1000					1,000	LTS ROOM 11	
	LTS ROOM 12	1,000					1000	20 / 1	15	B	16	20 / 1	1000					1,000	LTS ROOM 11	
	LTS ROOM 12	1,000					1000	20 / 1	17	C	18	20 / 1	1000					1,000	LTS ROOM 17	
	LTS ROOM 18	1,000					1000	20 / 1	19	A	20	20 / 1	1000					1,000	LTS ROOM 17	
	LTS ROOM 18	1,000					1000	20 / 1	21	B	22	20 / 1	1080				1,080		PLUGS ROOM 23	
	LTS OFFICE / BKRM	1,000					1000	20 / 1	23	C	24	20 / 1	1080				1,080		PLUGS PRINCIPAL OFFICE	
	SPARE						0	20 / 1	25	A	26	20 / 1	0						SPARE	

PHASE LOADING SUMMARY	PH A	PH B	PH C
LOAD TYPE (VA)			
LIGHTING	6,000.0	5,000.0	6,000.0
RECEPTACLES	2,160.0	3,240.0	2,160.0
MOTORS	0.0	0.0	0.0
OTHER	0.0	0.0	0.0
GENERAL	0.0	0.0	0.0
TOTAL (VA)	8,160.0	8,240.0	8,160.0
NEC CALCULATED			
PHASE AMPACITY	80.3	78.9	80.3
	#REF!		
PHASE BALANCE	A-B	B-C	C-A
	1%	1%	0%

PANEL LOADING SUMMARY

LOAD TYPE	CONNECTED LOAD KVA	NEC CALCULATED DEMAND LOAD		POWER FACTOR	DEMAND LOAD KW
LIGHTING	17.0	KVA x 125% = 21.3	KVA	x 95% = 20.2	kW
RECEPTACLES					
FIRST 10 KVA	7.6	KVA x 100% = 7.6	KVA	x 100% = 7.6	kW
REMAINDER	0.0	KVA x 50% = 0.0	KVA	x 100% = 0.0	kW
MOTORS					
LARGEST	0.0	KVA x 125% = 0.0	KVA	x 90% = 0.0	kW
REMAINDER	0.0	KVA x 100% = 0.0	KVA	x 90% = 0.0	kW
OTHER	0.0	KVA x 125% = 0.0	KVA	x 100% = 0.0	kW
GENERAL	0.0	KVA x 100% = 0.0	KVA	x 100% = 0.0	kW
TOTAL	24.6	KVA	28.8	KVA	27.7 kW

PANEL CONNECTED PF= 96%
CONNECTED AMPACITY = 112.3
NEC DEMAND AMPACITY = 124.7

PANEL LPB2 LOAD CONNECTED TO FEED THROUGH LUGS: 15.9 KVA, 16.1 KVA, 15.8 kW
40.5 KVA, 44.9 KVA, 43.6 kW

GENERAL NOTES:
' PROVIDE NEW UPDATED PANEL DIRECTORIES FOR PANELS THAT ARE INCLUDED IN THIS PROJECT.
' PROVIDE TYPED DESCRIPTIONS OF NEW CIRCUITS BEING INSTALLED. INDICATE NEW SPARES IN PENCIL.

EXISTING **PANEL** **LPB2**

225 A M.L.O.
225 A BUS
MFR : GE
MTG. : RECESSED
VOLTAGE 120 / 208 V
PHASE 3 PH
WIRE 4 W
AMPERE SHORT CIRCUIT RATING (FULLY RATED)

Panel Notes:
1. NEW LOAD ON EXISTING CIRCUIT BREAKER.
2. PROVIDE CIRCUIT BREAKER IN SPACE TO MATCH EXISTING.
3. REPLACE EXISTING CIRCUIT BREAKER WITH NEW CIRCUIT BREAKER.
4. EXISTING LOAD ON NEW CIRCUIT BREAKER. LOAD IS ESTIMATED.
5. EXISTING LOAD REMOVED.

NOTE	DESCRIPTION	LTG	RECEPT	MOTORS	OTHER	GENERAL	TOTAL	BREAKER AMP / P	CCT	PH	CCT	BREAKER AMP / P	TOTAL	GENERAL	OTHER	MOTORS	RECEPT	LTG	DESCRIPTION	NOTE
	LTS OFFICE	1,000					1000	20 / 1	1	A	2	20 / 1	1080				1,080		PLUGS OFFICE	
	LTS OFFICE	1,000					1000	20 / 1	3	B	4	20 / 1	1080				1,080		PLUGS ROOM 17	
	PLUGS ROOM 53		1,080				1080	20 / 1	5	C	6	20 / 1	1080				1,080		PLUGS ROOM 18	
	WATER COOLER		370				370	20 / 1	7	A	8	20 / 1	0						LTS TELEPHONE ROOM	
	EF-2 (ON ROOF)			1,176			1176	20 / 1	9	B	10	20 / 1	1500	1,500					DWYER KITCH. UNIT 2	
1	**R-CLASS 12 & 13**		**1,080**				**1080**	20 / 1	11	C	12	20 / 1	**1080**					**1,080**	**R-CLASS 15 & 16**	1
1	**R-CLASS 14 & 15**		**1,080**				**1080**	20 / 1	13	A	14	30 /	0						SPARE	
	DOOR PUSH BUTTONS					50	50	15 / 1	15	B	16	/ 2	0						SPARE	
1	**R-CLASS 11 & 12**		**1,080**				**1080**	20 / 1	17	C	18	**20** / 1	**1080**					**1,080**	**R-CLASS 16 & 17**	1
	SPARE						0	50 /	19	A	20	/	0						SPACE	
	SPARE						0	/ 2	21	B	22	/	0						SPACE	
	SPARE						0	20 /	23	C	24	/	0						SPACE	
	SPARE						0	/ 2	25	A	26	/	0						SPACE	
	SPARE						0	20 / 1	27	B	28	/	0						SPACE	
	SPACE						0	/	29	C	30	/	0						SPACE	
	SPACE						0	/	31	A	32	/	0						SPACE	
	SPACE						0	/	33	B	34	/	0						SPACE	
	SPACE						0	/	35	C	36	20 / 1	1080				1,080		ROOM 18 & 19	

PHASE LOADING SUMMARY	PH A	PH B	PH C
LOAD TYPE (VA)			
LIGHTING	1,000.0	1,000.0	0.0
RECEPTACLES	2,530.0	1,080.0	7,560.0
MOTORS	0.0	1,176.0	0.0
OTHER	0.0	0.0	0.0
GENERAL	0.0	1,550.0	0.0
TOTAL (VA)	3,530.0	4,806.0	7,560.0
NEC CALCULATED			
PHASE AMPACITY	#REF!	44.5	#REF!
	#REF!		
PHASE BALANCE	A-B	B-C	C-A
	36%	57%	114%

PANEL LOADING SUMMARY

LOAD TYPE	CONNECTED LOAD KVA	NEC CALCULATED DEMAND LOAD		POWER FACTOR	DEMAND LOAD KW
LIGHTING	2.0	KVA x 125% = 2.5	KVA	x 95% = 2.4	kW
RECEPTACLES					
FIRST 10 KVA	10.0	KVA x 100% = 10.0	KVA	x 100% = 10.0	kW
REMAINDER	1.2	KVA x 50% = 0.6	KVA	x 100% = 0.6	kW
MOTORS					
LARGEST	1.2	KVA x 125% = 1.5	KVA	x 90% = 1.3	kW
REMAINDER	0.0	KVA x 100% = 0.0	KVA	x 90% = 0.0	kW
OTHER	0.0	KVA x 125% = 0.0	KVA	x 100% = 0.0	kW
GENERAL	1.6	KVA x 100% = 1.6	KVA	x 100% = 1.6	kW
TOTAL	15.9	KVA	16.1	KVA	15.8 kW

PANEL CONNECTED PF= 98%
CONNECTED AMPACITY = 44.1
NEC DEMAND AMPACITY = 44.7

GENERAL NOTES:
' PROVIDE NEW UPDATED PANEL DIRECTORIES FOR PANELS THAT ARE INCLUDED IN THIS PROJECT.
' PROVIDE TYPED DESCRIPTIONS OF NEW CIRCUITS BEING INSTALLED. INDICATE NEW SPARES IN PENCIL.

EXISTING **PANEL** **LA**

225 A M.L.O.
225 A BUS
MFR : GE
MTG. : RECESSED
VOLTAGE 120 / 208 V
PHASE 3 PH
WIRE 4 W
AMPERE SHORT CIRCUIT RATING (FULLY RATED)

Panel Notes:
1. NEW LOAD ON EXISTING CIRCUIT BREAKER.
2. PROVIDE CIRCUIT BREAKER IN SPACE TO MATCH EXISTING.
3. REPLACE EXISTING CIRCUIT BREAKER WITH NEW CIRCUIT BREAKER.
4. EXISTING LOAD ON NEW CIRCUIT BREAKER. LOAD IS ESTIMATED.
5. EXISTING LOAD REMOVED.

NOTE	DESCRIPTION	LTG	RECEPT	MOTORS	OTHER	GENERAL	TOTAL	BREAKER AMP / P	CCT	PH	CCT	BREAKER AMP / P	TOTAL	GENERAL	OTHER	MOTORS	RECEPT	LTG	DESCRIPTION	NOTE
	LTS ROOM 5	250					250	20 / 1	1	A	2	20 / 1	250					250	LTS ROOM 6	
	LTS ROOM 5	250					250	20 / 1	3	B	4	20 / 1	250					250	LTS ROOM 6	
	PLUGS RM 5 & S. ENT.		900				900	20 / 1	5	C	6	20 / 1	250					250	LTS ROOM 7	
	PLUGS ROOMS 6 & 7		900				900	20 / 1	7	A	8	20 / 1	250					250	LTS ROOM 7	
	PLUGS ROOMS 7 & 8		720				720	20 / 1	9	B	10	20 / 1	900				900		PLUGS ROOMS 8 & 9	
	LTS ROOM 9	250					250	20 / 1	11	C	12	20 / 1	900				900		PLUGS ROOMS 9 & 10	
	LTS ROOM 9	250					250	20 / 1	13	A	14	20 / 1	250					250	LTS ROOM 10	
	LTS ROOM 9	250					250	20 / 1	15	B	16	20 / 1	250					250	LTS ROOM 10	
	LTS ROOM 9	250					250	20 / 1	17	C	18	20 / 1	250					250	LTS ROOM 4	
	LTS ROOM 2	250					250	20 / 1	19	A	20	20 / 1	250					250	LTS ROOM 4	
	LTS ROOM 2	250					250	20 / 1	21	B	22	20 / 1	720				720		PLUGS ROOM 1 & 2	
	LTS ROOM 3	250					250	20 / 1	23	C	24	20 / 1	1080				1,080		**OFFICE 1A**	1
	LTS ROOM 3	250					250	20 / 1	25	A	26	20 / 1	900				900		PLUGS ROOMS 2 & 3	
	LTS VIDEO ROOM						0	20 / 1	27	B	28	20 / 1	1260				1,260		PLUGS ROOMS 3 & 4	
	LTS ROOM 1	250					250	20 / 1	29	C	30	20 / 1	250					250	LTS ROOMS 24 & 25	
	PLUGS ROOM 24		360				360	20 / 1	31	A	32	20 / 1	250					250	LTS LIBRARY	
	LTS LIBRARY	250					250	20 / 1	33	B	34	20 / 1	250					250	LTS LIBRARY	
	PLUGS LIBRARY		1,080				1080	20 / 1	35	C	36	20 / 1	370	370					WATER COOLER	
	SPACE						0	/	37	A	38	60 /	0						(OFF)	
	SPACE						0	/	39	B	40	/ 2	0						--	
	SPACE						0	/	41	C	42	/	0						SPACE	

PHASE LOADING SUMMARY	PH A	PH B	PH C
LOAD TYPE (VA)			
LIGHTING	2,250.0	1,750.0	1,750.0
RECEPTACLES	2,160.0	3,600.0	3,960.0
MOTORS	0.0	0.0	0.0
OTHER	0.0	0.0	0.0
GENERAL	0.0	0.0	370.0
TOTAL (VA)	4,410.0	5,350.0	6,080.0
NEC CALCULATED			
PHASE AMPACITY	41.4	48.1	54.2
	#REF!		
PHASE BALANCE	A-B	B-C	C-A
	21%	14%	38%

PANEL LOADING SUMMARY

LOAD TYPE	CONNECTED LOAD KVA	NEC CALCULATED DEMAND LOAD		POWER FACTOR	DEMAND LOAD KW
LIGHTING	5.8	KVA x 125% = 7.2	KVA	x 95% = 6.8	kW
RECEP