FoCo Transfort Overhead Door Replace

Transfort Maintenance Facility

6570 Portner Rd, Fort Collins, CO
80525
07/06/2026

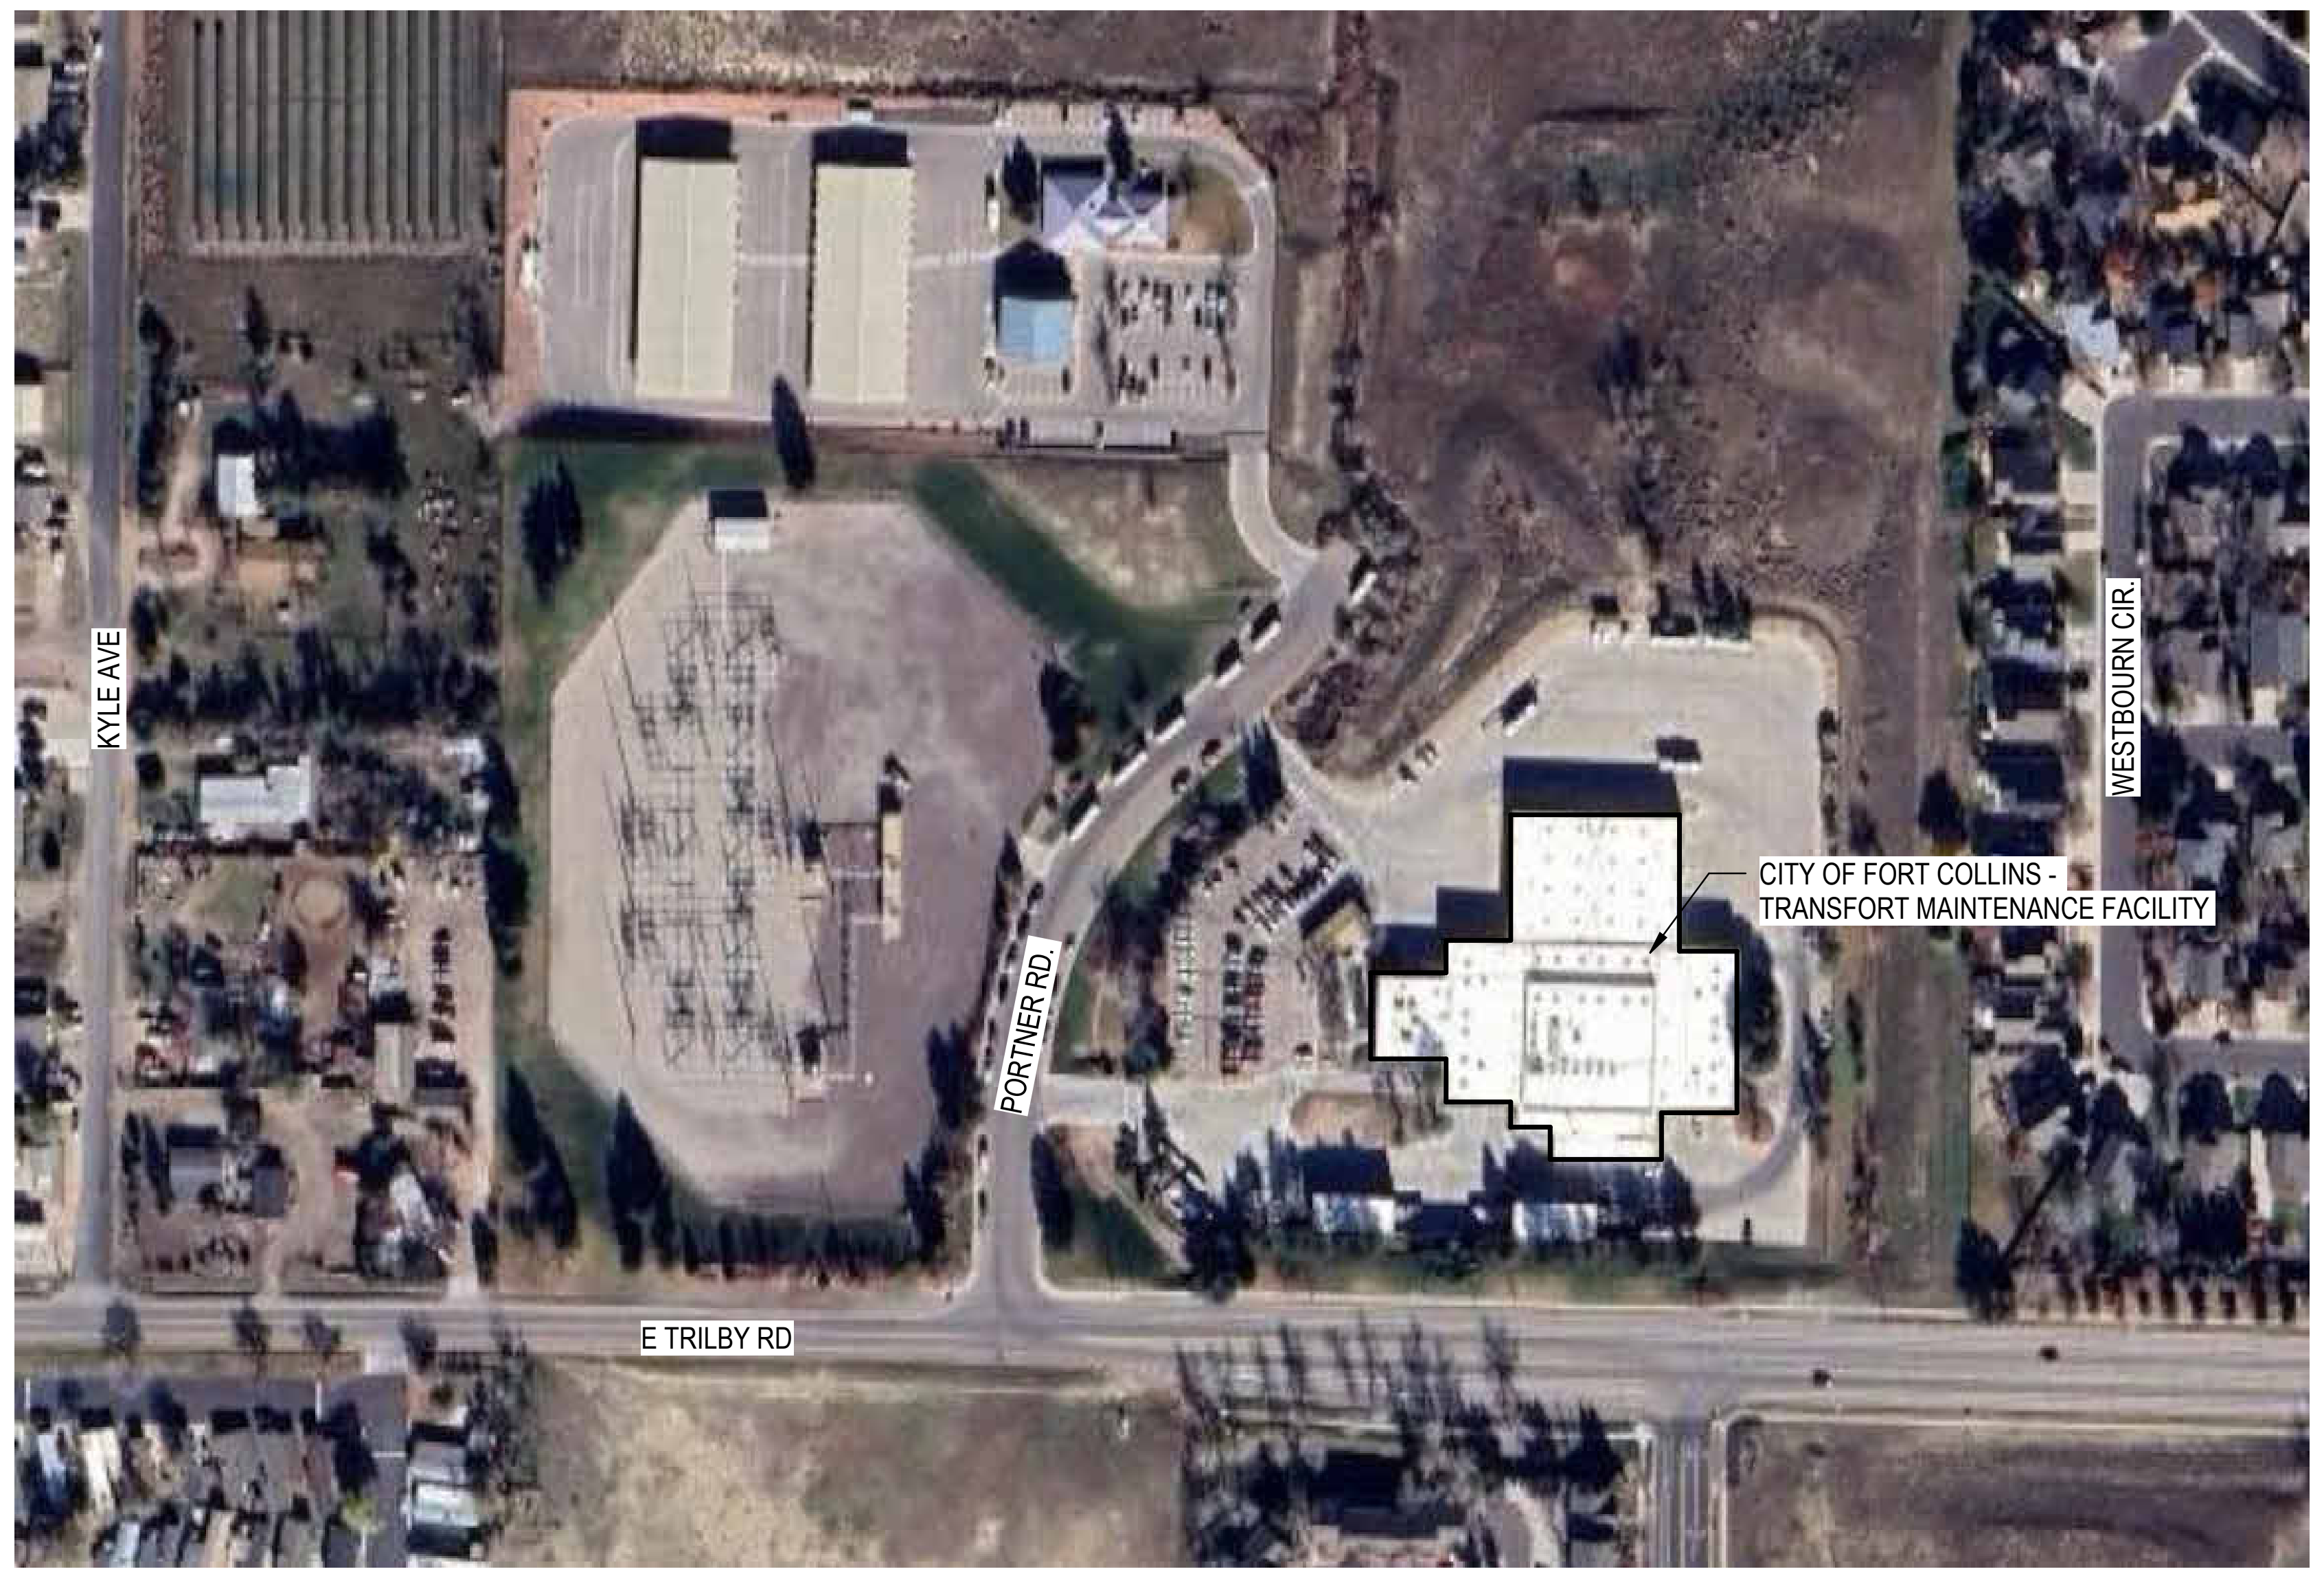

Vicinity Plan
Not To Scale
Plan North

GENERAL

G0.00	Title Sheet, Drawing Index, & Code Compliance
G0.01	General Notes, Symbols & Abbreviations

ARCHITECTURAL

A0.11	First Floor Demolition Plan
A1.11	First Floor Plan
A6.40	Door Schedule, Door Types, Frame Types

ELECTRICAL

E0.00	Electrical Abbreviations, Symbols Legend & General Notes
E0.11	First Floor Electrical Orientation Plans
E0.12	Mezzanine Floor Electrical Orientation Plan
E0.21	First Floor Electrical Demolition Plan
E2.01	First Floor Power Plan
E4.01	Electrical Schedules

ALTERNATES

ALT 1: OVERHEAD DOOR BASIS OF DESIGN

BASE BID: BASIS OF DESIGN CLOPAY 3724, FINISH: BAKED ENAMEL, COLOR TO BE SELECTED BY ARCHITECT FROM STANDARD COLORS. OR APPROVED EQUAL AS INDICATED ON SHEET A6.40 - DOOR SCHEDULE, DOOR TYPES, FRAME TYPES AND AS SPECIFIED IN SECTION 08 36 13 - SECTIONAL DOORS.

ALTERNATE: BASIS OF DESIGN CLOPAY 3722, FINISH: COLOR BLAST, COLOR TO MATCH EXISTING OHD'S. OR APPROVED EQUAL AS INDICATED ON SHEET A6.40 - DOOR SCHEDULE, DOOR TYPES, FRAME TYPES AND AS SPECIFIED IN SECTION 08 36 13 - SECTIONAL DOORS.

CODE GENERAL INFORMATION LEGEND

GENERAL INFORMATION

LOCATION: Transfort Maintenance Facility
6570 Portner Rd,
Fort Collins, CO 80525

AGENCY INFORMATION: City of Fort Collins
Fort Collins, CO

AUTHORITY HAVING JURISDICTION:
City of Fort Collins

REASON FOR SUBMITTAL: Overhead Door Replacement

PROJECT DESCRIPTION

Replacing existing overhead doors with new. Existing egress and life safety is not altered by this project. There will be no change to the use and occupancy of any rooms.

APPLICABLE CODES

2024 - International Building Code (IBC)
2024 - International Plumbing Code (IPC)
2024 - International Mechanical Code (IMC)
2024 - International Fire Code (IFC)
2023 - National Electric Code (NEC)
Americans With Disabilities Act Accessibility Guidelines (ADAAG)
American National Standards Institute (ANSI) 117.1 Guidelines for Accessible & Useable Buildings & Facilities

2010 - NFPA 110 - Standard for Emergency and Standby Power Systems
2009 - NFPA 90A - Installation of Air Conditioning and Ventilating Systems
2010 - NFPA 72 - National Fire Alarm Code
2009 - NFPA 54 - National Fuel Gas Code

2007 ASHREA 90.1

2011 - NFPA 45 - Standard of Fire Protection for Laboratories Using Chemicals
2010 - NFPA 20 - Standard for the Installation of Stationary Fire Pumps for Fire Protection
2010 - NFPA 14 Standard for the Installation of Standpipe, Private Hydrants and Hose Systems
2010 - NFPA 13 Installation of Fire Sprinkler Systems

CLARK&
ENERSEN

Architecture \ Engineering \ Planning \
Landscape Architecture \ Commissioning

clarkenersen.com

? # ?-#

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

COLORADO LICENSED ARCHITECT
ANDREA M. ANDERSON
ARC.00406215
07/06/2026

Title Sheet, Drawing Index, & Code Compliance

G0.00

MATERIAL SYMBOLS

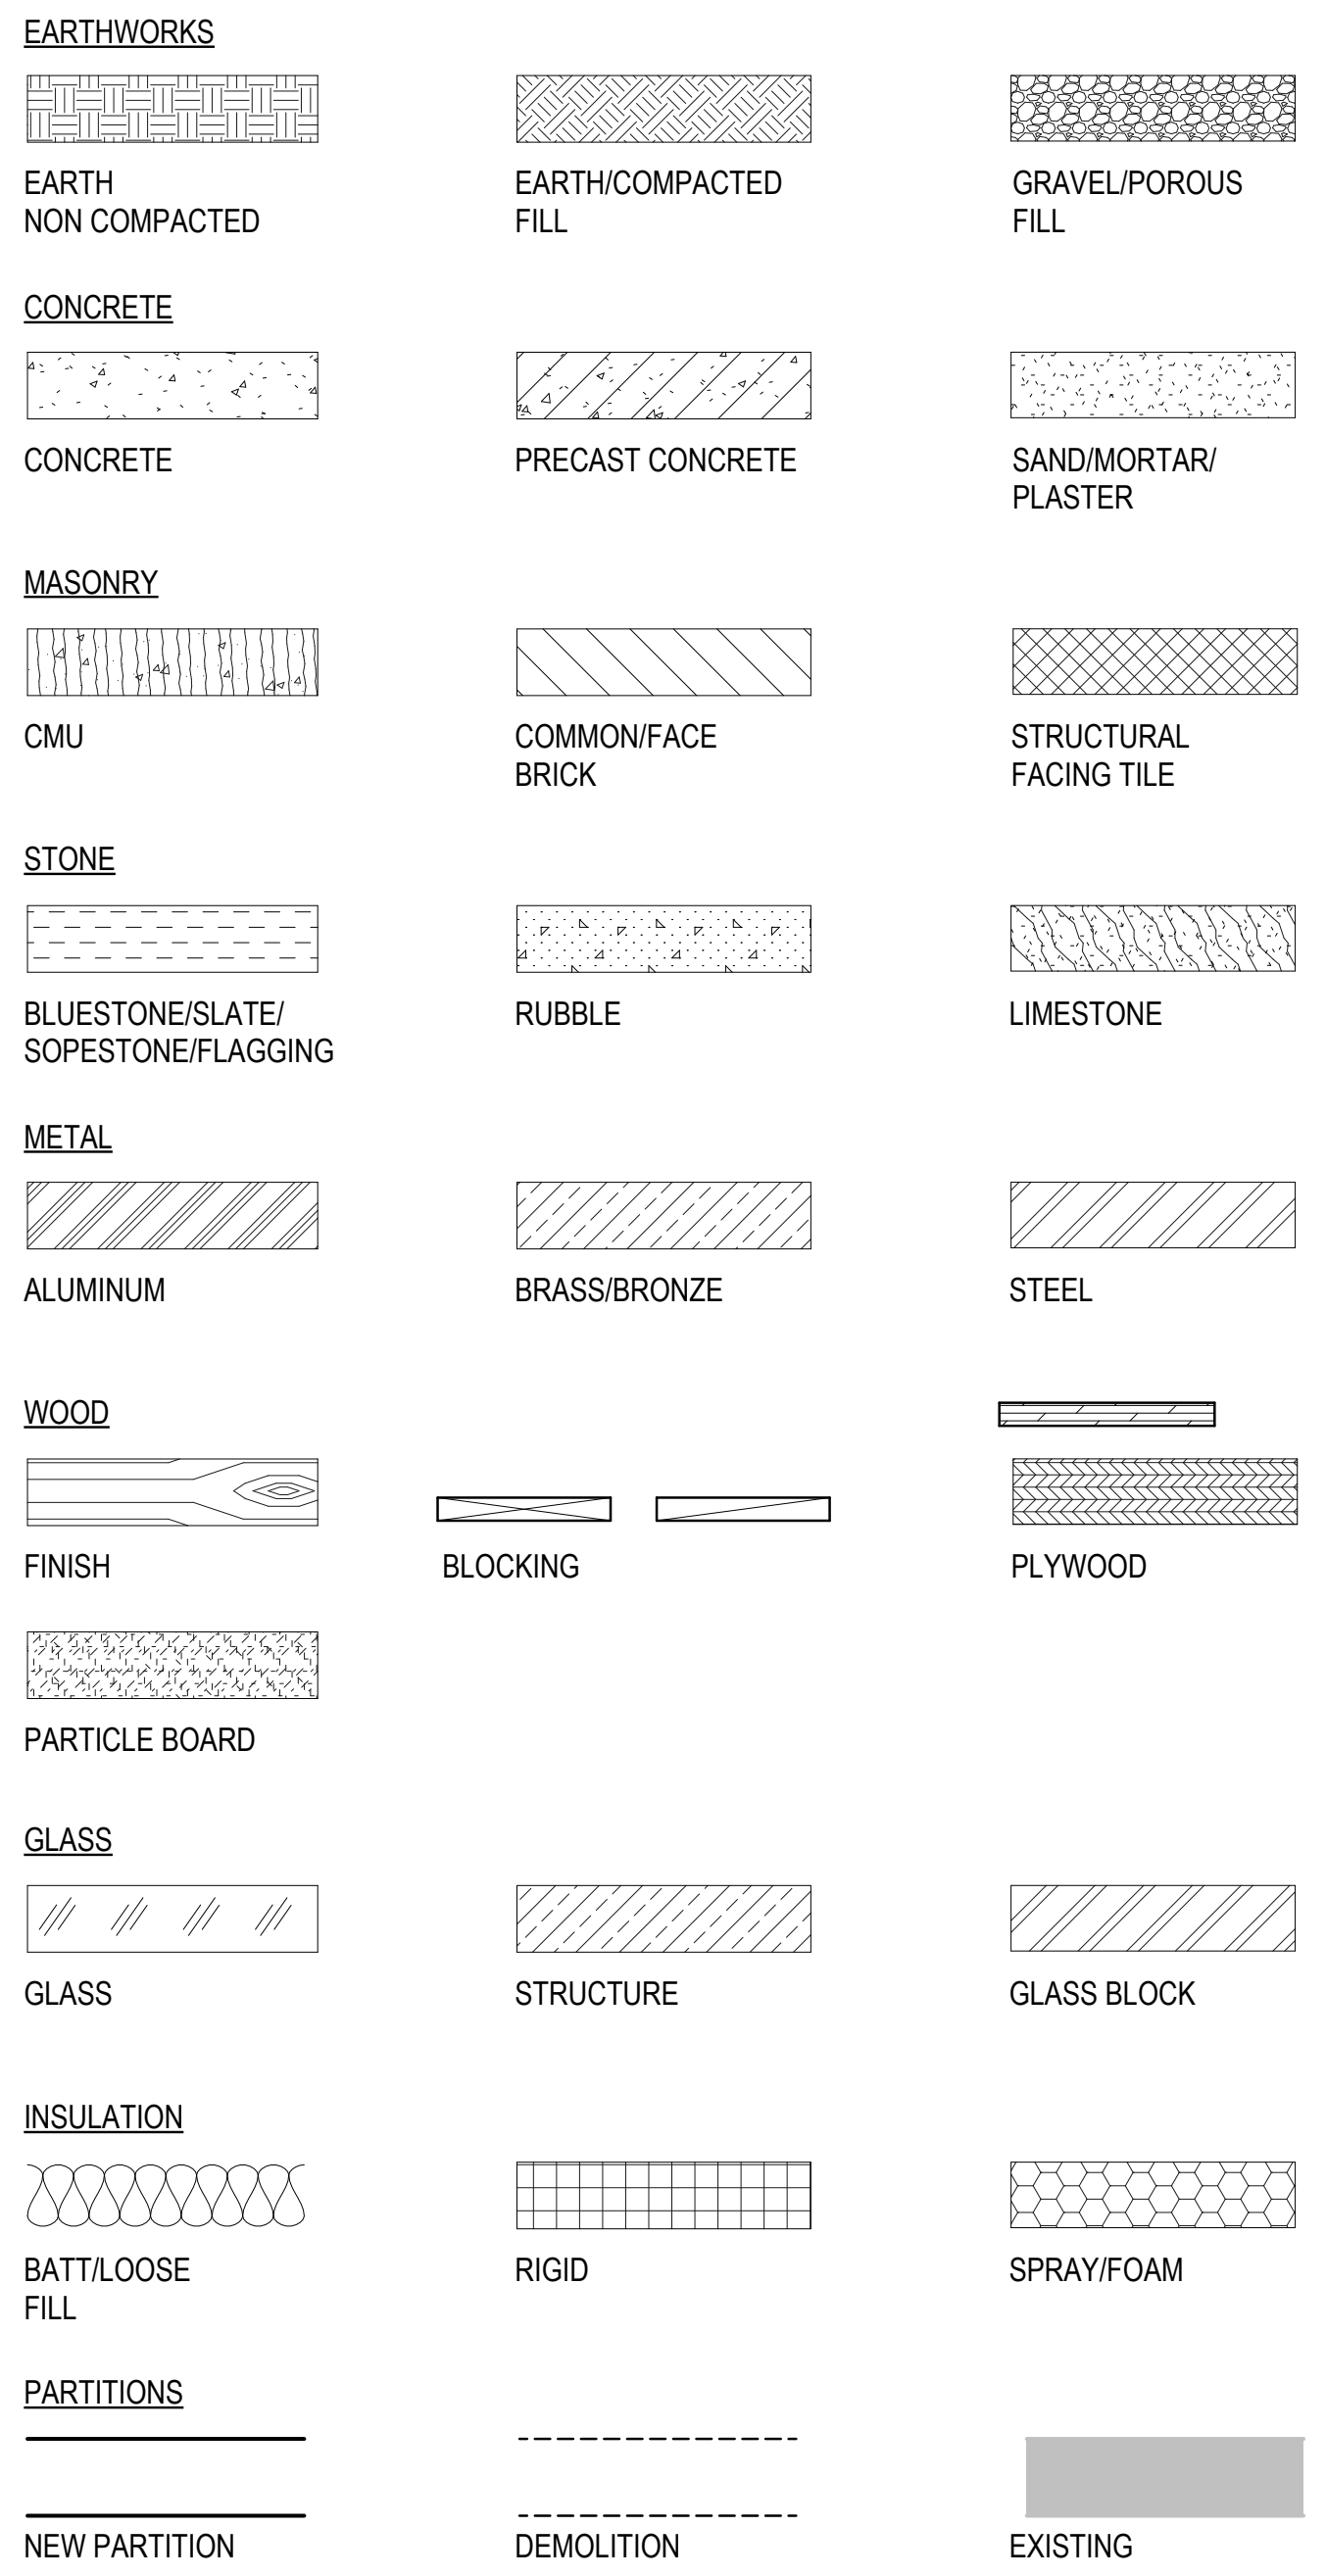

REFERENCE SYMBOLS

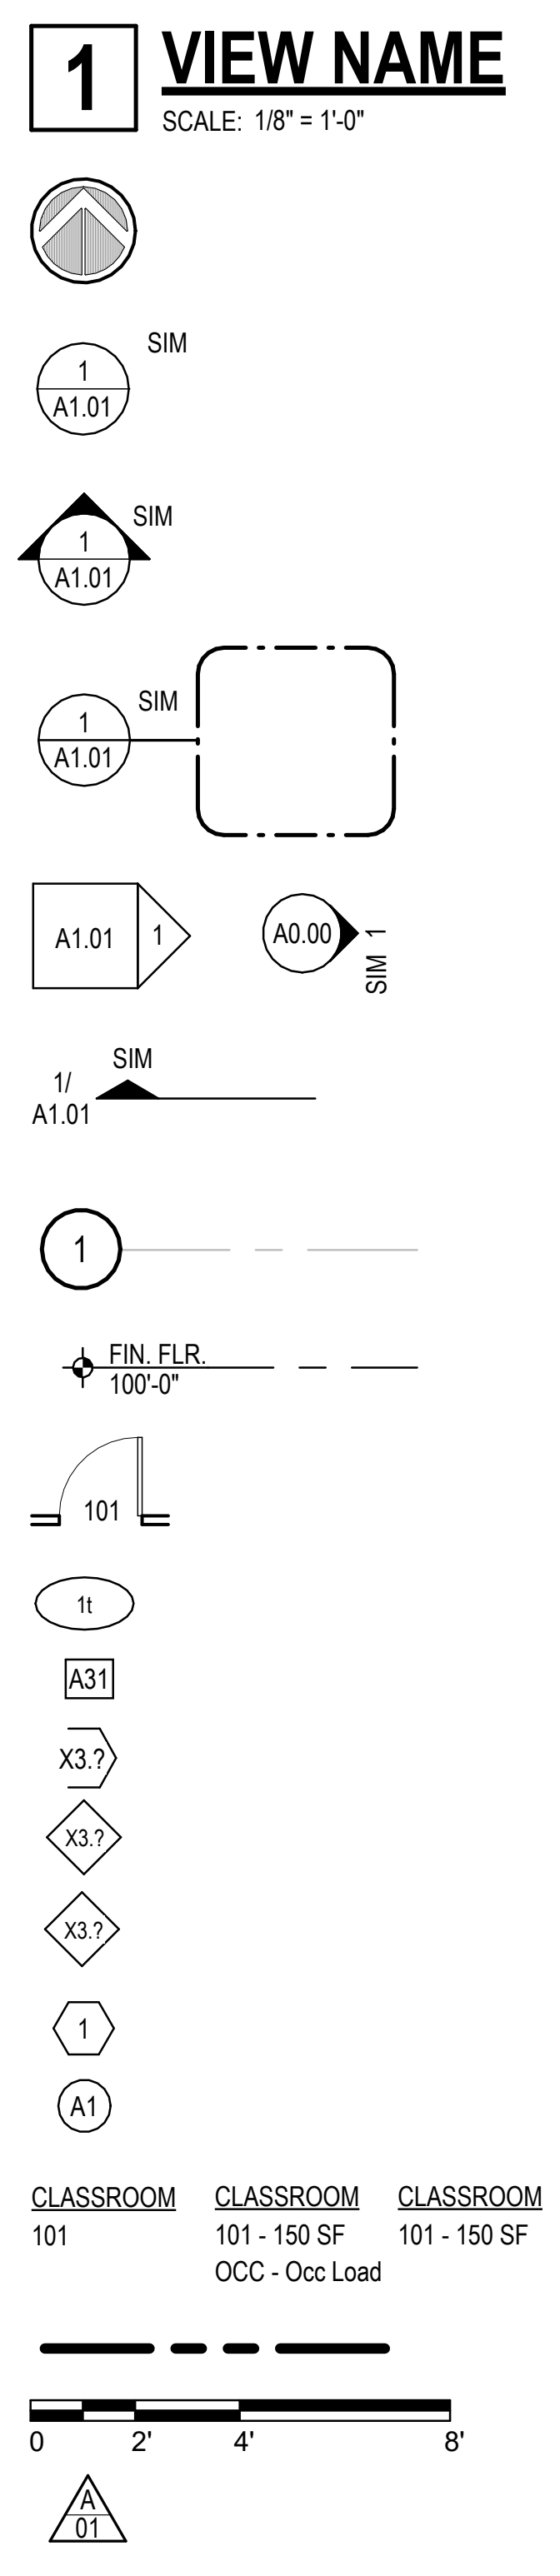

DETAIL REFERENCE NUMBER
NORTH ARROW
DETAIL OR SECTION NUMBER
SHEET ON WHICH IT IS FOUND
SECTION REFERENCE
DETAIL REFERENCE
ELEVATION REFERENCE
DETAIL SECTION REFERENCE
GRID LINE
ELEVATION REFERENCE
DOOR/OPENING IDENTIFIER
WINDOW/OPENING IDENTIFIER
WALL TYPE REFERENCE
EXTERIOR WALL TYPE REFERENCE
ROOF TYPE REFERENCE
FLOOR TYPE REFERENCE
NOTES - PLANS, RCP, ROOF, ELEVATIONS
NOTES - DEMOLITION
ROOM IDENTIFIER
MATCHLINE
GRAPHIC SCALE
REVISION TAG & CLOUD INDICATOR

REVISION TAG INFORMATION:
TOP indicates the instrument type
- A = Addendum
- B = Bid Package
- D = Construction Change Directive or Change Directive
- F = Field Order
- G = Guaranteed Maximum Price
- I = Architects Supplemental Instructions or Architects Supplemental information
- L = Limited Permit
- P = Proposal Request, Proposal Request Order or Change Proposal Request
- R = Request For Information

BOTTOM indicates consecutive number assigned to instrument type.

GENERAL NOTES

1. ALL DISCIPLINES SHALL BE RESPONSIBLE FOR THEIR SCOPE OF WORK. THIS WORK IS TO BE SCHEDULED AND COMPLETED WITH THE GENERAL CONTRACTOR'S FULL KNOWLEDGE.
2. ALL DIMENSIONS LOCATING PLUMBING FIXTURES ARE FROM FINISH MATERIAL NOT FROM GPDW SHEATHING.
3. FINAL CLEANING - REMOVE OR REPAIR DAMAGED OR SOILED SPOTS ON NEWLY PAINTED WALLS AND ON ALL NEWLY INSTALLED WORK. REMOVE DUST AND DEBRIS FROM ALL NEW WORK.

STANDARD ABBREVIATIONS

A/E	ARCHITECT/ENGINEER
AB	ANCHOR BOLT
ABBR	ABBREVIATE
ABV	ABOVE
AC	AIR CONDITIONING
ACID RES	ACID-RESISTANT
ACOUS	ACOUSTICAL
ACOUS INSUL	ACOUSTICAL INSULATION
ACOUS PLAS	ACOUSTICAL PLASTER
ACOUS PNL	ACOUSTICAL PANEL
ACOUS TILE	ACOUSTICAL TILE
ACT	ACTUAL
AD	AREA DRAIN
ADC	AUTOMATIC DOOR CLOSER
ADDL	ADDITIONAL
ADDM	ADDENDUM
ADJ	ADJUSTABLE
ADJC	ADJACENT
AF	ACCESS FLOOR
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AFS	ABOVE FINISHED SLAB
AGGR	AGGREGATE
AHR	ANCHOR
AHU	AIR HANDLING UNIT
ALD	ALUMINUM DOOR
ALM	ALARM
ALT	ALTERNATE
ALUM	ALUMINUM
AMB	AMBIENT
AMPL	AMPLIFIER
AMT	AMOUNT
ANN	ANNUNCIATOR
ANOD	ANODIZED
ANT	ANTENNA
AP	ACCESS PANEL
APC	ACOUSTICAL PANEL CEILING
APPX	APPENDIX
ARCH	ARCHITECT (URAL)
ASB	ASBESTOS
ASC	ABOVE SUSPENDED CEILING
ASPH	ASPHALT
ASYM	ASYMMETRICAL
AV	AUDIO VISUAL
AVE	AVENUE
AWC	ACOUSTICAL WALL COVERING
AWP	ACOUSTICAL WALL PANEL
B&B	BALLED AND BURLAPPED
BAF	BAFFLE
BAL	BALANCE
BB	BULLETIN BOARD
BC	BOTTOM OF CURB
BD	BOARD
BEV	BEVEL
BF	BOTH FACES
BFF	BELOW FINISH FLOOR
BFP	BACKFLOW PREVENTER
BITUM	BITUMINOUS
BJT	BED JOINT
BL	BASE LINE
BLDG	BUILDING
BLK	BLOCK
BLKG	BLOCKING
BLKHD	BULKHEAD
BLST	BALLAST
BM	BEAM
BO	BOTTOM OF
BOC	BACK OF CURB
BOW	BOTTOM OF WALL
BP	BASE PLATE
BRCG	BRACING
BRDG	BRIDGING
BRDG JST	BRIDGING JOIST
BRG	BEARING
BRG PL	BEARING PLATE
BRK	BRICK
BRKT	BRACKET
BRS	BRASS
BRZ	BRONZE
BS	BOTH SIDES
BSMT	BASEMENT
BTM	BOTTOM
BUR	BUILT-UP ROOF
BW	BOTH WAYS
C&G	CURB AND GUTTER
C/C	CENTER TO CENTER
CAB	CABINET
CAV	CAVITY
CB	CATCH BASIN
CCTV	CLOSED CIRCUIT TELEVISION
CEM	CEMENT
CEM PLAS	CEMENT PLASTER
CER	CERAMIC
CER TILE	CERAMIC TILE
CFLG	COUNTER FLASHING
CG	CORNER GUARD
CH BD	CHALKBOARD
CHAN	CHANNEL
CHFR	CHAMFER
CHK	CHECK
CI	CAST IRON
CIP	CAST IN PLACE
CIR	CIRCLE
CJ	CONTROL JOINT
CL	CENTER LINE
CLG	CEILING
CLG DIFF	CEILING DIFFUSER
CLG HT	CEILING HEIGHT
CLL	CONTRACT LIMIT LINE
CLOS	CLOSET
CLR	CLEAR
CLSR	CLOSURE
CMPST	COMPOSITE
CMU	CONCRETE MASONRY UNIT
CNR	CORNER
CNTR	COUNTER
CO	CLEANOUT
COL	COLUMN
COMM	COMMERCIAL
COMPL	COMPLETE
CONC	CONCRETE
CONC FL	CONCRETE FLOOR
CONF	CONFERENCE
CONN	CONNECTION
CONSTR	CONSTRUCTION
CONT	CONTINUOUS
CONTR	CONTRACTOR
COORD	COORDINATE
CORR	CORRIDOR
COV PL	COVER PLATE
CPRS	COMPRESSIBLE
CPT	CARPET
CRCMF	CIRCUMFERENCE
CRS	COLD ROLLED STEEL
CSG	CASING
CSK	COUNTERSUNK
CSMT	CASEMENT
CSWK	CASEWORK
CT	CERAMIC TILE
CTV	CABLE TELEVISION
CUB	CUBICLE
CUR	CURRENT
CW	COLD WATER
DBL GLZ	DOUBLE GLAZING
DEPT	DEPARTMENT
DET	DETAIL
DF	DRINKING FOUNTAIN
DF	DRAPERY FABRIC
DFR	DOOR FRAME
DH	DOUBLE HUNG
DIA	DIAMETER
DIM	DIMENSION
DIST	DISTANCE
DIV	DIVIDER
DIW	DEIONIZED WATER
DJ	DOUBLE JOIST
DL	DEAD LOAD
DL	DRAPERY LINER
DMPF	DAMPPROOFING
DN	DOWN
DO	DITTO
DR	DOOR
DR	DRAIN
DRCLSR	DOOR CLOSURE
DS	DOWNSPOUT
DST	DOOR STOP
DT	DRAIN TILE
DUPL	DUPLICATE
DVTL	DOVETAIL
DW	DISHWASHER
DWG	DRAWING
DWL	DOWEL
DWR	DRAWER
DWTR	DUMBWAITER
E	EAST
EA	EACH
EF	EACH FACE
EIFS	EXTERIOR INSULATION FINISH SYSTEM
EJ	EXPANSION JOINT
EL	ELEVATION
ELEC	ELECTRICAL
ELEV	ELEVATOR
EMER	EMERGENCY
EMER SHR	EMERGENCY SHOWER
ENAM	ENAMEL
ENCL	ENCLOSURE
ENGR	ENGINEER
ENTR	ENTRANCE
EO	ELECTRICAL OUTLET
EP	ELECTRICAL PANEL
EPS	EXPANDED POLYSTYRENE
EPX	EPOXY FLOOR
EQ	EQUAL
EQL SP	EQUALLY SPACED
EQUIP	EQUIPMENT
EQUIV	EQUIVALENT
ERECT	ERECTION
ESCAL	ESCALATOR
ESMT	EASEMENT
EST	ESTIMATE
EW	EACH WAY
EXC	EXCAVATE
EXG	EXISTING
EXH FN	EXHAUST FAN
EXH HD	EXHAUST HOOD
EXP	EXPANSION
EXSP	EXPOSED
EXST	EXISTING
EXST GR	EXISTING GRADE
EXT	EXTERIOR
EXTN	EXTENSION
F BRK	FIRE BRICK
F/F	FACE TO FACE
FBD	FIBERBOARD
FC	FIRE COATED
FD	FLOOR DRAIN
FDN	FOUNDATION
FEC	FIRE EXTINGUISHER CABINET
FF	FACTORY FINISH
FFE	FINISH FLOOR ELEVATION
FGL	FIBERGLASS
FIN	FINISH
FIN FL	FINISH FLOOR
FIN GR	FINISH GRADE
FL	FLASHING
FL	FLOWLINE
FLDG	FOLDING
FLG	FLANGE
FLR	FLOOR
FLR FIN	FLOOR FINISH
FLR PL	FLOOR PLATE
FLR SK	FLOOR SINK
FLT GL	FLOAT GLASS
FLUOR	FLUORESCENT
FOC	FACE OF CONCRETE
FOM	FACE OF MASONRY
FOS	FACE OF STUD
FPL	FIREPLACE
FPRF	FIREPROOFING
FRM	FRAME
FRNT	FRONT
FS	FAR SIDE
FS	FLAT SCREEN
FS	FULL SIZE
FSP	FIRE STANDPIPE
FSTNR	FASTENER
FTG	FOOTING
FURR	FURRING
FUT	FUTURE
FXTR	FIXTURE
GALV	GALVANIZED
GB	GRAB BAR
GC	GENERAL CONTRACTOR
GDRL	GUARD RAIL
GENL	GENERAL
GFI	GROUND FAULT INTERRUPTER
GL	GLASS
GL BLK	GLASS BLOCK
GLU LAM	GLUE LAMINATED
GLZ	GLAZING
GLZ CMU	GLAZED CONCRETE MASONRY UNIT
GND	GROUND
GPDW	GYPSUM DRY WALL
GR	GRADE
GR BM	GRADE BEAM
GRTG	GRATING
GUT	GUTTER
GYP	GYPSUM
GYP PLAS	GYPSUM PLASTER
H	HIGH
H&CW	HOT AND COLD WATER
HB	HOSE BIBB
HC	HANDICAP
HC	HOLLOW CORE
HCMU	HOLLOW CONCRETE MASONRY UNIT
HD	HEAVY DUTY
HDBD	HARDBOARD
HDJT	HEAD JOINT
HDR	HEADER
HDWD	HARDWOOD
HGT	HEIGHT
HLB	HORIZONTAL LOUVER BLINDS
HM	HOLLOW METAL
HMD	HOLLOW METAL DOOR
HMF	HOLLOW METAL FRAME
HNDRL	HAND RAIL
HO	HOLD-OPEN
HORIZ	HORIZONTAL
HR	HOUR
HS	HIGH STRENGTH
HSB	HIGH STRENGTH BOLT
HTG	HEATING
HVAC	HEATING, VENTILATION, AIR CONDITIONING
HW	HOT WATER
HYD	HYDRANT
ID	INSIDE DIAMETER
IF	INSIDE FACE
INCAND	INCANDESCENT
INL	INLET
INSTL	INSTALLATION
INSUL	INSULATION
INTR	INTERIOR
INV	INVERT
INV EL	INVERT ELEVATION
JAN	JANITOR
JC	JANITOR'S CLOSET
JST	JOIST
JT	JOINT
KB	KNEE BRACE
KO	KNOCKOUT
KOP	KNOCKOUT PANEL
KPL	KICK PLATE
KWY	KEYWAY
L	LEFT
LAB	LABORATORY
LAV	LAVATORY
LB	POUND
LBR	LUMBER
LCMU	LIGHTWEIGHT CONCRETE MASONRY UNIT
LD BRG	LOAD BEARING
LDG	LANDING
LF	LINEAR FOOT
LG	LENGTH
LH	LEFT HAND
LHR	LEFT HAND REVERSE
LIN	LINEAR
LIN	LINOLEUM
LIQ	LIQUID
LKR	LOCKER
LKR RM	LOCKER ROOM
LL	LIVE LOAD
LNTL	LINTEL
LOC	LOCATION
LONG	LONGITUDINAL
LRG	LARGE
LS	LUMP SUM
LT	LIGHT
LT WT	LIGHTWEIGHT
LTG	LIGHTING
LVL	LEVEL
LVR	LOUVER
LW PLAS	LIGHTWEIGHT PLASTER
LWC	LIGHTWEIGHT CONCRETE
M	METER
MAINT	MAINTENANCE
MARB	MARBLE
MAS	MASONRY
MATL	MATERIAL
MAX	MAXIMUM
MB	MARKERBOARD
MBR	MEMBER
MC	METAL CLAD
MC	MOMENT CONNECTION
MDF	MEDIUM DENSITY FIBERBOARD
MDO	MEDIUM DENSITY OVERLOAD
ME	MATCH EXISTING
ME	MISCELLANEOUS EQUIPMENT
MECH	MECHANICAL
MED	MEDIUM
MEMB	MEMBRANE
MEZZ	MEZZANINE
MFG	MANUFACTURING
MFR	MANUFACTURER
MH	MANHOLE
MIL	MILLIMETER
MIN	MINIMUM
MIR	MIRROR
MISC	MISCELLANEOUS
MK	MARK
ML	MATCH LINE
ML	METAL LATH
MLC	METAL LABORATORY CASEWORK
MLDG	MOLDING
MLWK	MILLWORK
MO	MASONRY OPENING
MOD	MODULE
MTD	MOUNTED
MTG	MEETING
MTL	METAL
MTR	MORTAR
MULL	MULLION
MULT	MULTIPLE
MVBL	MOVABLE
N	NORTH
N/A	NOT APPLICABLE
NEG	NEGATIVE
NF	NEAR FACE
NIC	NOT IN CONTRACT
NO	NUMBER
NOM	NOMINAL
NS	NEAR SIDE
NTS	NOT TO SCALE
O/O	OUT TO OUT
OA	OVERALL
OC	ON CENTER
OD	OUTSIDE DIAMETER
OD	OVERFLOW DRAIN
OF	OUTSIDE FACE
OFCI	OWNER FURNISHED/CONTRACTOR INSTALL
OFF	OFFICE
OFOI	OWNER FURNISHED-OWNER INSTALLED
OHD	OVERHEAD DOOR
OPER	OPERABLE
OPNG	OPENING
OPP	OPPOSITE
OPT	OPTIONAL
ORIG	ORIGINAL
OTA	OPEN TO ABOVE
OTFA	OPEN TO FLOOR ABOVE
OTS	OPEN TO STRUCTURE
OVHD	OVERHEAD
OXY	OXYGEN
OZ	OUNCE
P/C	PRECAST
PAR	PARALLEL
PARG	PARGING
PB	PANIC BAR
PBD	PARTICLE BOARD
PC	PORTLAND CEMENT
PCP	PORTLAND CEMENT PLASTER
PCT	PORCELAIN TILE
PED	PEDESTAL
PERF	PERFORATED
PERIM	PERIMETER
PERM	PERMANENT
PERP	PERPENDICULAR
PF	PANEL FABRIC
PFP	PRE-FINISHED PANEL
PGBD	PEGBOARD
PH	PHASE
PL	PLATE
PL	PLASTIC LAMINATE
PLAM	PLASTIC LAMINATE
PLAS	PLASTER
PLAT	PLATFORM
PLBG	PLUMBING
PLYWD	PLYWOOD
POL	POLISHED
POLY	POLYSTYRENE
POLYISO	POLYISOCYANURATE
POS	POSITIVE
PR	PAIR
PREFAB	PREFABRICATED
PRELIM	PRELIMINARY
PRKG	PARKING
PROJ	PROJECT
PS	PROJECTION SCREEN
PT	PAINT
PTN	PARTITION
PVC	POLYVINYL CHLORIDE
PVG	PAVING
PVMT	PAVEMENT
PWR	POWER
QT	QUARRY TILE
QTY	QUANTITY
QUAL	QUALITY
R	RISER
RAD	RADIUS
RB	RUBBER BASE
RBR	RUBBER
RC	REINFORCED CONCRETE
RCP	REINFORCED CONCRETE PIPE
RD	ROOF DRAIN
REC	RECESSED
RECD	RECEIVED
RECPT	RECEPTACLE
RECT	RECTANGULAR
REF	REFERENCE
REINF	REINFORCEMENT
REM	REMOVABLE
REQD	REQUIRED
RESIL	RESILIENT
RFG	ROOFING
RFM	RECESSED FLOOR MAT
RH	RIGHT HAND
RHR	RIGHT HAND REVERSE
RND	ROUND
RO	ROUGH OPENING
RST	RUBBER STAIR TREAD
RT	RUBBER TILE
RV	ROOF VENT
RVS	REVERSE
S	SOUTH
S	SEATING
SALV	SALVAGE
SB	SPLASH BLOCK
SC	SOLID CORE
SCH	SCHEDULE
SCMU	SOLID CONCRETE MASONRY UNIT
SCRN	SCREEN
SD	STORM DRAIN
SECT	SECTION
SF	SYSTEMS FURNITURE
SGL	SINGLE
SHR	SHOWER
SHTHG	SHEATHING
SHVL	SHELVES
SIM	SIMILAR
SJ	SLIP JOINT
SK	SINK
SLA	SLATE
SLP	SLOPE
SLS	SUB-FLOOR LEVELING SYSTEM
SLV	SLEEVE
SM	SHEET METAL
SMLS	SEAMLESS
SP	SPACING
SPCL	SPECIAL
SPEC	SPECIFICATION
SPKLR	SPRINKLER
SPKR	SPEAKER
SPRT	SUPPORT
SQ	SQUARE
SQFT	SQUARE FOOT
SQIN	SQUARE INCH
SQYD	SQUARE YARD
SS	STAINLESS STEEL
SSK	SERVICE SINK
SSM	SOLID SURFACING MATERIAL
ST	STAIN
ST	STREET
STAG	STAGGERED
STC	SOUND TRANSMISSION CLASS
STD	STANDARD
STIR	STIRRUP
STL	STEEL
STL JST	STEEL JOIST
STL PL	STEEL PLATE
STN	STONE
STOR	STORAGE
STRUCT	STRUCTURAL
STRUCT STL	STRUCTURAL STEEL
SUPPL	SUPPLEMENT
SURF	SURFACE
SUSP	SUSPENDED
SUSP CLG	SUSPENDED CEILING
SVB	SHEET VINYL BASE
SVF	SHEET VINYL FLOOR
SYM	SYMBOL
SYMM	SYMMETERICAL
SYST	SYSTEM
T	TABLE
T&B	TOP AND BOTTOM
T&G	TONGUE AND GROOVE
TB	TACKBOARD
TB-xx	TEST BORING-xx(E.G. TB-1)
TC	TOP OF CURB
TD	TRENCH DRAIN
TE	TRANSITION EDGE
TECH	TECHNICAL
TEMP	TEMPORARY
TER	TERRAZZO
TFTI	TENANT FURNISHED-TENANT INSTALLED
THK	THICK
THRES	THRESHOLD
THRU	THROUGH
TKBD	TACKBOARD
TLT	TOILET
TMPD	TEMPERED
TMPD GL	TEMPERED GLASS
TNL	TUNNEL
TO	TOP OF
TOF	TOP OF FLANGE
TOFF	TOP OF FINISH FLOOR
TOJ	TOP OF JOIST
TOL	TOLERANCE
TOS	TOP OF STEEL
TOT	TOTAL
TOW	TOP OF WALL
TRNBKL	TURNBUCKLE
TS	TENSILE STRENGTH
TS	TUBE STEEL
TV	TELEVISION
TYP	TYPICAL
UDR	UNDER
UDRLMNT	UNDERLAYMENT
UF	UPHOLSTERY FABRIC
UFD	UNDER FLOOR DUCT
UG	UNDERGROUND
UL	UNDERWRITERS LABORATORY
ULT	ULTIMATE
UNEX	UNEXCAVATED
UNFIN	UNFINISHED
UNO	UNLESS NOTED OTHERWISE
UPS	UNINTERRUPTIBLE POWER SUPPLY
UR	URINAL
UTIL	UTILITY
V	VOLT
VAC	VACUUM
VAV	VARIABLE AIR VOLUME
VB	VAPOR BARRIER
VB	VINYL BASE
VCT	VINYL COMPOSITION TILE
VDB	VISUAL DISPLAY BOARD
VERT	VERTICAL
VEST	VESTIBULE
VIB	VIBRATION
VNR	VENEER
VOL	VOLUME
VR	VAPOR RETARDER
VT	VINYL TILE
VWC	VINYL WALL COVERING
W	WEST
W/	WITH
W/O	WITHOUT
W/W	WALL TO WALL
WC	WATER CLOSET
WC	WALL COVERING
WCPT	WALL CARPET
WD	WOOD
WDD	WOOD DOOR
WDW	WINDOW
WF	WIDE FLANGE
WF	WOOD FLOORING
WGL	WIRE GLASS
WH	WALL HUNG
WH	WATER HEATER
WHSE	WAREHOUSE
WL	WIND LOAD
WLD	WELDED
WR	WATER RESISTANT
WS	WEATHERSTRIPPING
WSCT	WAINSCOT
WT	WEIGHT
WTR	WATER
WTRPRF	WATERPROOFING
WWM	WELDED WIRE MESH
X SECT	CROSS SECTION

CLARK & ENERSEN

Architecture \ Engineering \ Planning \ Landscape Architecture \ Commissioning

clarkenersen.com

? # ? - #

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

COLORADO LICENSED ARCHITECT
ANDREA M. ANDERSON
ARC.00406215

07/06/2026

General Notes, Symbols & Abbreviations

G0.01

Plot Time Stamp: 7/6/2026 2:14:32 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_A26.rvt

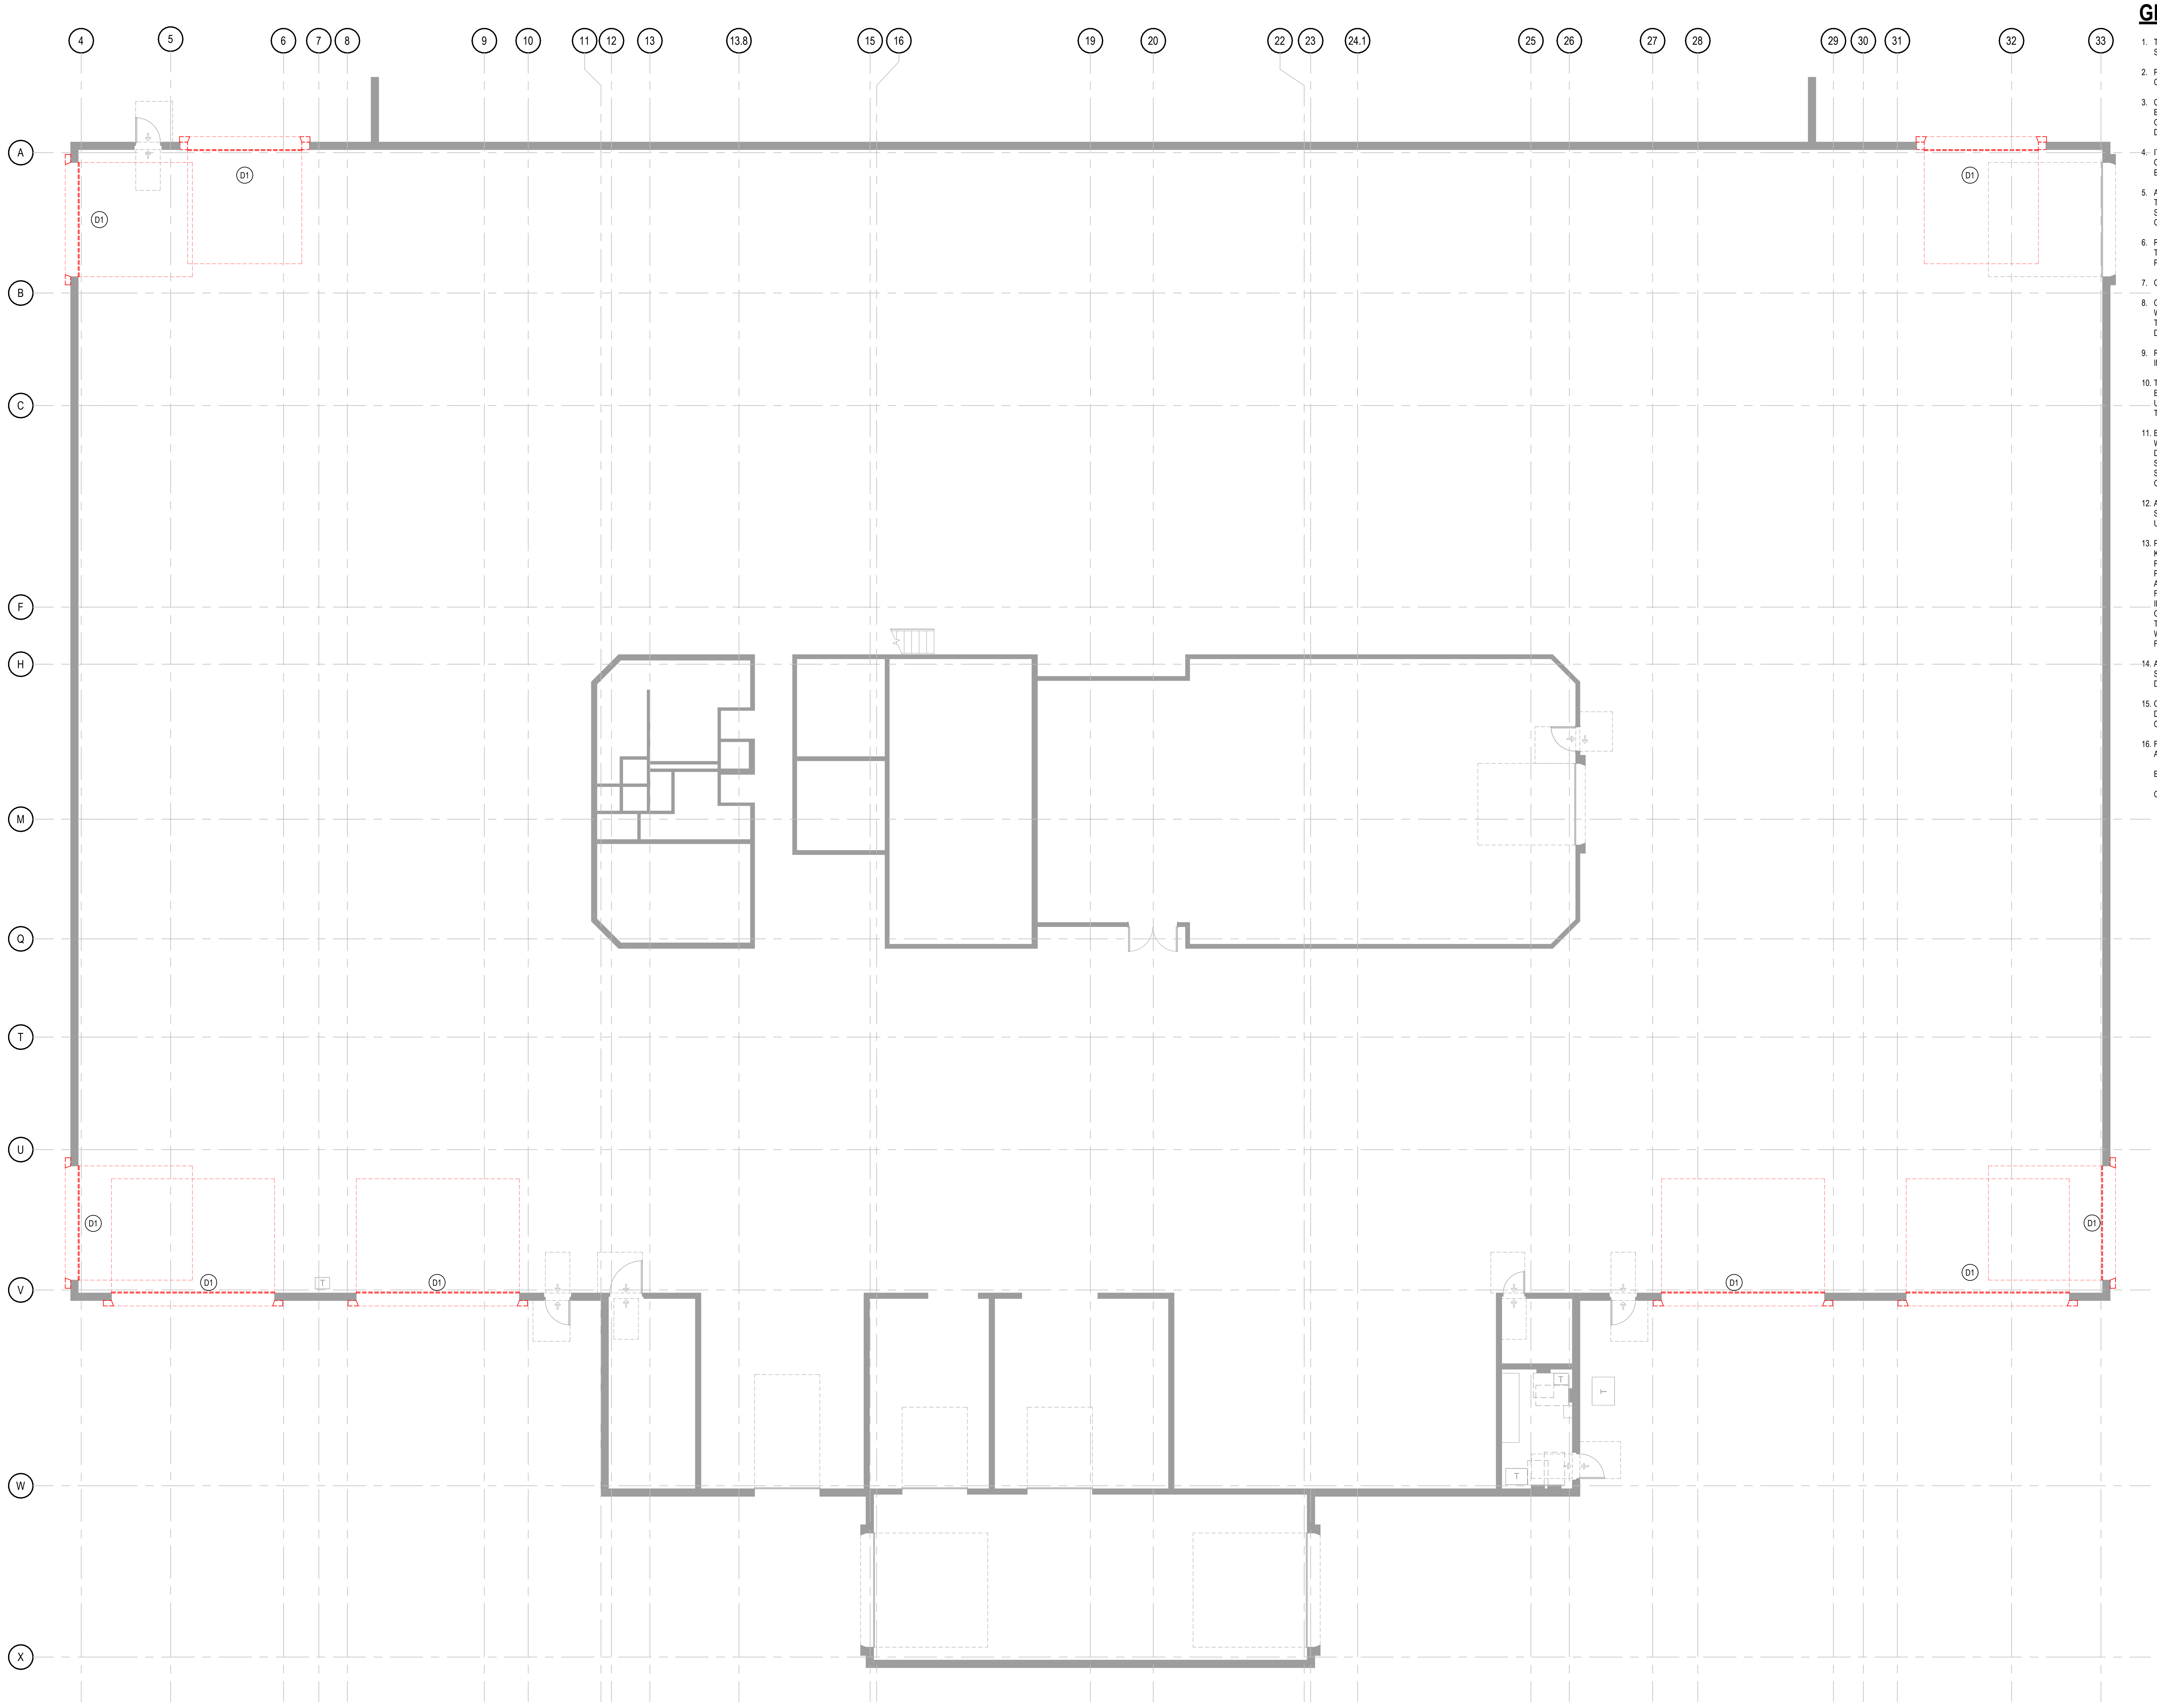

FIRST FLOOR DEMO PLAN

SCALE: 1/8" = 1'-0"

DEMOLITION KEY NOTES

D-DOOR	
D1	REMOVE EXISTING DOOR IN ITS ENTIRETY TO THE ROUGH OPENING, INCLUDING BUT NOT LIMITED TO DOOR PANEL SECTIONS, DOOR FRAME, OHD TRACK, OPERATOR, HARDWARE AND ALL SEALANT. PROTECT AND SALVAGE ADJACENT FINISHED SURFACES. REPAIR WALL, VAPOR BARRIER, INSULATION, FLOORING, AND ADJACENT WALL(S), IF APPLICABLE, TO MATCH EXISTING FINISH, OR COORDINATE W/ NEW CONSTRUCTION & INTERIOR FINISHES.

GENERAL DEMO NOTES

1. THE OWNER SHALL HAVE FIRST RIGHT OF REFUSAL OF ALL SALVAGEABLE ITEMS.
2. PROTECT ITEMS NOT BEING REMOVED FROM DAMAGE DURING CONSTRUCTION.
3. CONTRACTOR SHALL FIELD VERIFY ALL CONDITIONS PRIOR TO BIDDING TO DETERMINE THE TOTAL QUANTITIES AND SCOPE OF WORK THAT IS TO OCCUR AND COORDINATE ANY DISCREPANCIES WITH THE ARCHITECT.
4. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO COORDINATE THE INSTALLATION OF NEW WORK WITHIN EXISTING CONDITIONS.
5. ALL MATERIALS REMOVED AND NOT REUSED SHALL BECOME THE PROPERTY OF THE CONTRACTOR UNLESS OTHERWISE SPECIFICALLY DESIGNATED TO REMAIN THE PROPERTY OF THE OWNER.
6. REMOVE ALL SURFACE MOUNTED OBJECTS IN AREA OF WORK THAT ARE ABANDONED AND NOT INTENDED FOR REUSE. PREPARE SURFACE FOR NEW FINISH.
7. COORDINATE ALL DEMOLITION WORK BETWEEN TRADES.
8. CONTRACTOR SHALL NOTIFY THE ARCHITECT IF DEMOLITION WORK APPEARS TO AFFECT THE STRUCTURAL INTEGRITY OF THE EXISTING BUILDING BEFORE PROCEEDING WITH DEMOLITION ACTIVITIES.
9. REFER TO ELECTRICAL SHEETS FOR ADDITIONAL DEMOLITION INFORMATION.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR DAMAGE TO EXISTING MATERIALS TO REMAIN RESULTING FROM WORK UNDER THIS CONTRACT, AND SHALL RESTORE SUCH DAMAGE TO IT'S ORIGINAL CONDITION.
11. BEFORE DEMOLITION BEGINS, CONTRACTOR SHALL CONFER WITH THE OWNER AND/OR BUILDING USERS TO SCHEDULE DISRUPTION OF DAILY ACTIVITIES. GENERAL CONTRACTOR SHALL COORDINATE DEMOLITION, AND INSTALLATION SEQUENCING WITH OWNER TO MAINTAIN BUILDING OPERATIONS DURING CONSTRUCTION.
12. ALL PRODUCTS AND EQUIPMENT SHALL BE KEPT CLEAN AND SAFE. DISPOSE OF DEBRIS DAILY AND CLEAN AREAS OF WORK UPON COMPLETION.
13. PURSUANT TO THE FEDERAL OSHA EMPLOYEE RIGHT-TO-KNOW ACT, THE CONTRACTOR IS HEREBY ADVISED THAT A POTENTIAL FOR LEAD HAZARD EXISTS. LEAD PAINT CAN BE PRESENT ON OLDER PAINTED SURFACES. THE CONTRACTOR IS ADVISED THAT HE/SHE IS RESPONSIBLE TO COMPLY WITH THE FEDERAL STANDARDS FOR LEAD PAINT IN THE CONSTRUCTION INDUSTRY THAT WERE ADOPTED IN JUNE OF 1993 BY OSHA.CFR 29 PART 1926.62. THESE REGULATIONS REQUIRE THE CONTRACTOR TO DEVELOP WORK STRATEGIES WHEN WORKING WITH LEAD TO MINIMIZE AND PROTECT WORKERS FROM LEAD HAZARDS.
14. ASBESTOS ABATEMENT WILL BE PERFORMED UNDER SEPARATE CONTRACT. IF ASBESTOS IS SUSPECTED OR DISCOVERED DURING DEMOLITION, NOTIFY THE ARCHITECT.
15. CONSTRUCTION AREA SHALL BE KEPT CLEAN AND SAFE. DISPOSE OF DEBRIS DAILY AND CLEAN AREAS OF WORK UPON COMPLETION.
16. FINAL CLEANING SHALL INCLUDE THE FOLLOWING:
    A. REMOVE LABELS THAT ARE NOT INTENDED TO BE PERMANENT.
    B. CLEAN ALL TRANSPARENT SURFACES, INCLUDING MIRRORS AND GLASS IN DOORS AND WINDOWS.
    C. CLEAN EXPOSED SURFACES AND INTERIOR HARD-SURFACED FINISHES TO A DUST-FREE CONDITION

CLARK&
ENERSEN

**Architecture \ Engineering \ Planning **
Landscape Architecture \ Commissioning

clarkenersen.com

?
#
? - #

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort
Collins, CO 80525

CE No.: 326-057-26

07/06/2026

ANDREA M. ANDERSON
ARC.00406215
07/06/2026

First Floor Demolition Plan

A0.11

Plot Time Stamp: 7/6/2026 2:14:34 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_A26.rvt

PLAN NOTES

1	OVERHEAD DOOR TRACK TO BE ROUTED ABOVE PERPINDICULAR TRACK.
2	OVERHEAD DOOR TRACK TO BE ROUTED BELOW PERPINDICULAR TRACK.

GENERAL PLAN NOTES

1. THE GENERAL CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS SHOWN ON THE PLANS PRIOR TO COMMENCEMENT OF THE WORK. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO COORDINATE INSTALLATION OF NEW WORK WITHIN THESE EXISTING CONDITIONS. ANY DEVIATIONS IN EXISTING CONDITIONS OR DIMENSIONS INDICATED SHALL BE COORDINATED WITH THE ARCHITECT AND OWNER.
2. ALL WALL / GENERAL PLAN DIMENSIONS ARE TO FACE OF MASONRY, FACE OF CONCRETE, AND TO FACE OF STUD, UNLESS NOTED OTHERWISE.
3. GENERAL CONTRACTOR SHALL COORDINATE REPAINTING OF WALLS BETWEEN SUBCONTRACTORS AFTER EXISTING FIXTURES ARE SCHEDULED TO BE REMOVED AND PRIOR TO FIXTURES BEING REINSTALLED. REFER TO ELECTRICAL & MECHANICAL PLANS.
4. GENERAL CONTRACTOR SHALL COORDINATE AND WORK WITH OWNER FOR INSTALLATION SEQUENCING, AND TEMPORARY PROTECTION REQUIREMENTS TO MAINTAIN BUILDING OPERATIONS DURING CONSTRUCTION.

CLARK & ENERSEN

**Architecture \ Engineering \ Planning \
Landscape Architecture \ Commissioning**

clarkenersen.com

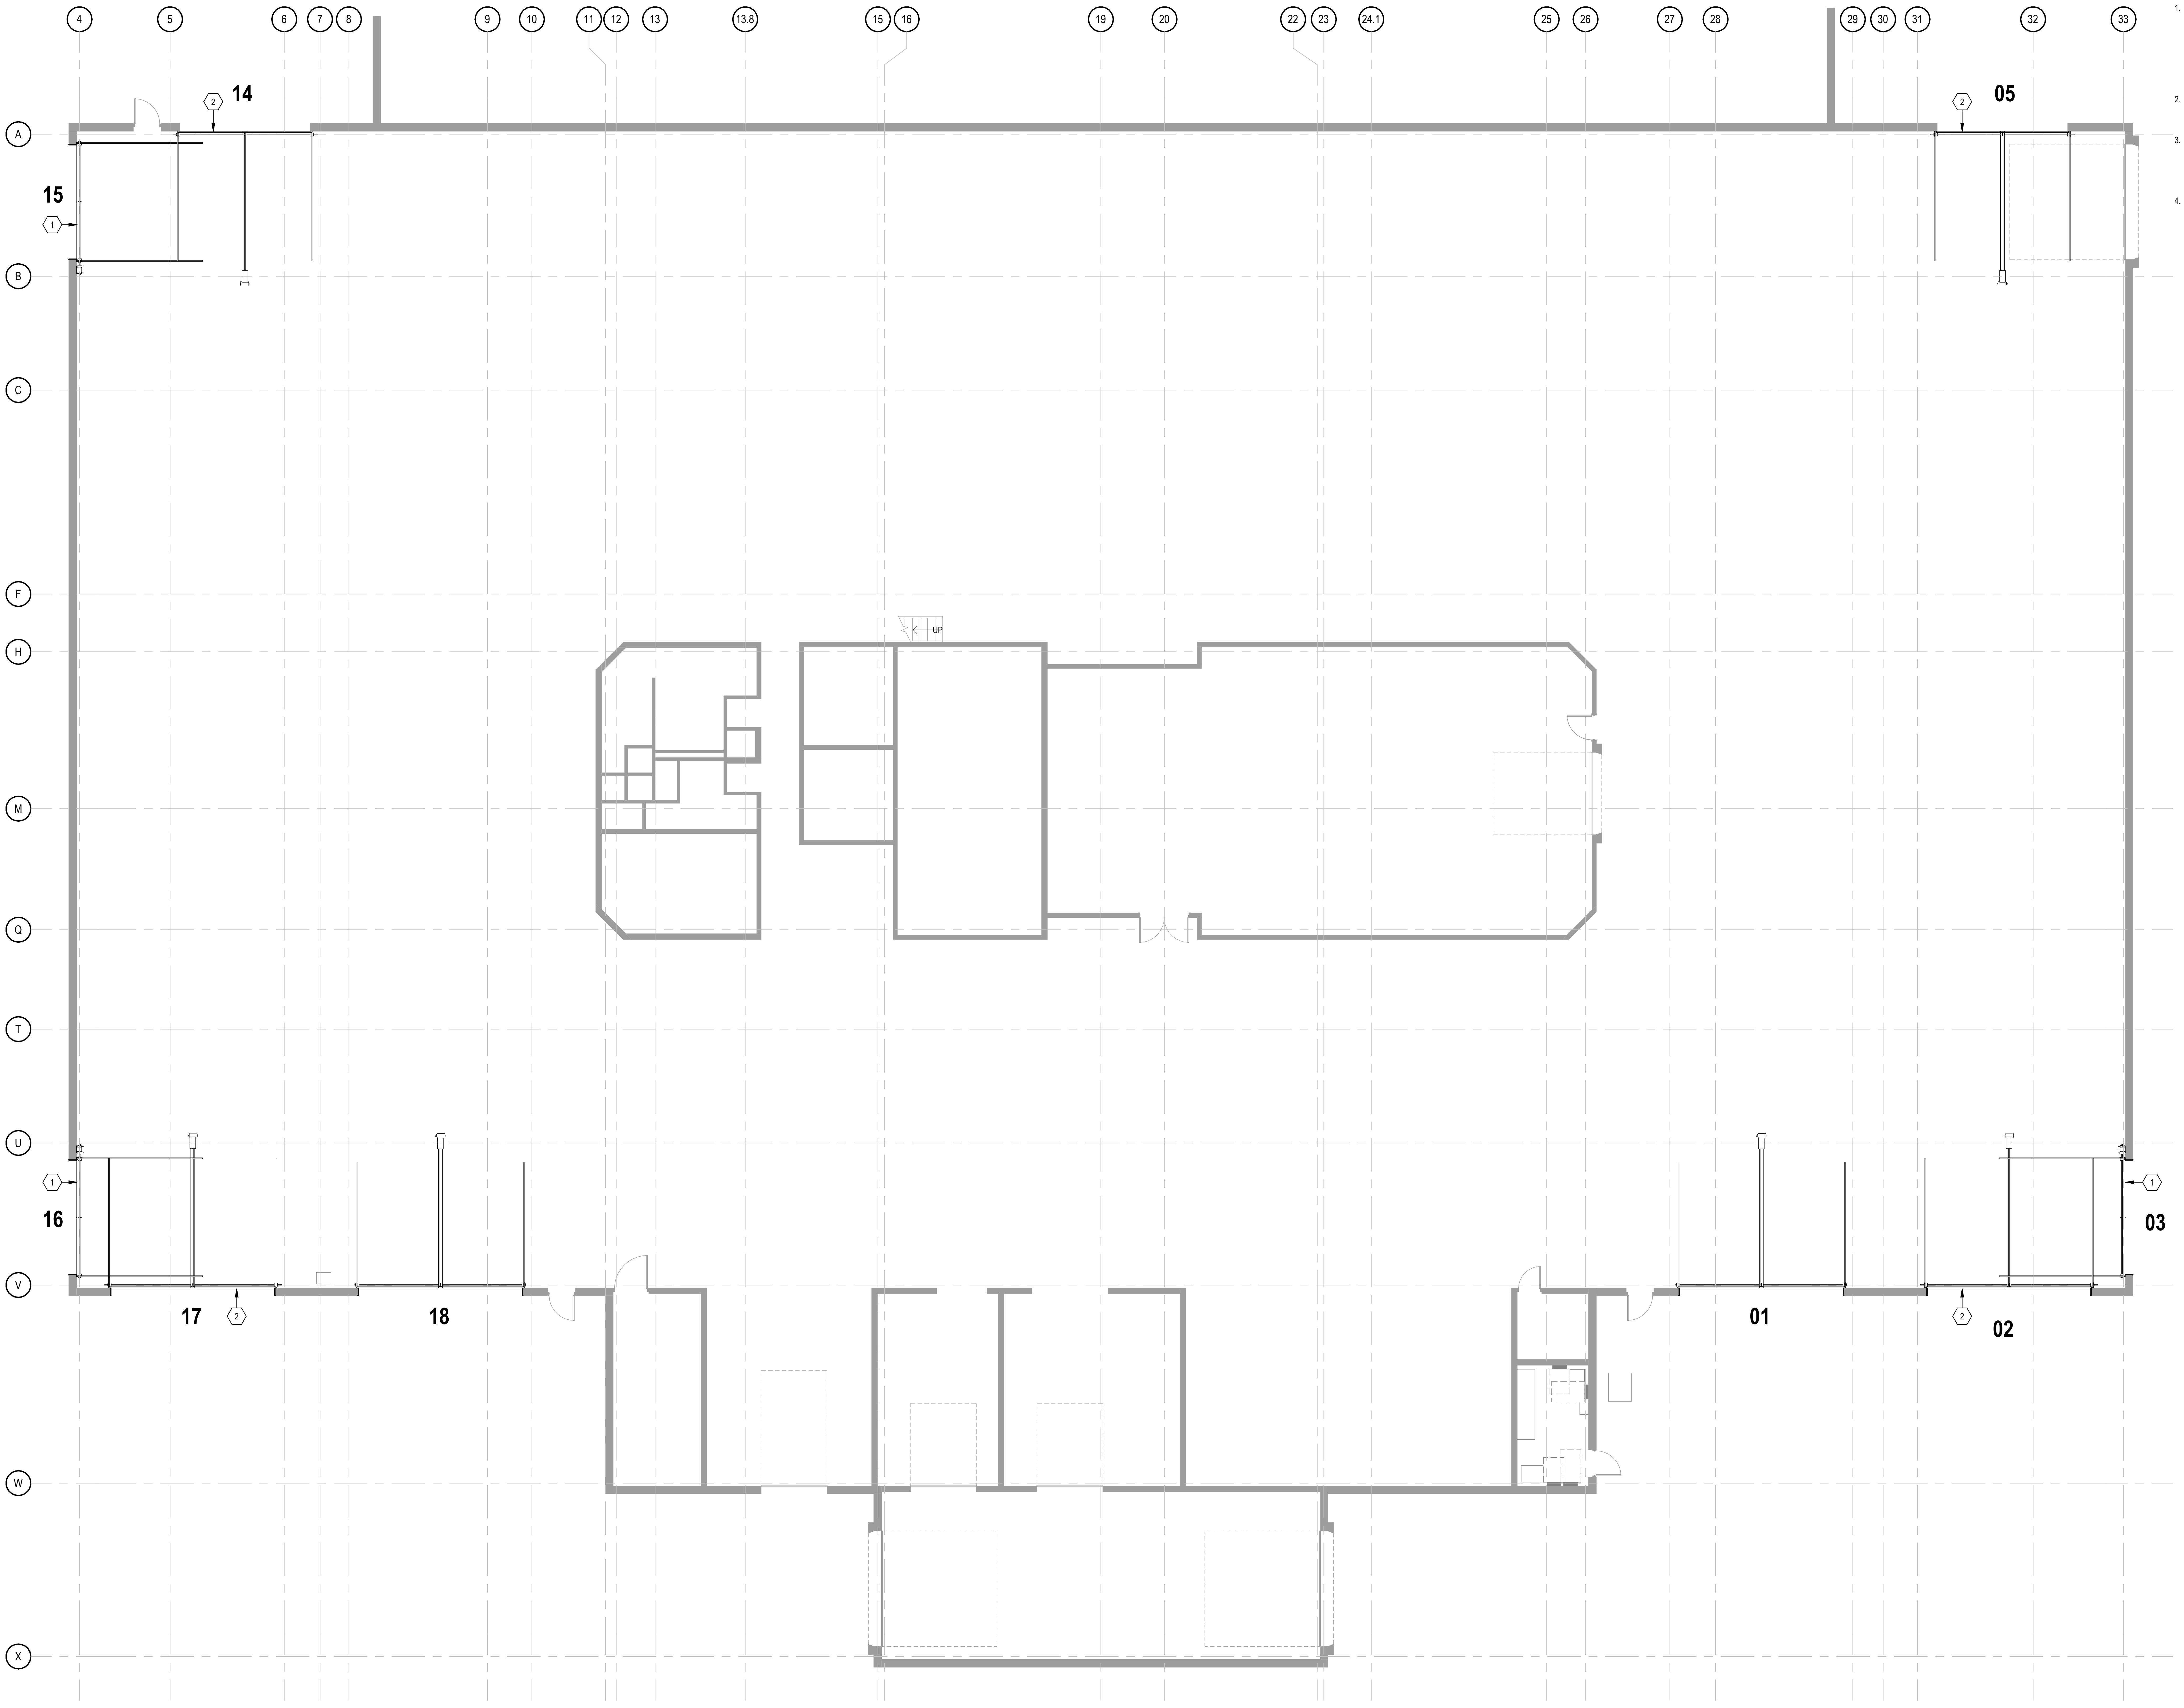

1 **LEVEL 1 - FLOOR PLAN**
SCALE: 1/8" = 1'-0"

Plot Time Stamp: 7/6/2026 2:14:34 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_A26.rvt

?
#
? - #

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort
Collins, CO 80525

CE No.: 326-057-26

07/06/2026

ANDREA M. ANDERSON
ARC.00406215
07/06/2026

First Floor Plan

A1.11

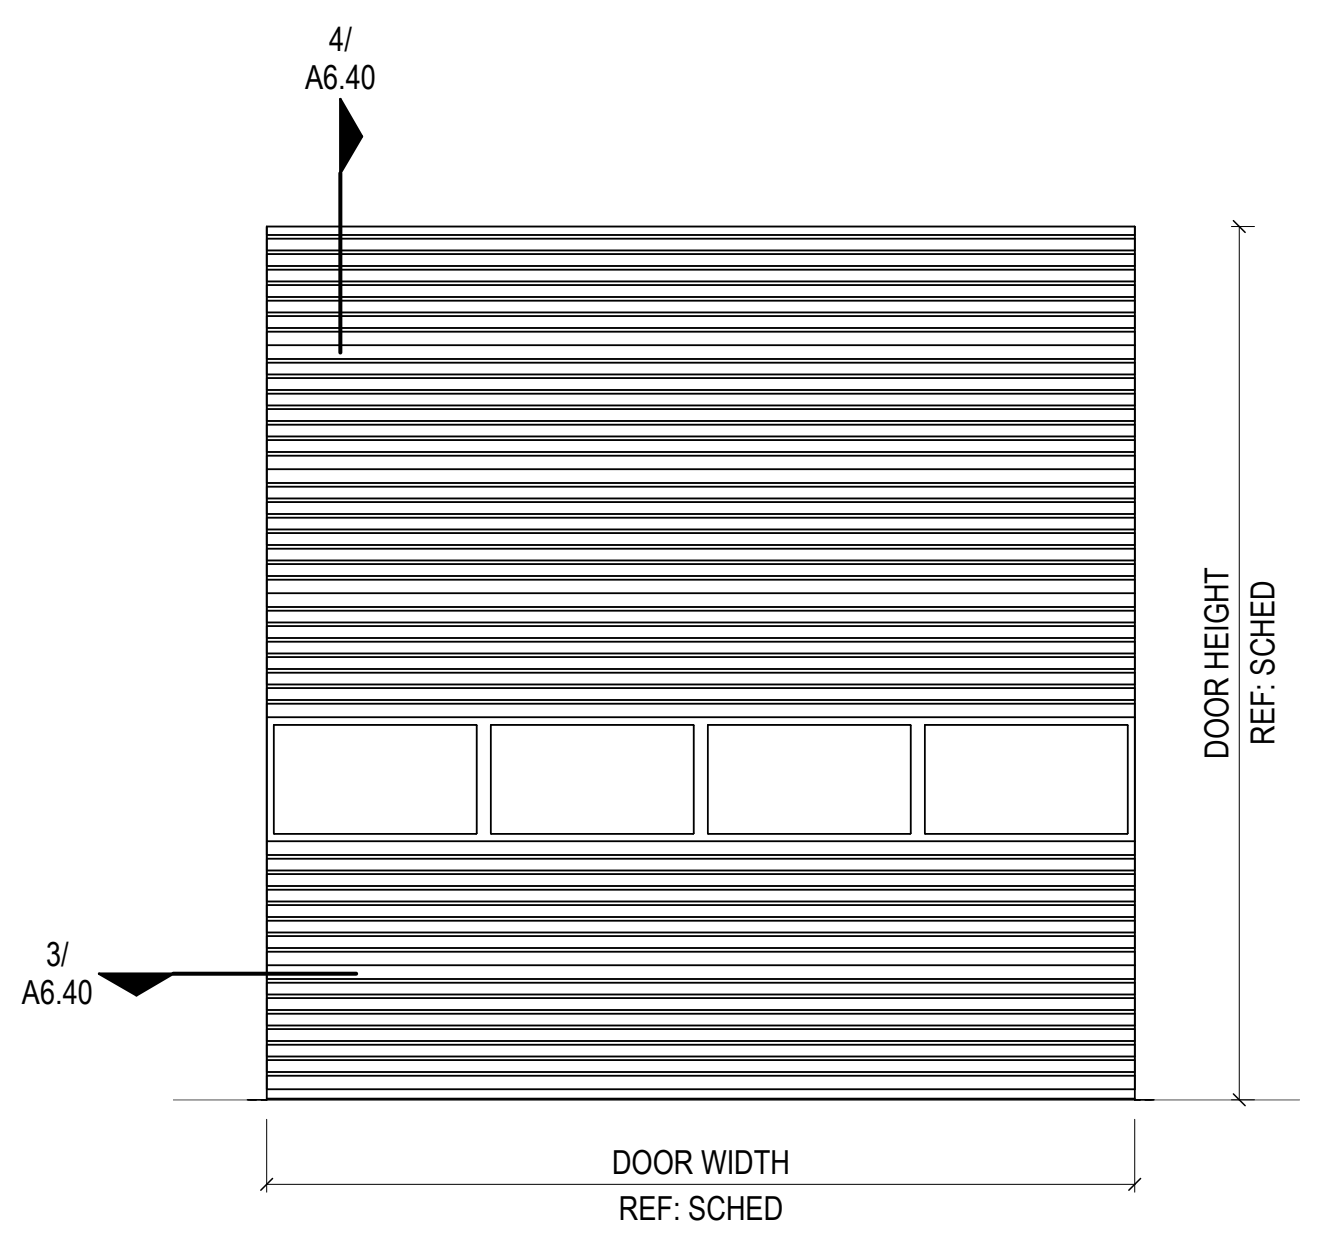
4/
A6.40
3/
A6.40
DOOR HEIGHT
REF: SCHED
DOOR WIDTH
REF: SCHED

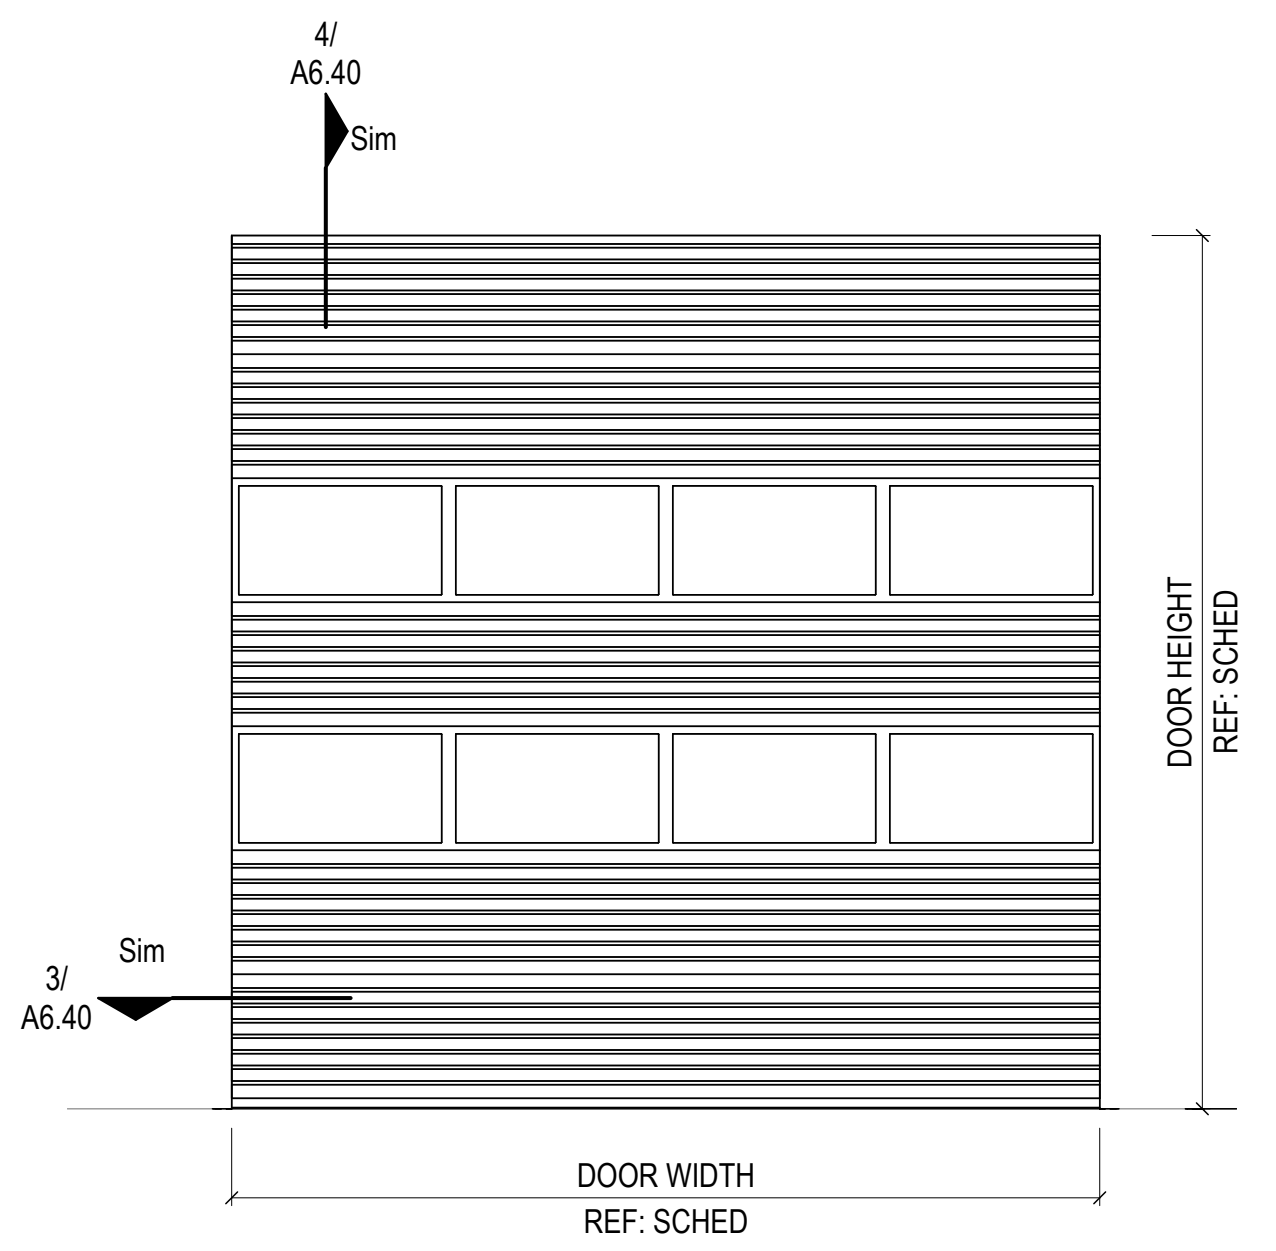
4/
A6.40
Sim
3/
A6.40
Sim
DOOR HEIGHT
REF: SCHED
DOOR WIDTH
REF: SCHED

BASE BID: BASIS OF DESIGN CLOPAY 3724, FINISH: BAKED ENAMEL, COLOR TO BE SELECTED BY ARCHITECT FROM STANDARD COLORS
ALT: 1: BASIS OF DESIGN CLOPAY 3722, FINISH: COLOR BLAST, COLOR TO MATCH EXISTING OHD 'S

1 Elevation OVHD-1

SCALE: 1/4" = 1'-0"

2 Elevation - OVHD-2

SCALE: 1/4" = 1'-0"

DOOR SCHEDULE

DOOR NO.	WIDTH	HEIGHT	TYPE	FINISH	HARDWARE	LIFT CLEARANCE	OPERATOR TYPE	VOLTAGE	NUMBER OF POLES
01	20' - 0"	14' - 0"	OVHD-2	BAKED ENAMEL	1, 2	NORMAL HEADROOM	TROLLEY TYPE	480 V	3
02	20' - 0"	14' - 0"	OVHD-2	BAKED ENAMEL	1, 2	LOW HEADROOM	TROLLEY TYPE	480 V	3
03	14' - 0"	14' - 0"	OVHD-1	BAKED ENAMEL	1, 3	LIFT CLEARANCE	LEFT HAND JACK SHAFT	480 V	3
05	16' - 0"	14' - 0"	OVHD-1	BAKED ENAMEL	1	LOW HEADROOM	TROLLEY TYPE	480 V	3
14	16' - 0"	14' - 0"	OVHD-1	BAKED ENAMEL	1	LOW HEADROOM	TROLLEY TYPE	480 V	3
15	14' - 0"	14' - 0"	OVHD-1	BAKED ENAMEL	1	LIFT CLEARANCE	LEFT HAND JACK SHAFT	480 V	3
16	14' - 0"	14' - 0"	OVHD-2	BAKED ENAMEL	1, 2, 3	LIFT CLEARANCE	RIGHT HAND JACK SHAFT	480 V	3
17	20' - 0"	14' - 0"	OVHD-2	BAKED ENAMEL	1	LOW HEADROOM	TROLLEY TYPE	480 V	3
18	20' - 0"	14' - 0"	OVHD-2	BAKED ENAMEL	1	NORMAL HEADROOM	TROLLEY TYPE	480 V	3

DOOR HARDWARE REMARKS

NO.	DOOR REMARKS
1	INTERIOR: WALL MOUNTED OPEN CLOSE OPERATOR
2	EXTERIOR: RE-INSTALL EXISTING KEY'ED OPENER
3	EXTERIOR: WIRELESS GARAGE DOOR OPENER

DOOR & FRAME TYPE GENERAL NOTES

1. PROVIDE SAFETY GLAZING OR FIRE-PROTECTION-RATED GLAZING IN LOCATIONS REQUIRED BY CURRENT LOCAL CODE. NOTIFY ARCHITECT OF CHANGES REQUIRED TO THE DRAWINGS.
2. PROVIDE AND INSTALL SAFETY GLAZING IN LOCATIONS AS PER SECTION *2406 & 2408 OF THE 2024 INTERNATIONAL BUILDING CODE.*
3. ALL DIMENSIONS ARE NOMINAL. ACTUAL DIMENSIONS TO BE PROVIDED BY SUPPLIER W/ ADJUSTMENTS MADE FOR INSTALLATION TOLERANCES REQUIRED. VERIFY ALL EXISTING OPENINGS PRIOR TO ORDER OF ALL NEW DOORS, DOOR FRAMES AND WINDOW FRAMES.
4. SEE FLOOR PLANS FOR DIRECTION OF DOOR SWINGS.
5. VERIFY FRAME FINISH WITH FINISH SCHEDULE.
6. MULLION LOCATIONS SHALL BE AS INDICATED ON THE DRAWINGS AND SHALL BE REFLECTED IN THE SHOP DRAWINGS. NOTIFY ARCHITECT OF ANY CHANGES OR DEVIATIONS.
7. BORROWED LIGHT LOCATIONS SHALL BE AS INDICATED ON THE PLAN DRAWINGS AND SHALL BE REFLECTED IN THE SHOP DRAWINGS. NOTIFY ARCHITECT OF ANY CHANGES OR DEVIATIONS.

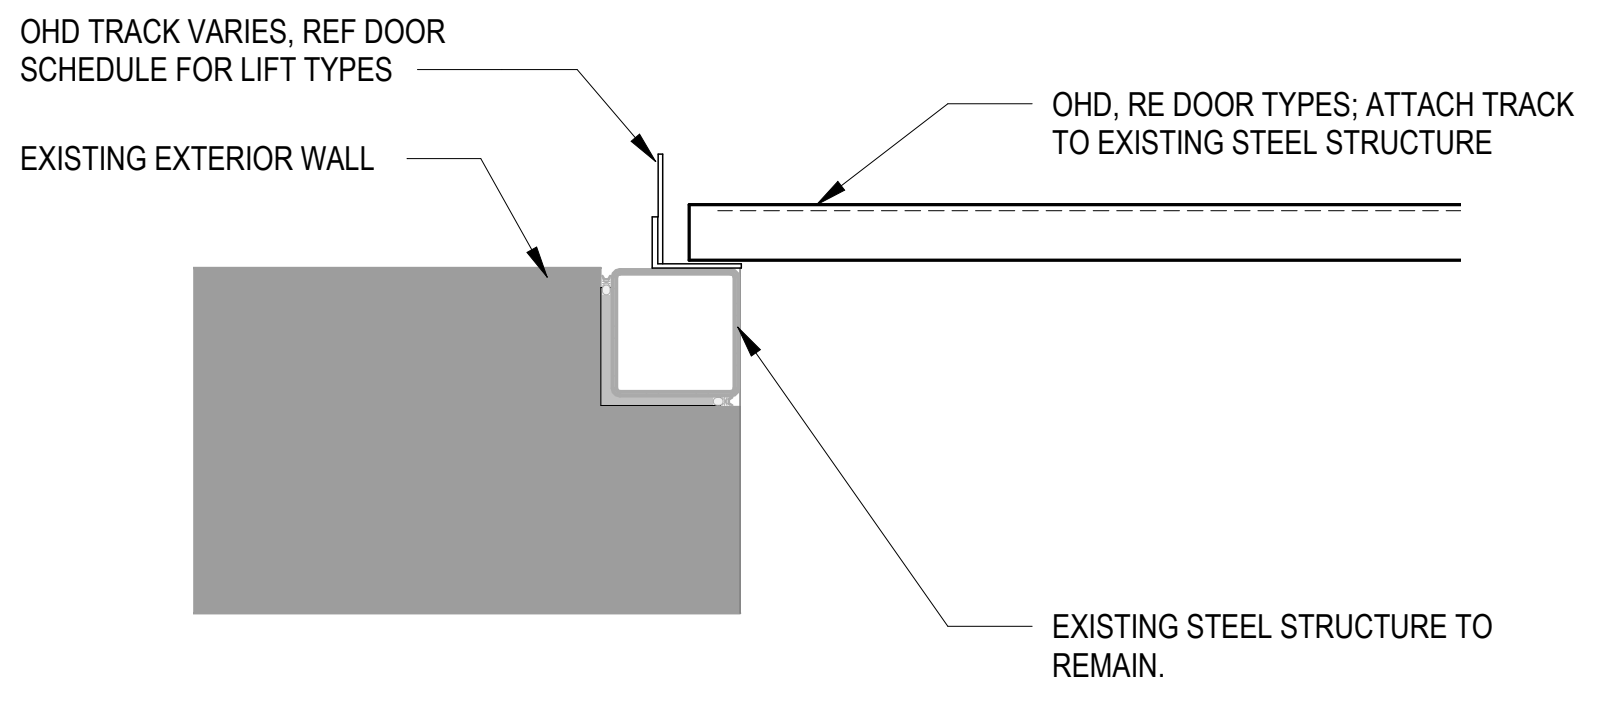
OHD TRACK VARIES, REF DOOR SCHEDULE FOR LIFT TYPES
EXISTING EXTERIOR WALL
OHD, RE DOOR TYPES; ATTACH TRACK TO EXISTING STEEL STRUCTURE
EXISTING STEEL STRUCTURE TO REMAIN.

3 OVERHEAD DOOR - JAMB DETAIL

SCALE: 1 1/2" = 1'-0"

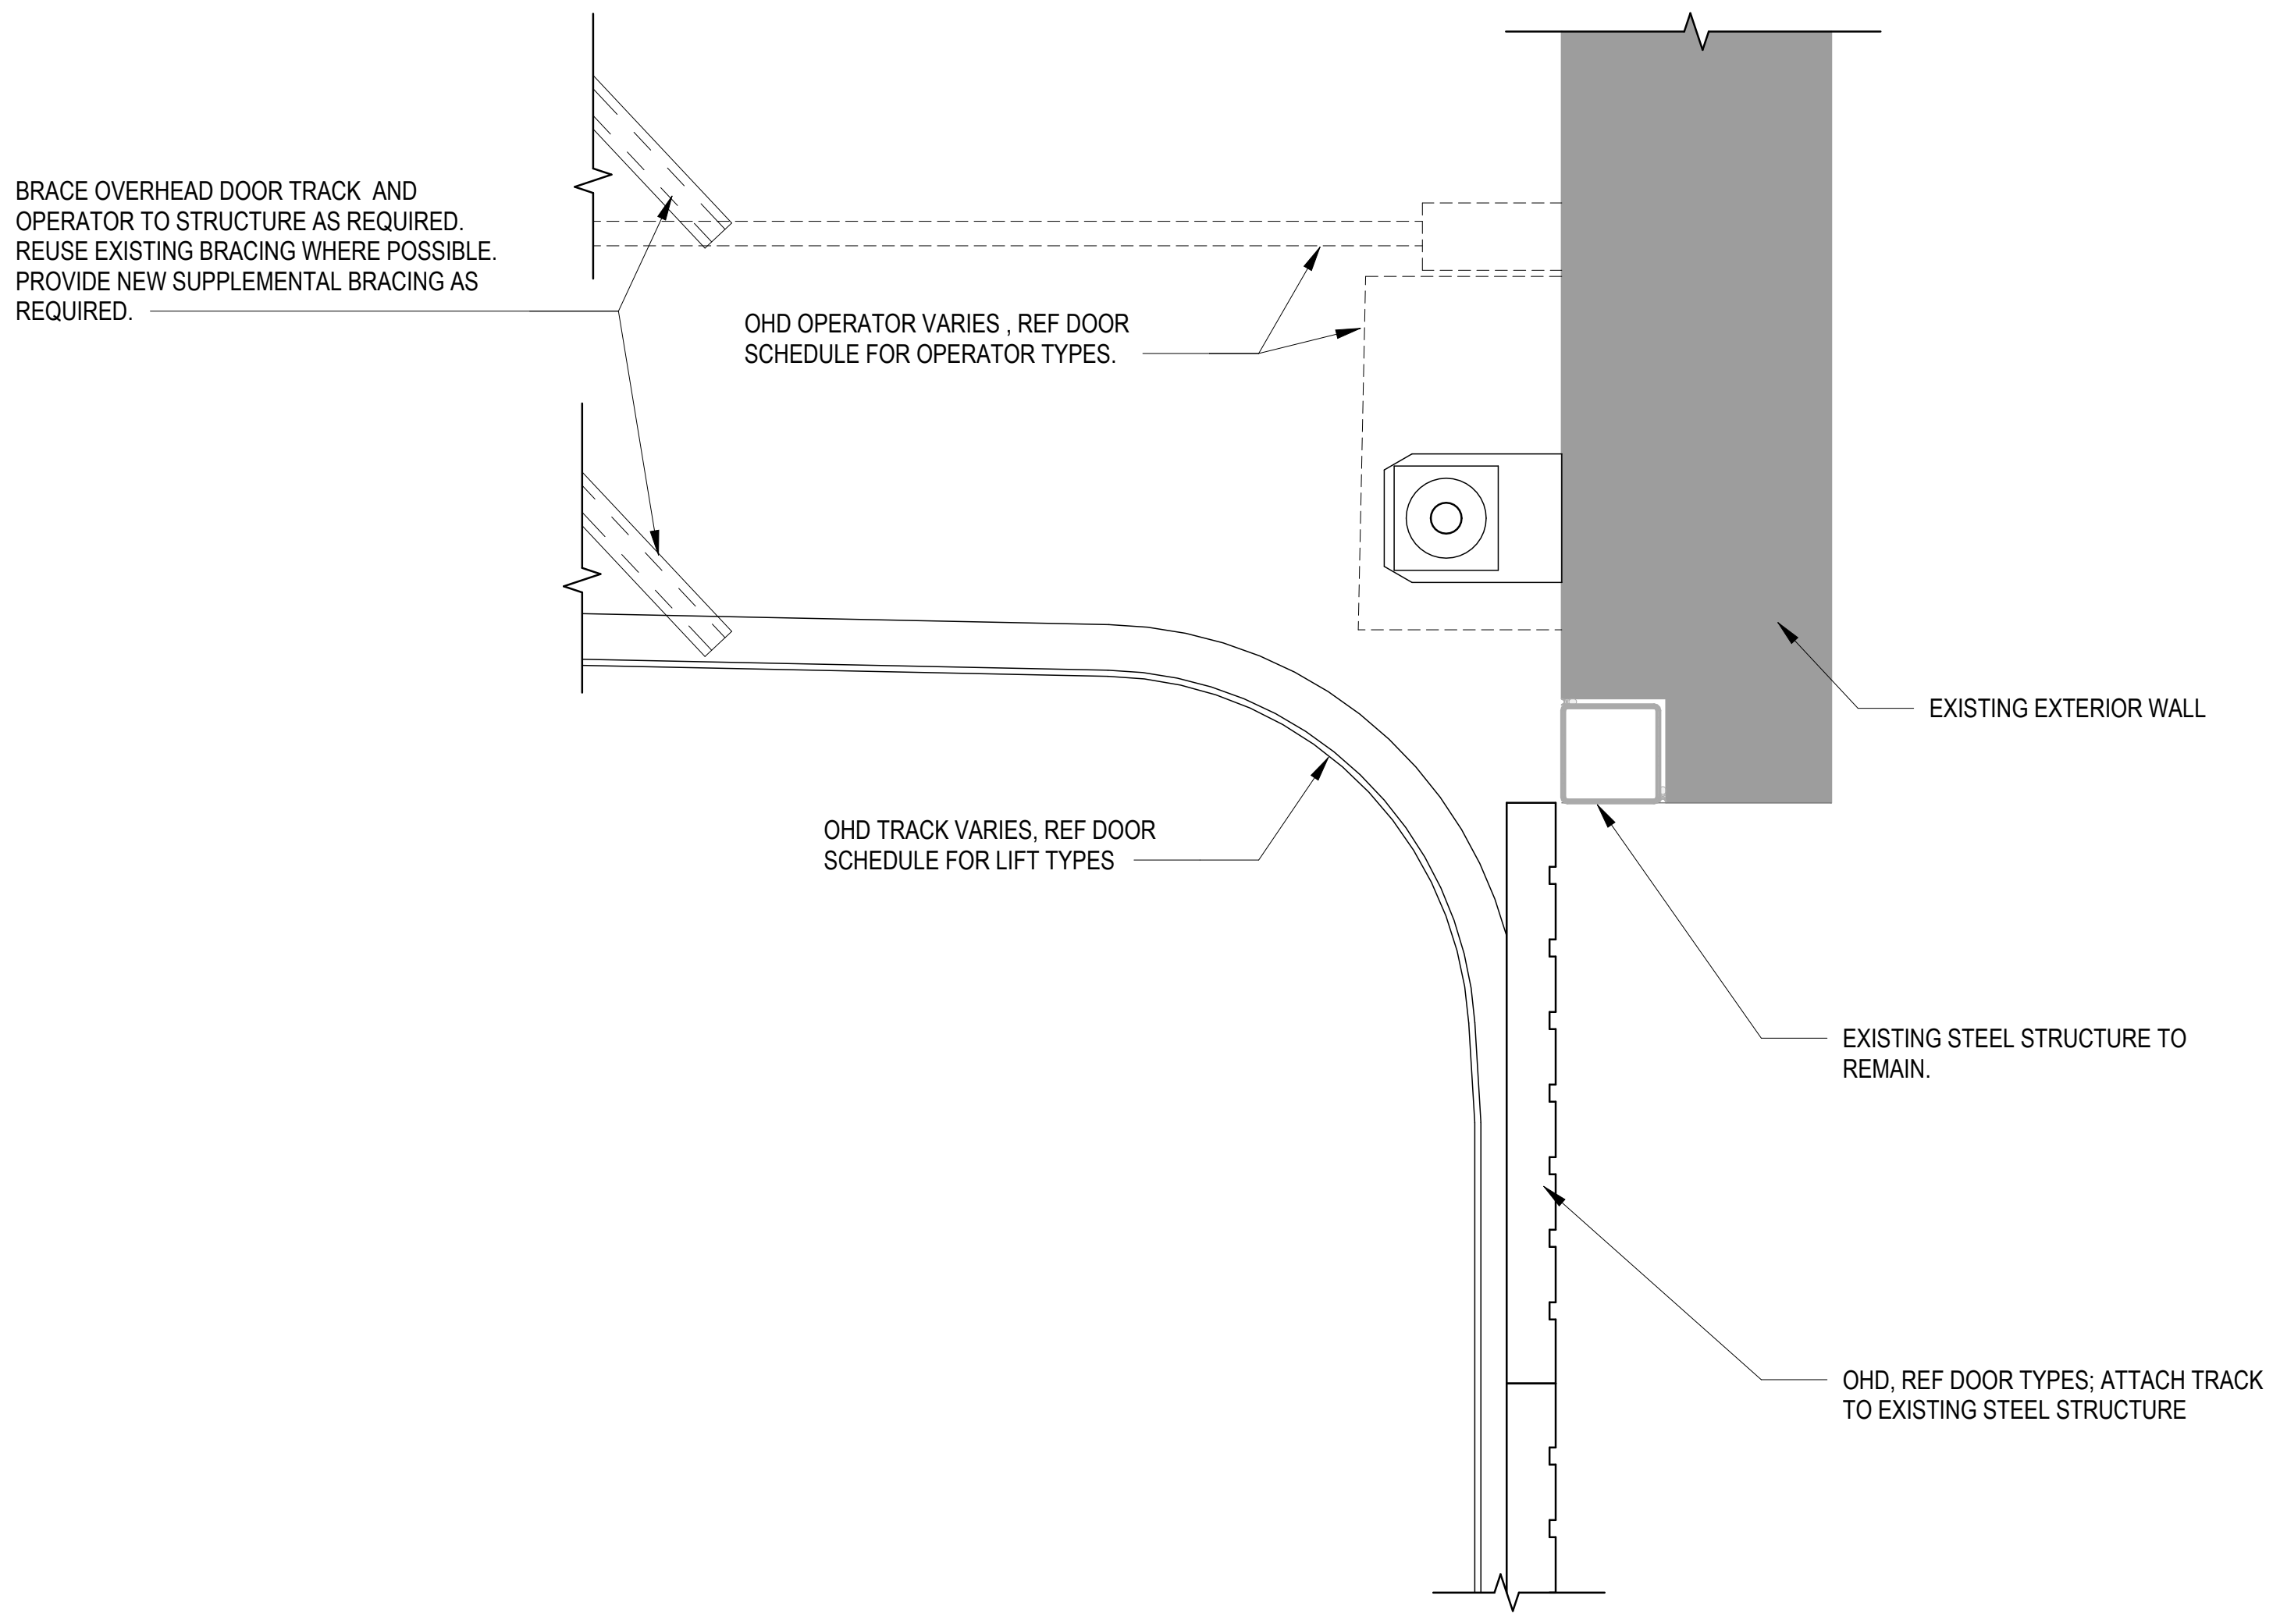
BRACE OVERHEAD DOOR TRACK AND OPERATOR TO STRUCTURE AS REQUIRED. REUSE EXISTING BRACING WHERE POSSIBLE. PROVIDE NEW SUPPLEMENTAL BRACING AS REQUIRED.
OHD OPERATOR VARIES , REF DOOR SCHEDULE FOR OPERATOR TYPES.
EXISTING EXTERIOR WALL
OHD TRACK VARIES, REF DOOR SCHEDULE FOR LIFT TYPES
EXISTING STEEL STRUCTURE TO REMAIN.
OHD, REF DOOR TYPES; ATTACH TRACK TO EXISTING STEEL STRUCTURE

4 OVERHEAD DOOR - HEAD DETAIL

SCALE: 1 1/2" = 1'-0"

CLARK& ENERSEN

Architecture \ Engineering \ Planning \
Landscape Architecture \ Commissioning

clarkenersen.com

? # ?-#

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

ANDREA M. ANDERSON
ARC.00406215
07/06/2026

Door Schedule, Door Types, Frame Types

A6.40

Plot Time Stamp: 7/6/2026 2:14:34 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_A26.rvt

ELECTRICAL ABBREVIATIONS AND SYMBOLS LEGEND

ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISH GRADE
C	SUBSCRIPT 'C' ADJACENT TO ANY DEVICE INDICATES CEILING.
CATV	CABLE TELEVISION
DAS	DISTRIBUTED ANTENNA SYSTEM
(E)	SUBSCRIPT 'E' ADJACENT TO ANY DEVICE INDICATES EXISTING.
EO	ELECTRICALLY OPERATED
EPO	EMERGENCY POWER OFF
(ER)	SUBSCRIPT 'ER' ADJACENT TO ANY DEVICE INDICATES EXISTING TO BE RELOCATED.
EWC	ELECTRIC WATER COOLER
F	SUBSCRIPT 'F' ADJACENT TO ANY DEVICE INDICATES FLOOR.
GFI	GROUND FAULT INTERRUPTER
H	SUBSCRIPT 'H' DENOTES HOSPITAL GRADE
HM	HORIZONTALLY MOUNTED DEVICE
HOA	HAND-OFF-AUTO
LTG	LIGHTING
MECH	MECHANICAL
NF	NON-FUSED
NIC	NOT IN CONTRACT
NO	NORMALLY OPEN
NC	NORMALLY CLOSED
OHE	OVERHEAD ELECTRICAL
OHT	OVERHEAD TELECOMMUNICATIONS
PL	PLUG LOAD
PVC	POLYVINYL CHLORIDE
RCPT	RECEPTACLE
(R)	SUBSCRIPT 'R' ADJACENT TO ANY DEVICE INDICATES THE RELOCATED POSITION OF AN EXISTING DEVICE.
RGS	RIGID GALVANIZED STEEL
(S)	SUBSCRIPT 'S' ADJACENT TO ANY DEVICE INDICATES THE DEVICE IS TO BE SURFACE MOUNTED.
TR	TAMPER RESISTANT
UGE	UNDERGROUND ELECTRICAL
USB	UNIVERSAL SERIAL BUS
HVE	UNDERGROUND MEDIUM OR HIGH VOLTAGE ELECTRICAL
UGT	UNDERGROUND TELECOMMUNICATIONS
WAP	WIRELESS ACCESS POINT
WG	WIRE GUARD
WP	WEATHERPROOF
X	EXPLOSION PROOF
⟍⟍⟍	CROSS-HATCHING AND/OR DASHED INDICATES REMOVAL

ELECTRICAL DISTRIBUTION

S	LINE VOLTAGE SINGLE POLE SWITCH
S_2	LINE VOLTAGE TWO POLE SWITCH
S_3	LINE VOLTAGE THREE WAY SWITCH
S_4	LINE VOLTAGE FOUR WAY SWITCH
S_P	LINE VOLTAGE SINGLE POLE SWITCH WITH PILOT LIGHT
S_D	LINE VOLTAGE DIMMER SWITCH
S_{MC}	LINE VOLTAGE MOMENTARY CONTACT SWITCH
S_{TE}	LINE VOLTAGE THERMAL ELEMENT SWITCH
S_K	LINE VOLTAGE KEYED SWITCH
S_O	LINE VOLTAGE OCCUPANCY SENSING SWITCH
S_T	LINE VOLTAGE DIGITAL TIMER SWITCH
S_{3T}	LINE VOLTAGE 3-WAY DIGITAL TIMER SWITCH
S_X	LINE VOLTAGE SPST EXPLOSION PROOF SWITCH
S_2X	LINE VOLTAGE DPST EXPLOSION PROOF SWITCH
⊕	20A, 125V DOUBLE DUPLEX CONVENIENCE OUTLET (NEMA 5 - 20R)
Φ	20A, 125V DUPLEX CONVENIENCE OUTLET (NEMA 5 - 20R)
⊕USB	20A, 125V DOUBLE DUPLEX CONVENIENCE OUTLET (NEMA 5 - 20R) WITH USB CHARGING PORTS.
ΦUSB	20A, 125V DUPLEX CONVENIENCE OUTLET (NEMA 5 - 20R) WITH USB CHARGING PORTS.
Φ	20A, 125V SIMPLEX OUTLET (NEMA 5 - 20R)
◐	20A, 125V RED DUPLEX CONVENIENCE OUTLET ON EMERGENCY SYSTEM (NEMA 5 - 20R)
CΦ FΦ	20A, 125V DUPLEX CONVENIENCE OUTLET - CEILING AND FLOOR MOUNTED (NEMA 5 - 20R)
⊙⊣	SPECIAL PURPOSE OUTLET, TYPE AS NOTED ON DRAWINGS.
⊡1	FLOOR BOX. ADJACENT NUMBER INDICATES FLOOR BOX TYPE. REFER TO THE FLOOR BOX SCHEDULE AND TELECOMMUNICATIONS SHEETS FOR ADDITIONAL INFORMATION.
Φ Φ Φ	SURFACE MOUNTED RACEWAY. TYPE AND NUMBER OF DEVICES AS INDICATED, REFER TO SPECIFICATION AND DETAIL.
◐ ◐ ◐	SURFACE MOUNTED RACEWAY (RED OUTLETS ON STANDBY SYSTEM). TYPE AND NUMBER OF DEVICES AS INDICATED, REFER TO SPECIFICATION AND DETAIL.
∽	PIGTAIL DENOTES CONNECTION TO EQUIPMENT
Ⓙ Ⓙ Ⓙ⊣ C F	JUNCTION BOX - CEILING, FLOOR, AND WALL MOUNTING. WALL MOUNTED DEVICES SHALL BE FLUSH MOUNTED AT 18" AFF UNLESS OTHERWISE NOTED.
▼	TELECOMMUNICATIONS OUTLET BOX SHOWN FOR REFERENCE ONLY. REFER TO THE TELECOMMUNICATIONS SHEETS FOR ROUGH-IN AND ADDITIONAL INFORMATION.
⌒➤	BRANCH CIRCUIT HOMERUN TO PANEL. NUMBER OF ARROWS INDICATES NUMBER OF CIRCUITS. NUMBER OF TICK MARKS INDICATES NUMBER OF WIRES (#12AWG, MINIMUM, UNLESS OTHERWISE NOTED). IF NO TICK MARKS ARE SHOWN, ASSUME 3-#12 AWG IN 3/4" CONDUIT.
⌒	CONDUIT AND WIRE CONCEALED. NUMBER OF TICK MARKS INDICATES NUMBER OF WIRES (#12AWG MINIMUM, UNLESS OTHERWISE NOTED) IF NO TICK MARKS ARE SHOWN, ASSUME 3-#12 AWG IN 3/4" CONDUIT.
⌒×	PARTIAL CIRCUIT
⌒•	CONDUIT RISER UP
⌒	CONDUIT RISER DOWN
—]	INDICATES BUSH AND CAP
⌒	CONDUIT SEAL FITTING FOR HAZARDOUS AREAS
⌿	CONDUIT STUBBED UP 6" AFF AND CAPPED

ELECTRICAL DISTRIBUTION EQUIPMENT

▬	LIGHTING AND APPLIANCE PANEL
▭	(LIGHTING) RELAY PANEL
▭▭▭	MOTOR CONTROL CENTER OR SWITCHBOARD
▧	POWER PANEL (DISTRIBUTION)
T	TRANSFORMER
⌒	CIRCUIT BREAKER
⏤⟋▭	FUSIBLE SWITCH
⟍	AUTOMATIC TRANSFER SWITCH
▭	POTENTIAL TRANSFORMER
▭	CURRENT TRANSFORMER
⏚	GROUND
AFM	ARC FLASH MAINTENANCE ENERGY REDUCTION SWITCH
GFP	GROUND FAULT PROTECTION
SPD	SURGE PROTECTION DEVICE
«⌒»	DRAWOUT TYPE CIRCUIT BREAKER
Ⓚ	KIRK-KEY INTERLOCK
Ⓖ	ENGINE GENERATOR
RGA	REMOTE GENERATOR ANNUNCIATOR
Ⓜ	METER
PNL #	PANELBOARD TAG. SEE THE CORRESPONDING PANELBOARD SCHEDULE AND/OR ONE LINE DIAGRAM FOR ADDITIONAL INFORMATION.

MOTOR CONTROL & MOTOR CONTROL EQUIPMENT

Ⓜ	MOTOR - HORSEPOWER AS INDICATED ON DRAWINGS
☐	NON-FUSED DISCONNECT SWITCH, ASSUME 30A/3P UNLESS OTHERWISE NOTED.
⧄	FUSED DISCONNECT SWITCH, ASSUME 30A/3P UNLESS OTHERWISE NOTED. FUSE SIZE AS NOTED ON DRAWINGS.
☒	COMBINATION FVNR MAGNETIC MOTOR STARTER WITH HOA SELECTOR SWITCH AND NON-FUSED DISCONNECT SWITCH, ASSUME NEMA SIZE 1 STARTER AND 30A/3P SWITCH UNLESS OTHERWISE NOTED.
☒	COMBINATION FVNR MAGNETIC MOTOR STARTER WITH HOA SELECTOR SWITCH AND FUSED DISCONNECT SWITCH, ASSUME NEMA SIZE 1 STARTER AND 30A/3P SWITCH UNLESS OTHERWISE NOTED. FUSE SIZE AS NOTED ON DRAWINGS.
⬚	MECHANICAL EQUIPMENT STARTER/DISCONNECT PROVIDED BY OTHERS, INSTALLED AND CONNECTED BY THE ELECTRICAL CONTRACTOR. FULLY COORDINATE ALL INSTALLATION AND CONNECTION DETAILS WITH THE MECHANICAL CONTRACTOR.
☒	FVNR MAGNETIC MOTOR STARTER WITH HOA SELECTOR SWITCH, ASSUME NEMA SIZE 1 STARTER UNLESS OTHERWISE NOTED.
⁚	START/STOP PUSH BUTTON
⁝	3 POSITION PUSH BUTTON
⊡	PUSH BUTTON
VFD	VARIABLE FREQUENCY DRIVE PROVIDED BY THE MECHANICAL CONTRACTOR, INSTALLED AND CONNECTED BY THE ELECTRICAL CONTRACTOR. FULLY COORDINATE ALL INSTALLATION AND CONNECTION DETAILS WITH THE MECHANICAL CONTRACTOR.

PROJECT GENERAL ELECTRICAL NOTES

GENERAL DEMOLITION NOTES:

1. ALL OF THE DEVICES SHOWN ON THE DEMOLITION PLANS ARE EXISTING. THE LOCATIONS OF EXISTING EQUIPMENT AND DEVICES WERE OBTAINED FROM PREVIOUS DRAWINGS AND SITE VISITS. THE LOCATIONS OF EXISTING EQUIPMENT AND DEVICES ARE SHOWN FOR THE CONVENIENCE OF THE CONTRACTOR. ACCURACY OF THE INFORMATION SHOWN IS NOT GUARANTEED. THE CONTRACTOR IS RESPONSIBLE FOR THE VERIFICATION OF ALL EXISTING CONDITIONS PRIOR TO SUBMITTING THE PROJECT BID. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR CHANGES WHICH OCCUR AFTER BIDS ARE SUBMITTED WHICH ARE A RESULT OF EXISTING CONDITIONS. SITE VISITS PRIOR TO SUBMISSION OF BIDS MUST BE FULLY COORDINATED WITH THE OWNER.

2. THE CONTRACTOR MUST FIELD VERIFY EXISTING CIRCUITING PRIOR TO COMMENCING ANY WORK. ALL BIDS MUST INCORPORATE THIS REQUIREMENT.

3. DEVICES SHOWN WITH CROSS HATCHING, DASHED AND/OR SO NOTED SHALL BE REMOVED. ALL OTHER DEVICES SHALL BE RELOCATED, SHALL REMAIN, OR SHALL BE ABANDONED AS SHOWN, OR AS FOLLOWS:

   DEVICES SHALL BE COMPLETELY REMOVED FROM WALLS THAT ARE ALSO SHOWN TO BE REMOVED. DEVICES SHOWN TO BE REMOVED ON DRYWALL OR PLASTER TYPE WALLS THAT ARE TO REMAIN SHALL HAVE THE WALL SURFACE PATCHED TO MATCH THE EXISTING FINISH. FLUSH TYPE DEVICES SHOWN TO BE REMOVED ON CONCRETE OR BRICK TYPE WALLS THAT ARE TO REMAIN SHALL HAVE THE DEVICES REMOVED AND BOXES PROVIDED WITH BLANK COVER PLATES.

4. CONDUITS SHALL BE COMPLETELY REMOVED FROM WALLS THAT ARE ALSO SHOWN TO BE REMOVED. CONCEALED CONDUITS MAY BE ABANDONED IN WALLS THAT ARE TO REMAIN. ALL CONDUITS AND BOXES THAT ARE SURFACE MOUNTED AND NO LONGER REQUIRE ACTIVE CIRCUITS SHALL BE REMOVED.

5. THE CONDUCTORS FOR DEVICES SHOWN TO BE REMOVED SHALL BE DISCONNECTED AND REMOVED BACK TO THE PANEL OR BACK TO THE NEXT DEVICE SHOWN TO REMAIN OR AS REQUIRED BY ACTUAL CIRCUITING. ACTUAL CIRCUITING MUST BE DETERMINED IN THE FIELD. ALL BIDS SHOULD INCORPORATE THIS REQUIREMENT. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR CHANGES WHICH OCCUR AS A RESULT OF EXISTING CIRCUITING. CONTINUITY OF CIRCUITING SHALL BE MAINTAINED FOR ALL EXISTING CIRCUITS AS REQUIRED. CONTRACTOR SHALL PROVIDE ALL NECESSARY WIRE, CONDUIT, DEVICES AND CONNECTIONS TO ENSURE CIRCUIT CONTINUITY TO ALL NEW AND EXISTING EQUIPMENT.

6. REFER TO ARCHITECTURAL DRAWINGS FOR WALL REMOVAL AND WALL TYPE.

7. THE OWNER HAS THE RIGHT TO RETAIN ALL SALVAGEABLE MATERIAL. ANY MATERIAL THE OWNER CHOOSES NOT TO ACCEPT SHALL BE REMOVED FROM THE SITE AND DISPOSED OF BY THE CONTRACTOR.

8. THE OWNER WILL OCCUPY PORTIONS OF THE FACILITY THROUGHOUT CONSTRUCTION. ELECTRICAL SYSTEMS TO OCCUPIED PORTIONS OF THE FACILITY MUST REMAIN IN OPERATION. THE ELECTRICAL CONTRACTOR MUST COORDINATE ALL PHASING REQUIREMENTS WITH THE GENERAL CONTRACTOR AND THE OWNER, AND MUST PROVIDE ALL NECESSARY DEVICES, EQUIPMENT, WIRE, CONDUIT, AND CONNECTIONS TO ENSURE PHASING AND OWNER OCCUPANCY REQUIREMENTS ARE SATISFIED. ALL BIDS SHOULD INCORPORATE THIS REQUIREMENT. NO ADDITIONAL COMPENSATION WILL BE ALLOWED FOR ISSUES AND CHANGES WHICH OCCUR AS A RESULT OF PHASING AND OWNER OCCUPANCY REQUIREMENTS.

9. FOR DEVICES THAT ARE TO REMAIN, ALL ASSOCIATED CONDUIT THAT IS ATTACHED TO OR SUPPORTED BY OTHER SYSTEMS OR EQUIPMENT SHOWN TO BE REMOVED ON OTHER DISCIPLINES' DRAWINGS IN THIS CONSTRUCTION SET, SHALL BE RE-SUPPORTED OR RE-ROUTED TO ACCOMMODATE THE REMOVAL OF OTHER SYSTEMS.

10. CONTRACTOR SHALL TRACE AND INVENTORY ALL CIRCUITS AND LOW VOLTAGE CABLING WITHIN AREA OF DEMOLITION TO ENSURE THAT NO CONDUIT, CONDUCTORS OR LOW VOLTAGE CABLING ARE REMOVED THAT SERVE DEVICES THAT ARE TO REMAIN. ALL EXISTING TO REMAIN CONDUIT, CONDUCTORS, AND LOW VOLTAGE CABLING SHALL BE PROTECTED DURING THE DURATION OF CONSTRUCTION.

11. FULLY COORDINATE REMOVAL OF ALL LOW VOLTAGE DEVICES AND ASSOCIATED CABLING WITH OWNER'S INFORMATION TECHNOLOGY REPRESENTATIVES.

12. FOR ANY ELECTRICAL DEVICE INSTALLATION REQUIRING SAW CUTTING OR CORE DRILLING OF THE CONCRETE SLAB, CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ANY AND ALL UNDERSLAB OR IN-SLAB UTILITIES AND/OR SYSTEMS BEFORE CUTTING. ANY DAMAGE DONE TO EXISTING SYSTEMS/UTILITIES SHALL BE FULLY REPAIRED BY THE CONTRACTOR AT NO ADDITIONAL EXPENSE TO THE OWNER.

GENERAL POWER NOTES:

1. FULLY COORDINATE THE INSTALLATION OF ALL ELECTRICAL DEVICES WITH THE WORK OF OTHER TRADES.

2. UNLESS OTHERWISE NOTED, ELECTRICAL DEVICES ARE TO BE FLUSH MOUNTED AND ALL WIRE AND CONDUIT IS TO BE ROUTED CONCEALED. FULLY COORDINATE INSTALLATION WITH EXISTING CONDITIONS, AND INCLUDE PATCHING AND REFINISHING OF EXISTING SURFACES TO ACCOMMODATE THIS REQUIREMENT.

3. SEAL AROUND ALL CONDUIT AND CABLE PENETRATIONS THROUGH WALLS, CEILINGS AND FLOORS TO MAINTAIN CODE REQUIRED RATINGS. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.

4. UNLESS OTHERWISE INDICATED PROVIDE DEDICATED NEUTRAL CONDUCTORS FOR ALL BRANCH CIRCUITS. NEUTRAL CONDUCTORS SHALL NOT BE SHARED BETWEEN CIRCUITS. WHERE THE DRAWINGS INDICATE SHARED NEUTRAL CONDUCTORS FOR A MULTIWIRE BRANCH CIRCUIT, GROUP BREAKERS TOGETHER IN ACCORDANCE WITH CODE.

CLARK & ENERSEN

Architecture \ Engineering \ Planning \
Landscape Architecture \ Commissioning

clarkenersen.com

? # ? - #

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

COLORADO LICENSED PROFESSIONAL ENGINEER
DANIEL ALBIN WROBLEWSKI
58949

7-6-26

Electrical Abbreviations, Symbols Legend & General Notes

E0.00

Plot Time Stamp: 7/6/2026 12:20:04 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_E26.rvt

FIRST FLOOR - ELECTRICAL ORIENTATION PLAN NOTES	
KEY NOTE	DESCRIPTION
1	AREA ENCLOSED BY DASHED LINE INDICATED IS PRIMARY AREA OF WORK. SEE POWER & AUXILIARY SYSTEMS PLANS FOR ADDITIONAL INFORMATION AND SCOPE OF WORK.

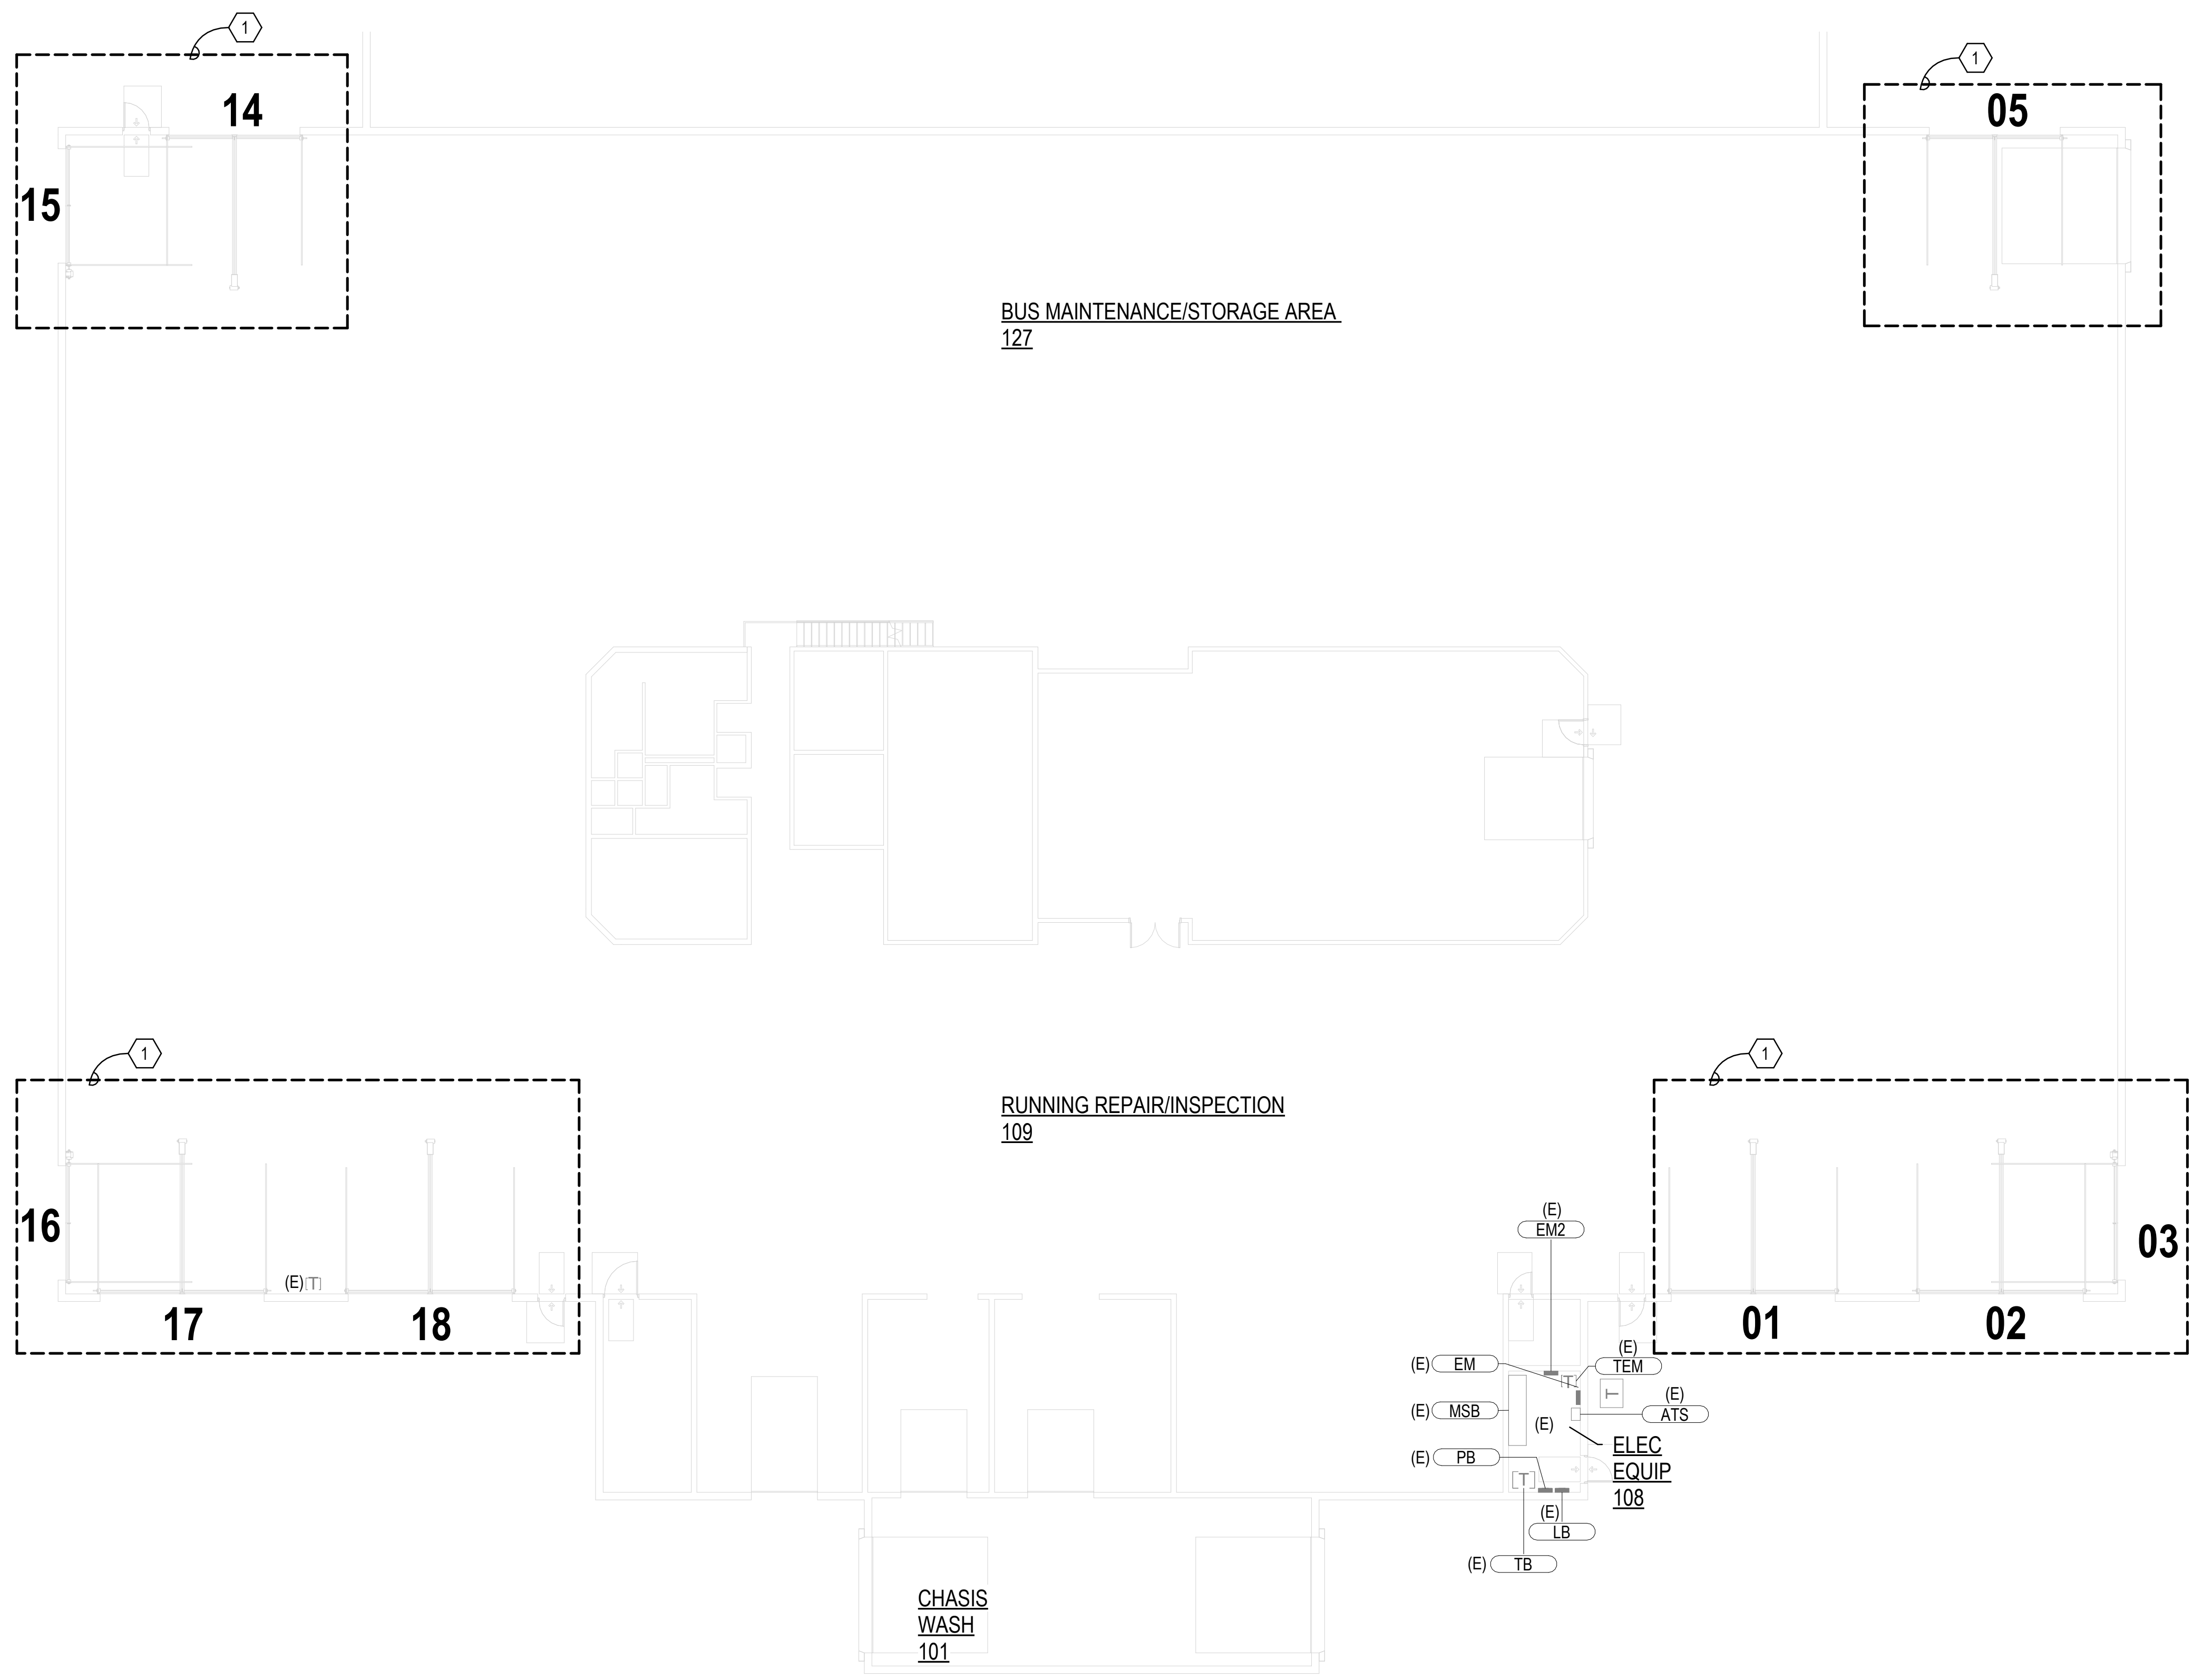
1
14
15
05
BUS MAINTENANCE/STORAGE AREA
127
RUNNING REPAIR/INSPECTION
109
16
17
(E) T
18
01
02
03
(E)
EM2
(E) EM
(E) TEM
(E) MSB
(E) ATS
(E)
ELEC
EQUIP
108
(E) PB
(E) LB
(E) TB
CHASIS
WASH
101

FIRST FLOOR ELECTRICAL ORIENTATION PLANS

SCALE: 1/16" = 1'-0"

0 8' 16' 32'

CLARK & ENERSEN

**Architecture \ Engineering \ Planning **
Landscape Architecture \ Commissioning

clarkenersen.com

? # ?-#

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

COLORADO LICENSED PROFESSIONAL ENGINEER
58949

7-6-26

First Floor Electrical Orientation Plans

E0.11

Plot Time Stamp: 7/6/2026 12:20:04 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_E26.rvt

MEZZANINE FLOOR ELECTRICAL ORIENTATION PLAN NOTES	
KEY NOTE	DESCRIPTION

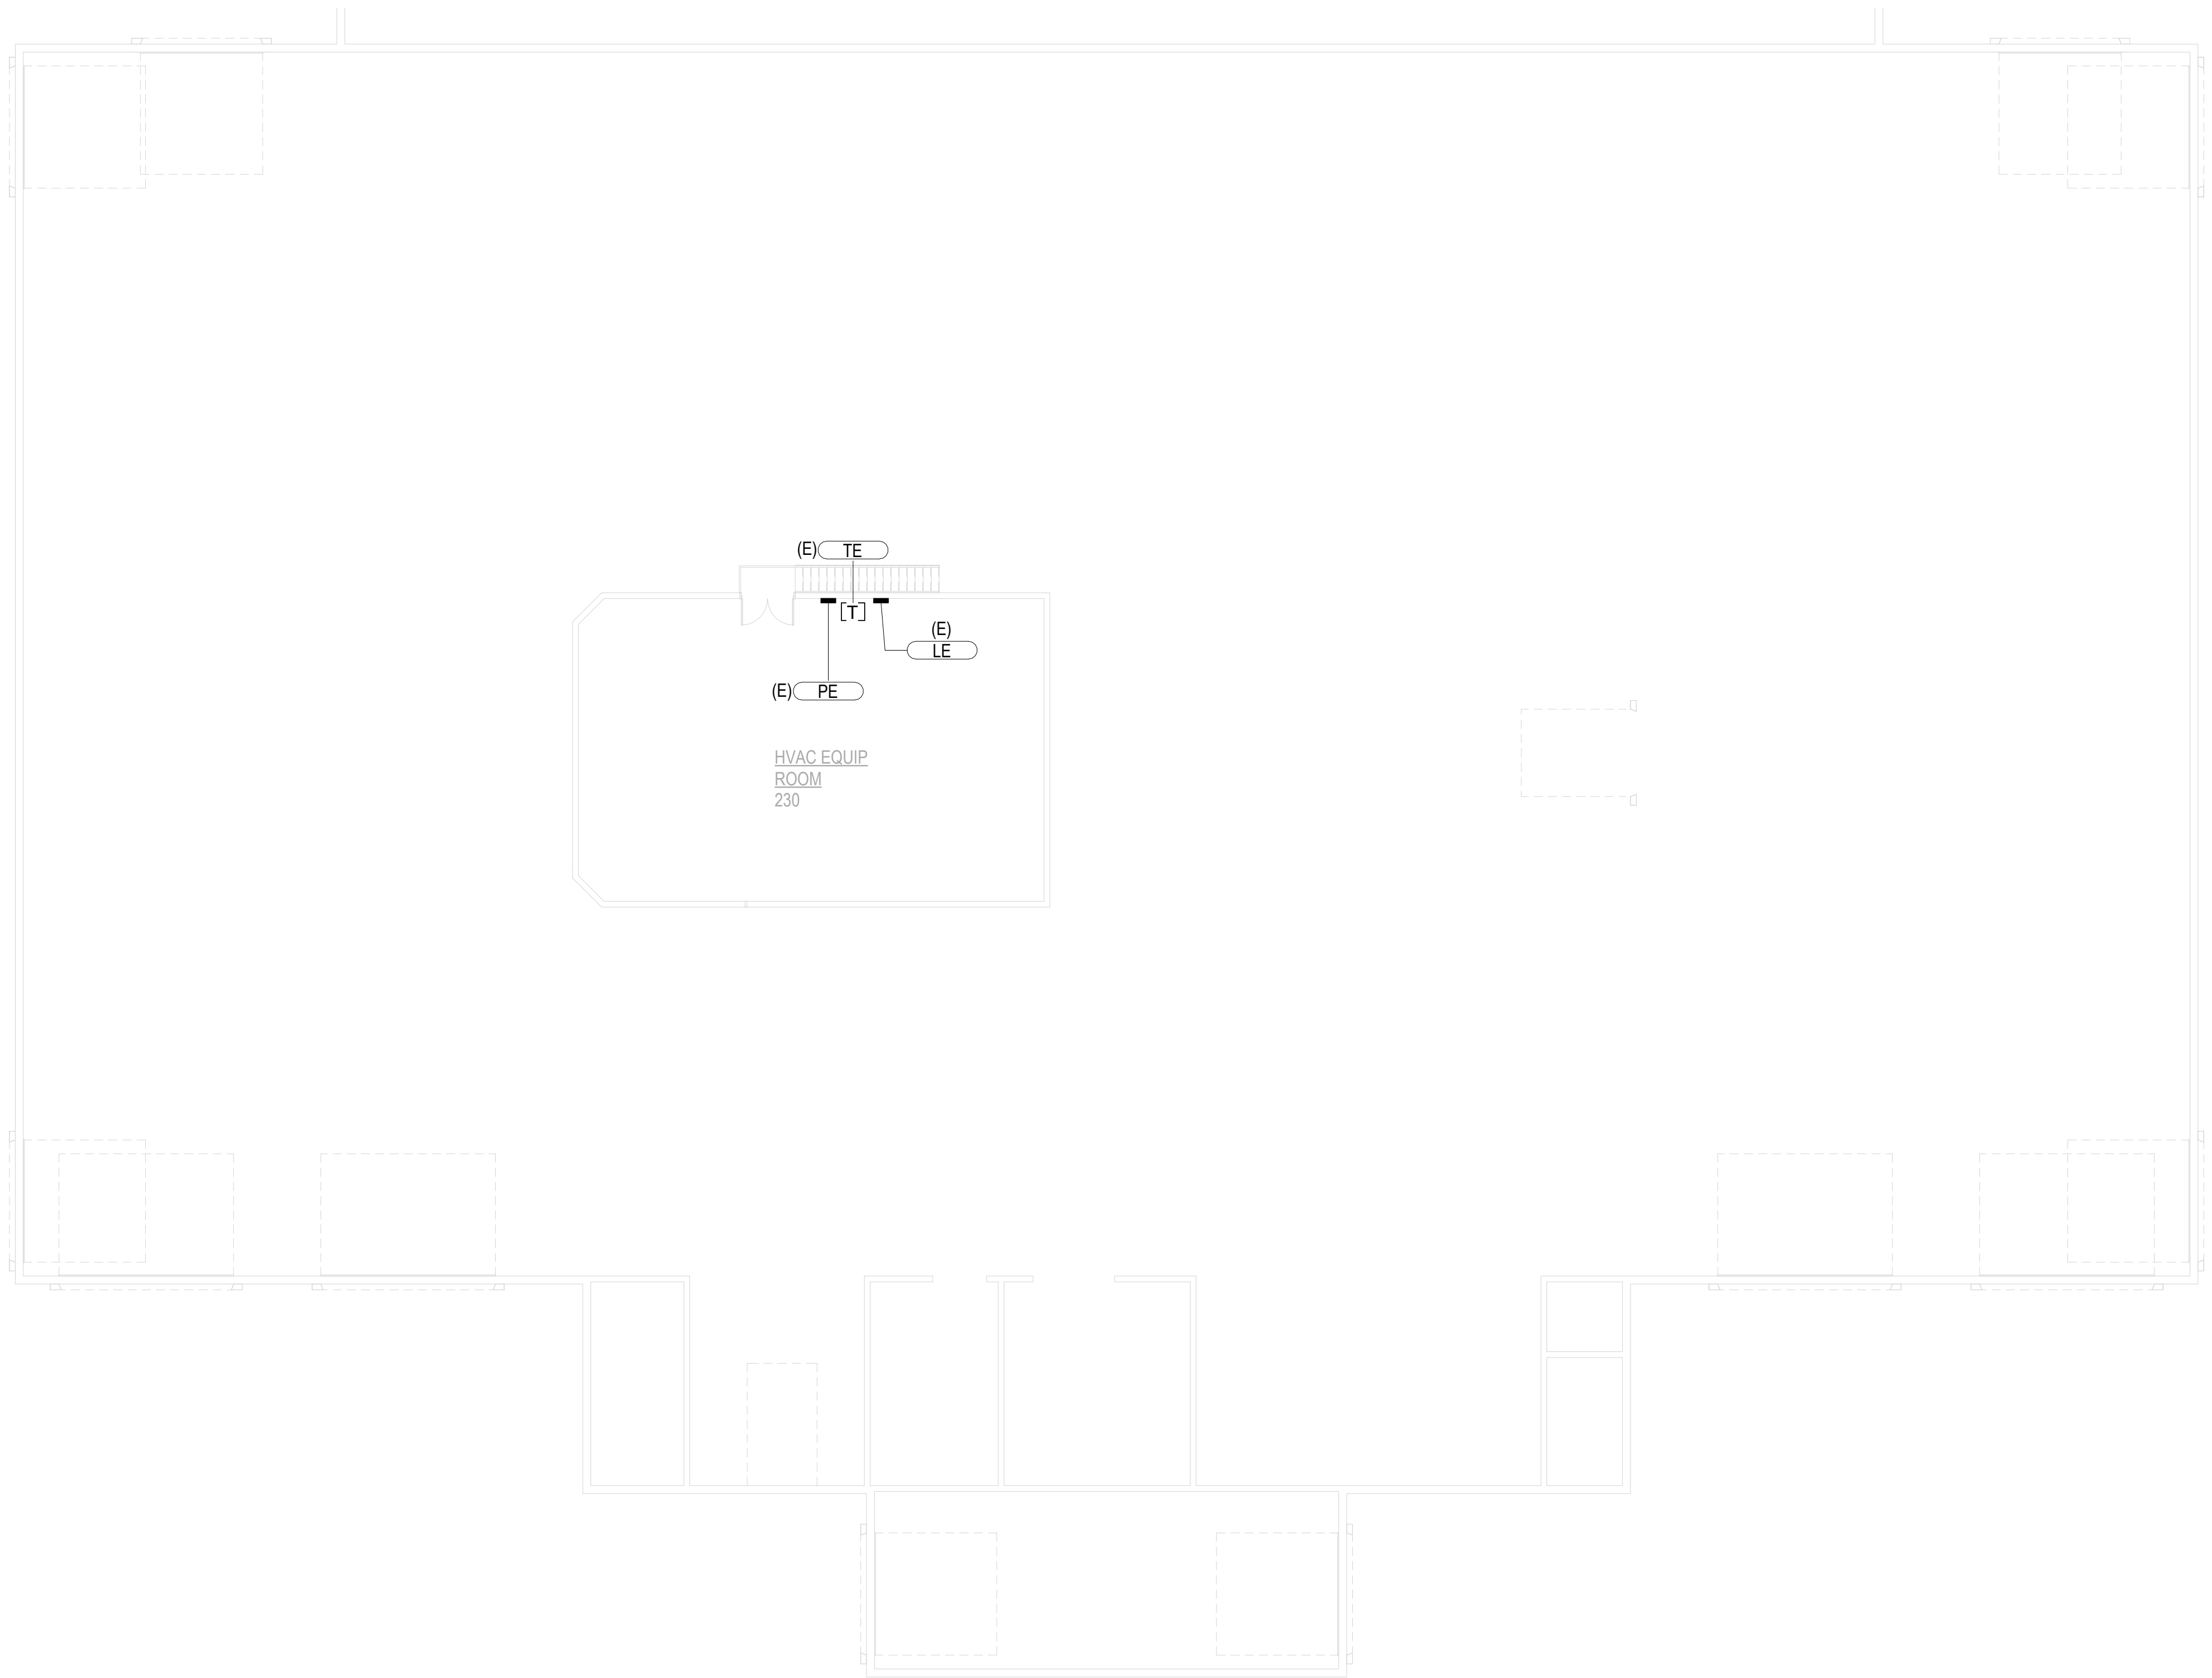

MEZZANINE FLOOR ELECTRICAL ORIENTATION PLAN

SCALE: 1/16" = 1'-0"

0 8' 16' 32'

CLARK & ENERSEN

Architecture \ Engineering \ Planning \
Landscape Architecture \ Commissioning

clarkenersen.com

? # ?-#

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

DANIEL ALBIN WROBLEWSKI
58949

7-6-26

Mezzanine Floor Electrical Orientation Plan

E0.12

Plot Time Stamp: 7/6/2026 12:20:05 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_E26.rvt

FIRST FLOOR - ELECTRICAL DEMOLITION PLAN NOTES	
KEY NOTE	DESCRIPTION
1	EXISTING MOTORIZED DOOR GARAGE DOOR OPENER TO BE DEMOLISHED. EXISTING WIRING AND BACKBOXES TO BE RE-UTILIZED AS APPLICABLE FOR INSTLLATION OF REPLACEMENT MOTOR. SEE POWER & AUXILIARY SYSTEMS PLAN FOR ADDITIONAL INFORMATION.
2	EXISTING PUSHBUTTON DOOR OPENER TO BE DEMOLISHED. EXISTING WIRING AND BACKBOXES TO BE RE-UTILIZED AS APPLICABLE FOR INSTLLATION OF REPLACEMENT PUSHBUTTON. SEE POWER & AUXILIARY SYSTEMS PLAN FOR ADDITIONAL INFORMATION.
3	EXISTING PUSHBUTTON DOOR OPENER TO BE REMAIN. REUTILIZED AS APPLICABLE FOR INSTALLATION OF REPLACEMENT MOTORIZED GARAGE DOOR OPENER. SEE POWER & AUXILIARY SYSTEMS PLAN FOR ADDITIONAL INFORMATION.

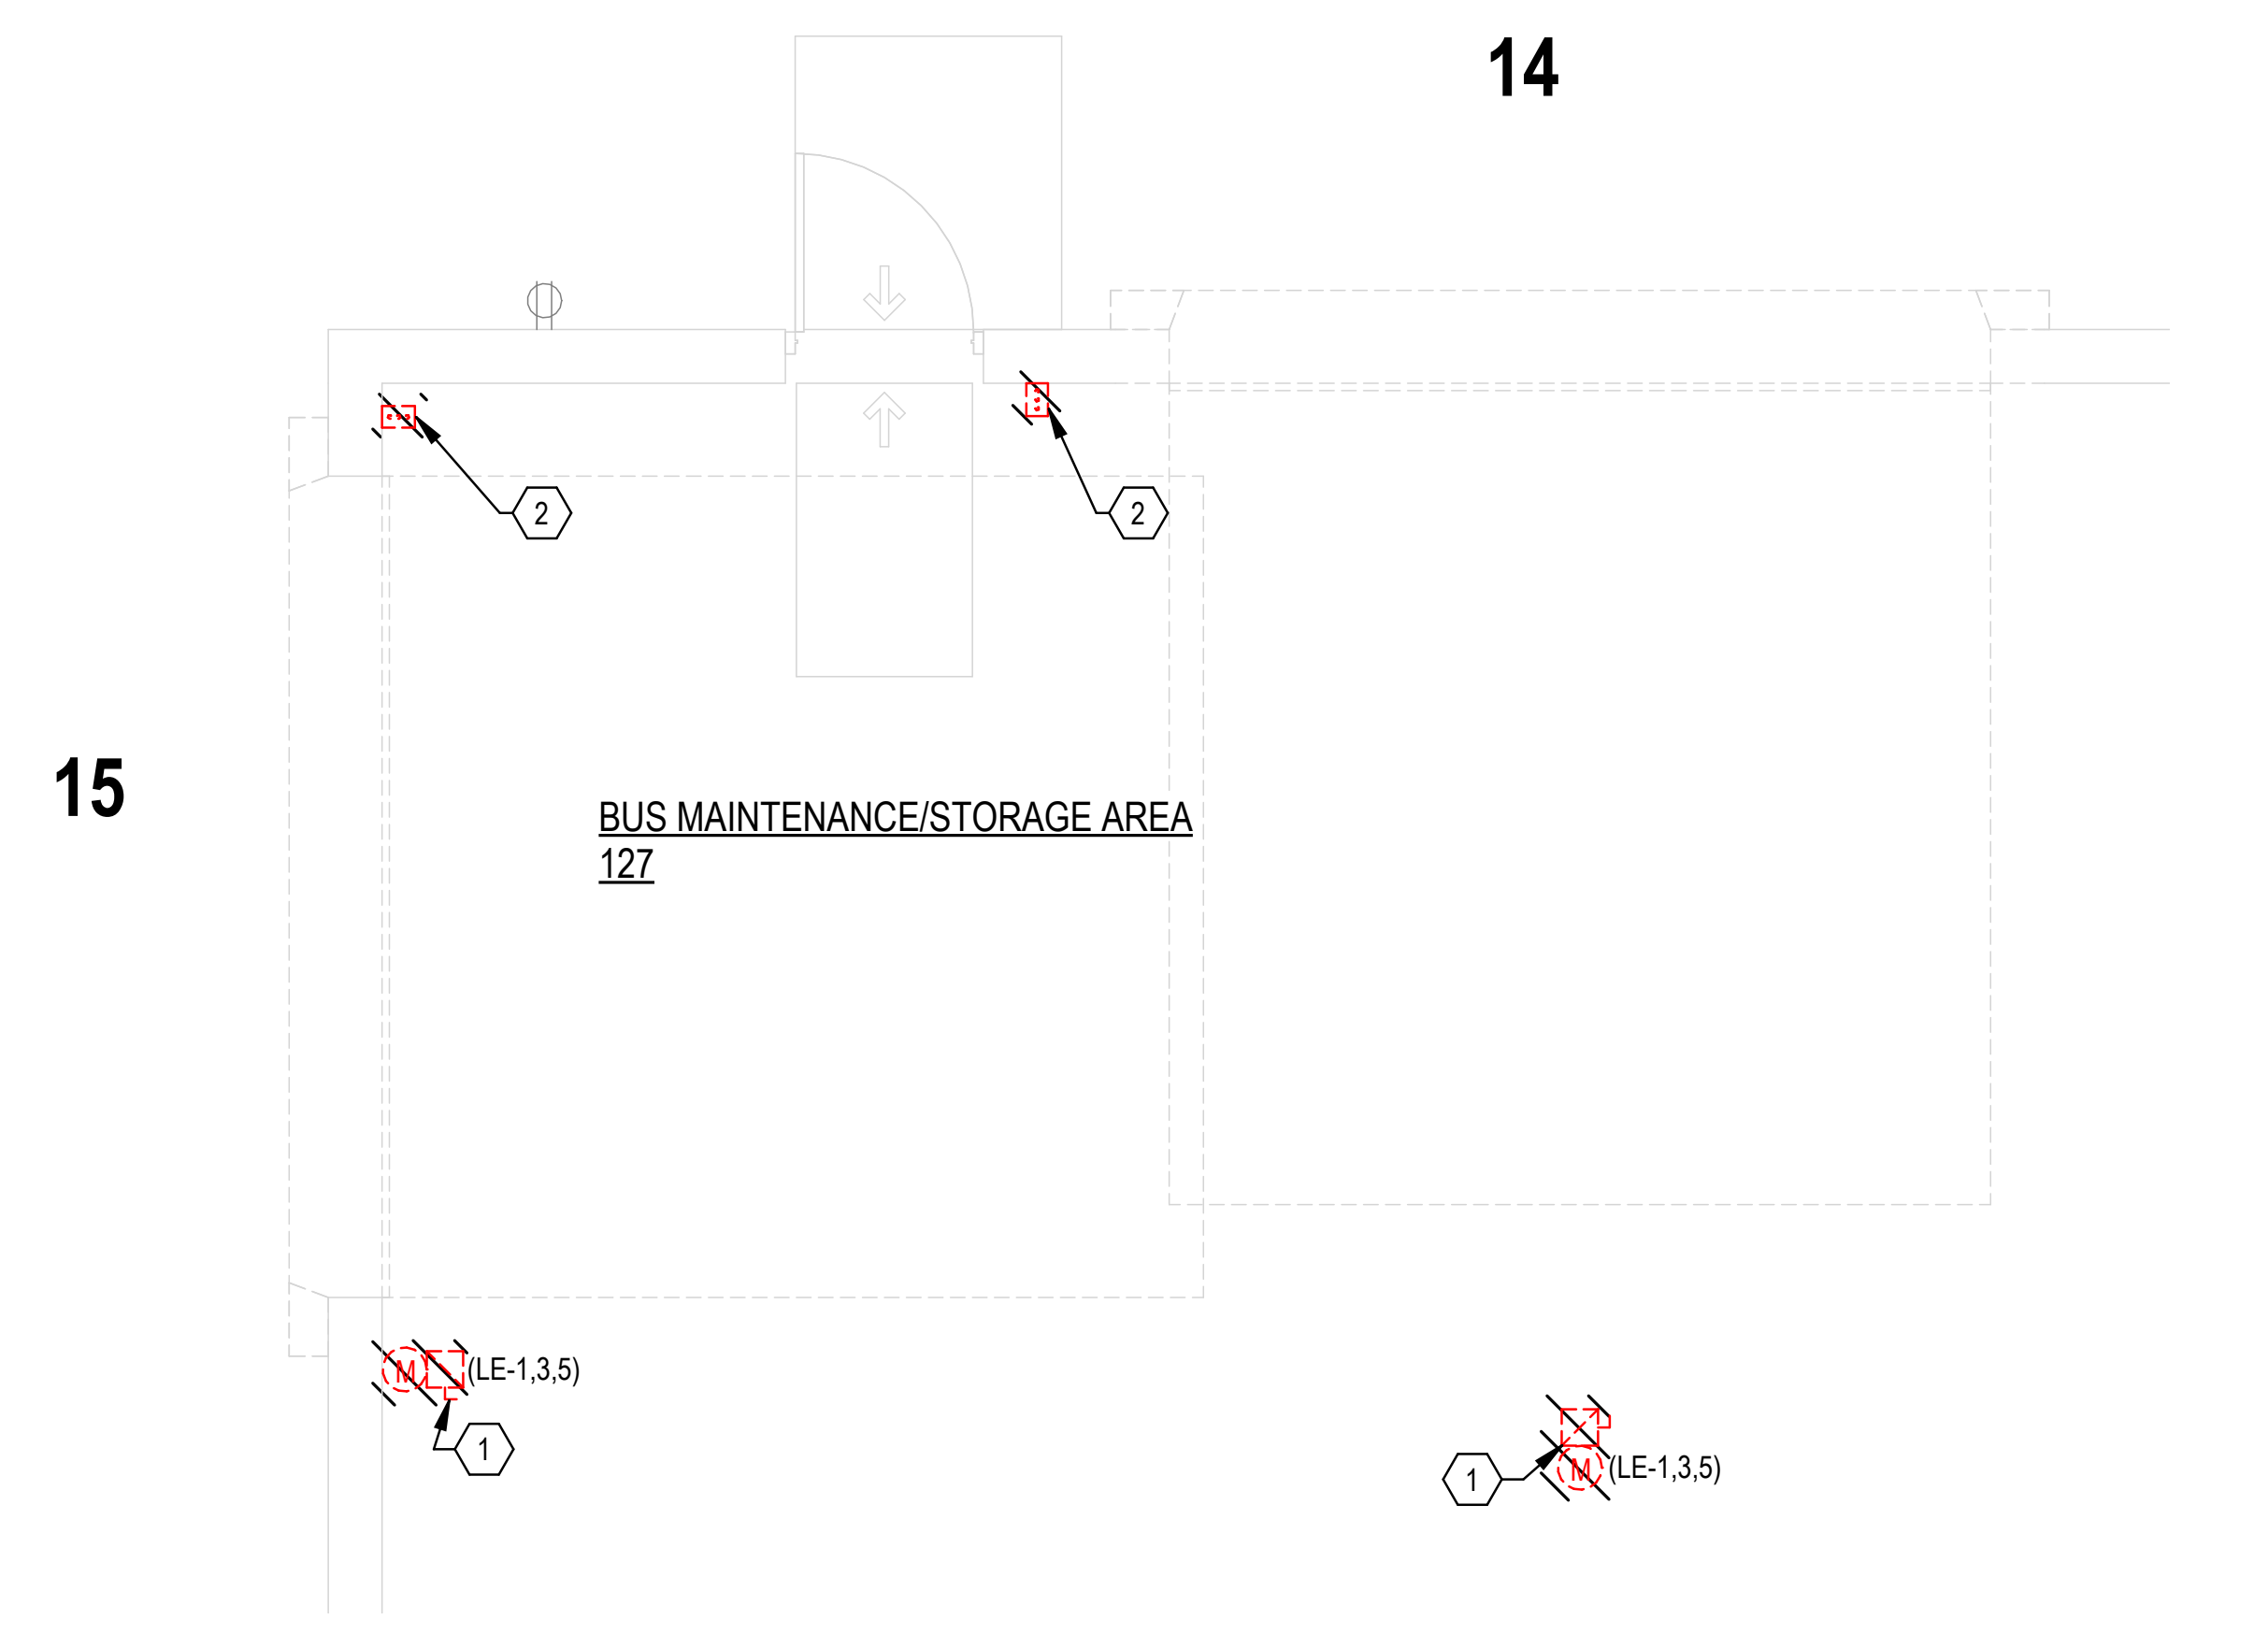
14
15
2
2
BUS MAINTENANCE/STORAGE AREA
127
(LE-1,3,5)
1
1
(LE-1,3,5)

FIRST FLOOR ELECTRICAL DEMOLITION PLAN NW

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

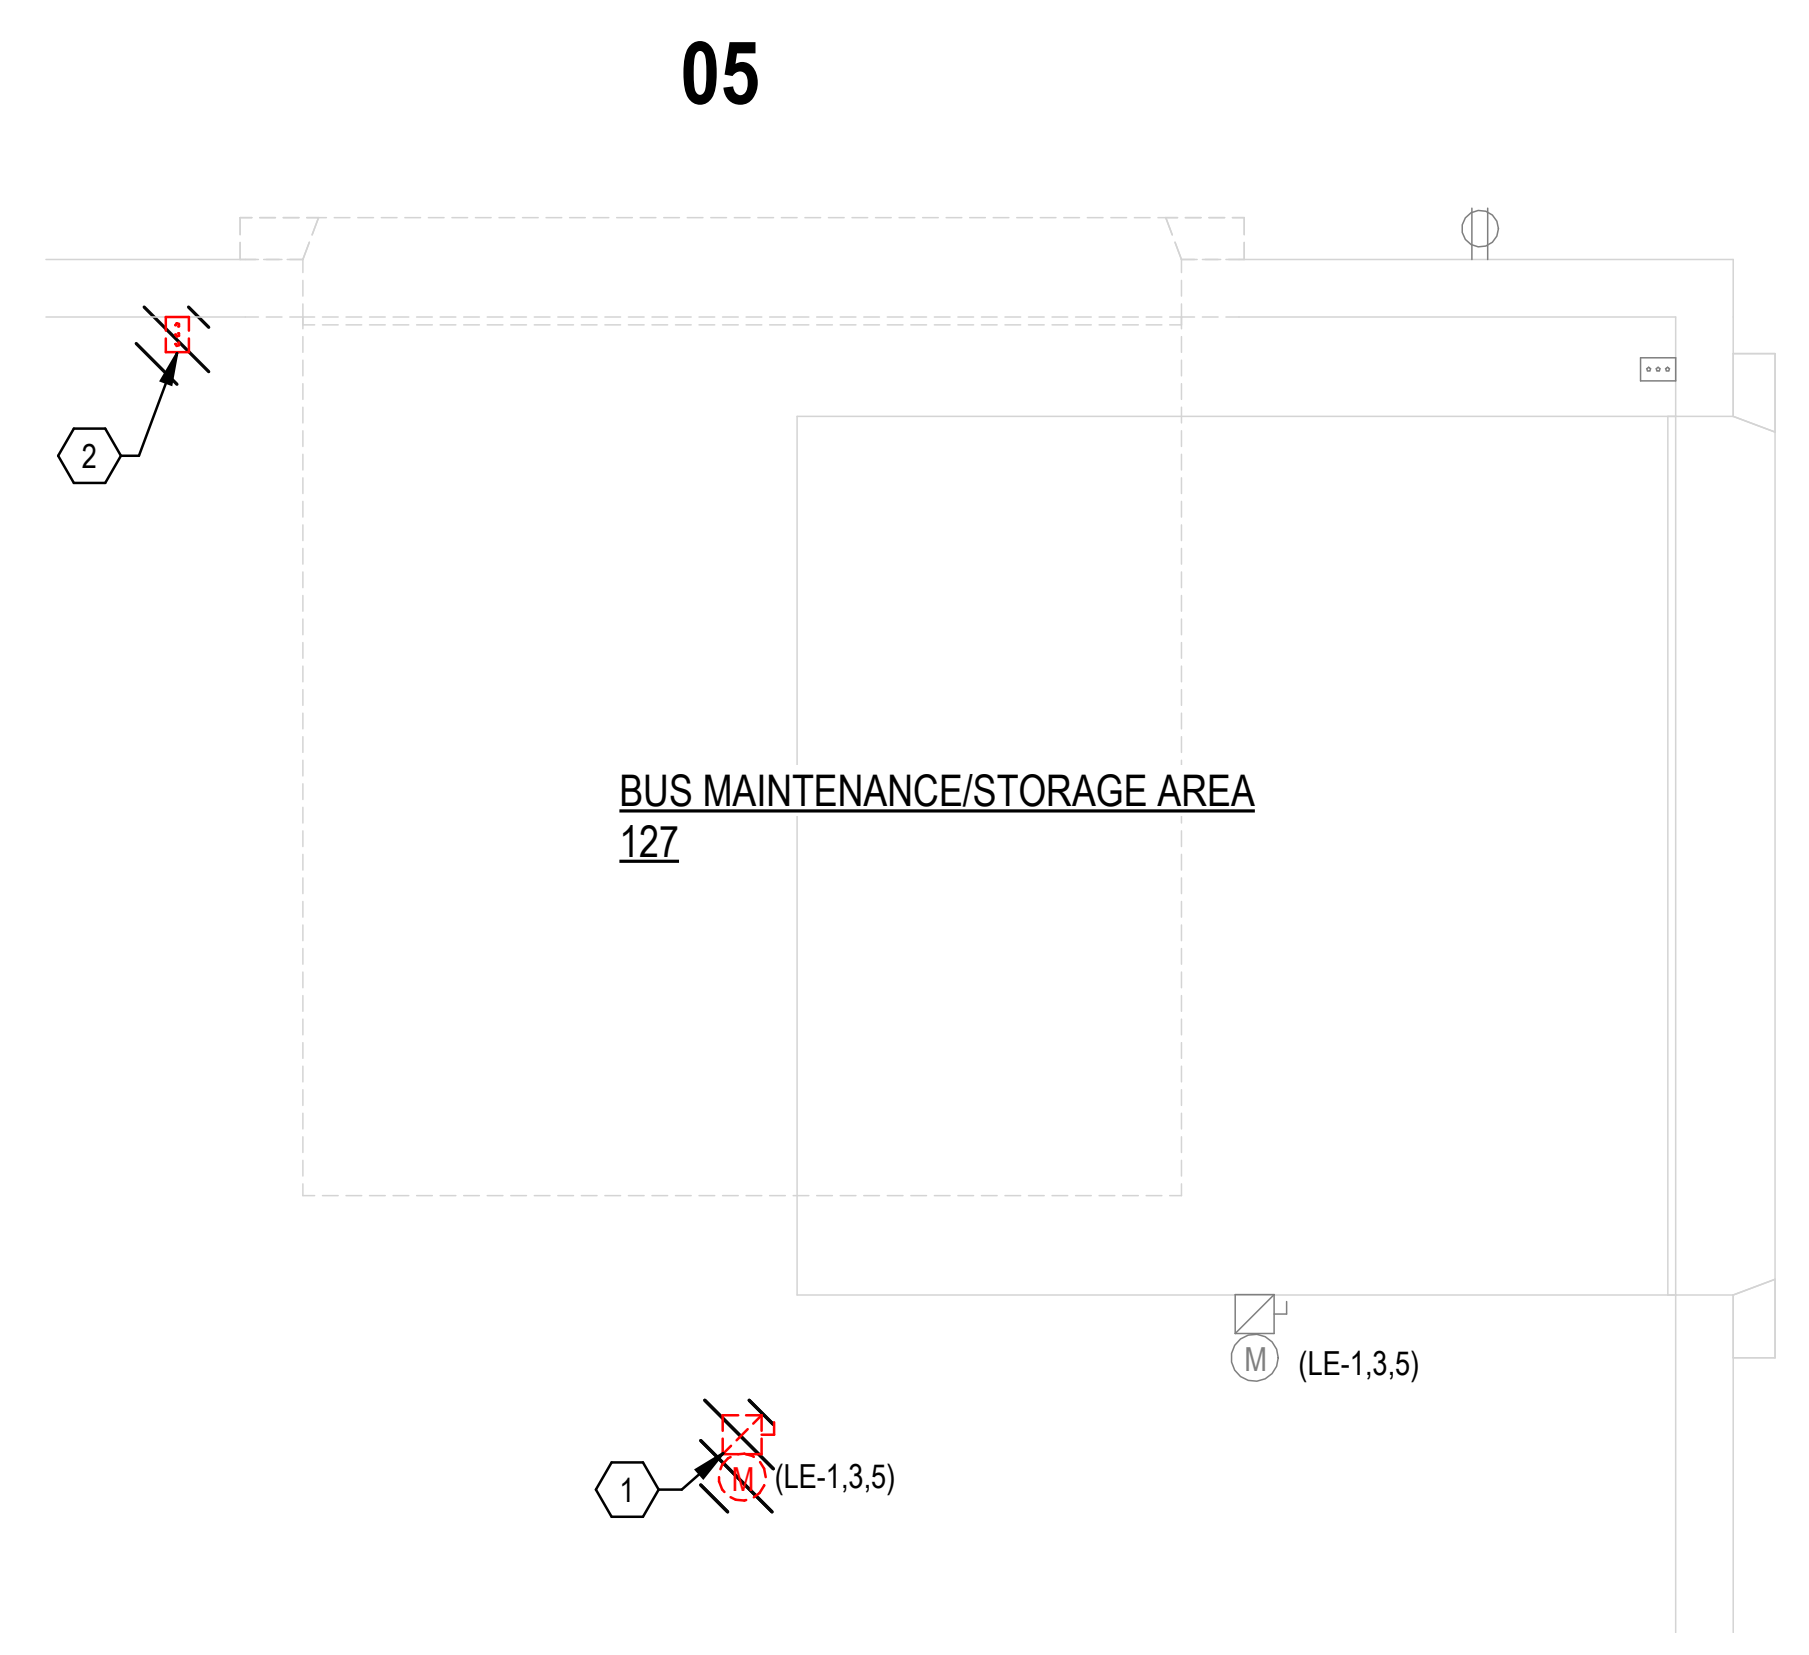
05
2
BUS MAINTENANCE/STORAGE AREA
127
M
(LE-1,3,5)
1
(LE-1,3,5)

FIRST FLOOR ELECTRICAL DEMOLITION PLAN NE

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

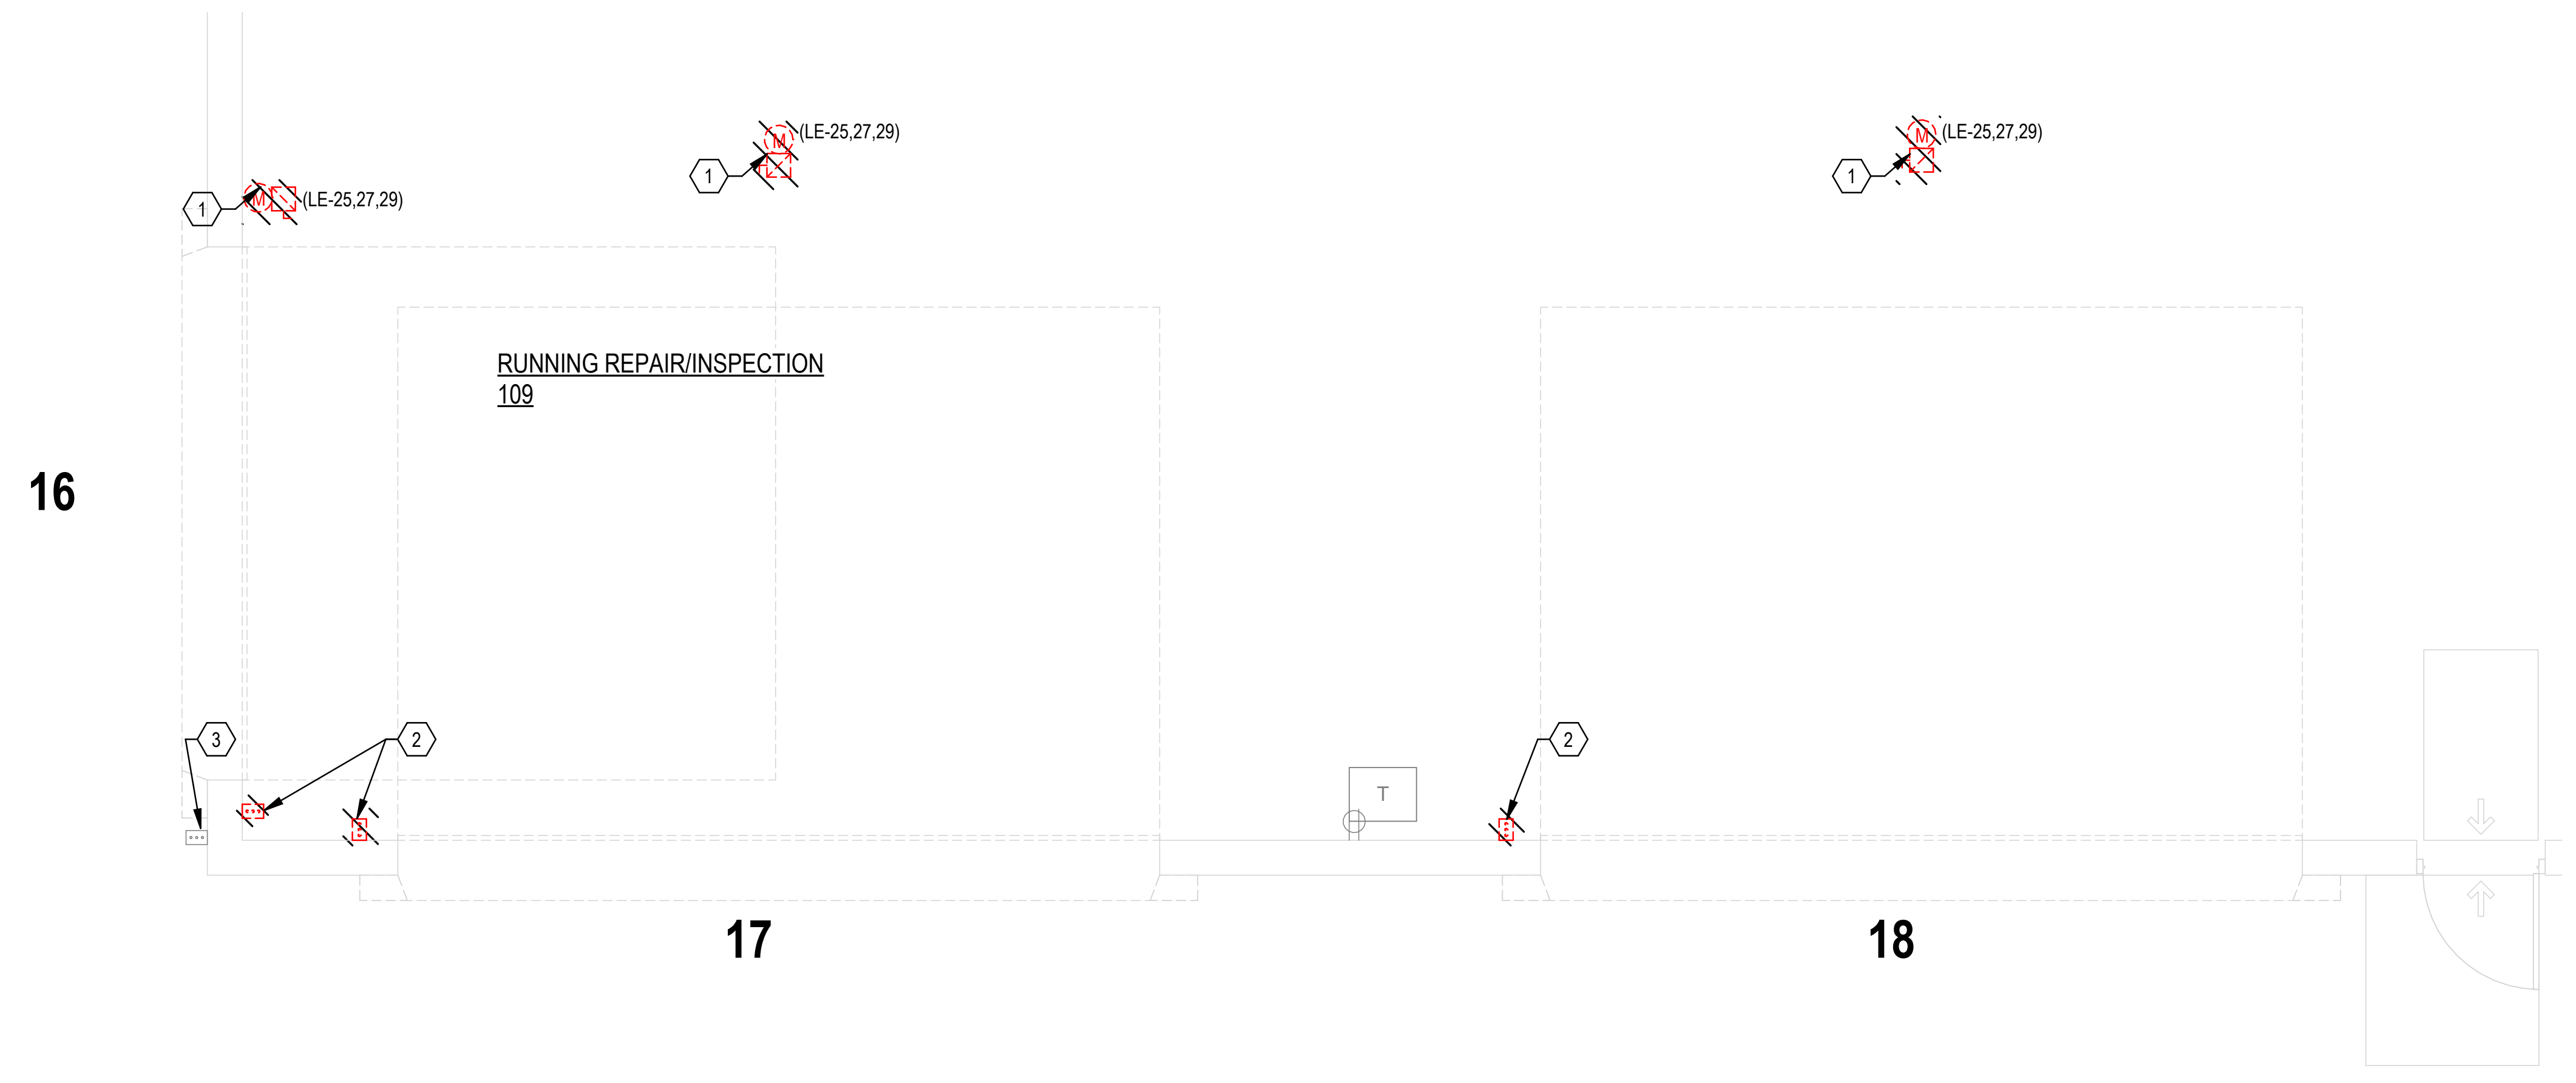
1
(LE-25,27,29)
1
(LE-25,27,29)
1
(LE-25,27,29)
16
RUNNING REPAIR/INSPECTION
109
3
2
T
2
17
18

FIRST FLOOR ELECTRICAL DEMOLITION PLAN SW

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

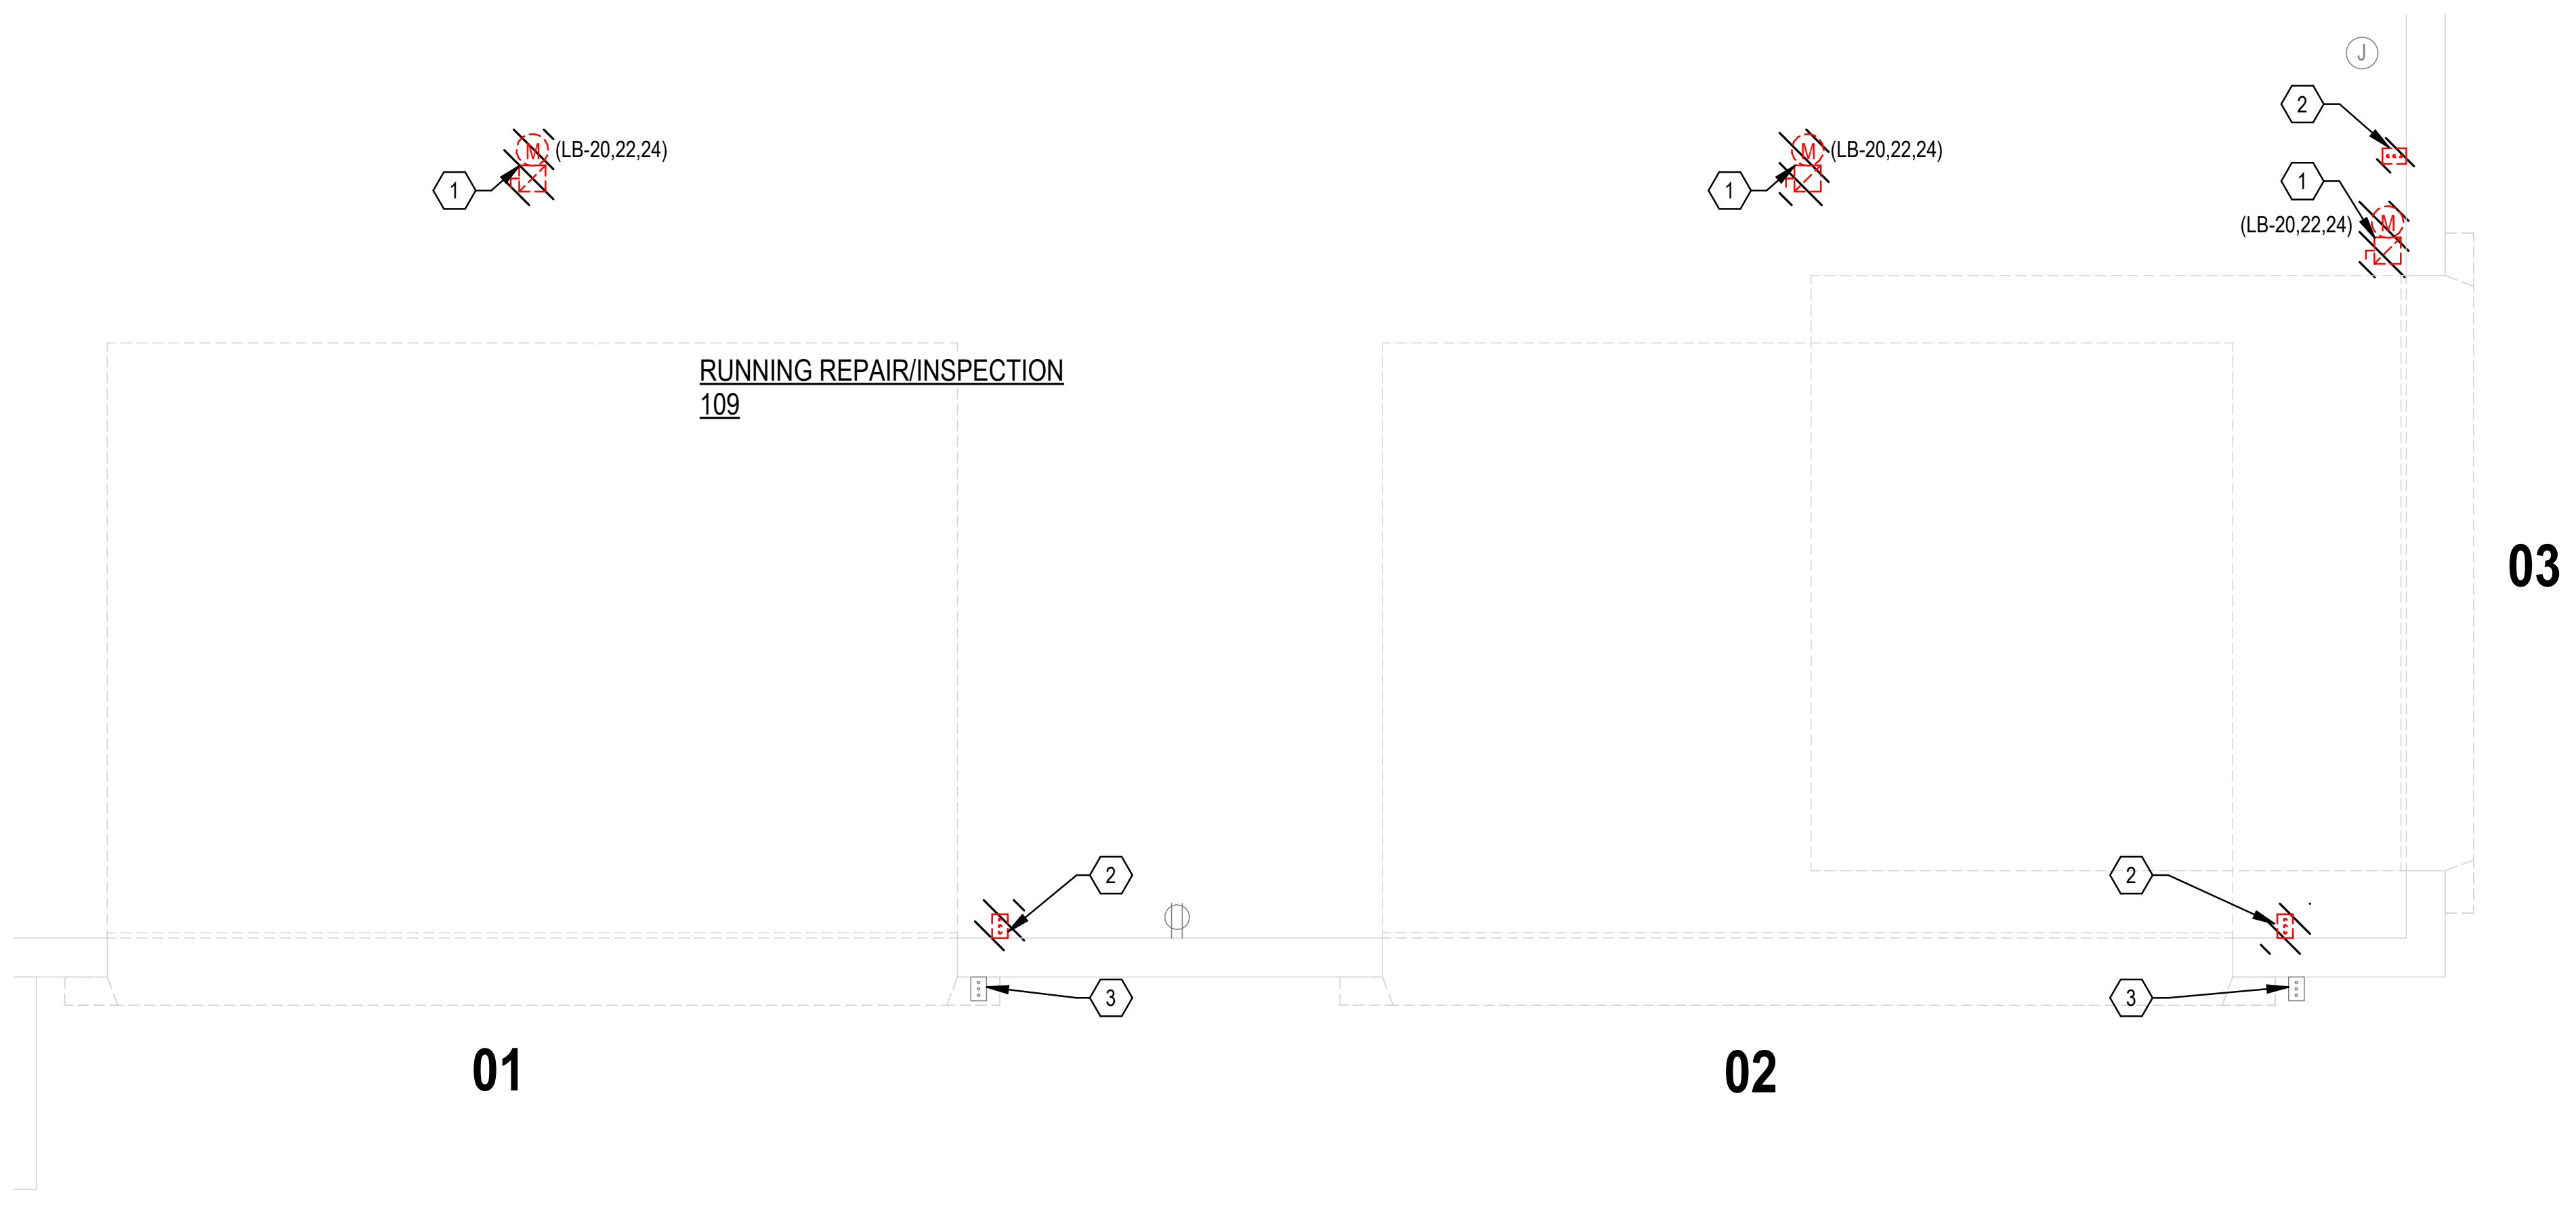
1
(LB-20,22,24)
1
(LB-20,22,24)
J
2
1
(LB-20,22,24)
RUNNING REPAIR/INSPECTION
109
03
2
3
2
3
01
02

FIRST FLOOR ELECTRICAL DEMOLITION PLAN SE

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

CLARK & ENERSEN

**Architecture \ Engineering \ Planning **
Landscape Architecture \ Commissioning

clarkenersen.com

? # ?-#

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

58949

7-6-26

First Floor Electrical Demolition Plan

E0.21

Plot Time Stamp: 7/6/2026 12:20:05 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_E26.rvt

FIRST FLOOR - POWER & AUXILIARY SYSTEMS PLAN NOTES

KEY NOTE	DESCRIPTION
1	CIRCUIT NEW OVERHEAD DOOR TO EXISTING OVERHEAD DOOR CIRCUIT SERVICING THE AREA. CONTRACTOR TO VERIFY EXISTING CIRCUIT LOADS PRIOR TO CONSTRUCTION. INTERCEPT, EXTEND, AND CONNECT EXISTING CIRCUITRY AS REQUIRED. PROVIDE ALL NECESSARY CONNECTIONS BETWEEN OVERHEAD DOOR MOTOR AND CONTROLLER. COORDINATE CONNECTION REQUIREMENTS WITH THE MANUFACTURE/INSTALLER. COORDINATE CONTROLLER LOCATION WITH THE OWNER AND ARCHITECT.
2	CIRCUIT EXISTING KEYED OPENER TO NEW GARAGE DOOR OPENER. INTERCEPT, EXTEND, AND CONNECT EXISTING CIRCUITRY AS REQUIRED.
3	CONTRACTOR TO PROTECT ELECTRICAL OVERHEAD DOOR DURING CONSTRUCTION.

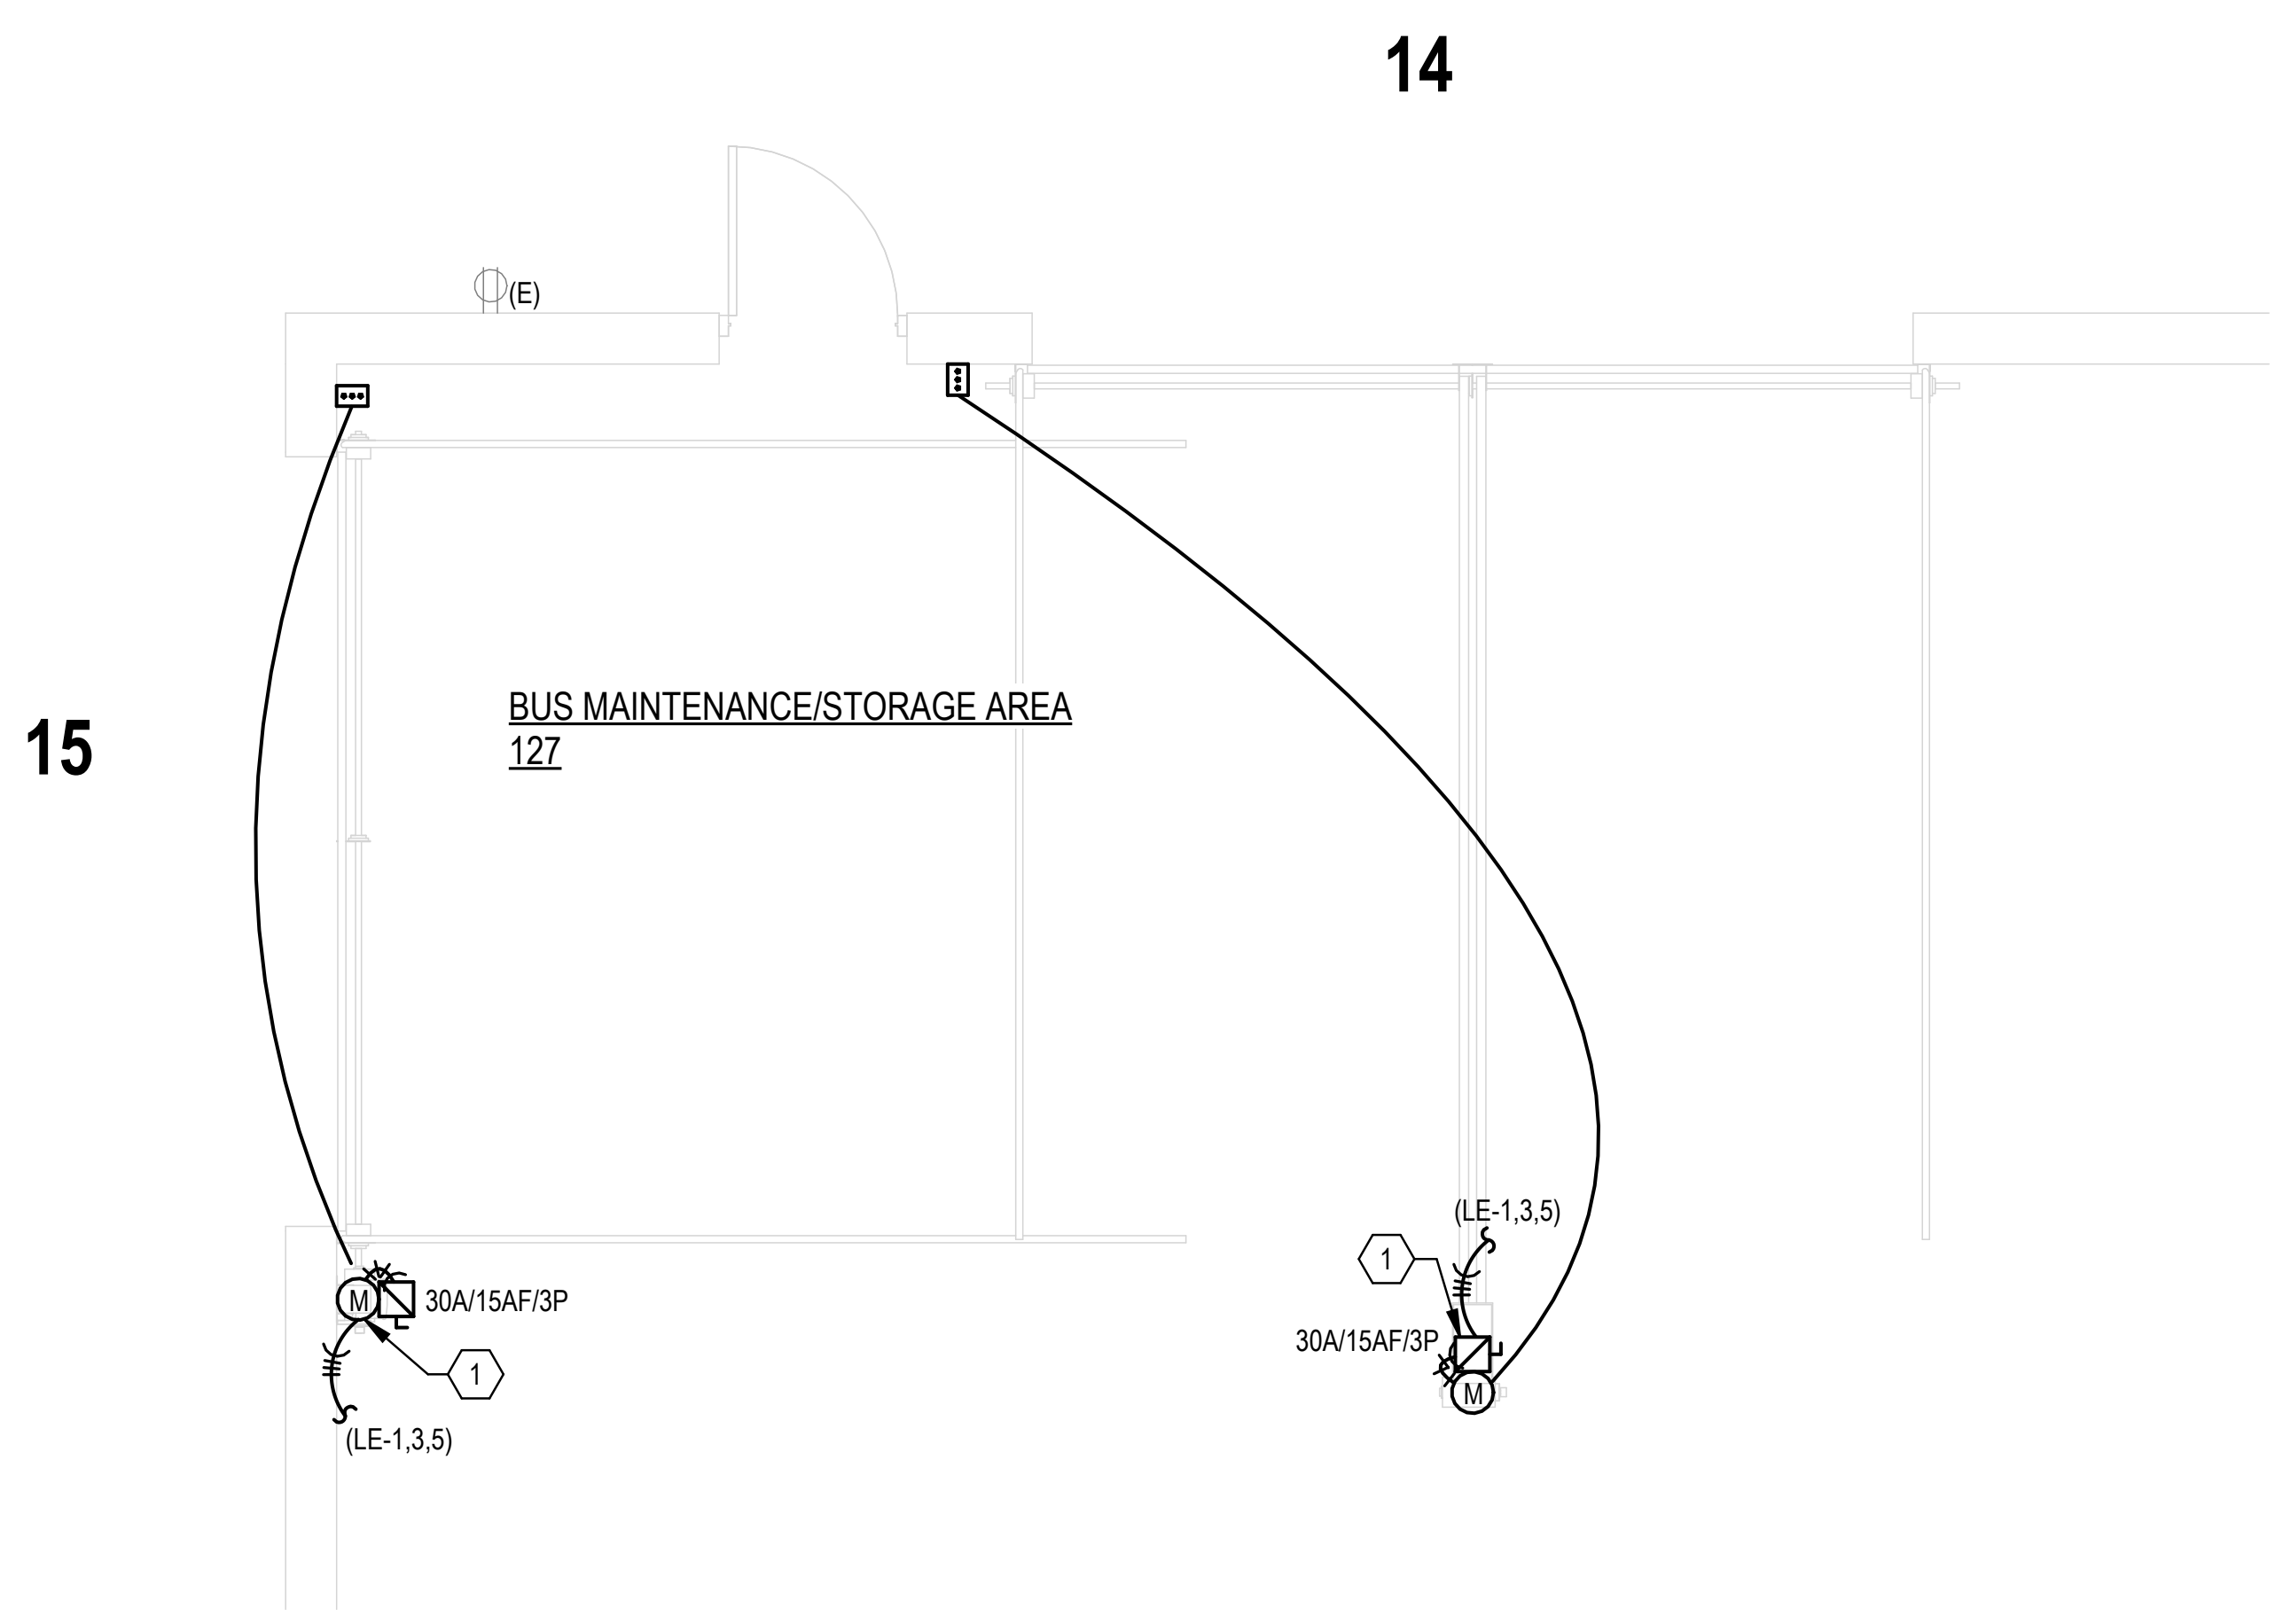
14
15
(E)
BUS MAINTENANCE/STORAGE AREA
127
30A/15AF/3P
1
(LE-1,3,5)
M
(LE-1,3,5)
1
30A/15AF/3P
M

FIRST FLOOR POWER PLAN - NW

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

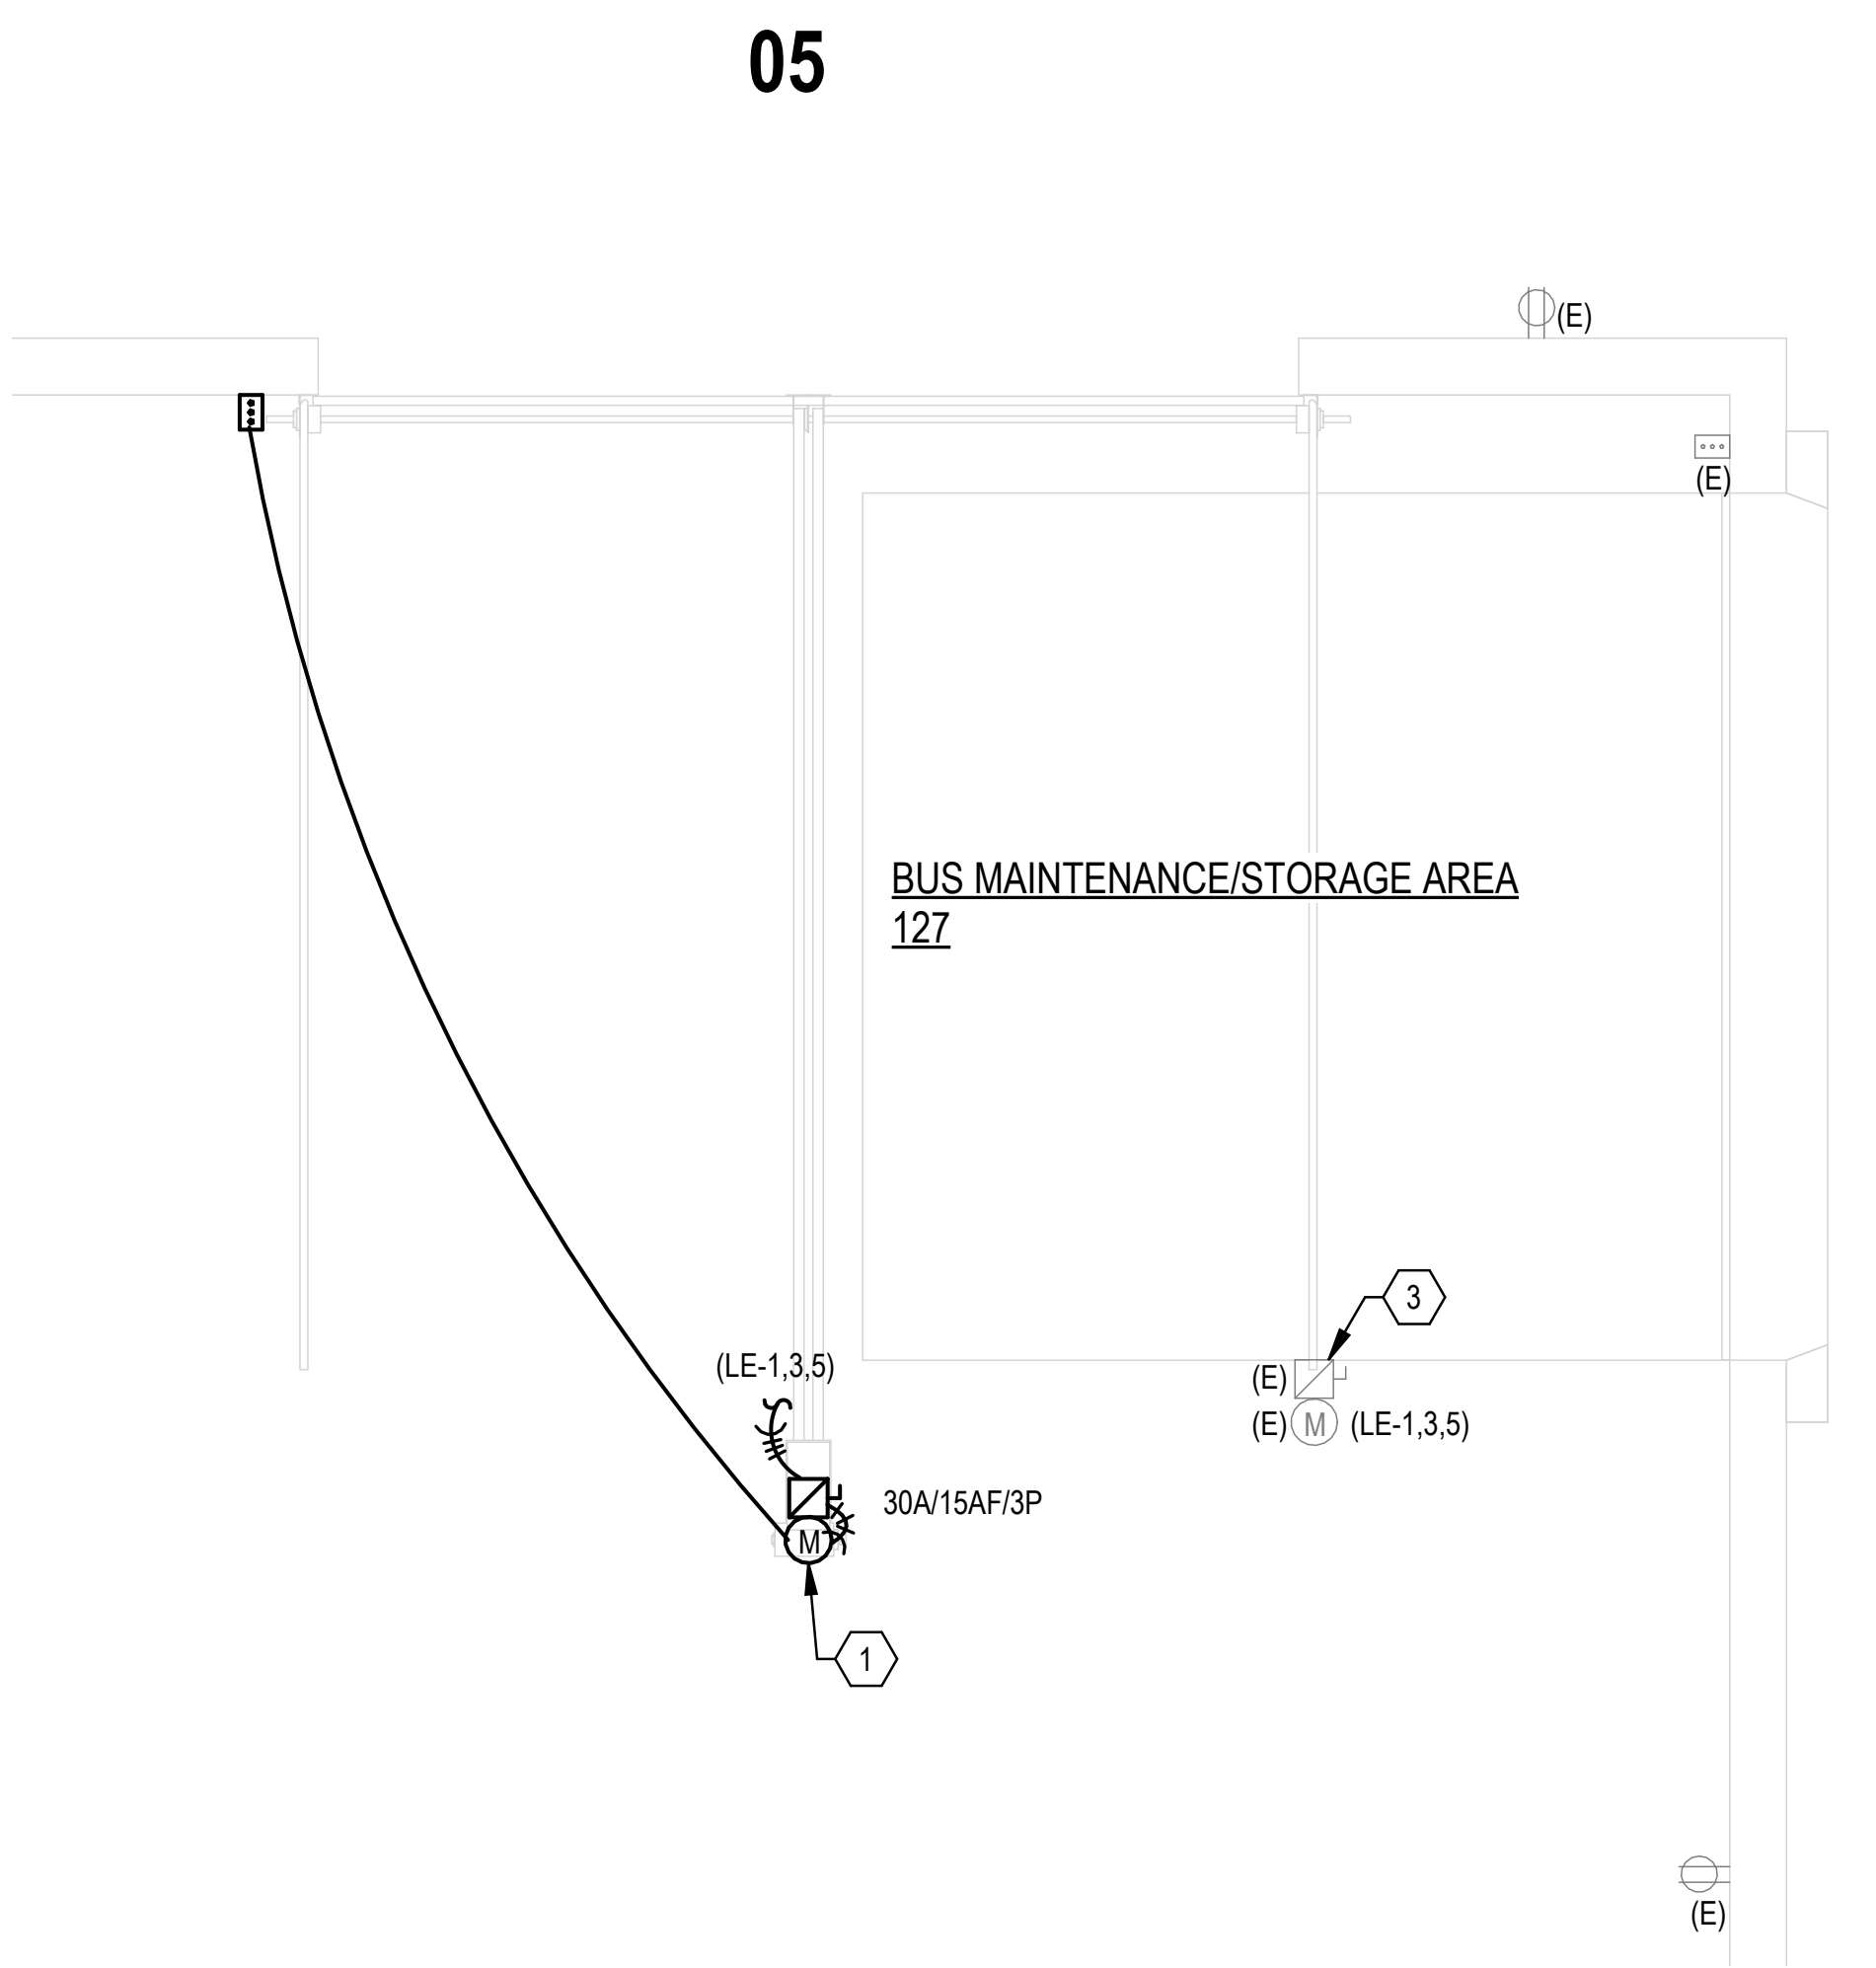
05
(E)
(E)
BUS MAINTENANCE/STORAGE AREA
127
(LE-1,3,5)
M
30A/15AF/3P
1
3
(E)
(E) M (LE-1,3,5)
(E)

FIRST FLOOR POWER PLAN - NE

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

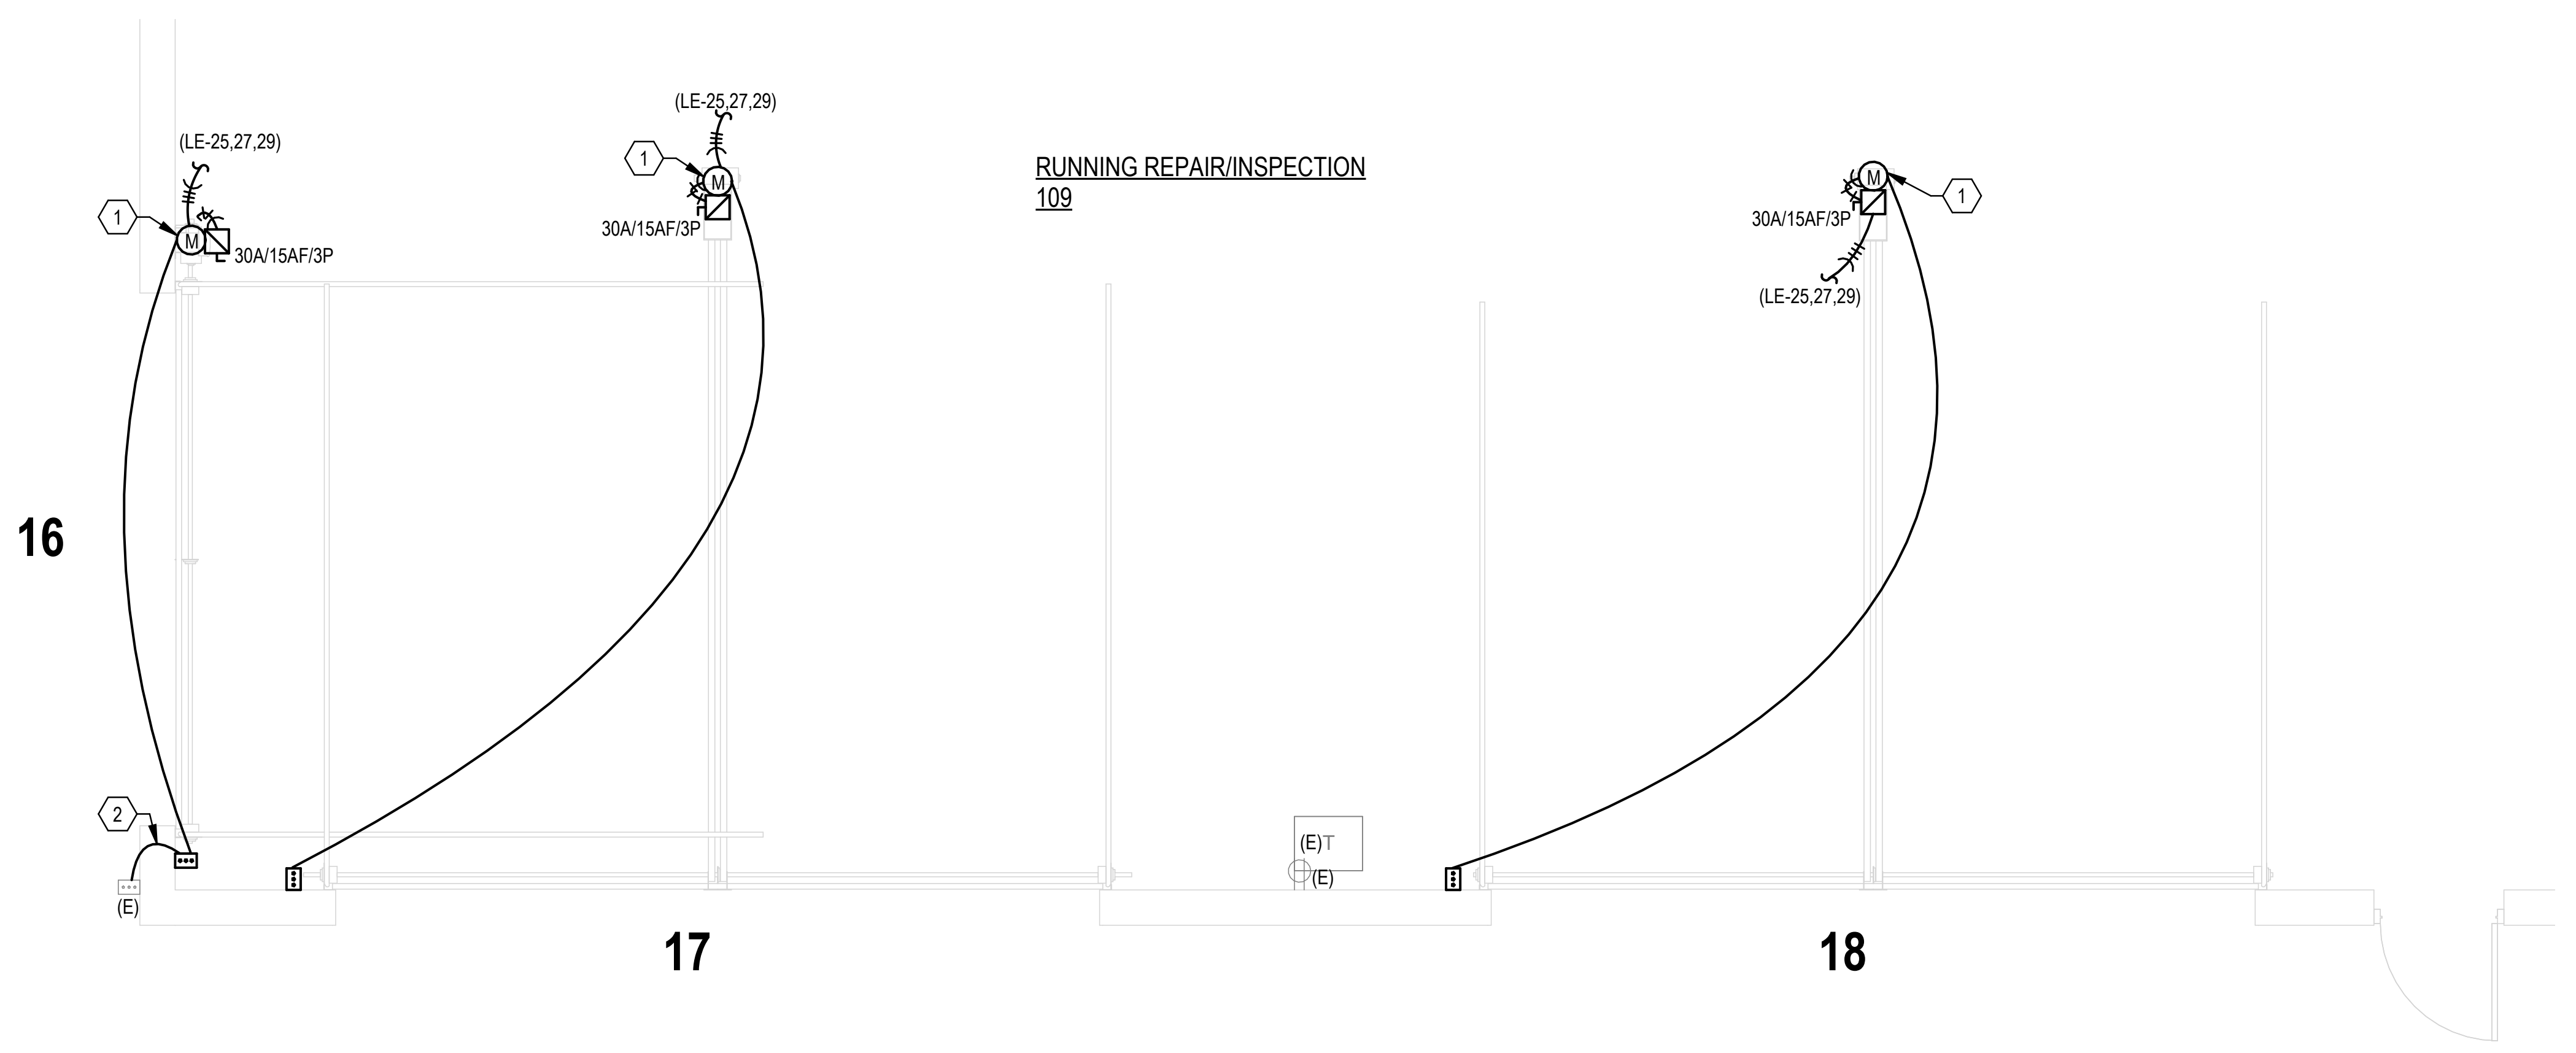
(LE-25,27,29)
1
M
30A/15AF/3P
(LE-25,27,29)
1
M
30A/15AF/3P
RUNNING REPAIR/INSPECTION
109
30A/15AF/3P
M
1
(LE-25,27,29)
16
2
(E)
(E)T
(E)
17
18

FIRST FLOOR POWER PLAN - SW

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

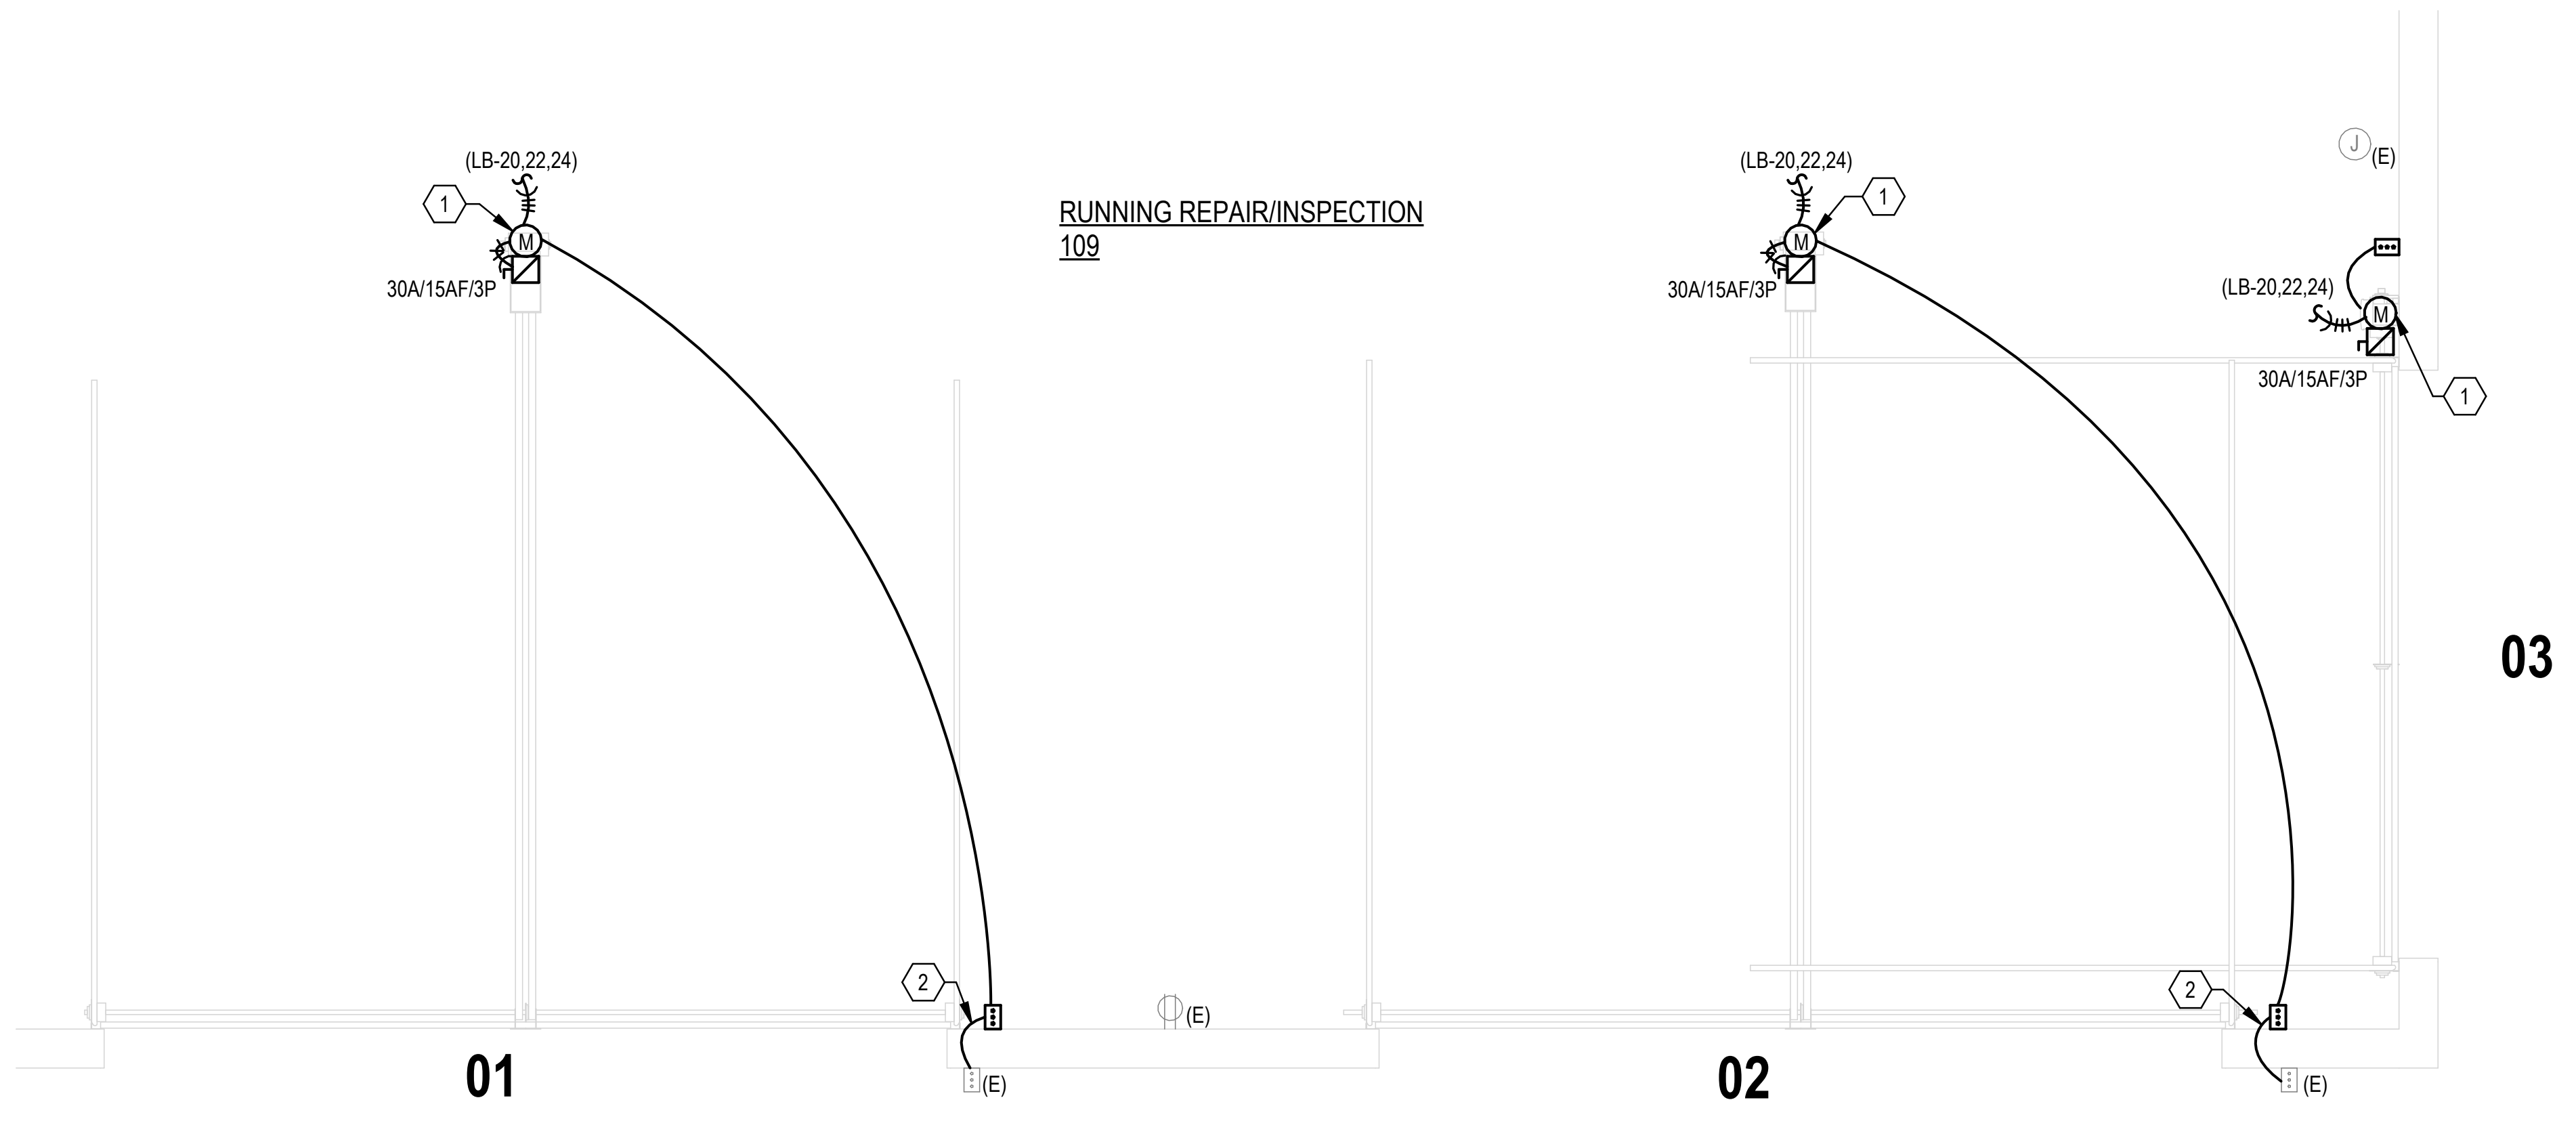
(LB-20,22,24)
1
M
30A/15AF/3P
RUNNING REPAIR/INSPECTION
109
(LB-20,22,24)
1
M
30A/15AF/3P
J
(E)
(LB-20,22,24)
M
30A/15AF/3P
1
03
2
(E)
(E)
01
2
(E)
02

FIRST FLOOR POWER PLAN - SE

SCALE: 1/4" = 1'-0"

0 2' 4' 8'

CLARK & ENERSEN

**Architecture \ Engineering \ Planning **
Landscape Architecture \ Commissioning

clarkenersen.com

? # ?-#

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

COLORADO LICENSED
ANIEL ALBIN WROBLEWSKI
58949
PROFESSIONAL ENGINEER

7-6-26

First Floor Power Plan

E2.01

Plot Time Stamp: 7/6/2026 12:20:07 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_E26.rvt

ELECTRICAL SCHEDULES GENERAL NOTES

1. NEW AND/OR REVISED LOADS TO 'REVISED PANELBOARDS' ARE DENOTED BY BOLD TEXT.
2. PROVIDE UPDATED PANEL SCHEDULE(S) FOR PANELBOARD(S) INVOLVED IN THIS PROJECT.

EXISTING PANELBOARD: LB

Location: ELEC EQUIP 108
Supply From: 200 AF SWITCH IN MSD
Mounting: SURFACE
Enclosure: NEMA 1

Volts: 480/277 Wye
Phases: 3
Wires: 4

A.I.C. Rating: Existing
Mains Rating: 225 A
MCB Rating: Main Lug Only (MLO)

C	A	P	LOAD CLASS	LOAD NAME	PHASE A LOAD (VA)		PHASE B LOAD (VA)		PHASE C LOAD (VA)		LOAD NAME	LOAD CLASS	P	A	C
1	30	3	MECH	MECH: HOTSEY	2923	1407					MECH: JIB CRANES	MECH	3	15	2
3	--	--	--	--			2923	1407			--	--	--	--	4
5	--	--	--	--					2923	1407	--	--	--	--	6
7	20	3	MECH	MECH: OVERHEAD DOORS	1383	1013					MECH: GRINDER & DRILL PRESS - REBUILD	MECH	3	15	8
9	--	--	--	--			1383	1013			--	--	--	--	10
11	--	--	--	--					1383	1013	--	--	--	--	12
13	15	3	MECH	MECH: J-BOX BY OUT OFF SAW	2393	5580					MECH: AIR COMPRESSOR	MECH	3	40	14
15	--	--	--	--			2393	5580			--	--	--	--	16
17	--	--	--	--					2393	5580	--	--	--	--	18
19	15	3	MECH	MECH: GRINDER #2040	640	**1303**					MECH: OVERHEAD DOORS	MECH	3	20	20
21	--	--	--	--			640	**1303**			--	--	--	--	22
23	--	--	--	--					640	**1303**	--	--	--	--	24
25	15	3	MECH	MECH: FLOOR LIFT	1090	2923					MECH: WAST FLOOR LIFT	MECH	3	40	26
27	--	--	--	--			1090	2923			--	--	--	--	28
29	--	--	--	--					1090	2923	--	--	--	--	30
31	15	3	MECH	MECH: AIR DRYER - COMPRESSORS	480	5580					MECH: AIR COMPRESSOR	MECH	3	40	32
33	--	--	--	--			480	5580			--	--	--	--	34
35	--	--	--	--					480	5580	--	--	--	--	36
37	--	1	--	SPACE	--	25000					TRANSFORMER TB	EQUIP	3	125	38
39	--	1	--	SPACE			--	25000			--	--	--	--	40
41	--	1	--	SPACE					--	25000	--	--	--	--	42
				Total Load:	51716 VA		51716 VA		51716 VA						
				Total Amps:	187 A		187 A		187 A						

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	125% OF ESTIMATED...			
RECEPTACLE	0 VA	First 10kVA @ 100% Remainder @ 50%	0 VA			**PANEL TOTALS**	
LIGHTING	0 VA	100%	0 VA	0 VA		**PANEL ESTIMATED DEMAND (VA):**	155148 VA
MECHANICAL	80148 VA	100%	80148 VA			**PANEL ESTIMATED DEMAND (AMPERES)**	187 A
SPARE	0 VA	50%	0 VA				
EQUIP	75000 VA	100%	75000 VA				

EXISTING PANELBOARD: LE

Location: HVAC EQUIP ROOM
Supply From: 200 AF SWITCH IN MSD
Mounting: SURFACE
Enclosure: NEMA 1

Volts: 480/277 Wye
Phases: 3
Wires: 4

A.I.C. Rating: Existing
Mains Rating: 225 A
MCB Rating: Main Lug Only (MLO)

C	A	P	LOAD CLASS	LOAD NAME	PHASE A LOAD (VA)		PHASE B LOAD (VA)		PHASE C LOAD (VA)		LOAD NAME	LOAD CLASS	P	A	C
1	15	3	MECH	MECH: OVERHEAD GARAGE DOOR NORTH SIDE	**1344**	2923					MECH: EF-7	MECH	3	30	2
3	--	--	--	--			**1344**	2923			--	--	--	--	4
5	--	--	--	--					**1344**	2923	--	--	--	--	6
7	15	3	MECH	MECH: EF-4	1277	2923					MECH: EF-8	MECH	3	30	8
9	--	--	--	--			1277	2923			--	--	--	--	10
11	--	--	--	--					1277	2923	--	--	--	--	12
13	40	3	MECH	MECH: MAU-2	5580	5580					MECH: MAU-1	MECH	3	40	14
15	--	--	--	--			5580	5580			--	--	--	--	16
17	--	--	--	--					5580	5580	--	--	--	--	18
19	15	3	MECH	MECH: EF-11, EF-12 & OD TOOL CRIB DOOR	1023	2268					MECH: RTU-1	MECH	3	15	20
21	--	--	--	--			1023	2268			--	--	--	--	22
23	--	--	--	--					1023	2268	--	--	--	--	24
25	15	3	MECH	MECH: OVERHEAD GARAGE DOOR SW PARTS ROOM	**1994**	1085					MECH: EF-9, EF-10, EF-3	MECH	3	15	26
27	--	--	--	--			**1994**	1085			--	--	--	--	28
29	--	--	--	--					**1994**	1085	--	--	--	--	30
31	30	3	MECH	MECH: WHEEL BAL. 2310	2923	640					MECH: GRINDER 2040	MECH	3	15	32
33	--	--	--	--			2923	640			--	--	--	--	34
35	--	--	--	--					2923	640	--	--	--	--	36
37	20	3	RCPT	RCPT: PORTABLE LIFT RECEP NORTH SIDE	333	25000					TRANSFORMER TE	EQUIP	3	100	38
39	--	--	--	--			333	25000			--	--	--	--	40
41	--	--	--	--					333	25000	--	--	--	--	42
				Total Load:	54895 VA		54895 VA		54895 VA						
				Total Amps:	198 A		198 A		198 A						

LOAD CLASSIFICATION	CONNECTED LOAD	DEMAND FACTOR	ESTIMATED DEMAND	125% OF ESTIMATED...			
RECEPTACLE	1000 VA	First 10kVA @ 100% Remainder @ 50%	1000 VA			**PANEL TOTALS**	
LIGHTING	0 VA	100%	0 VA	0 VA		**PANEL ESTIMATED DEMAND (VA):**	164685 VA
MECHANICAL	88685 VA	100%	88685 VA			**PANEL ESTIMATED DEMAND (AMPERES)**	198 A
SPARE	0 VA	50%	0 VA				
EQUIP	75000 VA	100%	75000 VA				

Plot Time Stamp: 7/6/2026 12:20:08 PM
File Location/Name: Autodesk Docs://326-057-26 FoCo Transfort Overhead Door Replace/326-057-26 FoCo Transfort Overhead Door Replace_E26.rvt

CLARK & ENERSEN

Architecture \ Engineering \ Planning \
Landscape Architecture \ Commissioning

clarkenersen.com

? # ? - #

SHEET HISTORY:

ISSUED 07/06/2026 Permit Set

Permit Set

FoCo Transfort Overhead Door Replace

6570 Portner Rd, Fort Collins, CO 80525

CE No.: 326-057-26

07/06/2026

COLORADO LICENSED PROFESSIONAL ENGINEER
DANIEL ALBIN WROBLEWSKI
58949

7-6-26

Electrical Schedules

E4.01