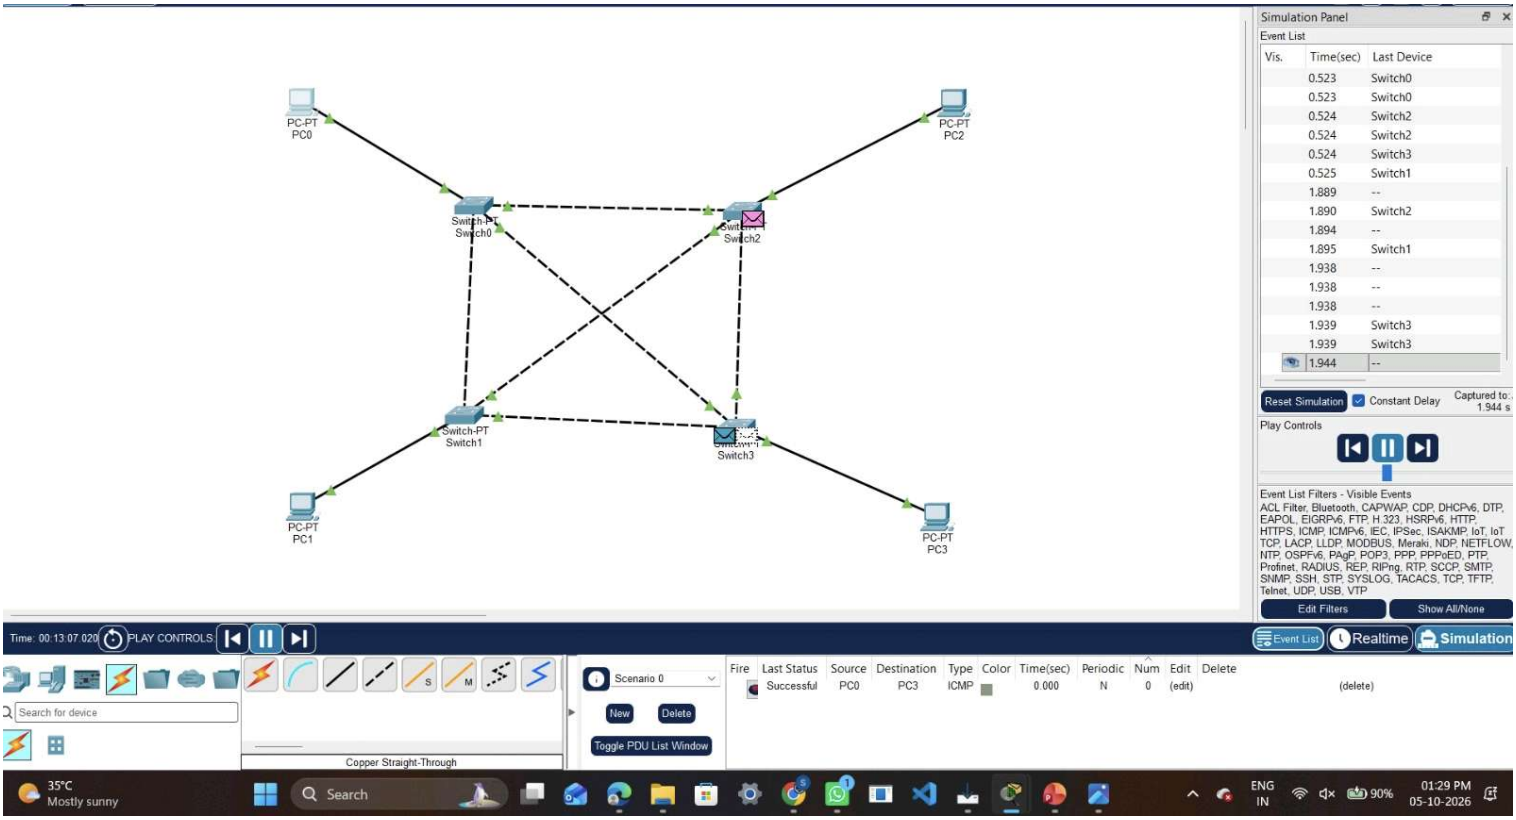

PC-PT PC0
PC-PT PC2
Switch-PT Switch0
Switch-PT Switch2
Switch-PT Switch1
Switch-PT Switch3
PC-PT PC1
PC-PT PC3
Simulation Panel
Event List
Vis. Time(sec) Last Device
0.523 Switch0
0.523 Switch0
0.524 Switch2
0.524 Switch2
0.524 Switch3
0.525 Switch1
1.889 --
1.890 Switch2
1.894 --
1.895 Switch1
1.938 --
1.938 --
1.938 --
1.939 Switch3
1.939 Switch3
1.944 --
Reset Simulation
Constant Delay
Captured to: 1.944 s
Play Controls
Event List Filters - Visible Events
ACL Filter, Bluetooth, CAPWAP, CDP, DHCPv6, DTP, EAPOL, EIGRPv6, FTP, H.323, HSRPv6, HTTP, HTTPS, ICMP, ICMPv6, IEC, IPSec, ISAKMP, IoT, IoT TCP, LACP, LLDP, MODBUS, Meraki, NDP, NETFLOW, NTP, OSPFv6, PAgP, POP3, PPP, PPPoED, PTP, Profinet, RADIUS, REP, RIPng, RTP, SCCP, SMTP, SNMP, SSH, STP, SYSLOG, TACACS, TCP, TFTP, Telnet, UDP, USB, VTP
Edit Filters
Show All/None
Time: 00:13:07.020
PLAY CONTROLS
Event List
Realtime
Simulation
Search for device
Copper Straight-Through
Scenario 0
New
Delete
Toggle PDU List Window
Fire Last Status Source Destination Type Color Time(sec) Periodic Num Edit Delete
Successful PC0 PC3 ICMP 0.000 N 0 (edit) (delete)
35°C
Mostly sunny
Search
ENG
IN
90%
01:29 PM
05-10-2026