Technical manual contents

Procedure 1 — label M-2; physical 2

Procedure 2 — label M-6; physical 6

Procedure 3 — label M-10; physical 10

Procedure 4 — label M-14; physical 14

Procedure 5 — label M-18; physical 18

Procedure 6 — label M-22; physical 22

Procedure 7 — label M-26; physical 26

Procedure 8 — label M-30; physical 30

Procedure 9 — label M-34; physical 34

Procedure 10 — label M-38; physical 38

Procedure 11 — label M-42; physical 42

Procedure 12 — label M-46; physical 46

Procedure 13 — label M-50; physical 50

Procedure 14 — label M-54; physical 54

Procedure 15 — label M-58; physical 58

Procedure 16 — label M-62; physical 62

Procedure 17 — label M-66; physical 66

Procedure 18 — label M-70; physical 70

Procedure 19 — label M-74; physical 74

Procedure 20 — label M-78; physical 78

Procedure 1

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 1 without losing source whitespace.

```
verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1


verify = procedure_1

verify = procedure_1

verify = procedure_1

verify = procedure_1
```

Procedure 1 running

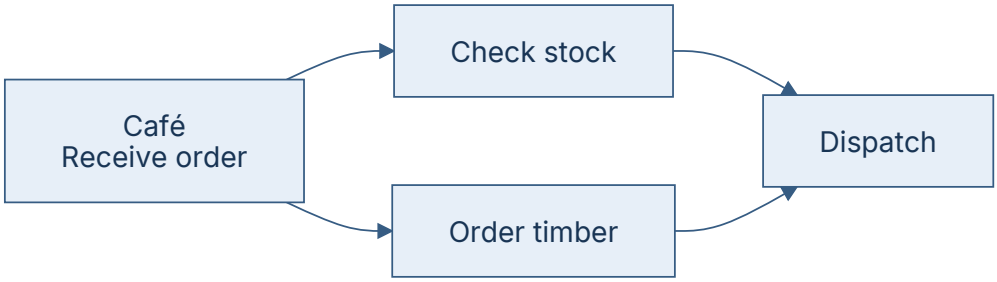

Prepared procedure diagram 1

The continued table remains inside the instruction and both callout panels.

Procedure 1 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 1 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 1 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 1 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 2

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 2 without losing source whitespace.

```
verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2


verify = procedure_2

verify = procedure_2

verify = procedure_2

verify = procedure_2
```

Procedure 2 running

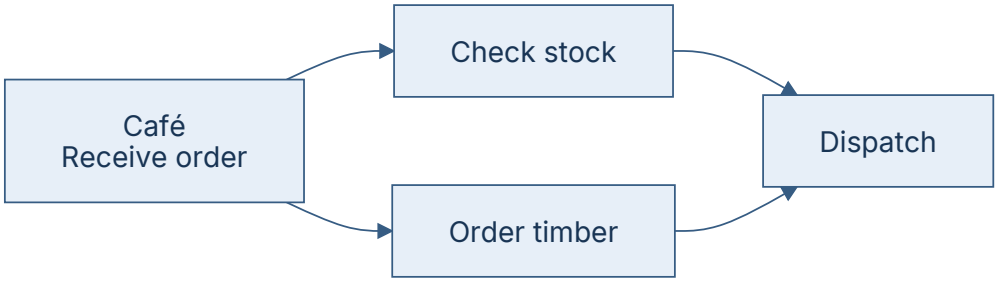

Prepared procedure diagram 2

The continued table remains inside the instruction and both callout panels.

Procedure 2 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 2 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 2 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 2 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 3

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 3 without losing source whitespace.

```
verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3


verify = procedure_3

verify = procedure_3

verify = procedure_3

verify = procedure_3
```

Procedure 3 running

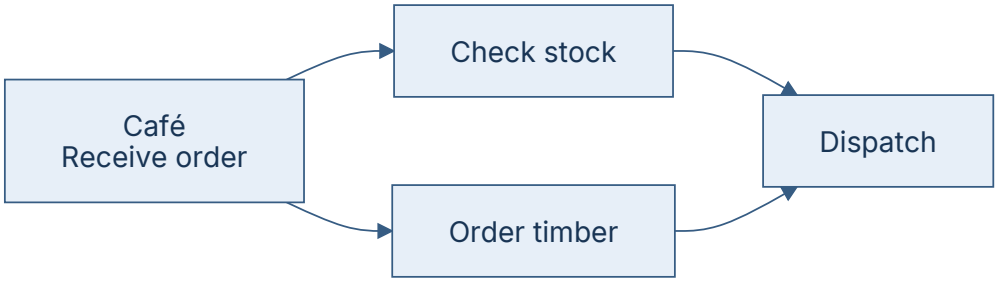

Prepared procedure diagram 3

The continued table remains inside the instruction and both callout panels.

Procedure 3 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 3 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 3 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 3 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 4

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 4 without losing source whitespace.

```
verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4


verify = procedure_4

verify = procedure_4

verify = procedure_4

verify = procedure_4
```

Procedure 4 running

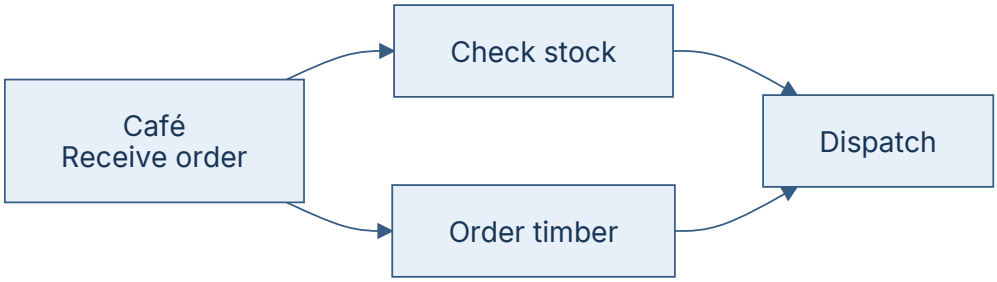

Prepared procedure diagram 4

The continued table remains inside the instruction and both callout panels.

Procedure 4 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 4 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 4 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 4 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 5

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 5 without losing source whitespace.

```
verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5


verify = procedure_5

verify = procedure_5

verify = procedure_5

verify = procedure_5
```

Procedure 5 running

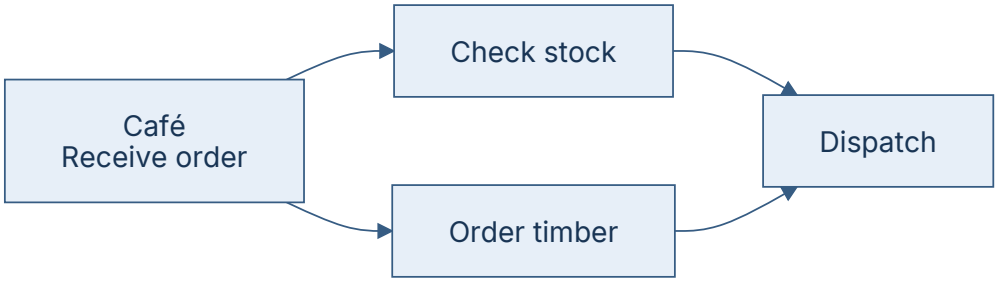

Prepared procedure diagram 5

The continued table remains inside the instruction and both callout panels.

Procedure 5 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 5 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 5 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 5 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 6

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 6 without losing source whitespace.

```
verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6


verify = procedure_6

verify = procedure_6

verify = procedure_6

verify = procedure_6
```

Procedure 6 running

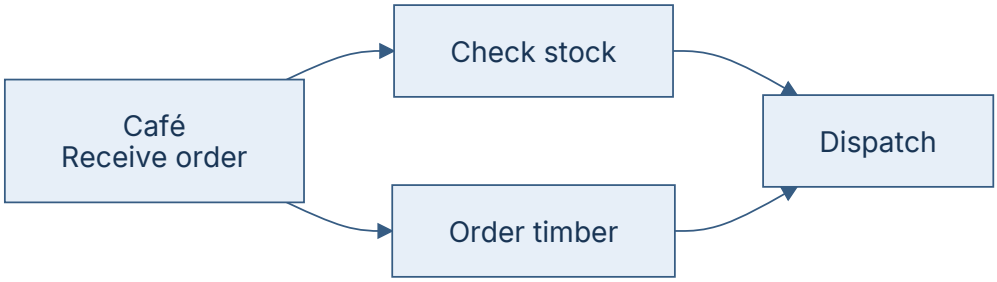

Prepared procedure diagram 6

The continued table remains inside the instruction and both callout panels.

Procedure 6 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 6 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 6 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 6 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 7

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 7 without losing source whitespace.

```
verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7


verify = procedure_7

verify = procedure_7

verify = procedure_7

verify = procedure_7
```

Procedure 7 running

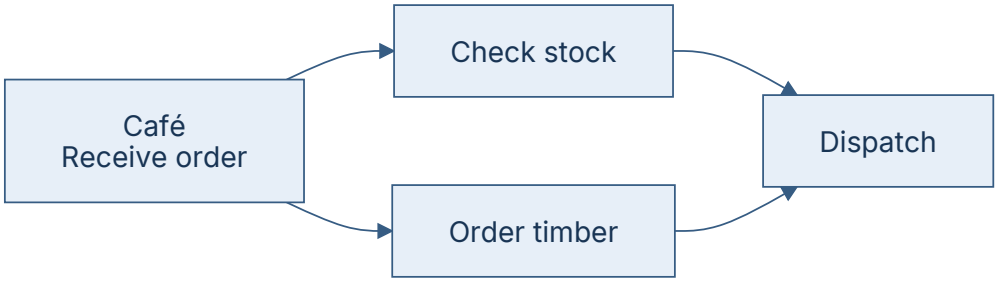

Prepared procedure diagram 7

The continued table remains inside the instruction and both callout panels.

Procedure 7 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 7 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 7 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 7 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 8

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 8 without losing source whitespace.

```
verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8


verify = procedure_8

verify = procedure_8

verify = procedure_8

verify = procedure_8
```

Procedure 8 running

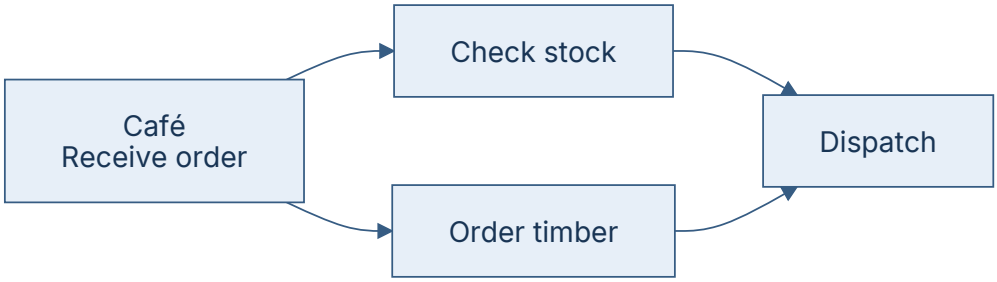

Prepared procedure diagram 8

The continued table remains inside the instruction and both callout panels.

Procedure 8 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 8 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 8 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 8 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 9

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 9 without losing source whitespace.

```
verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9


verify = procedure_9

verify = procedure_9

verify = procedure_9

verify = procedure_9
```

Procedure 9 running

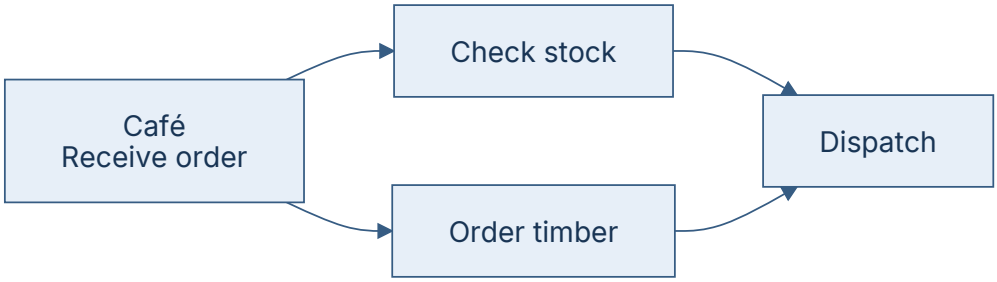

Prepared procedure diagram 9

The continued table remains inside the instruction and both callout panels.

Procedure 9 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 9 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 9 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 9 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 10

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 10 without losing source whitespace.

```
verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10


verify = procedure_10

verify = procedure_10

verify = procedure_10

verify = procedure_10
```

Procedure 10 running

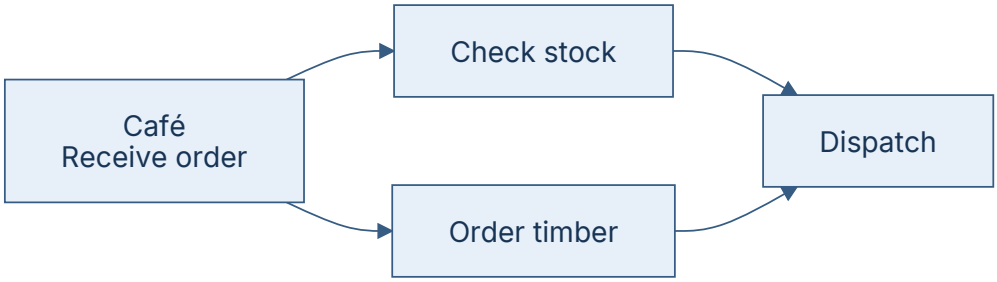

Prepared procedure diagram 10

The continued table remains inside the instruction and both callout panels.

Procedure 10 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 10 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 10 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 10 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 11

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 11 without losing source whitespace.

```
verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11


verify = procedure_11

verify = procedure_11

verify = procedure_11

verify = procedure_11
```

Procedure 11 running

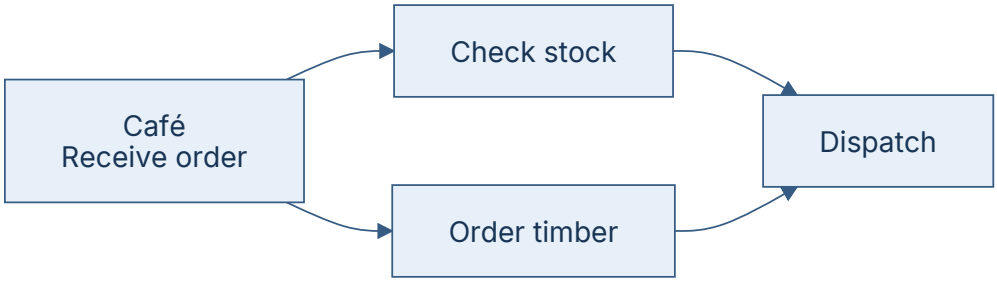

Prepared procedure diagram 11

The continued table remains inside the instruction and both callout panels.

Procedure 11 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 11 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 11 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 11 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 12

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 12 without losing source whitespace.

```
verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12


verify = procedure_12

verify = procedure_12

verify = procedure_12

verify = procedure_12
```

Procedure 12 running

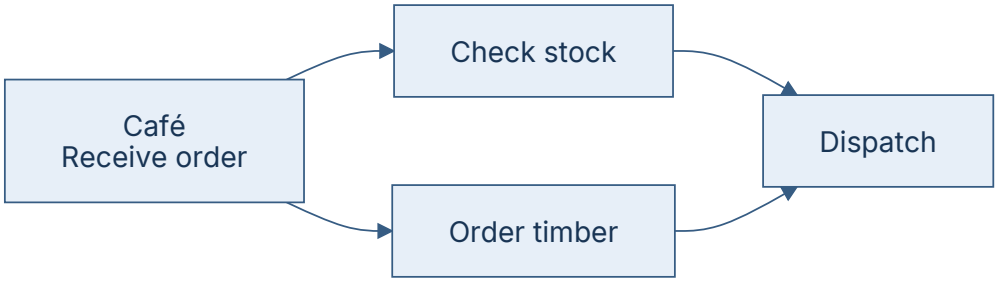

Prepared procedure diagram 12

The continued table remains inside the instruction and both callout panels.

Procedure 12 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 12 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 12 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 12 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 13

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 13 without losing source whitespace.

```
verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13


verify = procedure_13

verify = procedure_13

verify = procedure_13

verify = procedure_13
```

Procedure 13 running

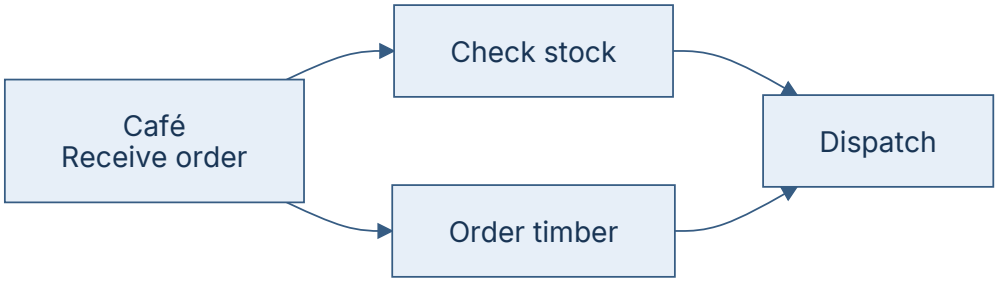

Prepared procedure diagram 13

The continued table remains inside the instruction and both callout panels.

Procedure 13 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 13 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 13 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 13 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 14

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 14 without losing source whitespace.

```
verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14


verify = procedure_14

verify = procedure_14

verify = procedure_14

verify = procedure_14
```

Procedure 14 running

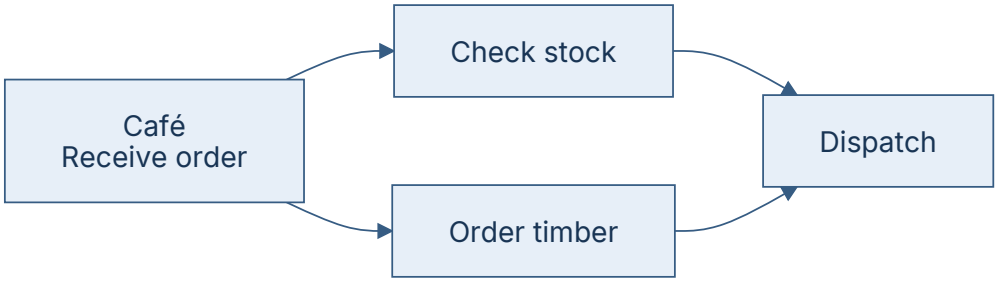

Prepared procedure diagram 14

The continued table remains inside the instruction and both callout panels.

Procedure 14 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 14 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 14 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 14 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 15

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 15 without losing source whitespace.

```
verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15


verify = procedure_15

verify = procedure_15

verify = procedure_15

verify = procedure_15
```

Procedure 15 running

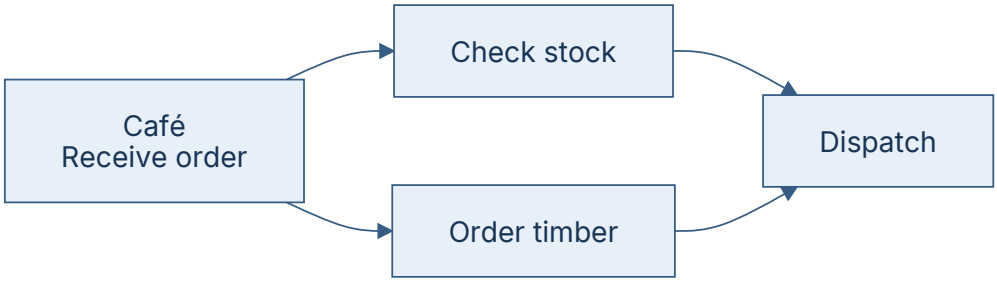

Prepared procedure diagram 15

The continued table remains inside the instruction and both callout panels.

Procedure 15 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 15 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 15 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 15 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 16

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 16 without losing source whitespace.

```
verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16


verify = procedure_16

verify = procedure_16

verify = procedure_16

verify = procedure_16
```

Procedure 16 running

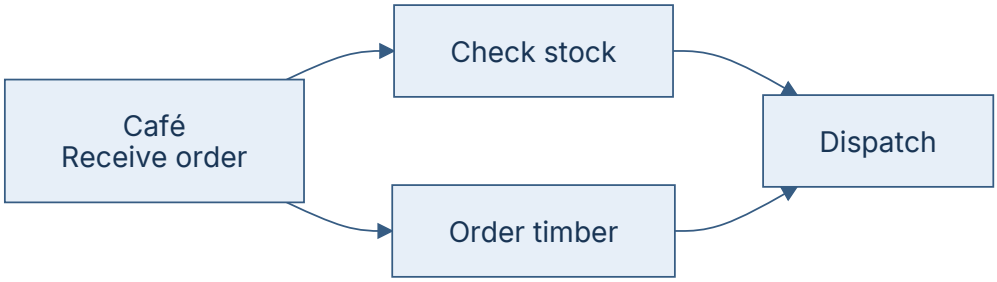

Prepared procedure diagram 16

The continued table remains inside the instruction and both callout panels.

Procedure 16 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 16 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 16 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 16 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 17

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 17 without losing source whitespace.

```
verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17


verify = procedure_17

verify = procedure_17

verify = procedure_17

verify = procedure_17
```

Procedure 17 running

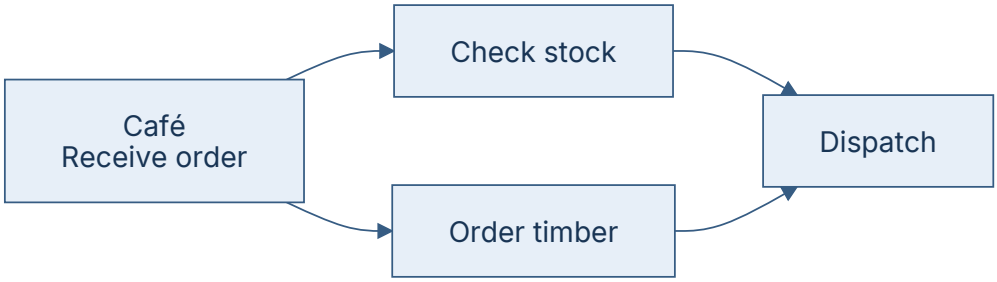

Prepared procedure diagram 17

The continued table remains inside the instruction and both callout panels.

Procedure 17 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 17 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 17 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 17 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 18

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 18 without losing source whitespace.

```
verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18


verify = procedure_18

verify = procedure_18

verify = procedure_18

verify = procedure_18
```

Procedure 18 running

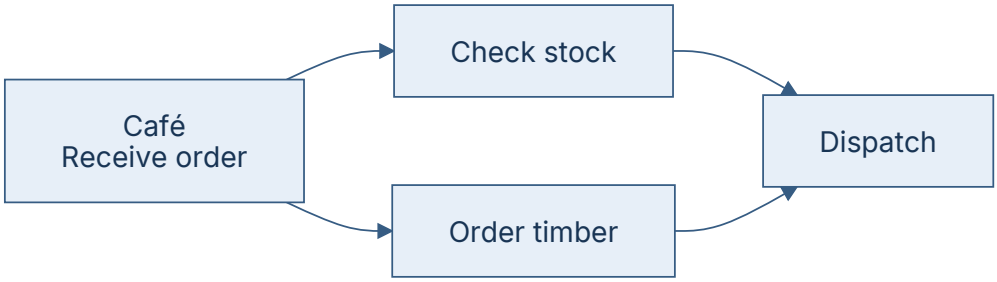

Prepared procedure diagram 18

The continued table remains inside the instruction and both callout panels.

Procedure 18 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 18 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 18 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 18 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 19

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 19 without losing source whitespace.

```
verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19


verify = procedure_19

verify = procedure_19

verify = procedure_19

verify = procedure_19
```

Procedure 19 running

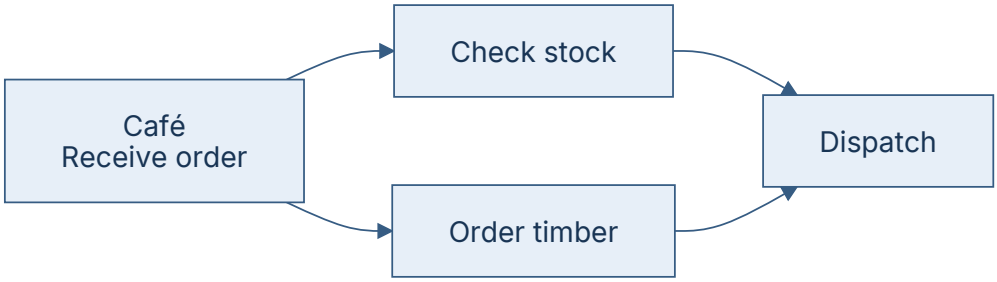

Prepared procedure diagram 19

The continued table remains inside the instruction and both callout panels.

Procedure 19 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 19 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 19 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 19 before the next chapter begins.

The outer callout closes after its one logical instruction.

Procedure 20

Contents physical 1 ; final procedure label M-78 ; final physical 78.

One logical procedure keeps its numbered instruction and rich children together in reading order.

100. Prepare procedure 20 without losing source whitespace.

```
verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20


verify = procedure_20

verify = procedure_20

verify = procedure_20

verify = procedure_20
```

Procedure 20 running

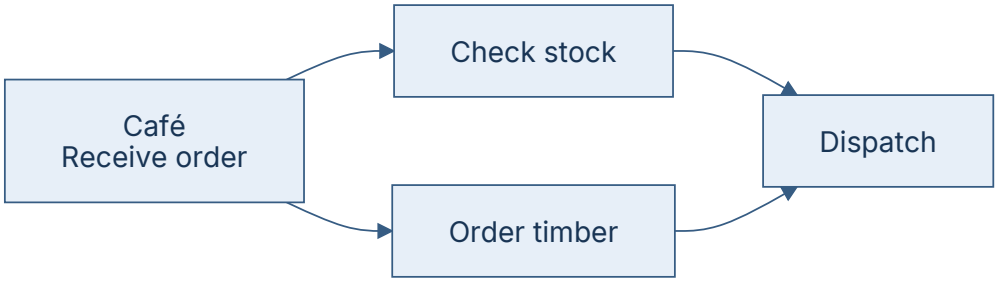

Prepared procedure diagram 20

The continued table remains inside the instruction and both callout panels.

Procedure 20 checklist

Step	Contents label M-1
Step 1	Retain the procedure, its boxed instructions and the measured table columns.
Step 2	Retain the procedure, its boxed instructions and the measured table columns.
Step 3	Retain the procedure, its boxed instructions and the measured table columns.
Step 4	Retain the procedure, its boxed instructions and the measured table columns.
Step 5	Retain the procedure, its boxed instructions and the measured table columns.
Step 6	Retain the procedure, its boxed instructions and the measured table columns.
Step 7	Retain the procedure, its boxed instructions and the measured table columns.
Step 8	Retain the procedure, its boxed instructions and the measured table columns.
Step 9	Retain the procedure, its boxed instructions and the measured table columns.
Step 10	Retain the procedure, its boxed instructions and the measured table columns.
Step 11	Retain the procedure, its boxed instructions and the measured table columns.
Step 12	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 20 running

Step	Contents label M-1
Step 13	Retain the procedure, its boxed instructions and the measured table columns.
Step 14	Retain the procedure, its boxed instructions and the measured table columns.
Step 15	Retain the procedure, its boxed instructions and the measured table columns.
Step 16	Retain the procedure, its boxed instructions and the measured table columns.
Step 17	Retain the procedure, its boxed instructions and the measured table columns.
Step 18	Retain the procedure, its boxed instructions and the measured table columns.
Step 19	Retain the procedure, its boxed instructions and the measured table columns.
Step 20	Retain the procedure, its boxed instructions and the measured table columns.
Step 21	Retain the procedure, its boxed instructions and the measured table columns.
Step 22	Retain the procedure, its boxed instructions and the measured table columns.
Step 23	Retain the procedure, its boxed instructions and the measured table columns.
Step 24	Retain the procedure, its boxed instructions and the measured table columns.
Step 25	Retain the procedure, its boxed instructions and the measured table columns.
Step 26	Retain the procedure, its boxed instructions and the measured table columns.
Step 27	Retain the procedure, its boxed instructions and the measured table columns.
Step 28	Retain the procedure, its boxed instructions and the measured table columns.
Step 29	Retain the procedure, its boxed instructions and the measured table columns.
Step 30	Retain the procedure, its boxed instructions and the measured table columns.

Procedure 20 running

Step	Contents label M-1
Step 31	Retain the procedure, its boxed instructions and the measured table columns.
Step 32	Retain the procedure, its boxed instructions and the measured table columns.
Step 33	Retain the procedure, its boxed instructions and the measured table columns.
Step 34	Retain the procedure, its boxed instructions and the measured table columns.
Step 35	Retain the procedure, its boxed instructions and the measured table columns.
Step 36	Retain the procedure, its boxed instructions and the measured table columns.
Step 37	Retain the procedure, its boxed instructions and the measured table columns.
Step 38	Retain the procedure, its boxed instructions and the measured table columns.
Step 39	Retain the procedure, its boxed instructions and the measured table columns.
Step 40	Retain the procedure, its boxed instructions and the measured table columns.

The inner callout closes after the complete checklist.

Complete procedure 20 before the next chapter begins.

The outer callout closes after its one logical instruction.