GWO-DE temporal diagnostics | DDTW | seed 19

(a) Best fitness and profile used

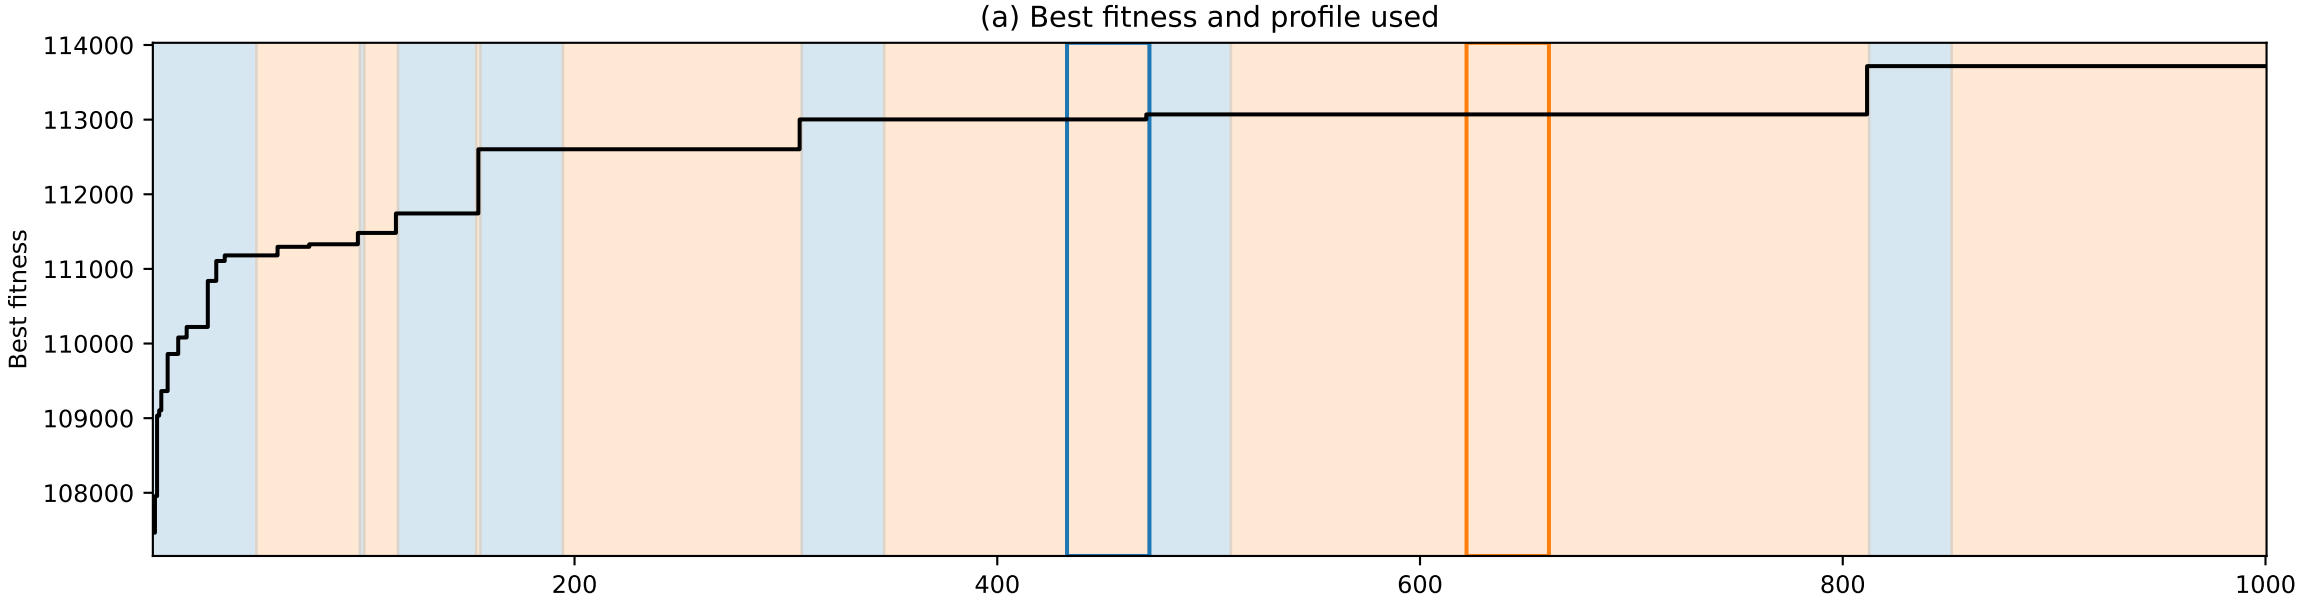

(b) Rising window

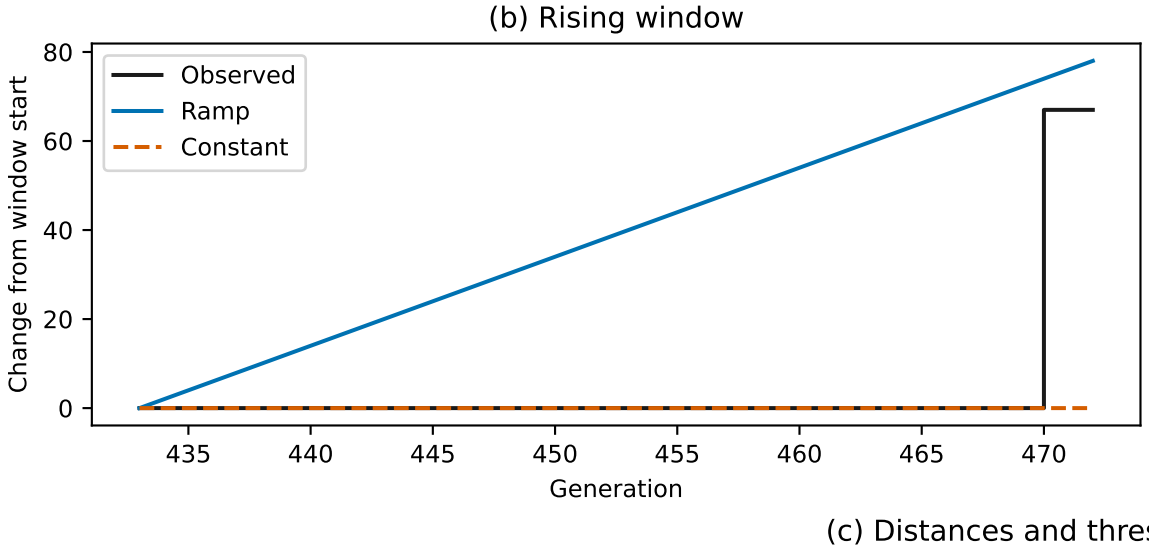

(b) Flat window

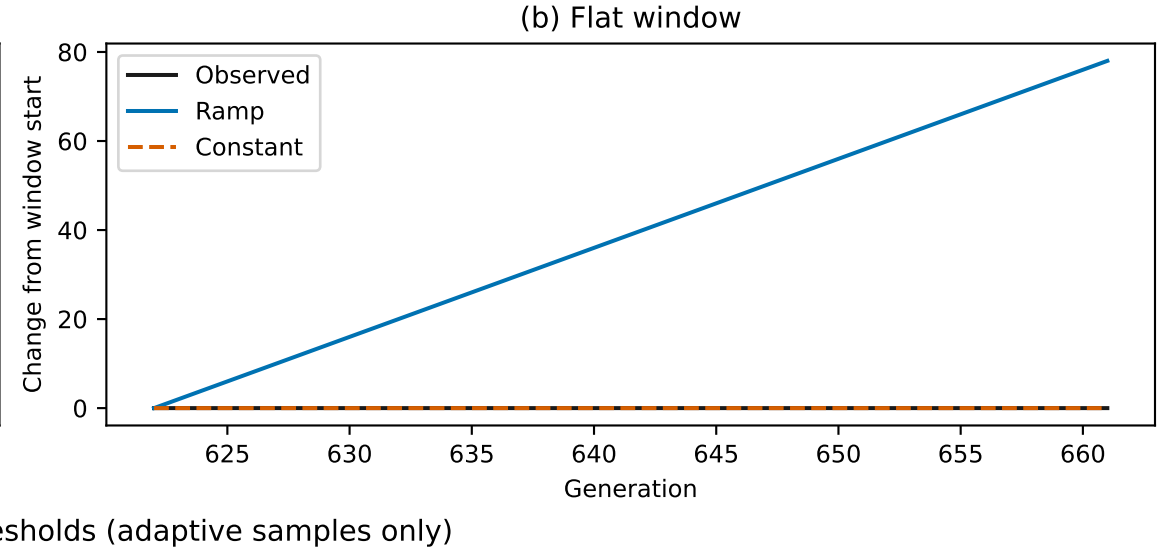

(c) Distances and thresholds (adaptive samples only)

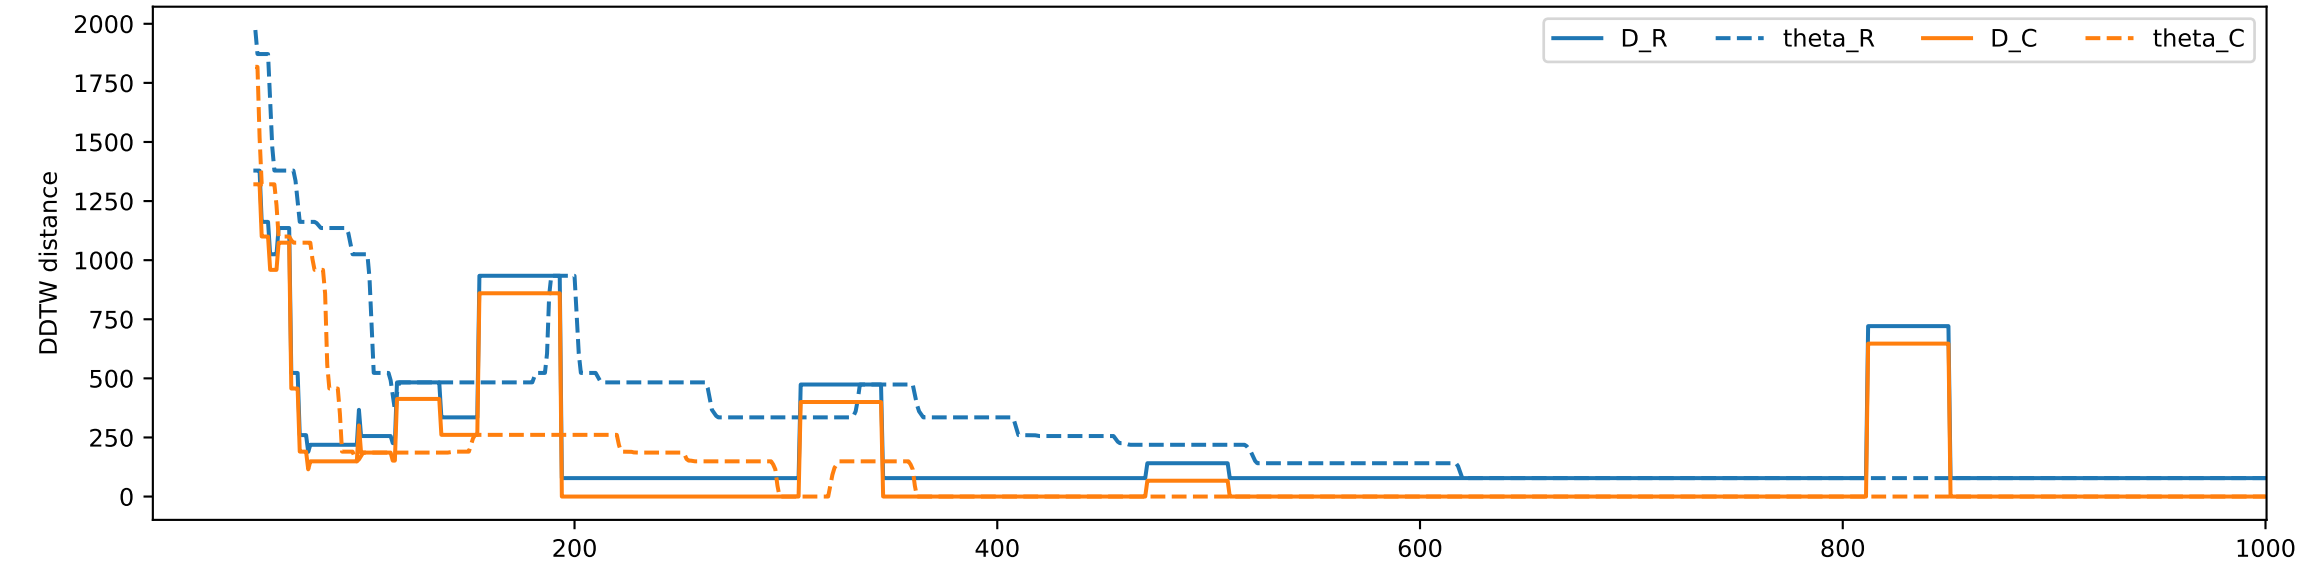

(d) Relative indicator and controller decision

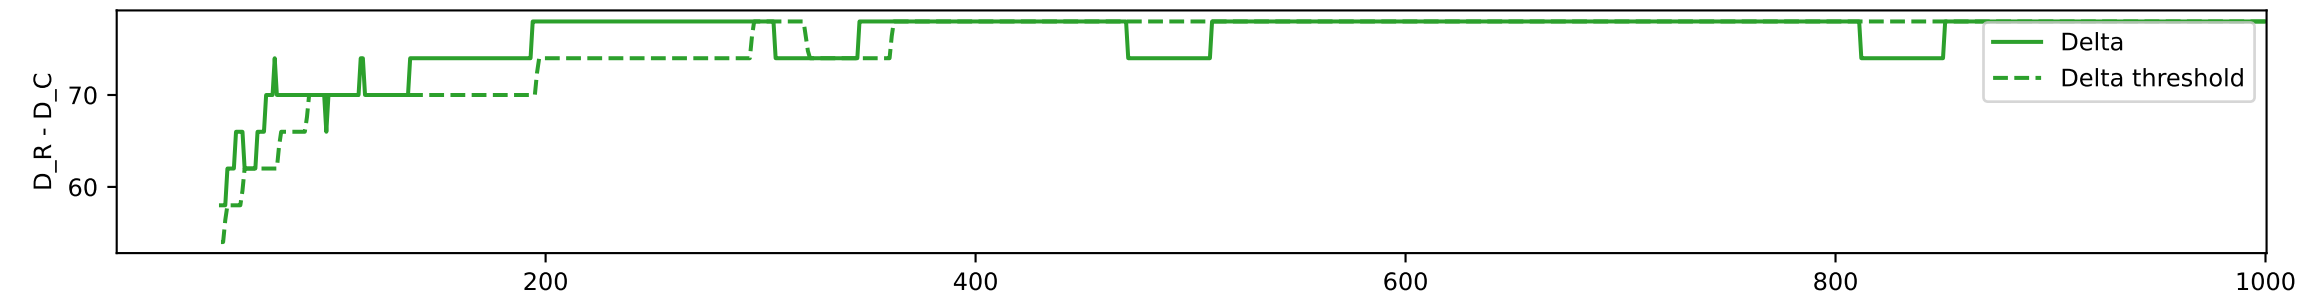
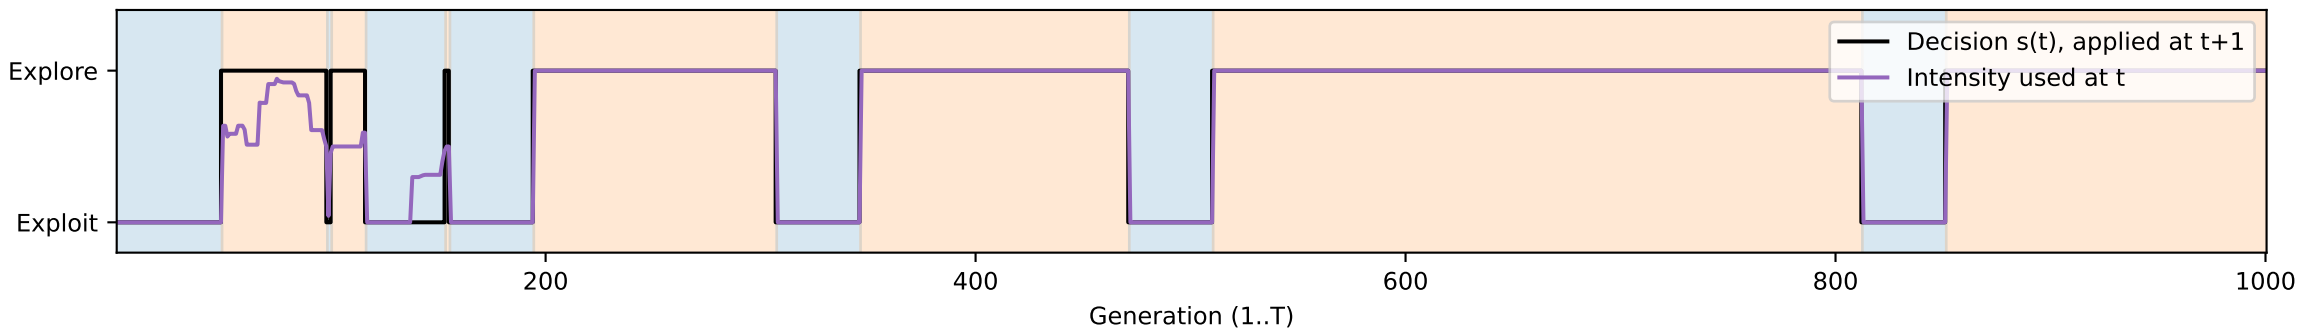
exploit: a=0.5-1.20685, F=0.5-0.688493, CR=0.617261-0.9; explore: a=1.25-2, F=0.7-0.9, CR=0.3-0.6