MACH LINE
CONTINUE ON DRAWING
NO. E-EL-DR-5002

UBSTATION SS2

CABLE TRENCH

CABLE TRENCH SECTION
DETAILS REFER TO DRAWING
NO.E-EL-DR-5011

02F HEAVEY CONTAINER YARD
02E HEAVEY CONTAINER YARD
02D HEAVEY CONTAINER YARD
02C HEAVEY CONTAINER YARD
02B HEAVEY CONTAINER YARD
02A HEAVEY CONTAINER YARD

DP25 T1 — MDB10 HM10 — SS2-HM10 SS2-HM11 SS2-HM12 SS2-MDB10 6xPVC110 — D47
DP26 T1 — SS2-HM11 SS2-HM12 SS2-MDB10 5xPVC110 — D48
MDB11 DP27 T1 HM11 — SS2-HM11 SS2-HM12 SS2-MDB10 5xPVC110 — D48
DP28 T1 — SS2-HM12 SS2-MDB10 3xPVC110 — D49
DP29 T1 — MDB12 HM12 — SS2-HM12 SS2-MDB10 3xPVC110 — D49

M07
M08
M09
DB07
xPVC110

MACH LINE
CONTINUE ON DRAWING
NO. E-EL-DR-5004

SS2-HM03 SS2-HM04
SS2-HM02 SS2-HM05
SS2-HM01 SS2-HM06
SS2-MDB01 SS2-MDB04
SS1-WMV-SS21
SS1-WMV-SS22
5xPVC160
12xPVC110
— D43

DP30 T3
DP31 T3
DP32 T3

SS1-WMV-SS21
SS1-WMV-SS22
SS1-WMV-STS2
SS1-WMV-STS3
SS1-WMV-STS4
SS1-SPO2
SS2-HM03
SS2-HM02
SS2-HM01
SS2-MDB01
14xPVC160
8xPVC110

MDB04 HM04 — SS1-WMV-STS3 SS1-SPO2 SS2-HM04 SS2-HM05 SS2-HM06 SS2-MDB04 12xPVC160 8xPVC110 — D34
SS2-HM04 SS2-MDB04 4xPVC110 — D40
MDB05 HM05 — SS1-WMV-STS4 SS2-HM05 SS2-HM06 SS2-MDB04 10xPVC160 6xPVC110 — D35
SS2-HM05 SS2-MDB04 4xPVC110 — D41
MDB06 HM06 — SS2-HM06 SS2-MDB04 3xPVC110 — D42

DP42a T3
DP43 T3
DP44 T3
12xPVC160
8xPVC110
DP45 T3
DP46 T3
10xPVC160
8xPVC110
DP47 T3
10xPVC160
6xPVC110
8xPVC160
6xPVC110
DP48 T3
DP49 T3
8xPVC160
3xPVC110
DP50 T2
SS2-HM06
SS2-MDB04
6xPVC160
3xPVC110
— D36
DP51 T2
6xPVC160
DP51a T2

CABLE DUCTWORK INTERFACE
FOR FUTURE EXPANSION

SPO1
VC110
SS1-WMV-STS2
3xPVC160
SS1-WMV-STS3
3xPVC160
SS1-SPO2
2xPVC110
SS1-WMV-STS4
3xPVC160
3xPVC160
2xPVC110
3xPVC160

SPO2 CTP4 CTP5 SPO3 CTP6 CTP7 SPO4 CTP8

85.2 81 154.63
6 52.8 40.5 48.6 52.8 110.65
600

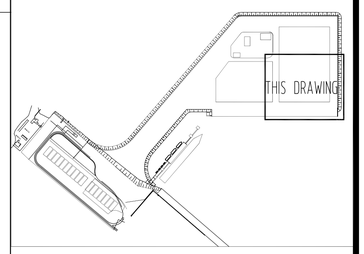

KEY PLAN

NOTE:
1. ALL DIMENSIONS ARE IN METRES UNLESS NOTED OTHERWISE.
2. ALL LEVELS ARE IN METRES UNLESS NOTED OTHERWISE.
3. EXACT COORDINATES OF LIGHTING MASTS/DRAWPITS/CABLE TRENCH REFER TO TERMINAL LAYOUT DRAWINGS.
4. THE DEPTH FROM THE CENTER OF BURIED DUCTS TO FINISHED GROUND LEVEL SHALL BE NOT LESS THAN 0.7m FOR 0.6/1kV CABLE DUCTS AND 1m FOR 6.35/11kV CABLE DUCTS. THE BURIED DEPTH FOR CABLE DUCTS WHERE CROSS THE RAILWAY SHALL BE NOT LESS THAN 1m.
5. CABLE DUCTS SHALL BE SURROUNDED WITH C20 CONCRETE(DETAILS REFER TO DRAWING NO. 'E-EL-DR-5012'TO 'E-EL-DR-5018').
6. THE CABLE PIT AND DUCT DESIGN HAS YET TO BE FINALIZED TO SUIT ERONGO RED'S INCOMING SUPPLY CABLES.

NAMIBIAN PORTS AUTHORITY
P.O. Box 35
Walvis Bay — Namibia
Elzevir Gelderbloem
PORT ENGINEER

1:500 0 5 20 40m

REV.	DATE	DESCRIPTION	DESIGNED	CHECKED	APPROVED	SIGNED
ab	2019.08	AS BUILT	WEN.G	LIAO.M	HUANG.B.G	
2	2018.05	FOR CONSTRUCTION	HE.H	ZHANG.Z.Y.		
1	2016.11	FOR CONSTRUCTION	HE.H	ZHANG.Z.Y.		
0	2016.06	FOR CONSTRUCTION	HE.H	ZHANG.Z.Y.		

CLIENT APROVAL

NAME:
RANK:
SIGNED:
DATE: STAMP:

CLIENT:
NAMPORT
NAMIBIAN PORTS AUTHORITY (NAMPORT)

PROJECT:
NEW PORT OF WALVIS BAY
CONTAINER TERMINAL ON RECLAIMED LAND

CONTRACTOR:
CHEC
CHINA HARBOUR ENGINEERING COMPANY LTD.

SUBCONSULTANT:
GSA
G.S. FAINSINGER & ASSOCIATES

TITLE:
ELECTRICAL INSTALLATION LAYOUT PLAN
(SHEET 5 OF 9)

SCALE:1:500	DRAWN:HE.H	DATE: 2018.05	
DRAWING No: E-EL-DR-5005			REV: ab